

1. CONTRACTOR SHALL SUPPLY AND INSTALL ALL MATERIALS AND EQUIPMENT IN ACCORDANCE WITH THE CURRENT EDITION OF THE N.E.C. AND ALL STATE AND LOCAL CODES.
2. ALL EXTERIOR DISCONNECTS SHALL BE W.P. TYPE.
3. ELECTRICAL CONTRACTOR (EC) SHALL REFER TO MECHANICAL PLANS FOR EXIST. SIZE AND LOCATION OF MECHANICAL EQUIPMENT. COORDINATE WITH MECHANICAL CONTRACTOR FOR ADDITIONAL INFORMATION.
4. ELECTRICAL CONTRACTOR RESPONSIBLE FOR FINAL ELECTRICAL WIRING CONNECTION OF MECHANICAL EQUIPMENT.
5. ALL EXTERIOR RECEPTACLES SHALL BE W.P./GFCI TYPE.


E6

GENERAL NOTES

REFER TO A1-E202 FOR WEST LIGHTING PLAN
REFER TO A1-E302 FOR WEST POWER PLAN

REFER TO A3-E201 FOR CENTER LIGHTING PLAN
REFER TO A3-E301 FOR CENTER POWER PLAN

REFER TO A1-E201 FOR EAST LIGHTING PLAN
REFER TO A1-E301 FOR EAST POWER PLAN

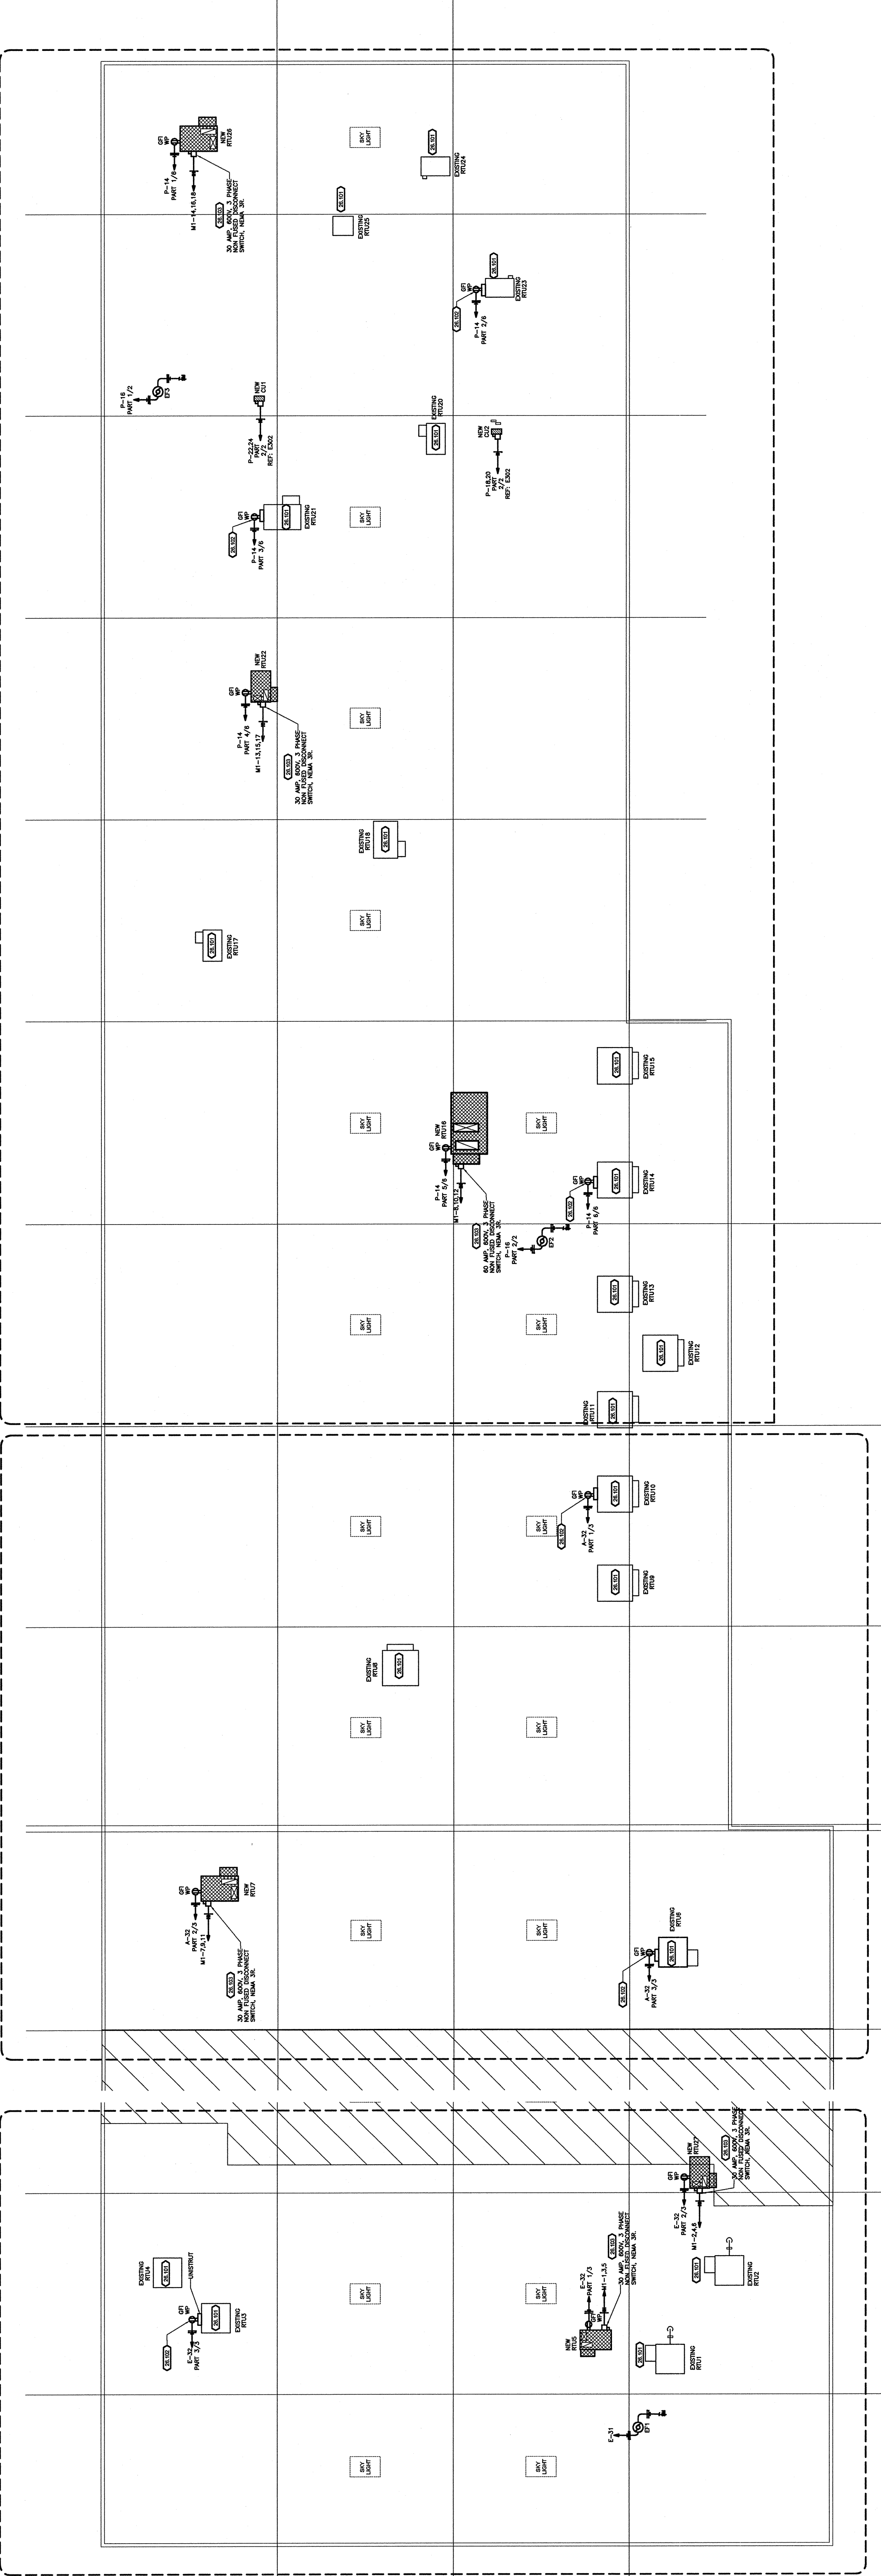

- 26.101
- ELECTRICAL CONTRACTOR SHALL VERIFY IN FIELD THE LOCATION OF ALL EXISTING ELECTRICAL PANELS, DISCONNECTS, AND RECEPTACLES. REPORT ANY DISCREPANCIES TO ENGINEER OR ARCHITECT.
- 26.102
- ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL WEATHER PROOF RECEPTACLE MOUNTED ON EXTERIOR WALLS TO THE EXISTING UNITS AS SHOWN ON THE PLAN.
- 26.103
- ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL WEATHER PROOF RECEPTACLE MOUNTED ON EXTERIOR WALLS TO THE EXISTING UNITS AS SHOWN.



A1

ROOF POWER PLAN

1/16"=1'-0"

A6

KEYNOTES

6