






1350 S. BOULDER AVENUE
SUITE 1100
TULSA, OK 74119-3204
918.587.2282
FAX 918.587.2285
SELSERSCHAEFER.COM



**MPW
ENGINEERING, LLC**
110 West 7th Street • Suite 600
Tulsa, Oklahoma 74119
(918) 582-4038
(918) 582-4087 FAX
CA #2040
EXP 06-30-11

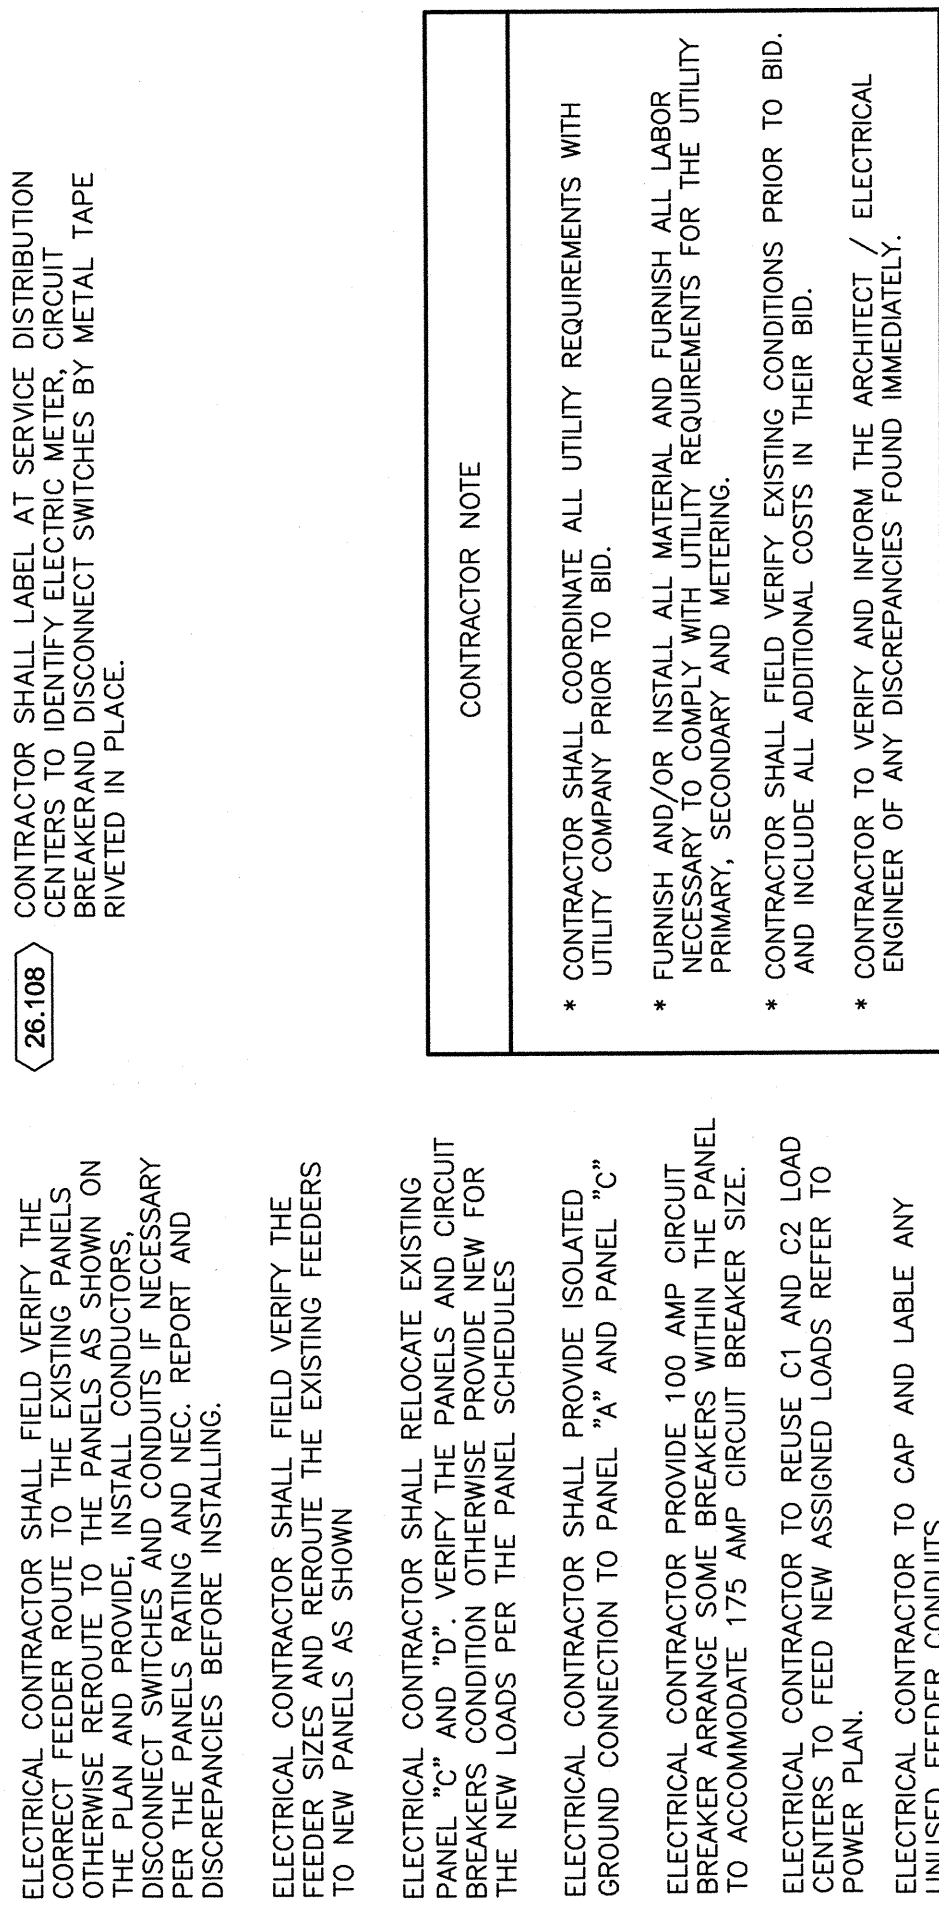


FEEDER SCHEDULE 									
NO.	AMPS	SETS	CONDUCTORS					CONDUIT SIZES	
			PHASE		NEUTRAL	GROUND	IG		
1	400	2	(3)	3/0	(1)	3/0	#3	2-1/2"	
2	250	1	(3)	250CMILL	(3)	250CMILL	#4	—	
3	225	1	(3)	4/0	(1)	4/0	#4	2-1/2"	
4	175	1	(3)	#2/0	(1)	#2/0	#6	—	
5	150	1	(3)	#1/0	(1)	#1/0	#6	2"	
6	110	1	(3)	#2	(1)	#2	#6	2"	
7	50	1	(3)	#2	—	—	#6	1-1/4"	

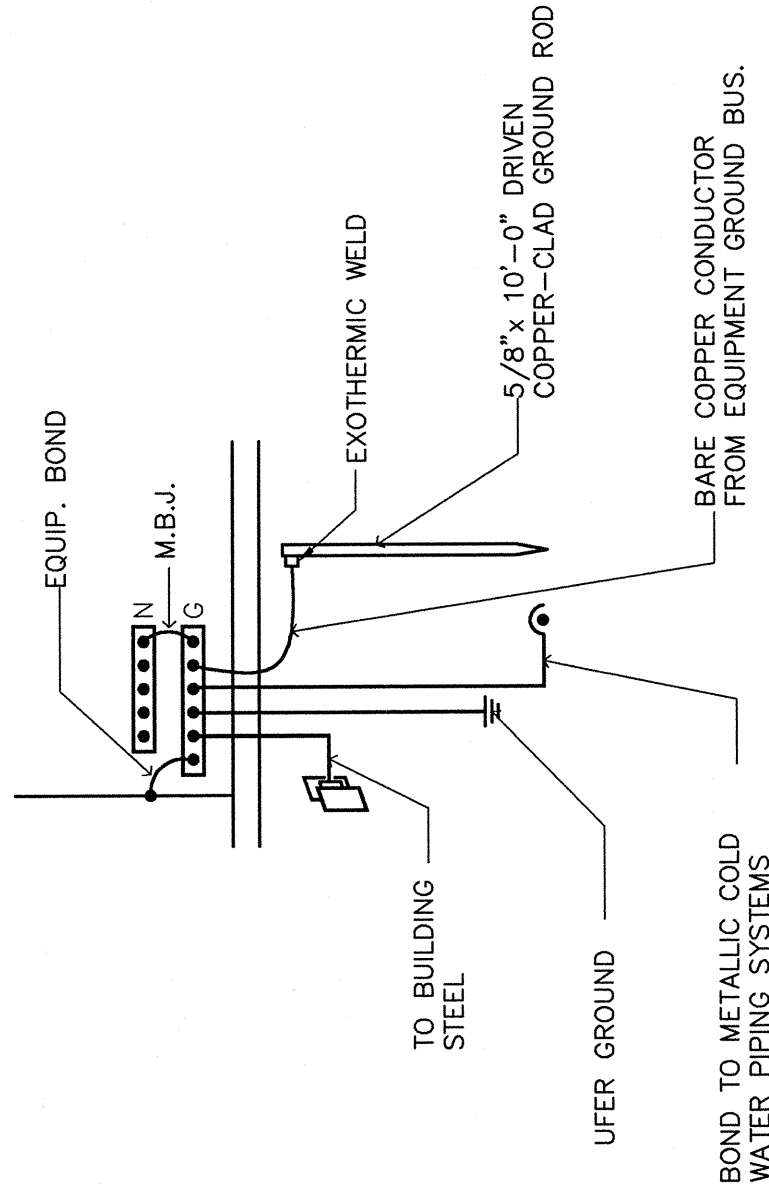


GROUNDING ELECTRODE SYSTEM
INSTALLATION SHALL BE IN STRICT
COMPLIANCE WITH LOCAL CODES
AND/OR AUTHORITY HAVING
JURISDICTION.
SIZE OF GROUND CONDUCTORS PER
NEC 250.66 AND 250.122 TABLES

FEEDER SCHEDULE AND NOTES

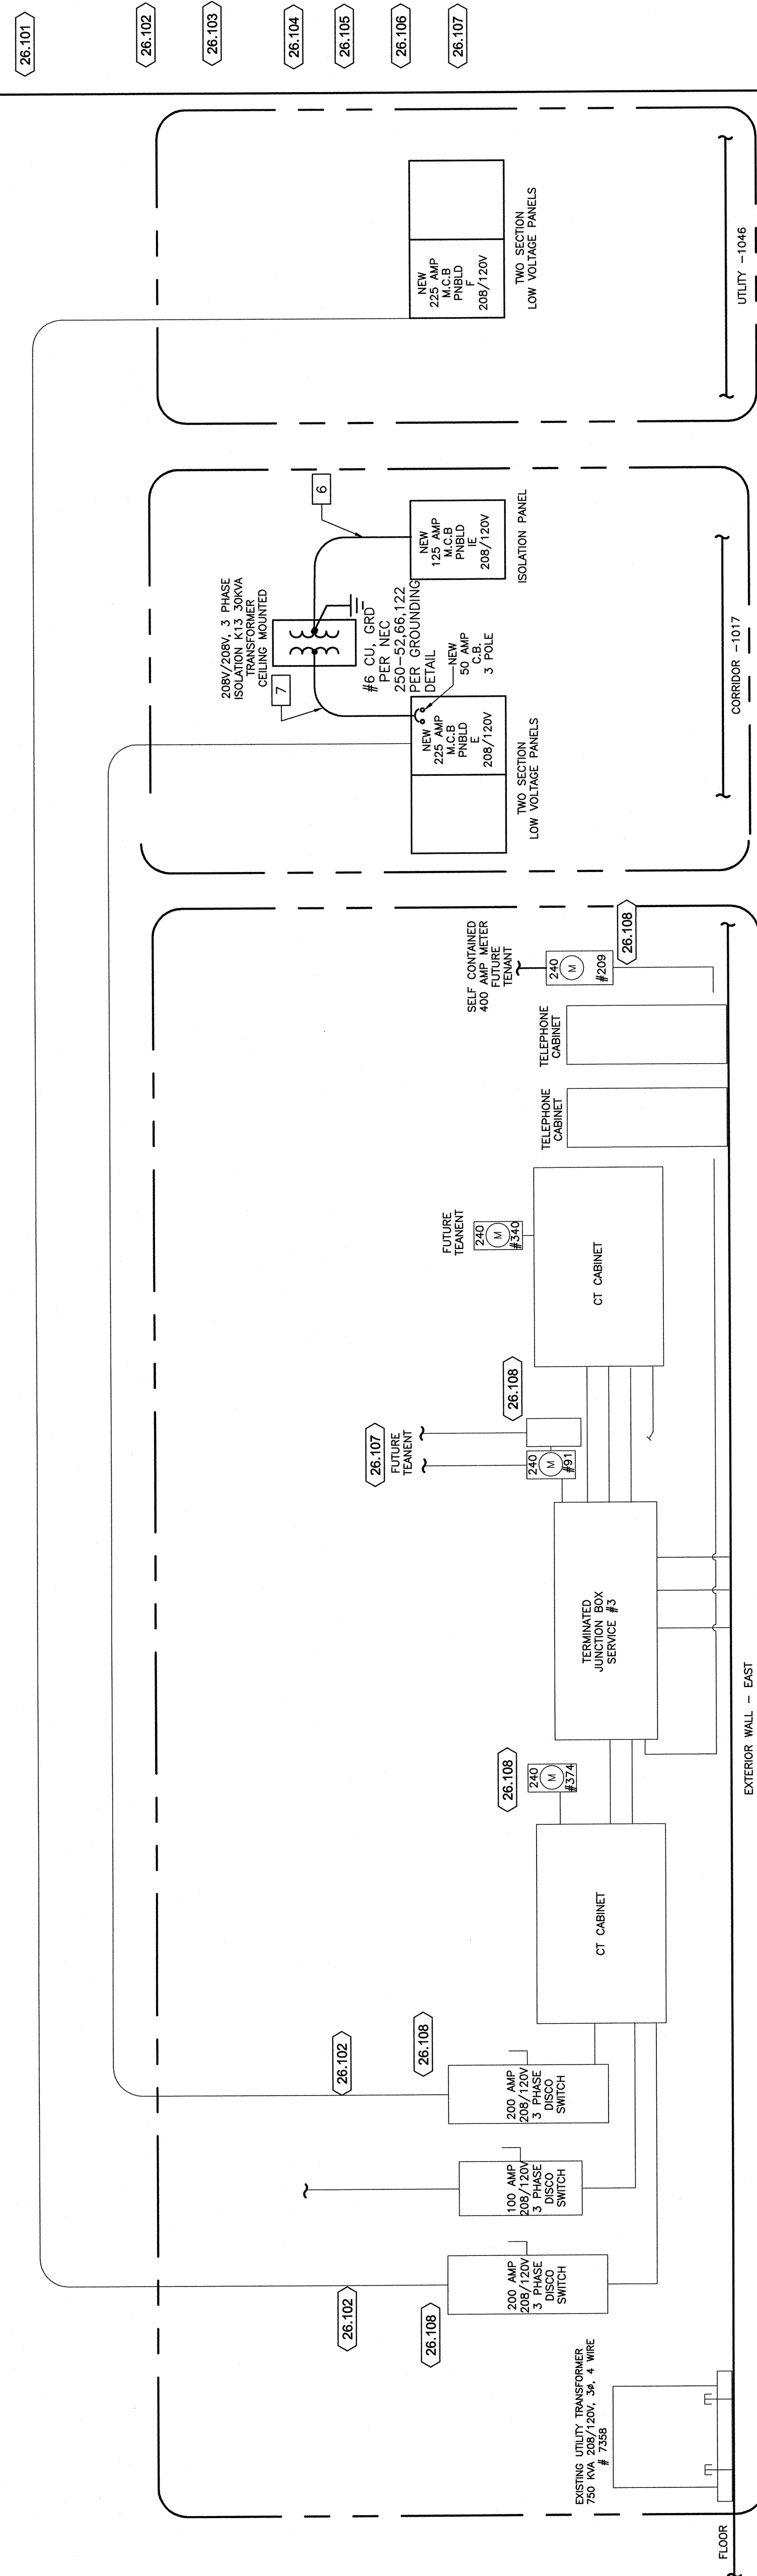

SERVICE #3 EAST - ONE LINE DIAGRAM

NTS

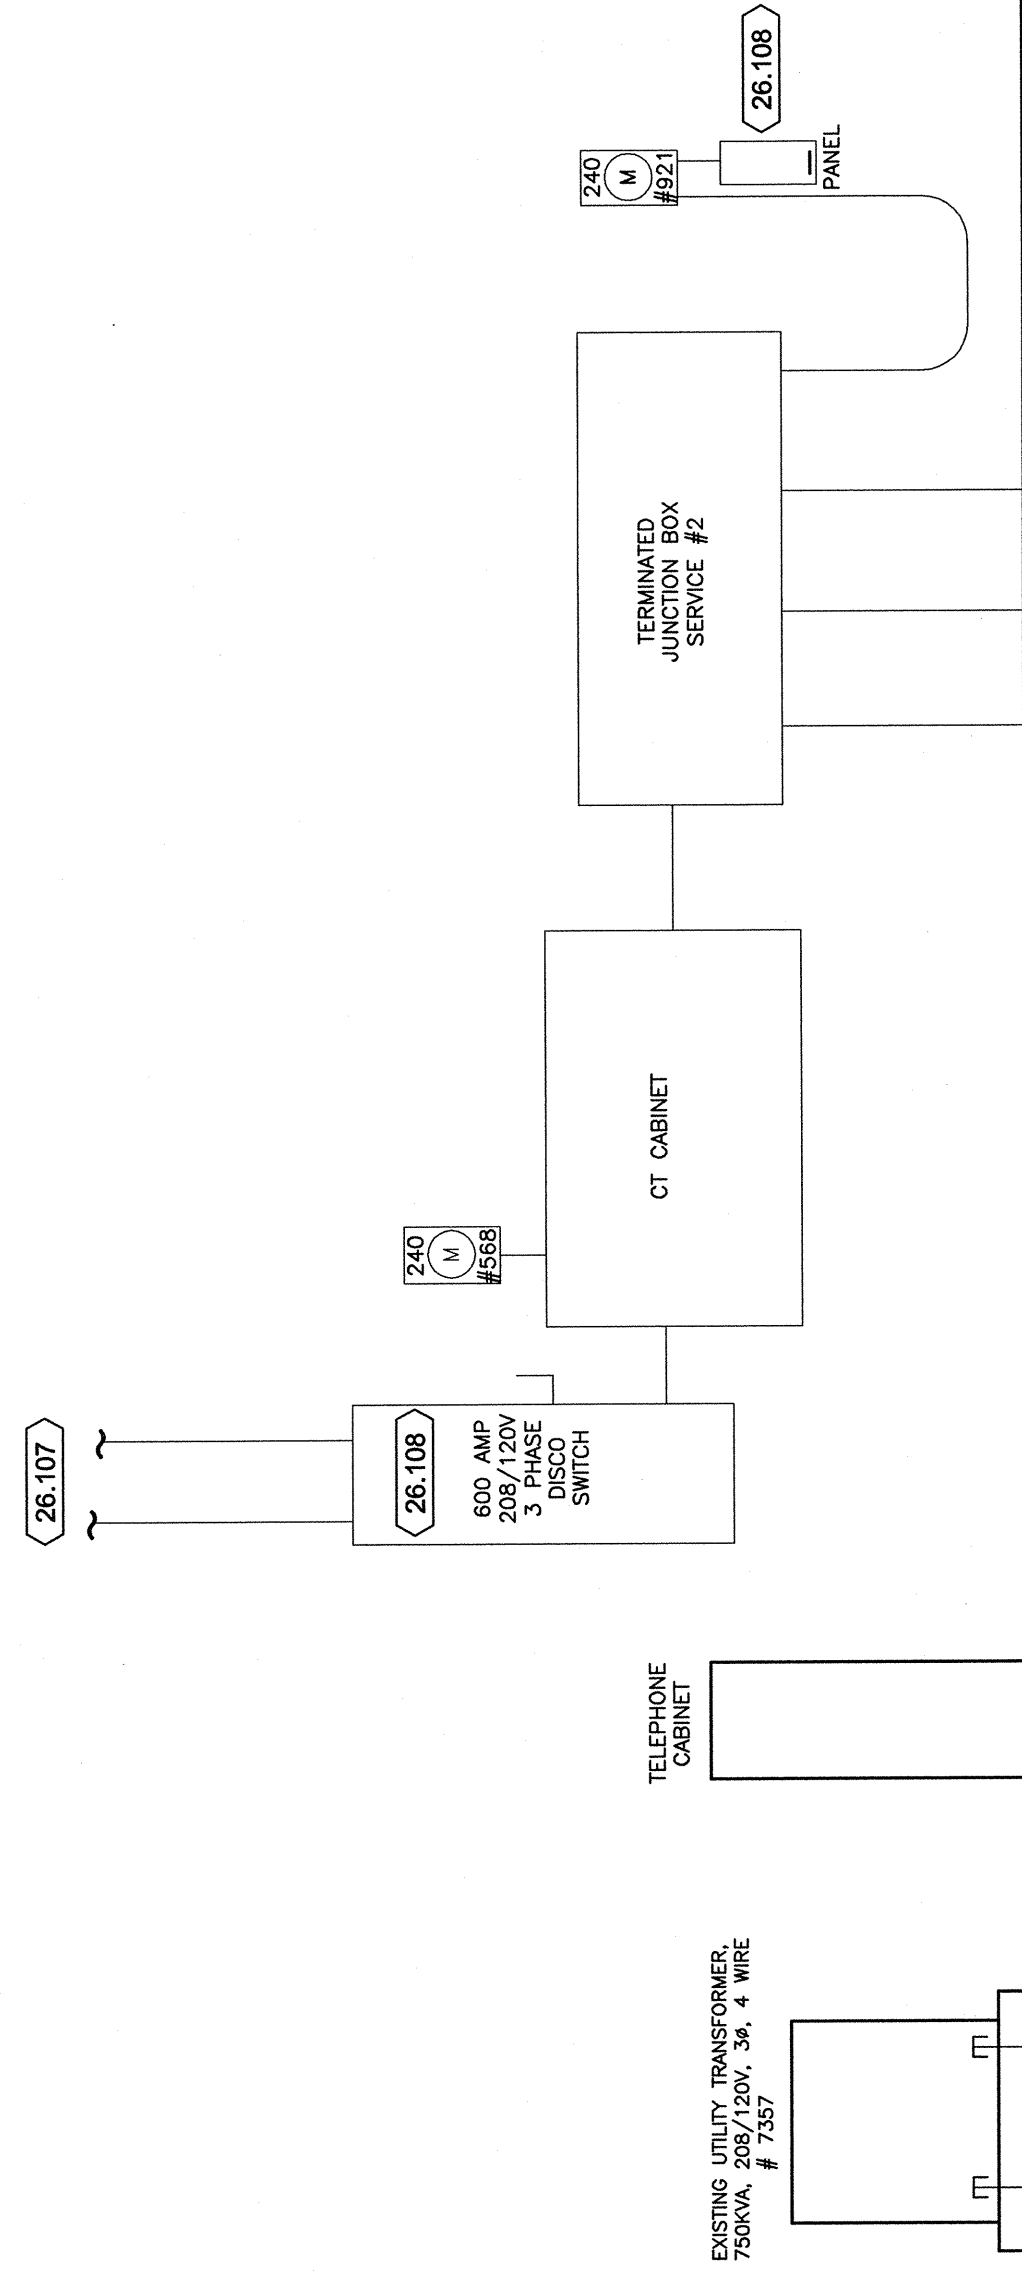


B1	SERVICE #2 CENTER - ONE LINE DIAGRAM
----	--------------------------------------

NTS

GROUNDING DETAIL

NTS

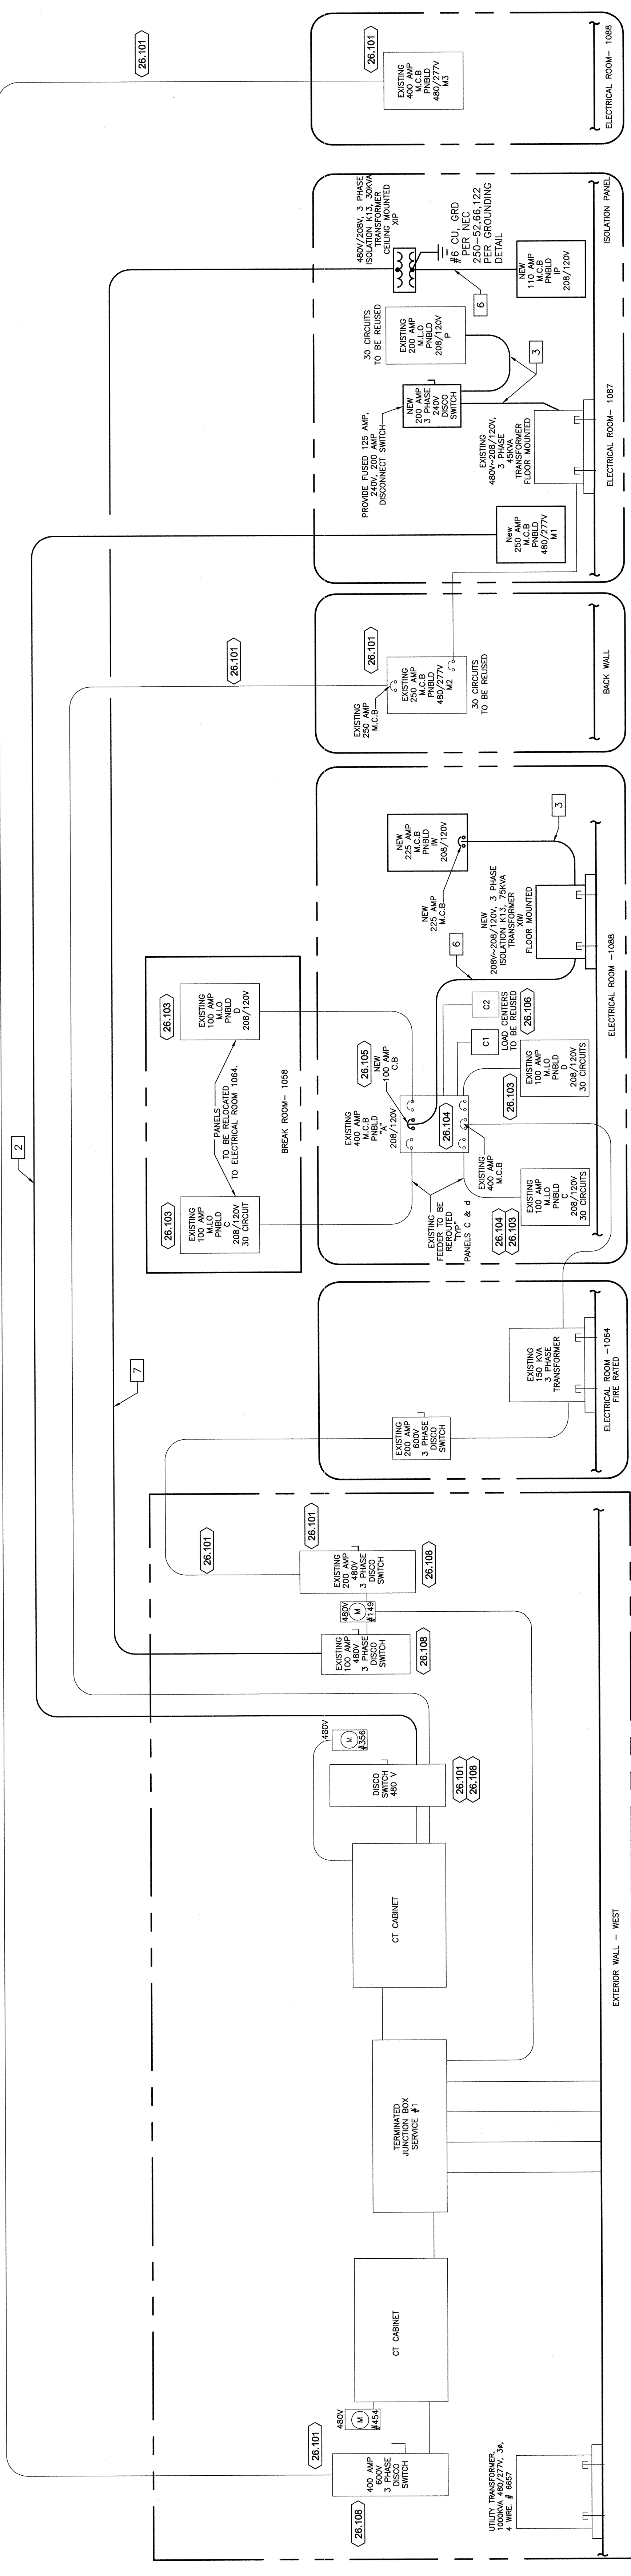


A1 SERVICE #1 WEST - ONE LINE DIAGRAM

1

5

4

52

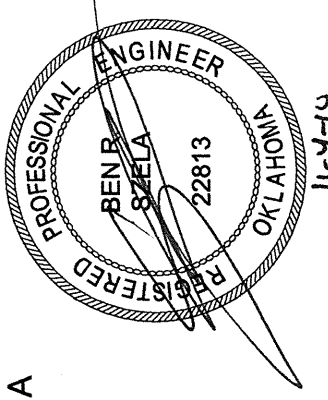

E401

© 2010 Selvar Schwefel Architects, Inc.