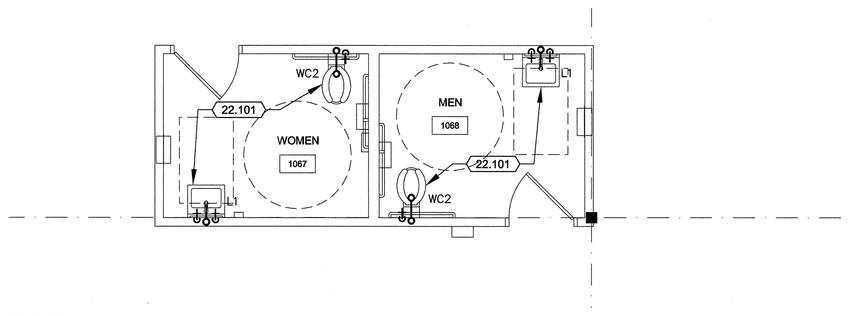

E1 ENLARGED PLUMBING PLAN

1/4"=1'-0" NORTH

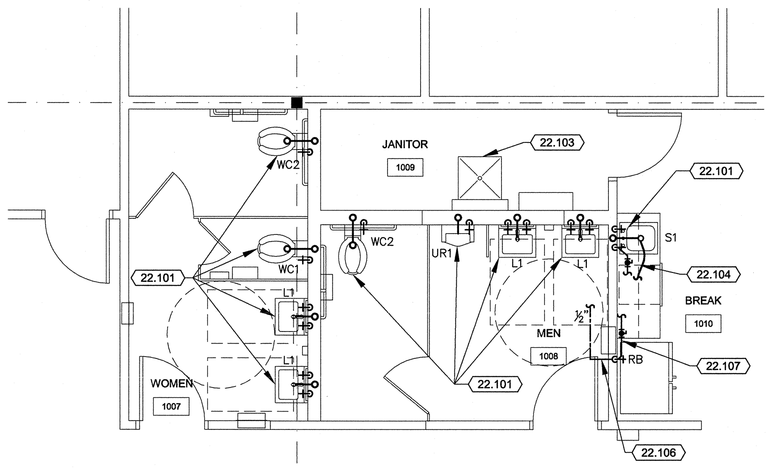

C1 ENLARGED PLUMBING PLAN

1/4"=1'-0" NORTH

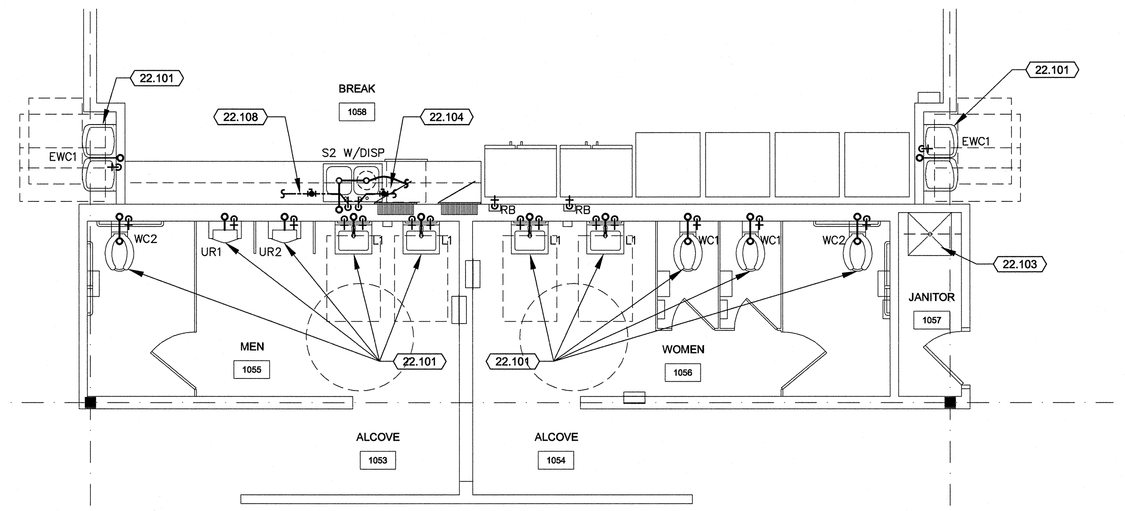

C2 ENLARGED PLUMBING PLAN

1/4"=1'-0" NORTH

C5 KEYNOTES

22.101 CONTRACTOR SHALL FIELD VERIFY AND ALTER EXISTING DOMESTIC WATER SUPPLY, DRAIN, WASTE AND VENT CONNECTIONS AS REQUIRED FOR NEW FIXTURES. REFER TO MANUFACTURER'S PRODUCT DATA FOR ROUGH-IN REQUIREMENTS. NEW FIXTURE TO BE INSTALLED AFTER ROOM FINISH IS COMPLETED. REFER TO PLUMBING FIXTURE SCHEDULE ON SHEET P201.

22.102 REMOVE PLUMBING FIXTURES IN THIS SPACE. CAP-OFF ANY UNUSED WATER SUPPLY PIPING TO CONCEALED LOCATION. PLUG AND CAP-OFF ANY UNUSED DRAIN, WASTE & VENT PIPING CONCEALED IN WALL OR BELOW FLOOR; PATCH TO MATCH SURROUNDING MATERIALS AND FINISHES. REFER TO ARCHITECTURAL PLANS. REFER TO PLUMBING PLANS FOR WATER SUPPLY, DRAIN, WASTE, AND VENT TO BE REUSED.

22.103 EXISTING PLUMBING FIXTURES TO REMAIN. CLEAN PLUMBING FIXTURES.

22.104 PROVIDE UNDER-COUNTER HOT WATER SUPPLY WITH BALL VALVE AND MANUFACTURER'S RECOMMENDED DRAIN CONNECTION TO DISHWASHER.

22.105 PROVIDE CONDENSATE REMOVAL PUMPS FOR MINI-SPLIT SYSTEMS FCU'S 1, 2 & 3. REFER TO M102 KEYNOTES FOR CONDENSATE REMOVAL PUMP SPECIFICATIONS.

22.106 CONNECT TO EXISTING ¾" OR LARGER COLD WATER (CW) LINE ABOVE CEILING. ROUTE DOWN IN WALL TO REFRIGERATOR VALVE BOX "RB". CONNECT TO REFRIGERATOR. REFER TO REFRIGERATOR'S INSTALLATION INSTRUCTIONS.

22.107 PROVIDE TEE AT REFRIGERATOR CONNECTION FOR COFFEE MAKER LINE. ROUTE ¾" COLD WATER (CW) LINE THROUGH BASE CABINET. PROVIDE WATER SHUT OFF VALVE ABOVE COUNTER AT BACK SPLASH. CONNECT TO COFFEE MAKER PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.

22.108 PROVIDE TEE AT RISER CONNECTION FOR COFFEE MAKER LINE. ROUTE ¾" COLD WATER (CW) LINE THROUGH BASE CABINET. PROVIDE WATER SHUT OFF VALVE ABOVE COUNTER AT BACK SPLASH. CONNECT TO COFFEE MAKER PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.

C6 GENERAL NOTES

A. ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH LATEST EDITIONS OF ALL APPLICABLE LOCAL, STATE AND NATIONAL CODES, AND INSTALLED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.

B. DRAWINGS ARE DIAGRAMMATIC AND INTEND TO SHOW APPROXIMATE LOCATION OF PIPING, FIXTURES, ETC. CONTRACTOR SHALL COORDINATE WITH ALL DISCIPLINES AND INSTALL ALL WORK WITHOUT CONFLICT WITH OTHER TRADES AND MAKE MINOR ALTERATIONS AS REQUIRED WITHOUT ADDITIONAL COST TO OWNER.

C. ALL WASTE PIPING SHALL BE UNIFORMLY GRADED AND SHALL HAVE A SLOPE OF NOT LESS THAN 1/4" PER FOOT FOR PIPING 3" AND BELOW AND 1/8" PER FOOT FOR PIPING LARGER THAN 3" SIZE. ALL PIPING BELOW FLOOR TO BE 2" MINIMUM. FIELD VERIFY ALL INVERT FLOW ELEVATIONS BEFORE WORK BEGINS.

D. PRIOR TO INSTALLATION OF ANY SUBGRADE SERVICE, THE CONTRACTOR SHALL EXAMINE AND VERIFY, ALL MEASUREMENTS, DISTANCES, LOCATIONS, SEWER ELEVATIONS, SIZES, CROSSINGS ETC. AND INFORM THE OWNER AND THE ENGINEERS OF ANY CONFLICTS PRIOR TO CONSTRUCTION.

E. GENERAL CONTRACTOR SHALL COORDINATE ALL BUILDING UTILITY REQUIRED CONNECTIONS OUTSIDE BUILDING LINE UNLESS OTHERWISE NOTED. HE SHALL BE RESPONSIBLE FOR ALL TAP FEES, PERMITS AND COST ASSOCIATED WITH UTILITY SERVICES. HE SHALL LOCATE ALL EXISTING UTILITIES, VERIFY SIZES, AND CONNECT NEW SERVICES AS REQUIRED FOR FULLY FUNCTIONING FACILITY.

F. FURNISH AND INSTALL NEW PLUMBING FIXTURES PER PLUMBING FIXTURE AND SPECIALTIES SCHEDULES ON SHEET P201.

G. VALVES SERVING DOMESTIC WATER SYSTEMS SHALL BE BALL VALVES OR APPROVED EQUAL. ALL VALVES SHALL BE LOCATED SO AS TO BE ACCESSIBLE BY MAINTENANCE PERSONNEL.

H. PLUMBING CONTRACTOR SHALL PROVIDE ALL EQUIPMENT CONDENSATE DRAINAGE, GAS PIPING AND ASSOCIATED PIPE SUPPORTS. REFER TO DETAILS A3/M201 FOR RTU PIPE CONNECTIONS.

J. CONTRACTOR SHALL PROVIDE ALL MATERIALS FOR A COMPLETE OPERATIONAL SYSTEM, INCLUDING OFFSETS REQUIRED TO COORDINATE WITH OTHER TRADES AND EXISTING CONDITIONS.

K. ALL PLUMBING FIXTURES SHOWN AS RELOCATED OR EXISTING SHALL BE CLEANED PRIOR TO REINSTALL.

M. REFER TO ARCHITECTURAL DRAWINGS FOR SPECIFIC FIXTURES TO BE DEMOLISHED OR REUSED.

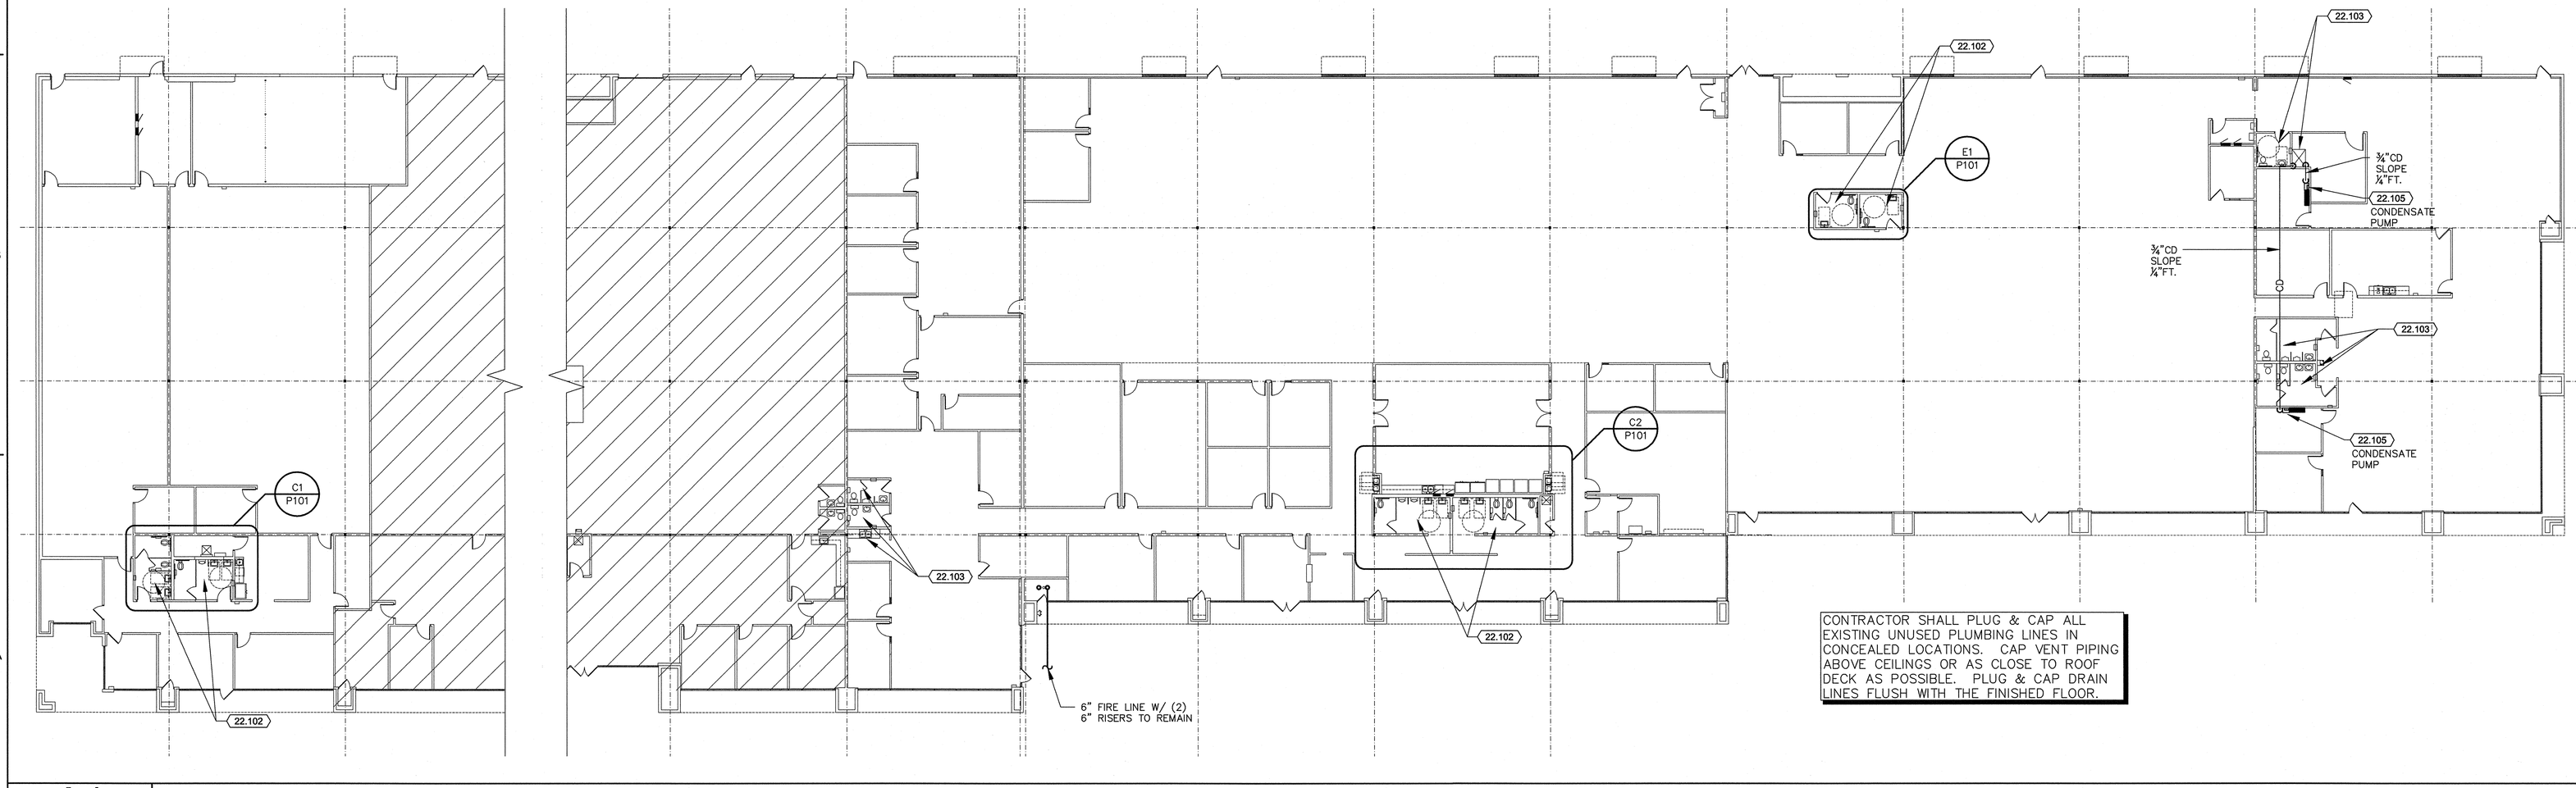

CONTRACTOR SHALL PLUG & CAP ALL EXISTING UNUSED PLUMBING LINES IN CONCEALED LOCATIONS. CAP VENT PIPING ABOVE CEILINGS OR AS CLOSE TO ROOF DECK AS POSSIBLE. PLUG & CAP DRAIN LINES FLUSH WITH THE FINISHED FLOOR.

A1 PLUMBING PLAN

1/16"=1'0" NORTH

SELSER SCHAEFER ARCHITECTS, INC.
1350 S. BOULDER AVENUE
SUITE 1100
TULSA, OK 74119-3204
918.587.2282
FAX 918.587.2285
SELSERSCHAEFER.COM

MPW ENGINEERING, LLC
110 West 7th Street • Suite 600
Tulsa, Oklahoma 74119
(918) 582-4088
(918) 582-4087 FAX
CA #2949
EXP 06-30-11

CHEROKEE NATION. Entertainment

CNE INTERCHANGE PARK TENANT IMPROVEMENT

10838 EAST MARSHALL STREET, TULSA, OKLAHOMA 74116

ISSUE 01

ISSUE DATE 11.05.10

PROJECT NO. R10.053

DRAWN BY AMM, MBM

CHECKED BY DAD, MEC

SHEET TITLE ENLARGED PLUMBING PLANS

REGISTERED PROFESSIONAL ENGINEER MARTIN B. MOSER 20483 OKLAHOMA 11-4-10

P101

© 2010 Selser Schaefer Architects, Inc.