

CNE Advantage Chemical Controllers and Water Treatment Stations

Central Plant

Advantage Controllers – 11

Closed Loop Water Treatment Stations – 5

Cooling Tower Water Treatment Stations – 6

HR South Central Plant

1 - Closed Loop Water Treatment Station with Advantage Controller

1 - Cooling Tower Water Treatment Station with Advantage Controller

HR North Central Plant

1 - Closed Loop Water Treatment Station with Advantage Controller

3 - Cooling Tower Water Treatment Stations with Advantage Controller

WSS Central Plant

1 - Closed Loop Water Treatment Station with Advantage Controller

1 - Cooling Tower Water Treatment Stations with Advantage Controller

Roland Central Plant

1 - Closed Loop Water Treatment Station with Advantage Controller

1 - Cooling Tower Water Treatment Stations with Advantage Controller

HR South Secondary Loop

1 - Closed Loop Water Treatment Station with Advantage Controller

HVAC

Advantage Controllers – 4

Cooling Tower Water Treatment Stations – 4

HR HVAC RTU 4

1 - Cooling Tower Water Treatment Stations with Advantage Controller

HR HVAC RTU 7


1 - Cooling Tower Water Treatment Stations with Advantage Controller

HR HVAC RTU 11

1 - Cooling Tower Water Treatment Stations with Advantage Controller

HR HVAC Cherokee Tower Pump Skid (Installed Fall 2019)

1 - Closed Loop Water Treatment Station with Advantage Controller

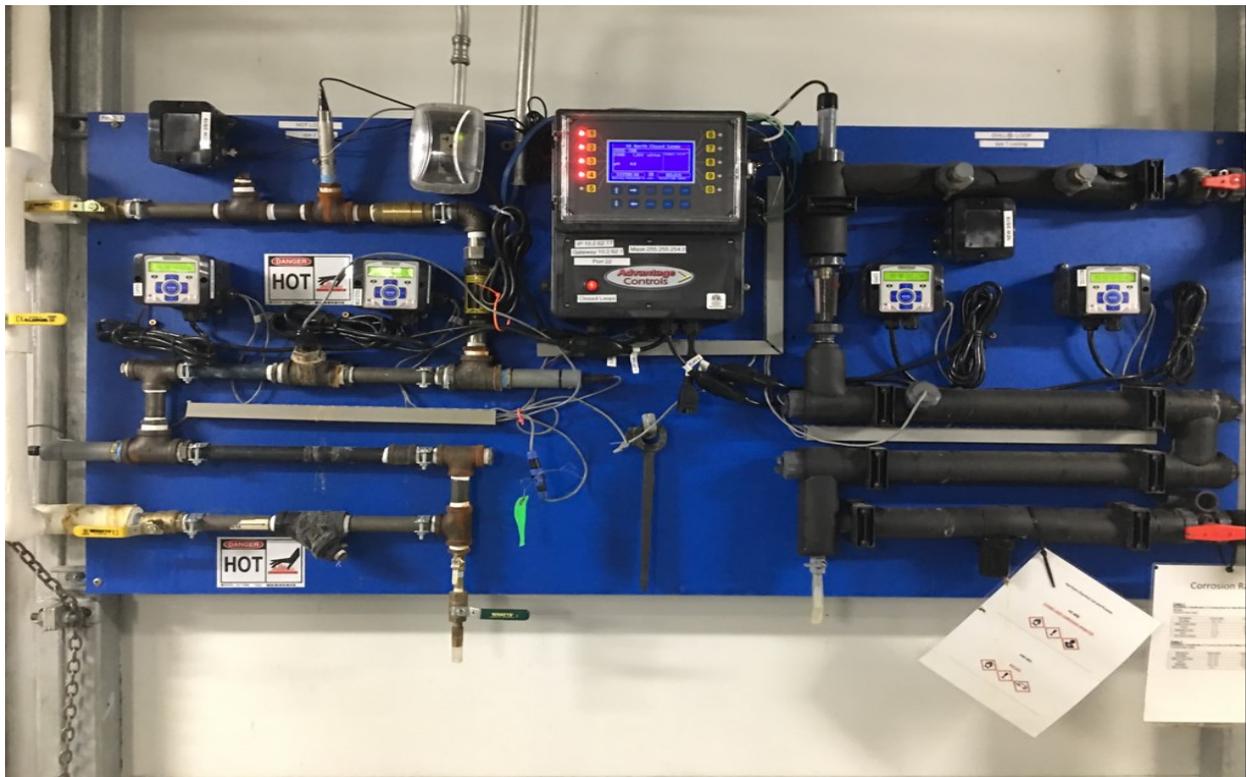



HVAC RTU (Water Cooled) Controller



HVAC RTU (Water Cooled) Water Treatment Station

