




WILMA P. MANKILLER HEALTH CENTER EXPANSION

BID PACKAGE 01 (DEMOLITION / STEEL / FOUNDATIONS)


INDEX OF DRAWINGS - BID PACKAGE 01	
SHEET NUMBER	SHEET NAME
GENERAL	
G0.01	COVER / INDEX
CIVIL	
C002	GENERAL NOTES
CS100	EXISTING SITE PLAN
CS101	DEMOLITION PLAN
CS102	DEMOLITION PLAN
CE100	EROSION CONTROL SITE PLAN
CE500	EROSION CONTROL DETAILS
ARCHITECTURAL	
A0.01	OVERALL BUILDING DEMOLITION PLAN
STRUCTURAL	
S0.01	ABBREVIATIONS AND LEGENDS
S0.02	GENERAL STRUCTURAL NOTES
S0.03	GENERAL STRUCTURAL NOTES AND SPECIAL INSPECTIONS
SD0.01	DEMOLITION GENERAL STRUCTURAL NOTES
SD1.01	DEMOLITION PLANS - SECTOR 1
SD2.01	DEMOLITION SECTIONS
S1.00	OVERALL PLAN - FOUNDATION
S1.01	FOUNDATION PLAN SECTOR 1
S1.02	FOUNDATION PLAN SECTOR 2
S1.10	OVERALL PLAN - FLOOR FRAMING
S1.11	FLOOR FRAMING PLAN - SECTOR 1
S1.12	FLOOR FRAMING PLAN - SECTOR 2
S1.13	LOW ROOF FRAMING PLAN
S1.20	OVERALL PLAN - ROOF FRAMING
S1.21	ROOF FRAMING PLAN - SECTOR 1
S1.22	ROOF FRAMING PLAN - SECTOR 2
S2.01	MOMENT FRAME ELEVATIONS
S2.02	MOMENT FRAME AND BRACED FRAME ELEVATIONS
S3.01	WALL SECTIONS
S3.02	WALL SECTIONS
S3.03	WALL SECTIONS
S3.04	WALL SECTIONS
S3.11	FOUNDATION SECTIONS
S3.12	FOUNDATION SECTIONS
S3.21	FLOOR FRAMING SECTIONS
S3.31	ROOF FRAMING SECTIONS
S4.01	ENLARGED PLANS
S5.21	MASONRY FRAMING SECTIONS AND DETAILS
S5.41	VERTICAL CIRCULATION DETAILS
S5.51	STEEL DETAILS
S5.52	STEEL DETAILS
S5.53	STEEL DETAILS
S6.01	SCHEDULES
S7.11	TYPICAL CONCRETE DETAILS
S7.21	TYPICAL MASONRY DETAILS
S7.31	TYPICAL COLD-FORMED DETAILS
S7.41	TYPICAL STEEL DETAILS
S7.42	TYPICAL STEEL DETAILS
S8.01	SIDEPLATE GENERAL NOTES AND CONSTRUCTION GUIDELINES
S8.02	SIDEPLATE COLUMN DETAILS, A TYPE
S8.03	SIDEPLATE COLUMN DETAILS, B TYPE
S8.04	SIDEPLATE BEAM DETAILS
S8.05	SIDEPLATE BEAM DETAILS, NARROW
S8.06	SIDEPLATE FIELD ERECTION DETAILS
S8.07	SIDEPLATE MISC DETAILS AND COORDINATION ITEMS
ELECTRICAL	
DE1.0	ELECTRICAL DEMOLITION PLAN
Grand total: 54	

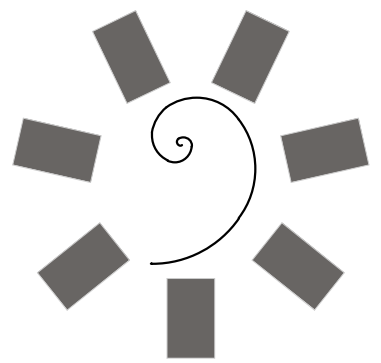

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com

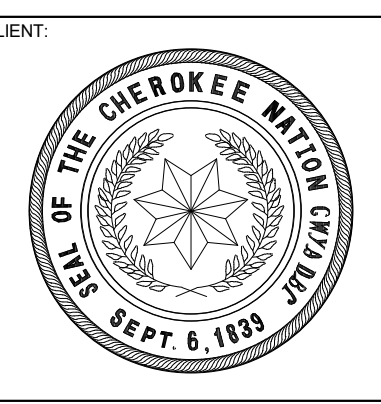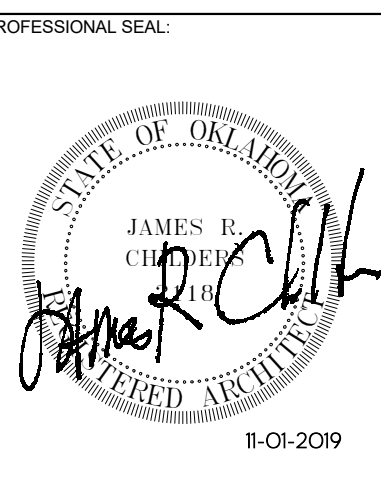

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
 STILWELL, OKLAHOMA

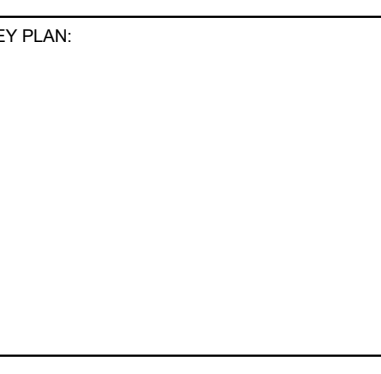

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:
G0.01

COVER / INDEX



1836 SOUTH BALTIMORE AVE.
TULSA, OK 74119
(539) 664-4618

MECHANICAL / ELECTRICAL / PLUMBING ENGINEER

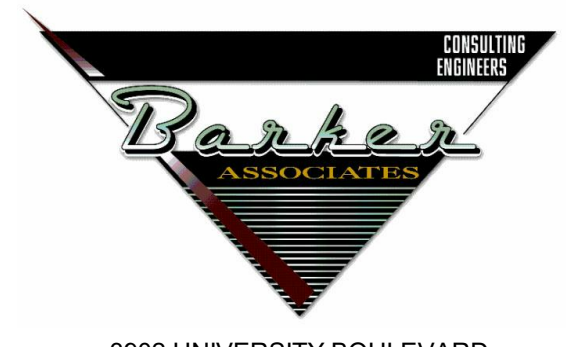

3902 UNIVERSITY BOULEVARD
DURANT, OK 74701
(580) 931-9045

CIVIL ENGINEER



4700 LINCOLN ROAD NE, SUITE 102
ALBUQUERQUE, NM 87109
(505) 344-4080

STRUCTURAL ENGINEER




808 TRAVIS STREET, SUITE 200
HOUSTON, TX 77002
(281) 589-5900

FIRE PROTECTION / LIFE SAFETY




1316 E 35TH PLACE, SUITE 100
TULSA, OK 74105
(918) 382-9120

EQUIPMENT PLANNER

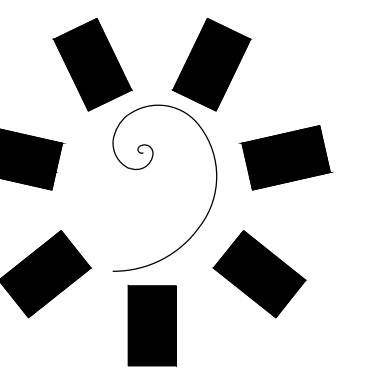

**James R. Childers
Architect, Inc.**
45 South 4th Street
Ft. Smith, AR 72301
479-763-2460
www.childersarchitect.com

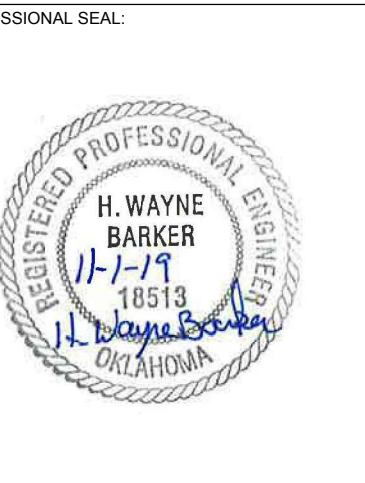

GENERAL NOTES

- THE CONTRACTOR SHALL HAVE EXISTING UTILITIES LOCATED PRIOR TO CONSTRUCTION. CONTRACTOR SHALL CALL "OKIE" 1-800-522-6543 IN ADDITION TO DIRECT NOTIFICATION. CONTRACTOR SHALL BRACE UTILITY POLES AS NECESSARY. UTILITIES DAMAGED BY THE CONTRACTOR SHALL BE REPAIRED TO THE UTILITY OWNER'S SPECIFICATIONS BY THE CONTRACTOR AT NO COST TO THE OWNER.
- THE CONTRACTOR SHALL ESTABLISH, INSTALL, OPERATE, AND MAINTAIN COMPLETE AND ADEQUATE AND SAFE TRAFFIC CONTROLS DURING THE ENTIRE CONSTRUCTION PERIOD. ALL TRAFFIC CONTROL DEVICES SHALL BE APPROVED BY THE ENGINEER.
- ALL DIMENSIONS OR ELEVATIONS WITH ± SHALL BE CONFIRMED BY THE CONTRACTOR.
- ALL DIMENSIONS OF EXISTING STRUCTURES AND EQUIPMENT SHALL BE VERIFIED BY THE CONTRACTOR. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER & OWNER.
- TOPSOIL IN THE DISTURBED AREAS SHALL BE REMOVED, STOCKPILED, AND RESTORED AFTER CONSTRUCTION OPERATIONS, IN ACCORDANCE WITH PROJECT SPECIFICATIONS. ALL EXCESS TOPSOIL SHALL BE CONSIDERED WASTE AND STOCKPILED ON-SITE BY THE CONTRACTOR, UNLESS OTHERWISE NOTED.
- ALL DISTURBED ROADWAY AND DRIVEWAY SURFACES SHALL BE RESTORED TO THEIR PRE-CONSTRUCTION CONDITION.
- FALL PROTECTION AROUND ALL OPENINGS AND EXCAVATION SHALL BE MAINTAINED AT ALL TIMES.
- NORTH ARROWS SHOWN ON DRAWINGS INDICATE LOCAL COORDINATE SYSTEM ESTABLISHED BY THE SURVEYOR, UNLESS OTHERWISE NOTED.
- TRENCH SAFETY AND SHORING IN ACCORDANCE WITH CURRENT OSHA REGULATIONS SHALL BE EMPLOYED BY CONTRACTOR AT ALL TIMES.
- IF AT ANY POINT CONSTRUCTION ACTIVITIES EXPOSE ARCHEOLOGICAL MATERIALS SUCH AS CHIPPED STONE, TOOLS, POTTERY, BONE, HISTORIC CROCKERY, GLASS, METAL ITEMS OR BUILDING MATERIALS, THE OKLAHOMA ARCHEOLOGICAL SURVEY STATE ARCHEOLOGIST, KARY L. STACKELBECK, SHALL BE CONTACTED IMMEDIATELY AT 405-325-7211.
- ALL STATIONS SHOWN ON THE PLANS ARE CENTERLINE STATIONS UNLESS NOTED OTHERWISE.
- THE TOPOGRAPHIC SURVEY WAS COMPLETED BY NATIVE PLAINS SURVEYING & MAPPING, LLC. ALL EXISTING INFORMATION IS SHOWN AS ACCURATELY AS POSSIBLE BASE UPON FIELD RECONNAISSANCE AND RESEARCH. CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL EXISTING INFORMATION. IF CONTRACTOR BELIEVES EXISTING INFORMATION IS INACCURATE, THE CONTRACTOR MAY HAVE A NEW SURVEY COMPLETED AT NO ADDITIONAL COST TO THE OWNER, ARCHITECT, OR ENGINEER.
- DIMENSIONS SHOWN ARE TO BACK OF CURB OR CENTERLINE OF PIPE UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL REVIEW & COORDINATE W/ ARCHITECTURAL, MECH., ELEC., & PLUMBING DISCIPLINES DRAWINGS, SPEC'S & DETAILS. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER. IN THE EVENT THAT THE ARCH. &/OR CONTRACTOR DEVIATES CONSTRUCTION FROM THESE PLANS W/O THE EXPRESS WRITTEN APPROVAL OF THE ENGINEER, THE ARCH. &/OR CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR THOSE MODIFICATIONS.

EROSION CONTROL NOTES:

- SILT FENCE SHALL BE MAINTAINED AND SEDIMENT BUILDUP REGULARLY REMOVED UNTIL PAVING OPERATIONS ARE COMPLETE AND/OR SEEDING IS IN PLACE AND 75% VEGETATION STABILIZATION IS OBTAINED.
- ALL TREES, BRUSH, AND OTHER DEBRIS THAT MIGHT INTERFERE WITH THE FLOW OF WATER IS TO BE CLEANED OUT TO THE RIGHT-OF-WAY LINE AT EACH STRUCTURE, IN A MANNER APPROVED BY THE ENGINEER.
- ALL FLOW LINES THAT ARE TO BE FILLED SHALL BE THOROUGHLY COMPACTED TO 95% STANDARD PROCTOR DENSITY BEFORE CONSTRUCTION OR EXTENSION OF DRAINAGE STRUCTURES.
- IN ORDER TO ALLEVIATE DUST CONDITIONS DURING GRADING OPERATIONS, AND AFTER GRADING OPERATIONS ARE COMPLETED, BUT BEFORE PAVEMENT AND/OR PERMANENT EROSION CONTROL WORK IS COMPLETED, THE CONTRACTOR SHALL SPRINKLE GRADING AT INTERVALS APPROVED BY THE OWNERS REPRESENTATIVE.
- ALL UNPAVED DISTURBED AREAS SHALL RECEIVE SLAB SOD FOR PERMANENT EROSION CONTROL, UNLESS NOTED OTHERWISE. THIS SHALL INCLUDE FERTILIZER, WATERING & MOWING AS REQUIRED TO ESTABLISH A VIABLE TURF.
- AT THE BEGINNING OF THE TURF OPERATIONS, ANY AREAS INCLUDED IN PLANNED QUANTITIES THAT HAVE GROWN A SATISFACTORY VOLUNTEER TURF OF PERENNIAL GRASS AS DETERMINED BY THE OWNER'S REPRESENTATIVE, SHALL BE FERTILIZED AND WATERED BUT SHALL NOT BE SEEDED, SODDED OR SPRIGGED.
- VEGETATIVE MULCH AND SEEDING SHALL BE UTILIZED FOR TEMPORARY EROSION CONTROL.
- SEED: THE FOLLOWING KINDS OF SEEDS, AT ACRES-RATES INDICATED BELOW, SHALL BE PLANTED ON THE AREAS DESIGNATED FOR SEEDING.

TEMPORARY SEEDING	QUANTITY PER ACRE
KINDS OF SEED TO BE FURNISHED	
COOL SEASON MIX-	
PERENNIAL RYEGRASS (LOLIUM PERENNE)	20 LBS. OF SEED
CRIMSON CLOVER (TRIFOLIUM INCARNATUM)	12 LBS. OF SEED
WARM SEASON MIX-	
KOREAN LESPEDEZA (LESPEDEZA STRIATA)	12 LBS. OF SEED
CRIMSON CLOVER (TRIFOLIUM INCARNATUM)	20 LBS. OF SEED
LITTLE BLUESTEM (ANDROPOGON SCOPARIUS)	12 LBS. OF SEED
COMMON BERMUDA (CYNODON DACTYLON)	4 LBS. OF SEED

VEGETATIVE MULCHING: THE VEGETATIVE MULCH SHALL BE ANCHORED IN ACCORDANCE WITH THE "ADHESIVE SPRAY METHOD", AS SPECIFIED IN 233.04(b) OF THE ODOT STANDARD SPECIFICATIONS.

SEASONAL PLANTING RESTRICTIONS

THE PLANTING OF SPRIGGING SHALL BE RESTRICTED TO THE PERIOD FROM APRIL 1ST TO JUNE 30TH.

THE PLANTING OF TEMPORARY SEEDS (COOL SEASON MIX) SHALL BE RESTRICTED TO THE PERIOD FROM SEPTEMBER 1ST TO NOVEMBER 15TH.

THE PLANTING OF TEMPORARY SEEDS (WARM SEASON MIX) SHALL BE RESTRICTED TO THE PERIOD FROM MARCH 15TH TO JUNE 30TH.

AREAS ON WHICH SALVAGED TOPSOIL IS TO BE REPLACED SHALL HAVE 0-46-0 FERTILIZER APPLIED, AT THE RATE OF 150 LBS. PER ACRE, JUST PRIOR TO THE REPLACEMENT OF SALVAGED TOPSOIL.

SITE WORK NOTES


- ALL EARTHWORK & PAVING MATERIALS & METHODS SHALL CONFORM WITH OKLAHOMA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION, LATEST REVISION, UNLESS OTHERWISE NOTED.
- CONTRACTOR SHALL REVIEW GEOTECHNICAL REPORT PREPARED BY BUILDING & EARTH, DATED AUGUST 30, 2018. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER. THIS REPORT SHOULD BE CONSIDERED A PART OF THESE CONSTRUCTION DOCUMENTS.
- ONLY REMOVE TREES THAT DIRECTLY INTERFERE WITH CONSTRUCTION. CONTRACTOR SHALL LIMIT CLEARING & GRUBBING TO BUILDING & PARKING AREA FOOTPRINT, AS MUCH AS POSSIBLE.
- CONTRACTOR SHALL DISPOSE OF TREES, STUMPS, DEBRIS, ETC. OFF SITE IN A MANNER APPROVED BY THE OWNER.
- ALL AREAS TO RECEIVE PAVING SHALL BE STRIPPED OF VEGETATION, TOPSOIL, SOFT OR OTHERWISE SUITABLE MATERIAL. THIS WOULD INCLUDE AREAS IDENTIFIED FOR UNDERCUT. AREA SHALL BE SCARIFIED TO A DEPTH OF 8 INCHES, MOISTURE CONDITIONED TO A RANGE OF 1% BELOW TO 3% ABOVE THE MATERIAL'S OPTIMUM MOISTURE CONTENT, & COMPACTED TO A DENSITY OF AT LEAST 95% OF THE STANDARD PROCTOR (ASTM D 698) MAXIMUM DRY DENSITY. SUBGRADE SHALL BE PROOF ROLLED WITH A ROLLER OR TRUCK (GROSS WEIGHT OF 25 TONS OR MORE). SOFT AREAS SHALL BE EXCAVATED & REPLACED WITH SUITABLE MATERIAL. PROOF ROLLING SHALL BE WITNESSED BY OWNER'S REPRESENTATIVE. OWNER SHALL DETERMINE SUITABILITY OF SUBGRADE. REFER TO GEOTECHNICAL RECOMMENDATIONS.
- WHERE LIMESTONE IS EXPOSED AT FINISHED SUBGRADE, IT IS RECOMMENDED TO UNDERCUT THE LIMESTONE ROCK UNTIL A LEVEL THAT WILL ALLOW FOR PLACEMENT OF AT LEAST 8" OF STRUCTURAL FILL TO PROVIDE FOR UNIFORM SUBGRADE CONDITIONS ACROSS PAVEMENT AREAS.
- REMOVE ANY STUMPS, ROOTS LARGER THAN 2 INCHES IN DIAMETER, ROCKS LARGER THAN 3 INCHES AND ANY MATTED ROOTS, TO A DEPTH OF 18 INCHES BELOW ORIGINAL GROUND SURFACE.
- SELECT FILL SHALL BE COMPOSED OF MATERIAL WITH MAXIMUM DRY DENSITY IN EXCESS OF 100 POUNDS PER CUBIC FOOT, PLASTICITY INDEX (PI) LESS THAN 18, AND A LIQUID LIMIT (LL) LESS THAN 40. STRUCTURAL FILL SHOULD BE FREE OF ANY ORGANICS, SHOULD NOT CONTAIN ROCK FRAGMENTS GREATER THAN 3 INCHES IN ANY DIMENSION, AND SHOULD BE PROPERLY MOISTURE CONDITIONED PRIOR TO USE AS SELECT FILL. SELECT FILL SHOULD BE COMPACTED TO A MINIMUM OF 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY AND WITHIN ±2% OF THE OPTIMUM MOISTURE AS DETERMINED BY ASTM D 698. THE FILL MATERIAL SHOULD BE SPREAD IN HORIZONTAL LIFTS STARTING AT THE LOWEST ELEVATION. THE LIFTS SHOULD NOT EXCEED 8 TO 12 INCHES IN LOOSE LIFT THICKNESS.
- REUSE OF ON SITE SOILS AS FILL IS NOT RECOMMENDED BELOW PLANNED BUILDING OR PAVEMENT AREAS.
- ALL DISTURBED AREAS THAT ARE NOT PAVED ARE TO RECEIVE SLAB SODDING.
- EARTHWORKS SHALL BE PERFORMED IN SUCH A MANNER TO MINIMIZE PONDING WATER ON THE SUBGRADE. SITE SHALL MAINTAIN DRAINAGE AT ALL TIMES. MOISTURE CONTENT OF SOIL SHOULD BE MAINTAINED NEAR OPTIMUM DURING CONSTRUCTION.
- ALL ROCKS AND DEBRIS SHALL BE REMOVED FROM ALL DRAINS PRIOR TO FINAL INSPECTION.
- ROADSIDE HAZARDS SHALL BE COMPLETELY BARRICADED AROUND THEIR PERIMETER FOR THE SAFETY OF PEDESTRIANS AND VEHICLES.
- ONLY THE AMOUNT OF TRENCH THAT CAN BE BACK FILLED OR SURFACED IN (2) DAYS SHALL BE ALLOWED OPEN UNLESS APPROVED BY OWNERS REPRESENTATIVE.
- ANY EXISTING FOUNDATIONS OR FOOTINGS SHALL BE REMOVED FULL DEPTH, & BACKFILLED WITH APPROVED COMPACTED MATERIAL.
- THIS BID PACKAGE IS INTENDED TO INCLUDE ONLY DEMOLITION RELATED TASKS INCLUDING BUT NOT LIMITED TO EROSION CONTROL ITEMS, STRIPPING/SALVAGING TOP SOIL, DEMOLITION, SUBGRADE MAINTENANCE.

UTILITY NOTES

- THE CONTRACTOR SHALL PROTECT ALL EXISTING UTILITIES AND SERVICES FROM DAMAGE. UTILITIES SHALL REMAIN IN SERVICE AT ALL TIMES, AND ANY DISRUPTION OF SERVICE SHALL BE AT THE CONTRACTOR'S SOLE EXPENSE.
- CONTRACTOR SHALL VERIFY EXISTING PIPE SIZE, TYPE AND LOCATION TO INSURE PROPER CONNECTION.
- THE PLANS HAVE BEEN PREPARED TO SHOW THE APPROXIMATE LOCATION OF EXISTING KNOWN UTILITIES. THE CONTRACTOR SHALL CONTACT OKIE, EACH RESPECTIVE UTILITY COMPANY AND THE PROJECT OWNER TO DETERMINE THE EXACT LOCATION OF UNDERGROUND UTILITIES PRIOR TO EXCAVATION. ANY CHANGE IN ALIGNMENT OR GRADE CAUSED BY INTERFERING UTILITIES SHALL BE MADE BY THE CONTRACTOR AT NO COST TO THE OWNER AND THE ENGINEER NOTIFIED.
- DEPTHS OF ANY EXISTING UTILITIES SHOWN ON THE PLANS ARE APPROXIMATE. CONTRACTOR SHALL AT HIS OWN EXPENSE UNCOVER AND VERIFY THE LOCATION AND ELEVATION OF EXISTING UTILITIES IN ADVANCE OF THE CONSTRUCTION.

PROPOSED SITE LEGEND

- SD — SD — STORM WATER LINE
- W — W — WATER LINE
- UGE — UGE — UNDERGROUND ELECTRIC LINE
- GAS — GAS — GAS LINE
- SS — SS — SANITARY SEWER LINE
- — — — — CENTER LINE OF DRIVES
- xxx — — — — PROPOSED CONTOURS
- - - - - CONTOURS
- (WM) WATER METER
- ⬮ GATE VALVE

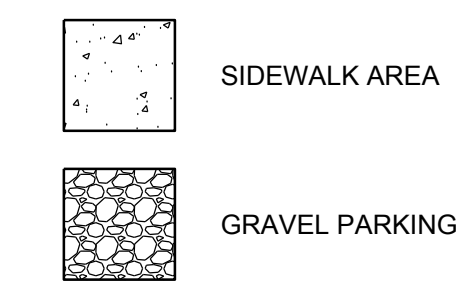

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE:

BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE:	JOB NUMBER:
11.01.19	18-01.01

SHEET NUMBER:


C002

GENERAL NOTES

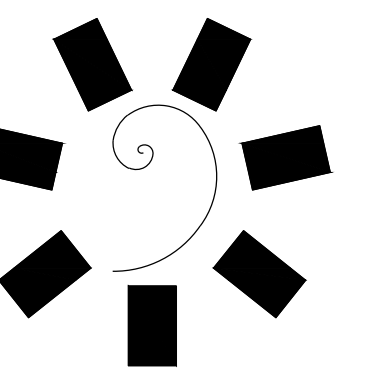

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-763-2460
www.childersarchitect.com

PROFESSIONAL SEAL

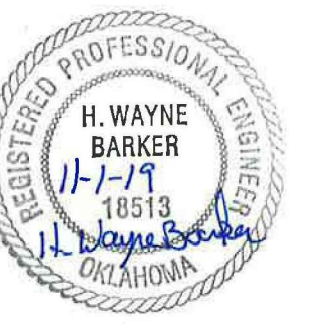

CONSULTANT LOGO



Banner & Associates
3802 UNIVERSITY BLVD
DURANT, OK 74701
580.931.9045
OK, CA, FL, IA
EXP. 05/30/2020

CLIENT



WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

KEY PLAN



PROJECT PHASE

BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

DATE: 11.01.19 JOB NUMBER: 18-01.01

SHEET NUMBER: CS100
EXISTING SITE PLAN

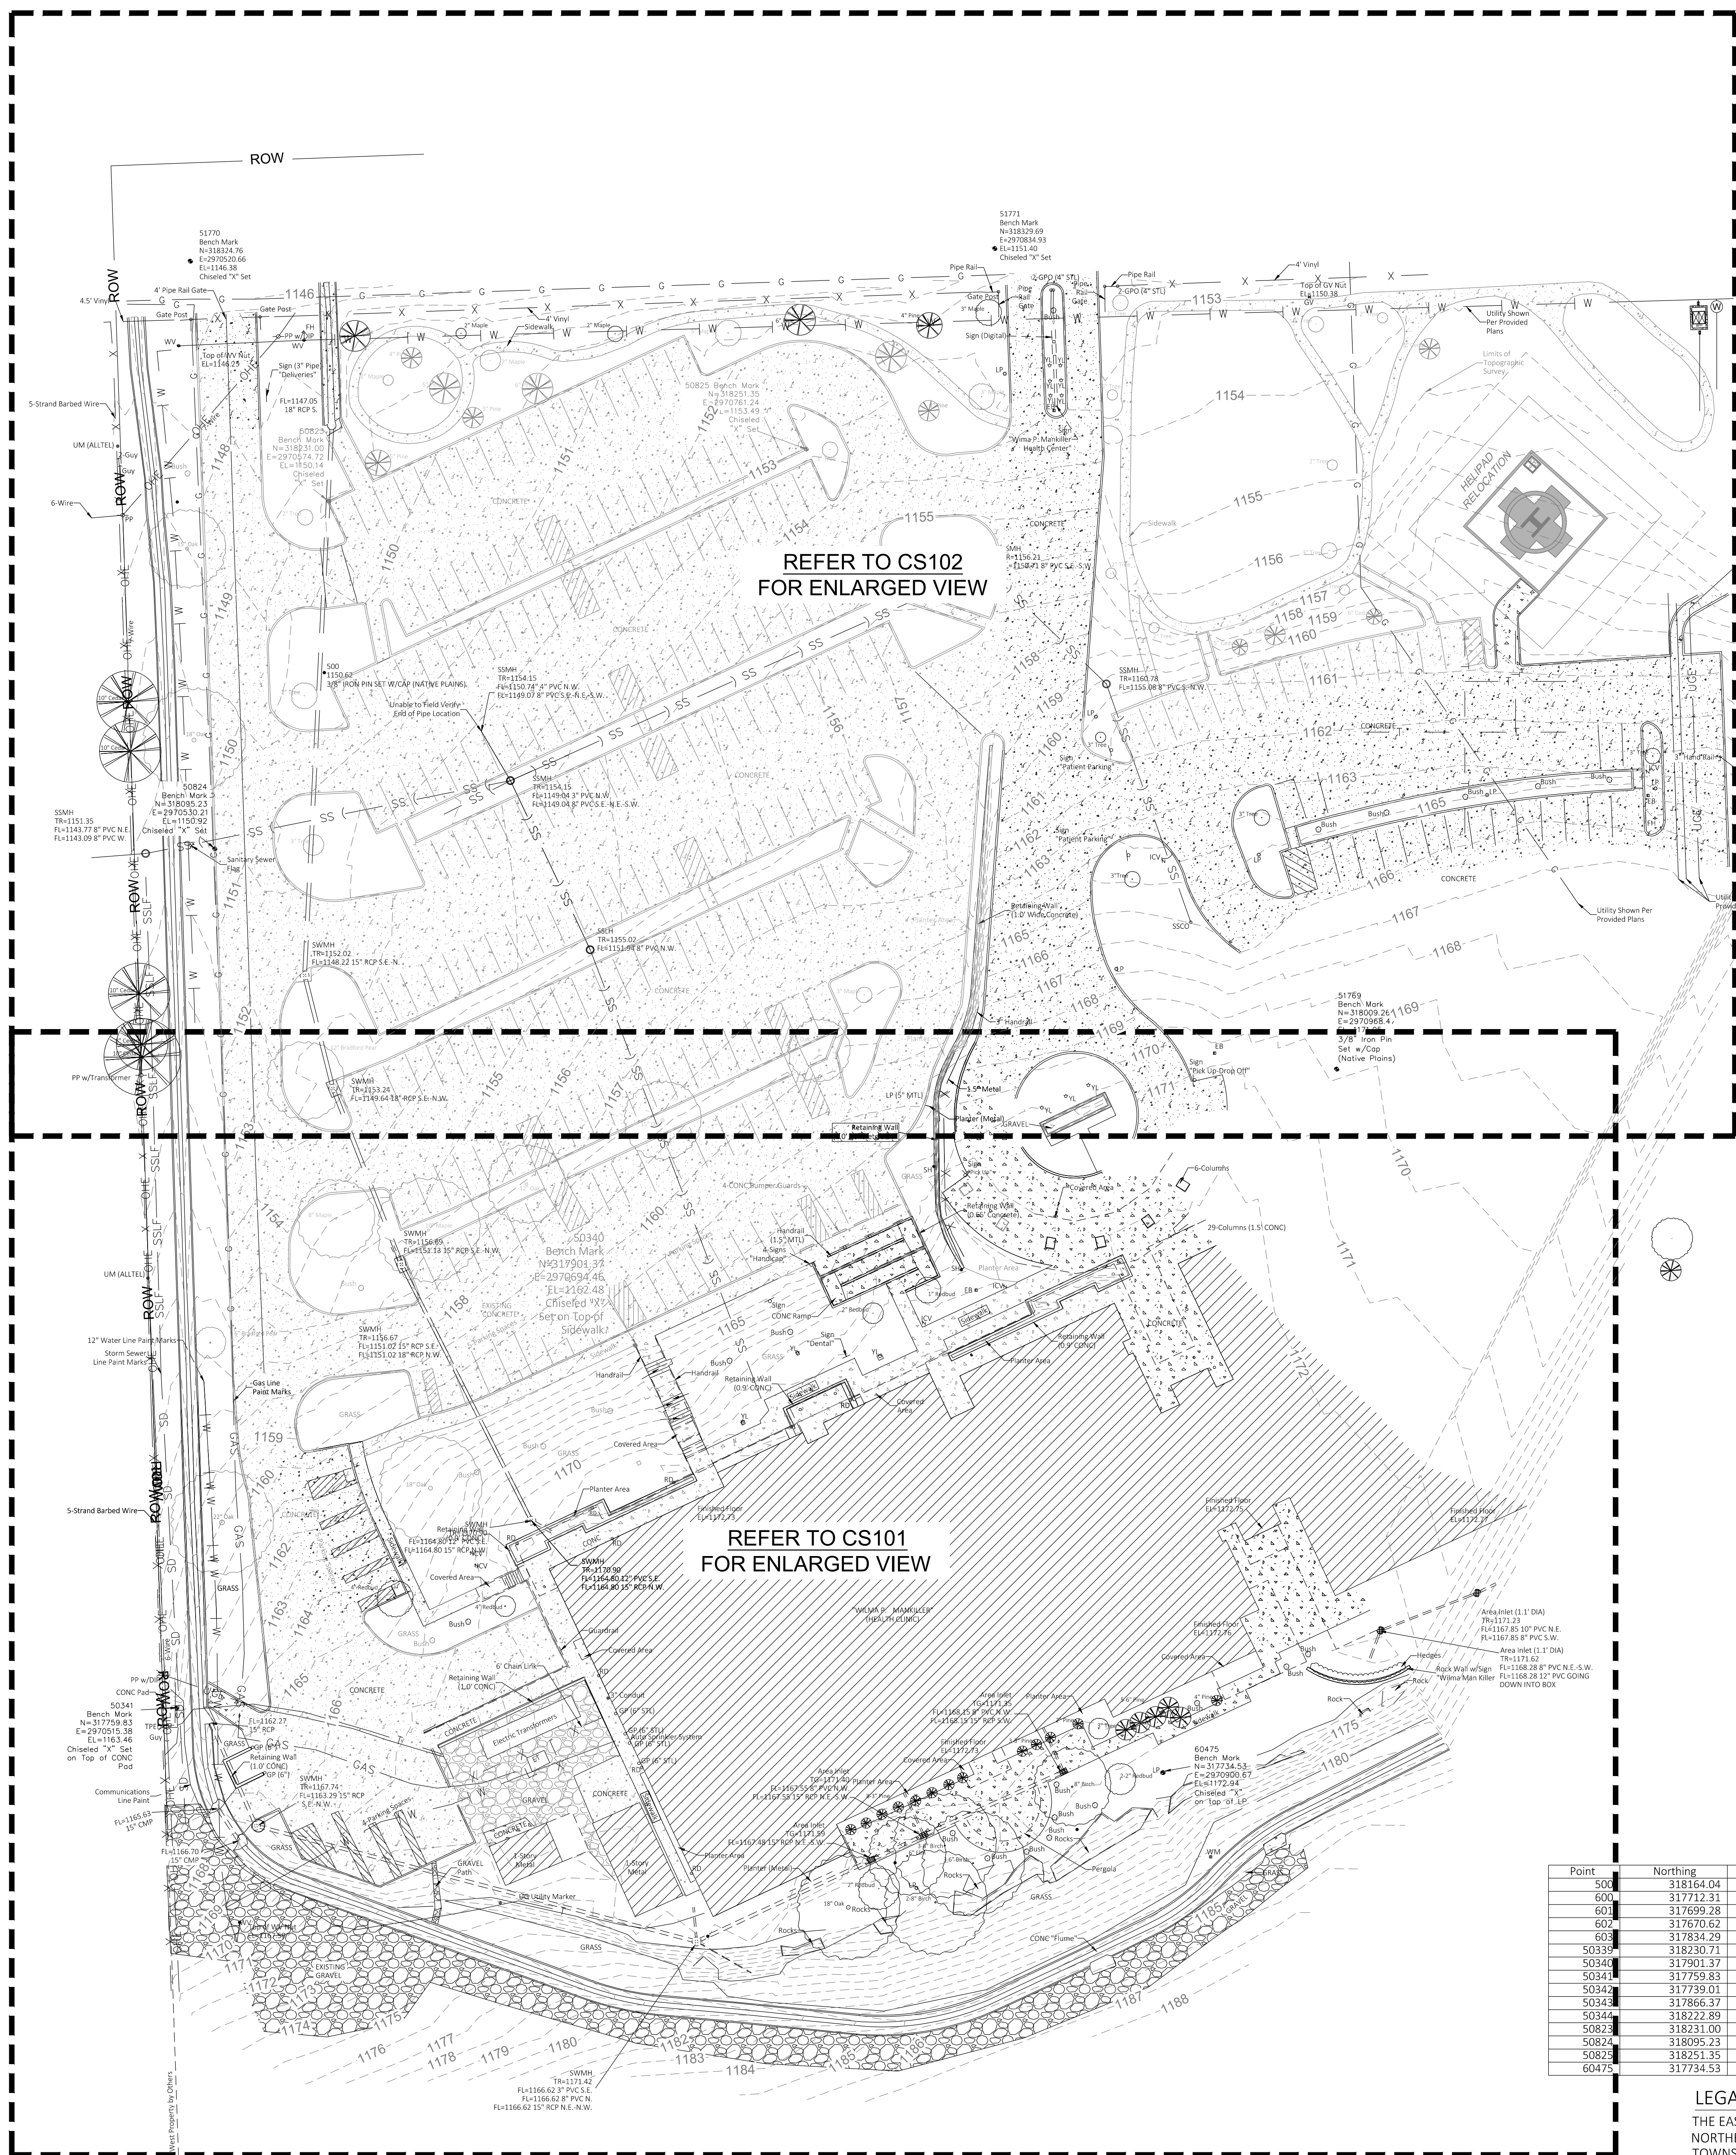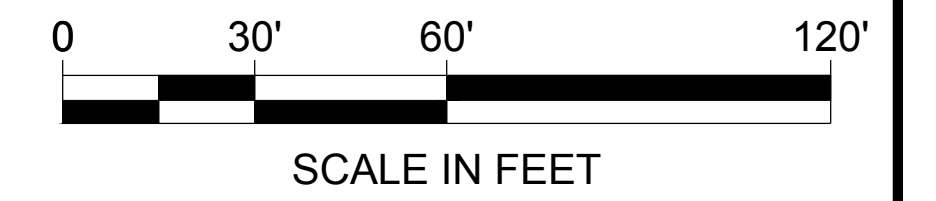

SYMBOL LEGEND


- ⊕ - Column (All Types)
- ⊖ - Electric Box
- ⊕ - Electric Meter
- ⊕ - Electric Transformer
- ⊕ - Fire Hydrant
- ⊕ - Gas Meter
- ⊕ - Guard Post
- ⊕ - Guy Anchor
- ⊕ - Handicap Parking
- ⊕ - Irrigation Control Valve
- ⊕ - Light Pole (All Types)
- ⊕ - Power Pole
- ⊕ - Roof Drain
- ⊕ - Sign (All Types)
- ⊕ - Sanitary Sewer Cleanout
- ⊕ - Sanitary Sewer Lamphole
- ⊕ - Sanitary Sewer Manhole
- ⊕ - Sprinkler Head
- ⊕ - Storm Sewer Area Inlet
- ⊕ - Storm Sewer Manhole
- ⊕ - Telephone Pedestal
- ⊕ - Underground Utility Marker
- ⊕ - Water Meter
- ⊕ - Water Valve
- ⊕ - Yard Light (All Types)
- ⊕ - Deciduous Tree (All Types)
- ⊕ - Coniferous Tree (All Types)
- ⊕ - Bush (All Types)
- X - Fence Line (All Types)
- GAS - Gas Line Paint Marks
- OHE - Overhead Electric
- SS - Sanitary Sewer Line
- SD - Storm Sewer Line
- T - Storm Sewer Line
- UGE - Communication Line Paint Marks
- W - Electric Line Paint Marks
- W - Water Line Paint Marks
- - Bench Mark
- - Survey Control Point Found
- - Survey Control Point Set
- - Sprinkler Head
- - Corrugated Metal Pipe
- - Polyurethane Pipe
- - Storm Sewer Manhole
- - Reinforced Concrete Pipe

SURVEY CONTROL



Point	Northing	Easting	Elevation	Description
500	318164.04	2970573.01	1150.62	3/8" Iron Pin Set w/Cap (NP Control)
600	317712.31	2970867.05	1172.51	60d Nail Set
601	317699.28	2970795.96	1171.75	60d Nail Set
602	317670.62	2970722.82	1171.56	60d Nail Set
603	317634.29	2970648.60	1170.44	60d Nail Set
50339	318230.71	2970515.56	1148.96	3/8" Iron Pin Set w/Cap (NP Control)
50340	317901.37	2970694.46	1162.48	Bench Mark
50341	317759.83	2970515.38	1163.46	Bench Mark
50342	317739.01	2970792.89	1180.63	3/8" Iron Pin Set w/Cap (NP Control)
50343	317866.37	2971153.74	1172.60	3/8" Iron Pin Set w/Cap (NP Control)
50344	318222.89	2971150.00	1157.02	3/8" Iron Pin Set w/Cap (NP Control)
50823	318231.00	2970574.72	1150.14	Bench Mark
50824	318095.23	2970530.21	1150.92	Bench Mark
50825	318251.35	2970761.24	1153.49	Bench Mark
60475	317734.53	2970900.67	1172.94	Bench Mark

POINT	NORTHING	EASTING	ELEVATION	DESCRIPTION
500	318164.04	2970573.01	1150.62	3/8" Iron Pin Set w/Cap (Native Plans)
50339	318230.71	2970515.56	1148.96	Bench Mark (Native Plans)
51769	318095.23	2970530.21	1150.92	Bench Mark (Native Plans)
51771	318251.35	2970761.24	1153.49	Bench Mark (Native Plans)
51773	318164.04	2970573.01	1150.62	Bench Mark (Native Plans)



LEGAL DESCRIPTION:
THE EAST HALF OF THE NORTHWEST QUARTER OF THE
NORTHEAST QUARTER (E/2 NW/4 NE/4 OF SECTION 35,
TOWNSHIP 16 NORTH, RANGE 25 EAST OF THE INDIAN BASE
AND MERIDIAN, ADAIR COUNTY, STATE OF OKLAHOMA.

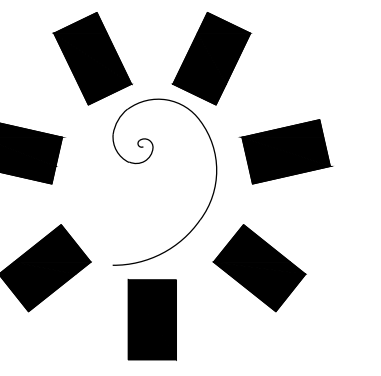

James R. Childers
Architect, Inc.
45 South 4th Street
Ft. Smith, AR 72601
479-763-2460
www.childersarchitect.com

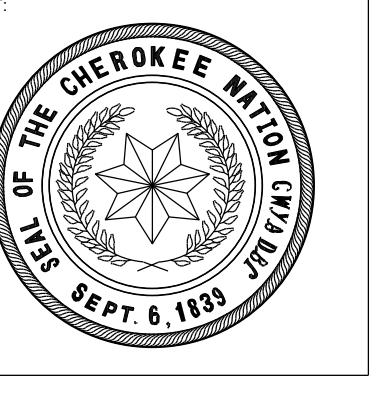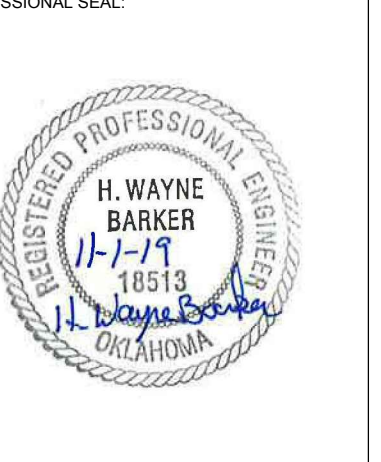


**WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA**

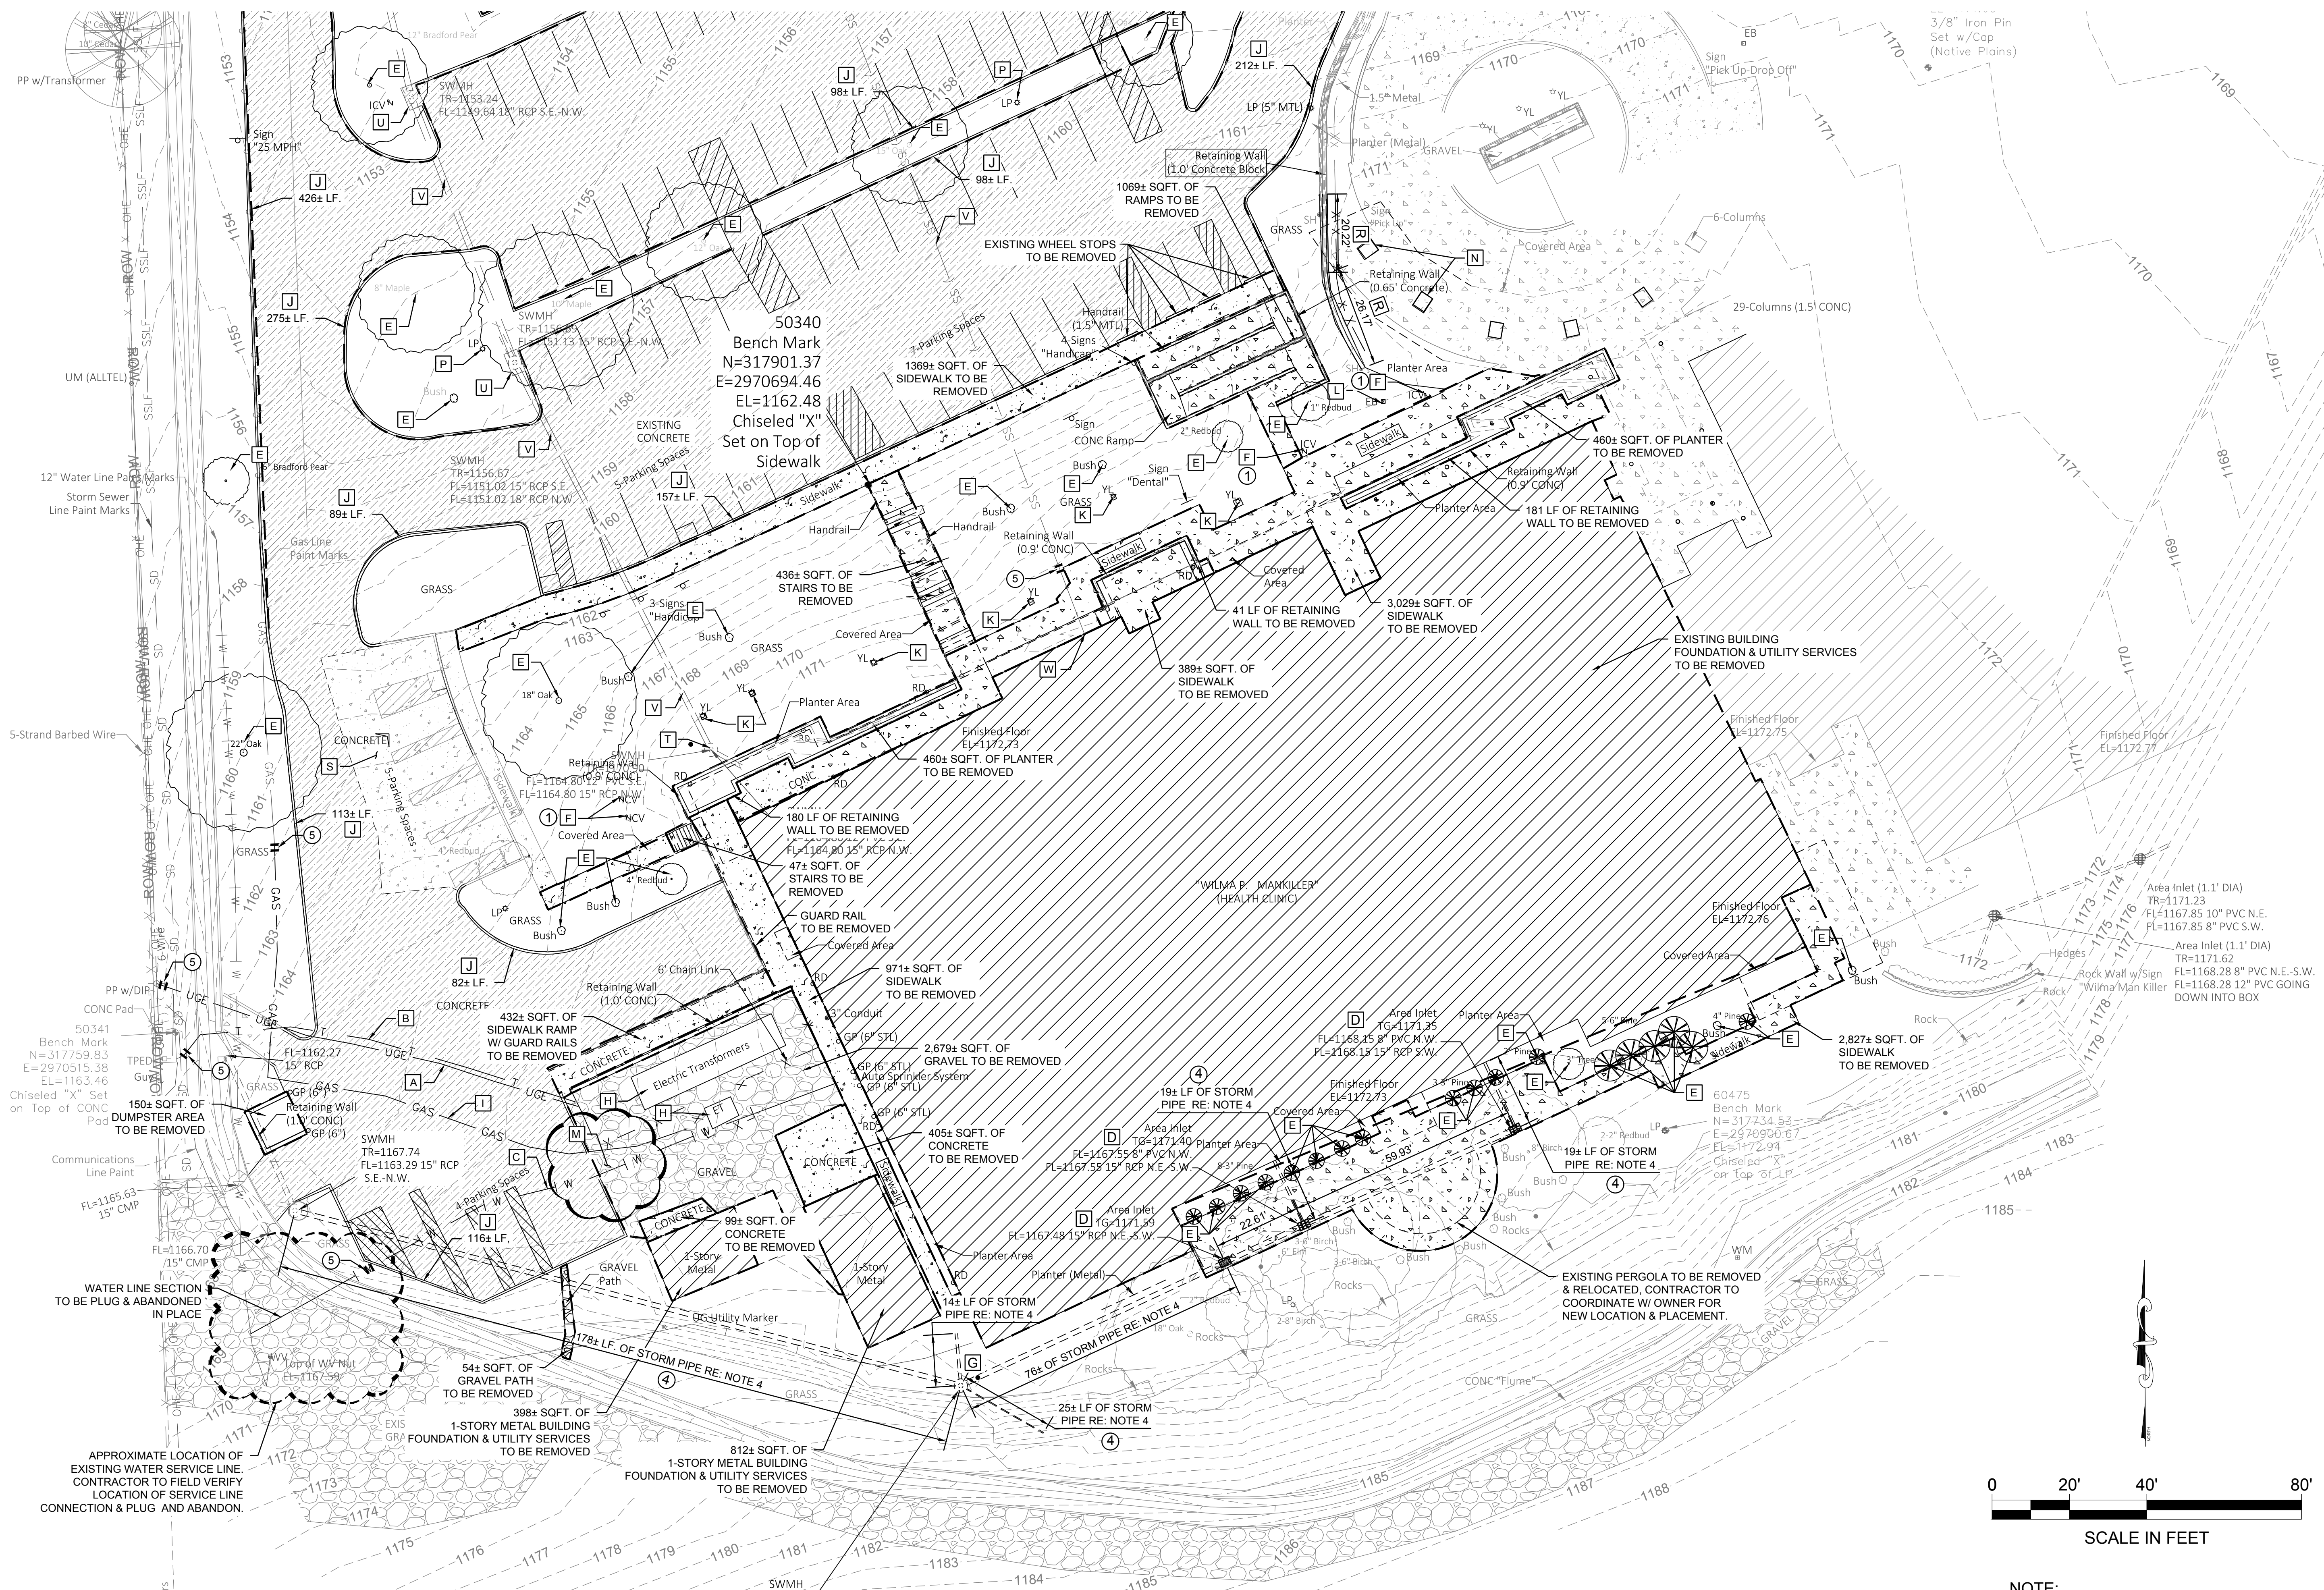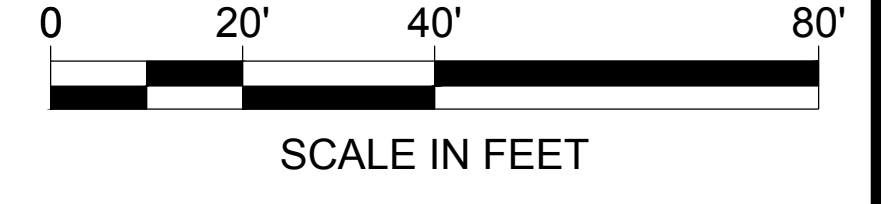

LEGEND

- APROX. LIMITS OF DEMOLITION.
- DEMOLITION LEGEND:**
- A 114± LF. OF UNDERGROUND ELECTRIC LINE TO BE REMOVED AND RELOCATED FROM UTILITY CUT OFF POINT TO EDGE OF BUILDING.
 - B 106± LF. OF TELEPHONE LINE TO BE REMOVED AND RELOCATED FROM UTILITY CUT OFF POINT TO EDGE OF BUILDING.
 - C 131± LF. OF WATER LINE TO BE REMOVED AND RELOCATED FROM UTILITY CUT OFF POINT TO EDGE OF BUILDING.
 - D EXISTING INLET TO REMAIN. RE: NOTE 4
 - E EXISTING SITE VEGETATION TO BE REMOVED. RE: NOTE 4
 - F EXISTING IRRIGATION VALVE TO BE REMOVED. RE: NOTE 4
 - G EXISTING STORM MANHOLE TO BE REMAIN. RE: NOTE 4
 - H EXISTING HVAC, GENERATOR & ELECTRICAL TRANSFORMER TO BE REMOVED. REFER TO MEP.
 - I 173± OF GAS LINE TO BE REMOVED AND RELOCATED FROM UTILITY CUT OFF POINT TO OUT SIDE OF BUILDING.
 - J EXISTING CURB TO BE REMOVED.
 - K EXISTING YARD LIGHT TO BE REMOVED.
 - L CONTRACTOR TO VERIFY IF EXISTING ELECTRIC BOX NEEDS TO BE REMOVED OR RELOCATED.
 - M APPROXIMATE LOCATION OF EXISTING FIRE HYDRANT. TO REMOVED ONLY AFTER INSTALLATION OF NEW FIRE HYDRANT.
 - N EXISTING COLUMN TO BE REMOVED, WITH CORRESPONDING ROOF SECTION.
 - O EXISTING FLUME TO BE REMOVED.
 - P EXISTING LIGHT POLE TO BE REMOVED.
 - Q EXISTING SITE SIGNAGE TO BE REMOVED/RELOCATE. RE: OWNER/ARCH.
 - R EXISTING WALL SECTION TO BE REMOVED.
 - S EXISTING PAVEMENT TO REMAIN.
 - T EXISTING SEWER/STORM MANHOLE TO BE REMAIN AND ADJUSTED TO NEW GRADE IN FUTURE BID PACKAGE.
 - U EXISTING STORM INLET TOP TO BE REMAIN AND ADJUSTED TO NEW GRADE IN FUTURE BID PACKAGE.
 - V EXISTING UNDERGROUND UTILITY TO REMAIN IN PLACE DURING CONSTRUCTION. CONTRACTOR TO ENSURE NOT DISTURB OR DAMAGE DURING CONSTRUCTION.
 - W 18± LF. OF SEWER LINE TO BE REMOVED AND REPLACED FROM UTILITY CUT OFF POINT TO EDGE OF BUILDING.

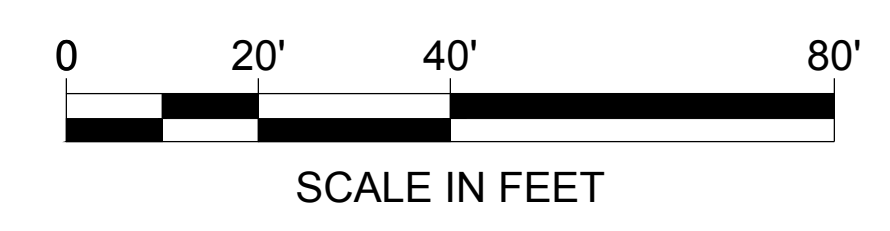

NOTE:

- 1 IRRIGATION LINES & EQUIPMENT MAY BE PRESENT THROUGHOUT THE LIMITS OF CONSTRUCTION. CONTRACTOR SHALL VERIFY LIMIT OF IRRIGATION SYSTEM AND COORDINATE WITH OWNER, CUT/PLUG EXISTING LINES TO CLEAR CONSTRUCTION AND MAINTAIN OPERATION OF OTHER ZONES.
- 2 UTILITY SERVICE LINES SUCH AS WATER, AND NATURAL GAS SHALL BE ISOLATED AT UTILITY MAIN CONNECTION, TO ISOLATE CONSTRUCTION SITE WHILE MAINTAINING SERVICE TO OTHERS.
- 3 QUANTITIES ARE SHOWN FOR INFORMATION ONLY. CONTRACTOR TO FIELD VERIFY QUANTITIES.
- 4 EXISTING STORM SYSTEM TO REMAIN IN PLACE AND WILL BE REMOVED IN FUTURE BID PACKAGE. AFTER NEW STORM SYSTEM IS PLACED.
- 5 UTILITY CUT OFF POINT SYMBOL. THE BEGINNING POINT OF ANY UTILITY (GAS, WATER, SEWER, & ELECTRIC) LINE TO BE REMOVED.

95,152± SQFT. OF EXISTING CONCRETE PAVING TO BE REMOVED.

KEY PLAN

PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS	DESCRIPTION

DATE: 11.01.19 JOB NUMBER: 18-01.01




SHEET NUMBER:

CS101

DEMOLITION PLAN



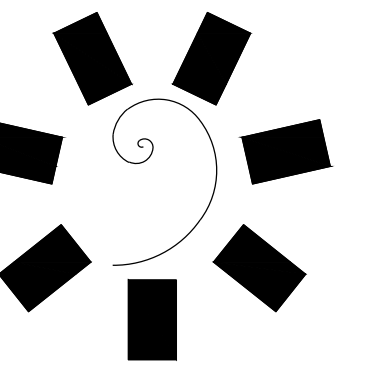


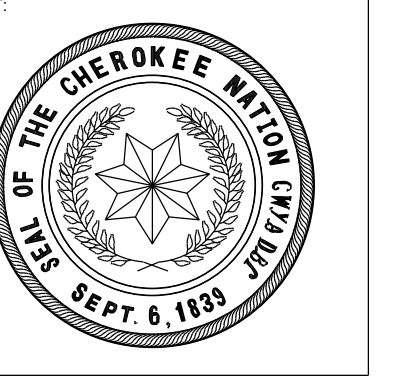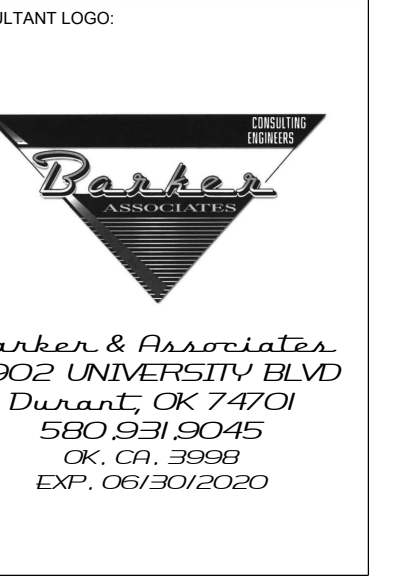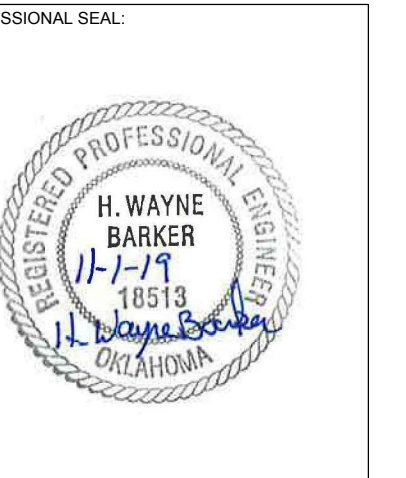

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-763-2460
www.childersarchitect.com





**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

LEGEND

-  SILT FENCE
(RE: CE500 FOR DETAIL)
-  SILT DIKE
(RE: CE500 FOR DETAIL)
-  STABILIZED CONSTRUCTION
ENTRANCE
(RE: CE500 FOR DETAIL)
-  INLET PROTECTION
RE: CE500 FOR DETAIL
-  CURB INLET PROTECTION
RE: CE500 FOR DETAILS

SITE DESCRIPTION	
PROJECT:	WILMAP. MANKILLER HEALTH CENTER CHOCTAW NATION OKLAHOMA
LEGAL DESCRIPTION	E/2 NW/4 NE/4 OF SECTION 35, T16N, R25E OF THE INDIAN BASE AND MERIDIAN, ADAIR COUNTY, STATE OF OKLAHOMA.
LATITUDE	35°49'33.0"N
LONGITUDE	94°37'06.5"W
DISTURBED AREA	5.78 Acres
RUNOFF CO. EFF.	0.65
RECEIVING WATERS	CITY STORM WATER SYSTEM

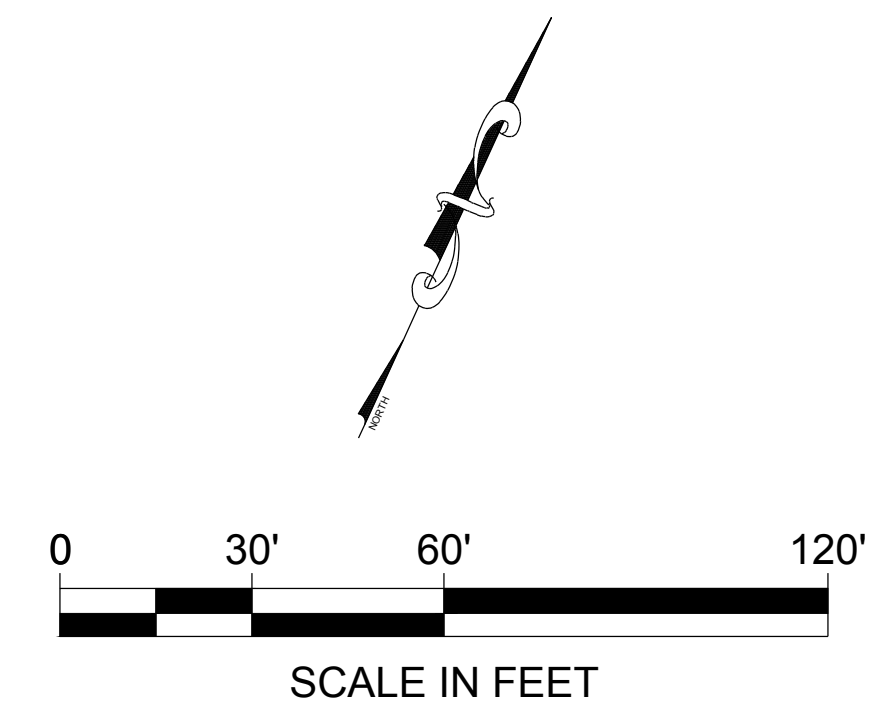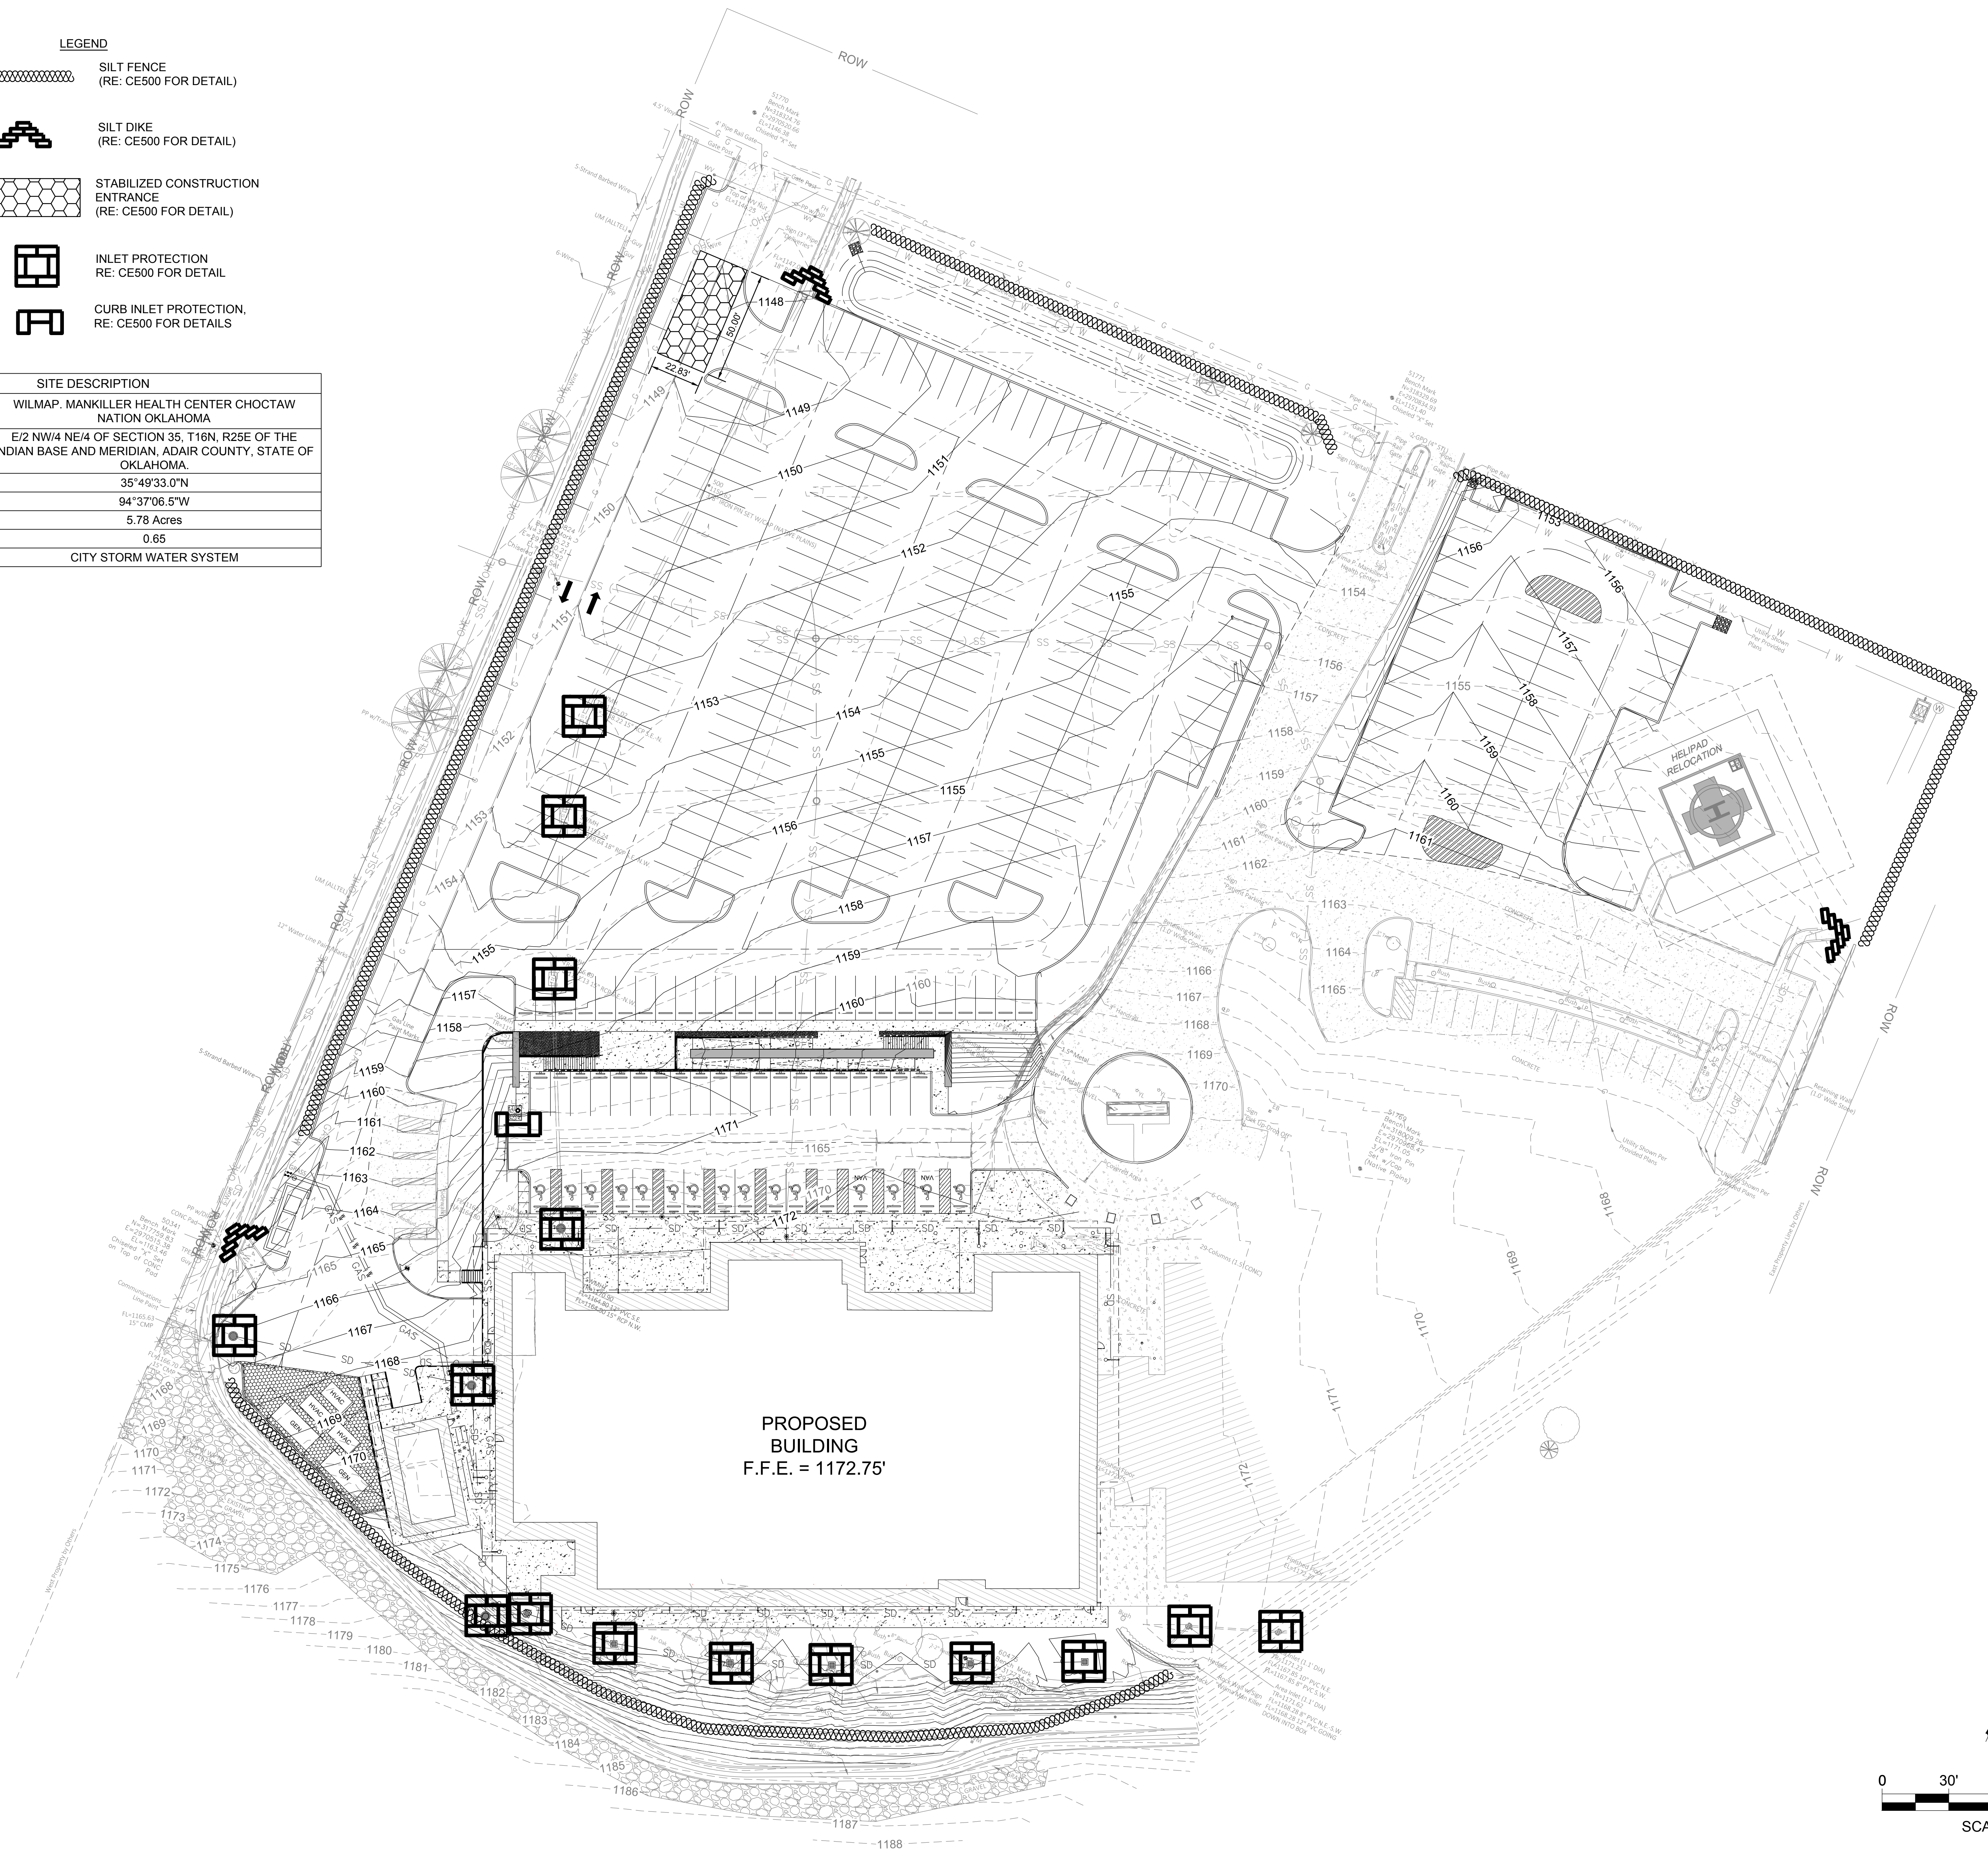


KEY PLAN

PROJECT PHASE:
BID PACKAGE 01




#	DATE	REVISIONS DESCRIPTION

DATE: 11.01.19 JOB NUMBER: 18-01.01

SHEET NUMBER:
CE100
EROSION CONTROL SITE PLAN

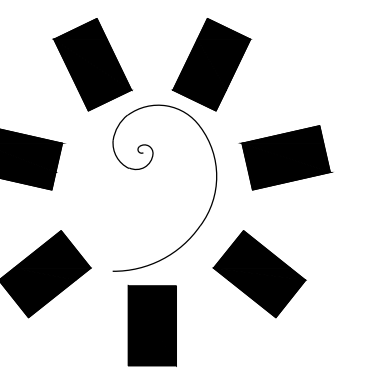

James R. Childers
Architect, Inc.
45 South 4th Street
Ft. Smith, AR 72301
479-763-2460
www.childersarchitect.com

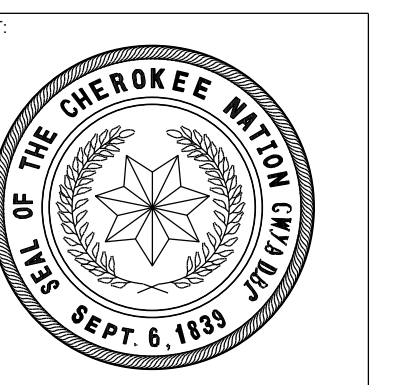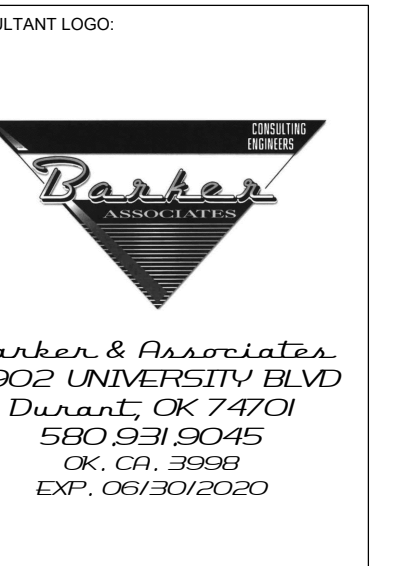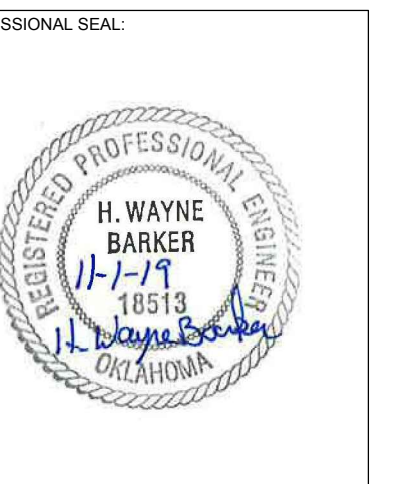


GENERAL EROSION NOTES

1. THE STORM WATER POLLUTION PREVENTION PLAN IS COMPRISED OF THIS DRAWING (SITE MAP), THE STANDARD DETAILS, PLUS THE PERMIT AND ALL SUBSEQUENT REPORTS AND RELATED DOCUMENTS.
2. ALL CONTRACTORS AND SUBCONTRACTORS INVOLVED WITH STORM POLLUTION PREVENTION SHALL OBTAIN A COPY OF THE STORM WATER POLLUTION PREVENTION PLAN AND THE STATE NATIONAL POLLUTION DISCHARGE ELIMINATION SYSTEM GENERAL PERMIT (NPDES PERMIT) AND BECOME FAMILIAR WITH THEIR CONTENTS.
3. CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES AS REQUIRED BY THE SWPPP. ADDITIONAL BEST MANAGEMENT PRACTICES SHALL BE IMPLEMENTED AS DICTATED BY CONDITIONS AT NO ADDITIONAL COST OF OWNER THROUGHOUT ALL PHASES OF CONSTRUCTION.
4. BEST MANAGE PRACTICES (BMP'S) AND CONTROLS SHALL CONFORM TO FEDERAL, STATE, OR LOCAL REQUIREMENTS OR MANUAL OF PRACTICE, AS APPLICABLE. CONTRACTOR SHALL IMPLEMENT ADDITIONAL CONTROLS AS DIRECTED BY PERMITTING AGENCY OR OWNER.
5. SITE MAP MUST CLEARLY DELINEATE ALL STATE WATERS, PERMITS FOR ANY CONSTRUCTION ACTIVITY IMPACTING STATE WATER OR REGULATED WETLANDS MUST BE MAINTAINED ON SITE AT ALL TIMES.
6. CONTRACTOR SHALL MINIMIZE CLEARING TO THE MAXIMUM EXTENT PRACTICAL OR AS REQUIRED BY THE GENERAL PERMIT.
7. GENERAL CONTRACTOR SHALL DENOTE ON PLAN THE TEMPORARY PARKING AND STORAGE AREA WHICH SHALL ALSO BE USED AS THE EQUIPMENT MAINTENANCE AND CLEANING AREA, EMPLOYEE PARKING AREA, AND AREA FOR LOCATING PORTABLE FACILITIES, OFFICE TRAILERS, AND TOILET FACILITIES. CONTRACTOR SHALL CONSTRUCT TEMPORARY BERM ON DOWN STREAM SIDES.
8. ALL WASH WATER (CONCRETE TRUCKS, VEHICLE CLEANING, EQUIPMENT CLEANING, ETC.) SHALL BE DETAINED AND PROPERLY TREATED OR DISPOSED.
9. SUFFICIENT OIL AND GREASE ABSORBING MATERIALS AND FLOTATION BOOMS SHALL BE MAINTAINED ON SITE OR READILY AVAILABLE TO CONTAIN AND CLEAN-UP FUEL OR CHEMICAL SPILLS AND LEAKS.
10. DUST ON THE SITE SHALL BE CONTROLLED. THE USE OF MOTOR OILS AND OTHER PETROLEUM BASED OR TOXIC LIQUIDS FOR DUST SUPPRESSION OPERATIONS IS PROHIBITED.
11. RUBBISH, TRASH, GARBAGE, LITTER, OR OTHER SUCH MATERIALS SHALL BE DEPOSITED INTO SEALED CONTAINERS, MATERIALS SHALL BE PREVENTED FROM LEAVING THE PREMISES THROUGH THE ACTION OF WIND OR STORM WATER DISCHARGE INTO DRAINAGE DITCHES OR WATERS OF THE STATE.
12. ALL STORM WATER POLLUTION PREVENTION MEASURES PRESENTED ON THIS SITE MAP, AND IN THE STORM WATER POLLUTION PREVENTION PLAN, SHALL BE INITIATED AS SOON AS PRACTICABLE.
13. ALL DENUDED AREAS THAT WILL BE INACTIVE FOR 14 DAYS OR MORE, MUST BE STABILIZED TEMPORARY WITH THE USE OF FAST-GERMINATING ANNUAL GRASS/GRAIN VARIETIES, STRAW/HAY MULCH, WOOD CELLULOSE FIBERS, TACKIFIERS NETTING OR BLANKETS AS SHOWN ON SITE MAP.
14. DISTURBED PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITY HAS PERMANENTLY STOPPED SHALL BE PERMANENTLY STABILIZED AS SHOWN ON THE PLANS. THESE AREAS SHALL BE SEEDED, SODDED, AND/OR VEGETATED NO LATER THAN 14 DAYS AFTER THE LAST CONSTRUCTION ACTIVITY OCCURRING IN THESE AREAS. REFER TO THE GRADING PLAN AND/OR LANDSCAPE PLAN.
15. IF THE ACTION OF VEHICLES TRAVELING OVER THE GRAVEL CONSTRUCTION ENTRANCES IS NOT SUFFICIENT TO REMOVE THE MAJORITY OF DIRT OR MUD, THEN THE TIRES MUST BE WASHED BEFORE THE VEHICLES ENTER A PUBLIC ROAD. IF WASHING IS USED, PROVISION MUST BE MADE TO INTERCEPT THE WASH WATER AND TRAP THE SEDIMENT BEFORE IT IS CARRIED OFF THE SITE ONLY USE INGRESS/EGRESS LOCATIONS AS PROVIDED.
16. ALL MATERIALS SPILLED, DROPPED, WASHED, OR TRACKED FROM VEHICLES ONTO ROADWAY OR INTO STORM DRAINS MUST BE REMOVED IMMEDIATELY.
17. CONTRACTORS OR SUBCONTRACTORS WILL BE RESPONSIBLE FOR REMOVING SEDIMENT IN DETENTION POND AND ANY SEDIMENT THAT MAY HAVE COLLECTED IN THE STORM SEWER DRAINAGE SYSTEMS IN CONJUNCTION WITH THE STABILIZATION OF THE SITE.
18. ON-SITE AND OFF-SITE SOIL STOCKPILE AND BORROW AREAS SHALL BE PROTECTED FROM EROSION AND SEDIMENTATION THROUGH IMPLEMENTATION OF BEST MANAGEMENT PRACTICES. STOCKPILE AND BORROW AREA LOCATIONS SHALL BE NOTED ON THE SITE MAP AND PERMITTED IN ACCORDANCE WITH GENERAL PERMIT REQUIREMENTS.
19. SLOPES SHALL BE LEFT IN A ROUGHENED CONDITION DURING THE GRADING PHASE TO REDUCE RUNOFF VELOCITIES AND EROSION.
20. DUE TO THE GRADE CHANGES DURING THE DEVELOPMENT OF THE PROJECT, THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADJUSTING THE EROSION AND SEDIMENT CONTROL MEASURES (SILT FENCES, ETC.) TO PREVENT EROSION AND POLLUTANT DISCHARGE.
21. GENERAL CONTRACTOR IS TO DESIGNATE/IDENTIFY AREAS ON THE SITE MAPS, INSIDE OF THE LIMITS OF DISTURBANCE, FOR WASTE DISPOSAL AND DELIVERY AND MATERIAL STORAGE.
22. CONTRACTOR SHALL BE RESPONSIBLE FOR PREPARING & SUBMITTING NOTICE OF INTENT (N.O.I.) & NOTICE OF TERMINATION (N.O.T.).
23. CONTRACTOR TO LIMIT DISTURBANCE OF SITE IN STRICT ACCORDANCE WITH EROSION CONTROL SEQUENCING SHOWN ON THIS PLAN. NO UNNECESSARY OR IMPROPERLY SEQUENCED CLEARING AND/OR GRADING SHALL BE PERMITTED.


BMP MAINTENANCE EROSION NOTES

- ALL MEASURES STATED ON THIS SITE MAP, AND IN THE STORM WATER POLLUTION PREVENTION PLAN, SHALL BE MAINTAINED IN FULLY FUNCTIONAL CONDITION UNTIL NO LONGER REQUIRED FOR A COMPLETED PHASE OF WORK OR FINAL STABILIZATION OF THE SITE. ALL EROSION AND SEDIMENTATION CONTROL MEASURES SHALL BE CHECKED BY A QUALIFIED PERSON IN ACCORDANCE WITH THE CONTRACT DOCUMENTS OR THE APPLICABLE PERMIT, WHICHEVER IS MORE STRINGENT, AND REPAIRED IN ACCORDANCE WITH THE FOLLOWING:
1. INLET PROTECTION DEVICES AND BARRIERS SHALL BE REPAIRED OR REPLACED IF THEY SHOW SIGNS OF UNDERMINING OR DETERIORATION.
 2. ALL SEEDED AREAS SHALL BE CHECKED REGULARLY TO SEE THAT A GOOD STAND IS MAINTAINED. AREAS SHOULD BE FERTILIZED, WATERED, AND RESEEDED AS NEEDED.
 3. SILT FENCES SHALL BE REPAIRED TO THEIR ORIGINAL CONDITIONS IF DAMAGED. SEDIMENT SHALL BE REMOVED FROM THE SILT FENCES WHEN IT REACHES ONE-HALF THE HEIGHT OF THE SILT FENCE.
 4. THE CONSTRUCTION EXITS SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOW OF MUD ONTO PUBLIC RIGHT-A-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING OF THE CONSTRUCTION EXITS AS CONDITIONS DEMAND.
 5. THE TEMPORARY PARKING AND STORAGE AREA SHALL BE KEPT IN GOOD CONDITION (SUITABLE FOR PARKING AND STORAGE). THIS MAY REQUIRE PERIODIC TOP DRESSING OF THE TEMPORARY PARKING AREA AS CONDITIONS DEMAND.
 6. OUTLET STRUCTURES IN THE SEDIMENTATION BASINS SHALL BE MAINTAINED IN OPERATIONAL CONDITIONS AT ALL TIMES. SEDIMENT SHALL BE REMOVED FROM SEDIMENT BASINS OR TRAPS WHEN THE DESIGN CAPACITY HAS BEEN REDUCED BY 50%.
 7. PRIOR TO LEAVING THE SITE, ALL VEHICLES SHALL BE CLEANED OF DEBRIS. ANY DEBRIS AND/OR SEDIMENT REACHING THE PUBLIC STREET SHALL BE CLEANED IMMEDIATELY BY A METHOD OTHER THAN FLUSHING.

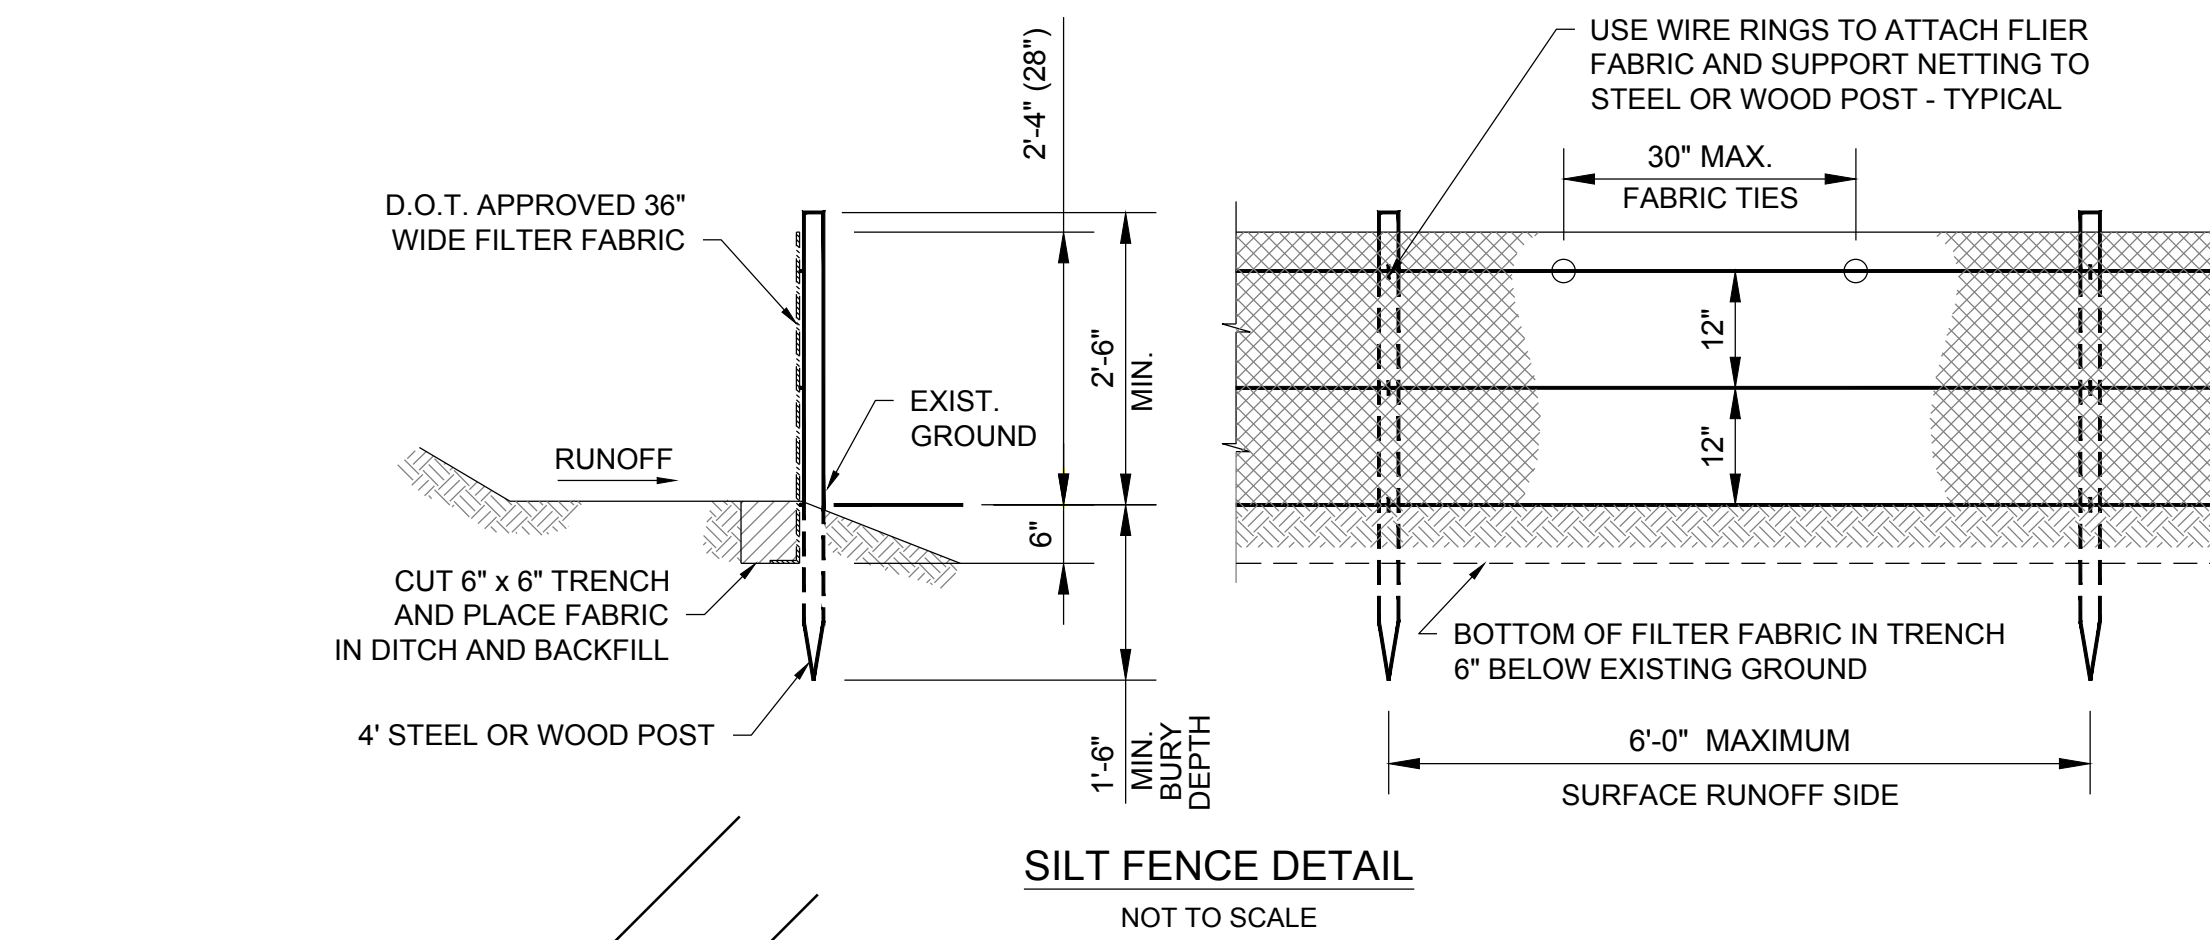


NOTES:

1. FLUSH SURFACE STONE TOWARD SEDIMENT TRAP WITH HIGH VOLUME WATER FLOW AS NEEDED TO MAINTAIN CLEAN SURFACE STONE.
2. SEE EROSION CONTROL FOR LOCATION.
3. CONTRACTOR TO LOCATED TEMPORARY CONSTRUCTION FENCING, JERSEY BARRIERS, OR BOTH ALONG THE SIDES OF THE CONSTRUCTION EXITS TO PREVENT CONSTRUCTION TRAFFIC FROM SHORT CIRCUITING/BYPASSING THE EXITS.
4. GEOTEXTILE TO BE AASHTO M 288-97 CLASS-2


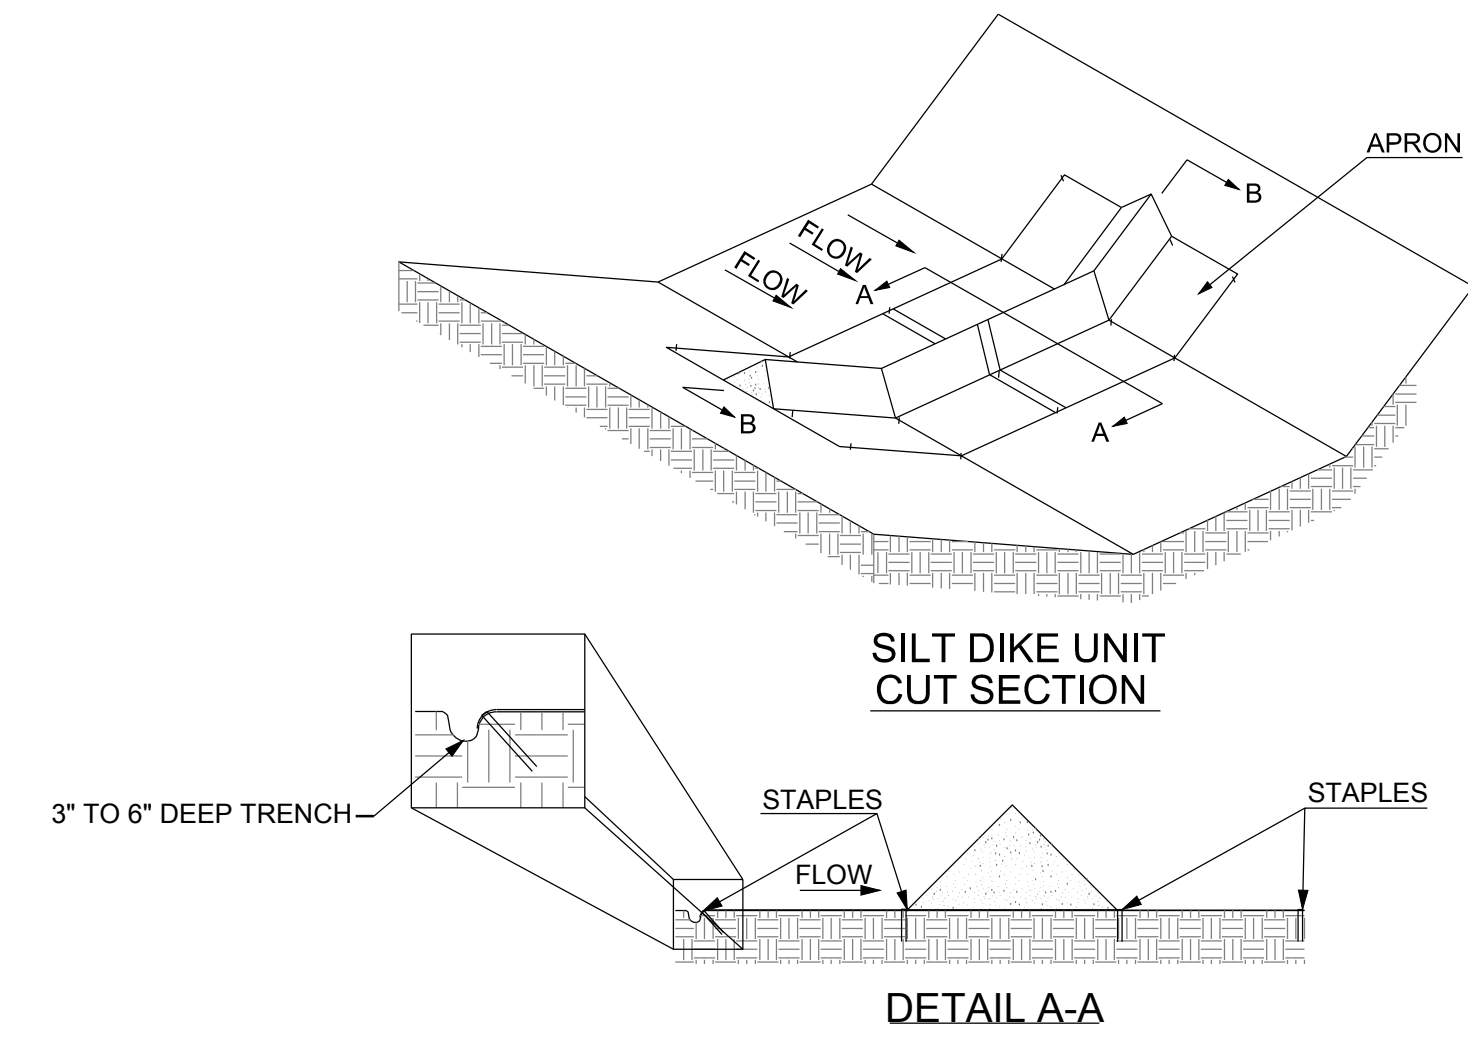


STAPLES SHALL BE PLACED WHERE THE UNITS OVERLAP AND IN THE CENTER OF THE T UNIT AS SHOWN ON THE DIAGRAMS

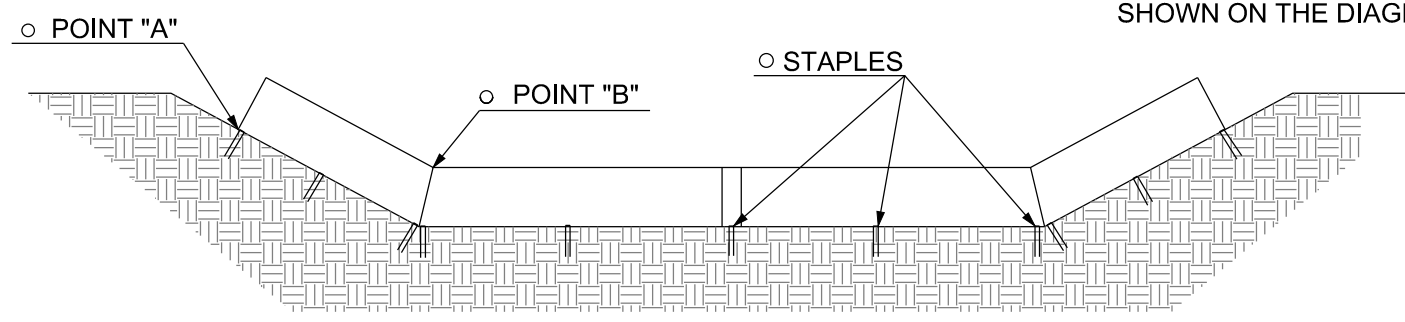




POINT "A" MUST BE HIGHER THAN POINT "B" TO ENSURE THAT WATER FLOWS OVER THE DIKE AND NOT AROUND THE ENDS.

TRIANGULAR SILT DIKE INSTALLATION FOR ROADWAY DITCH OR DRAINAGE DITCH
NOT TO SCALE

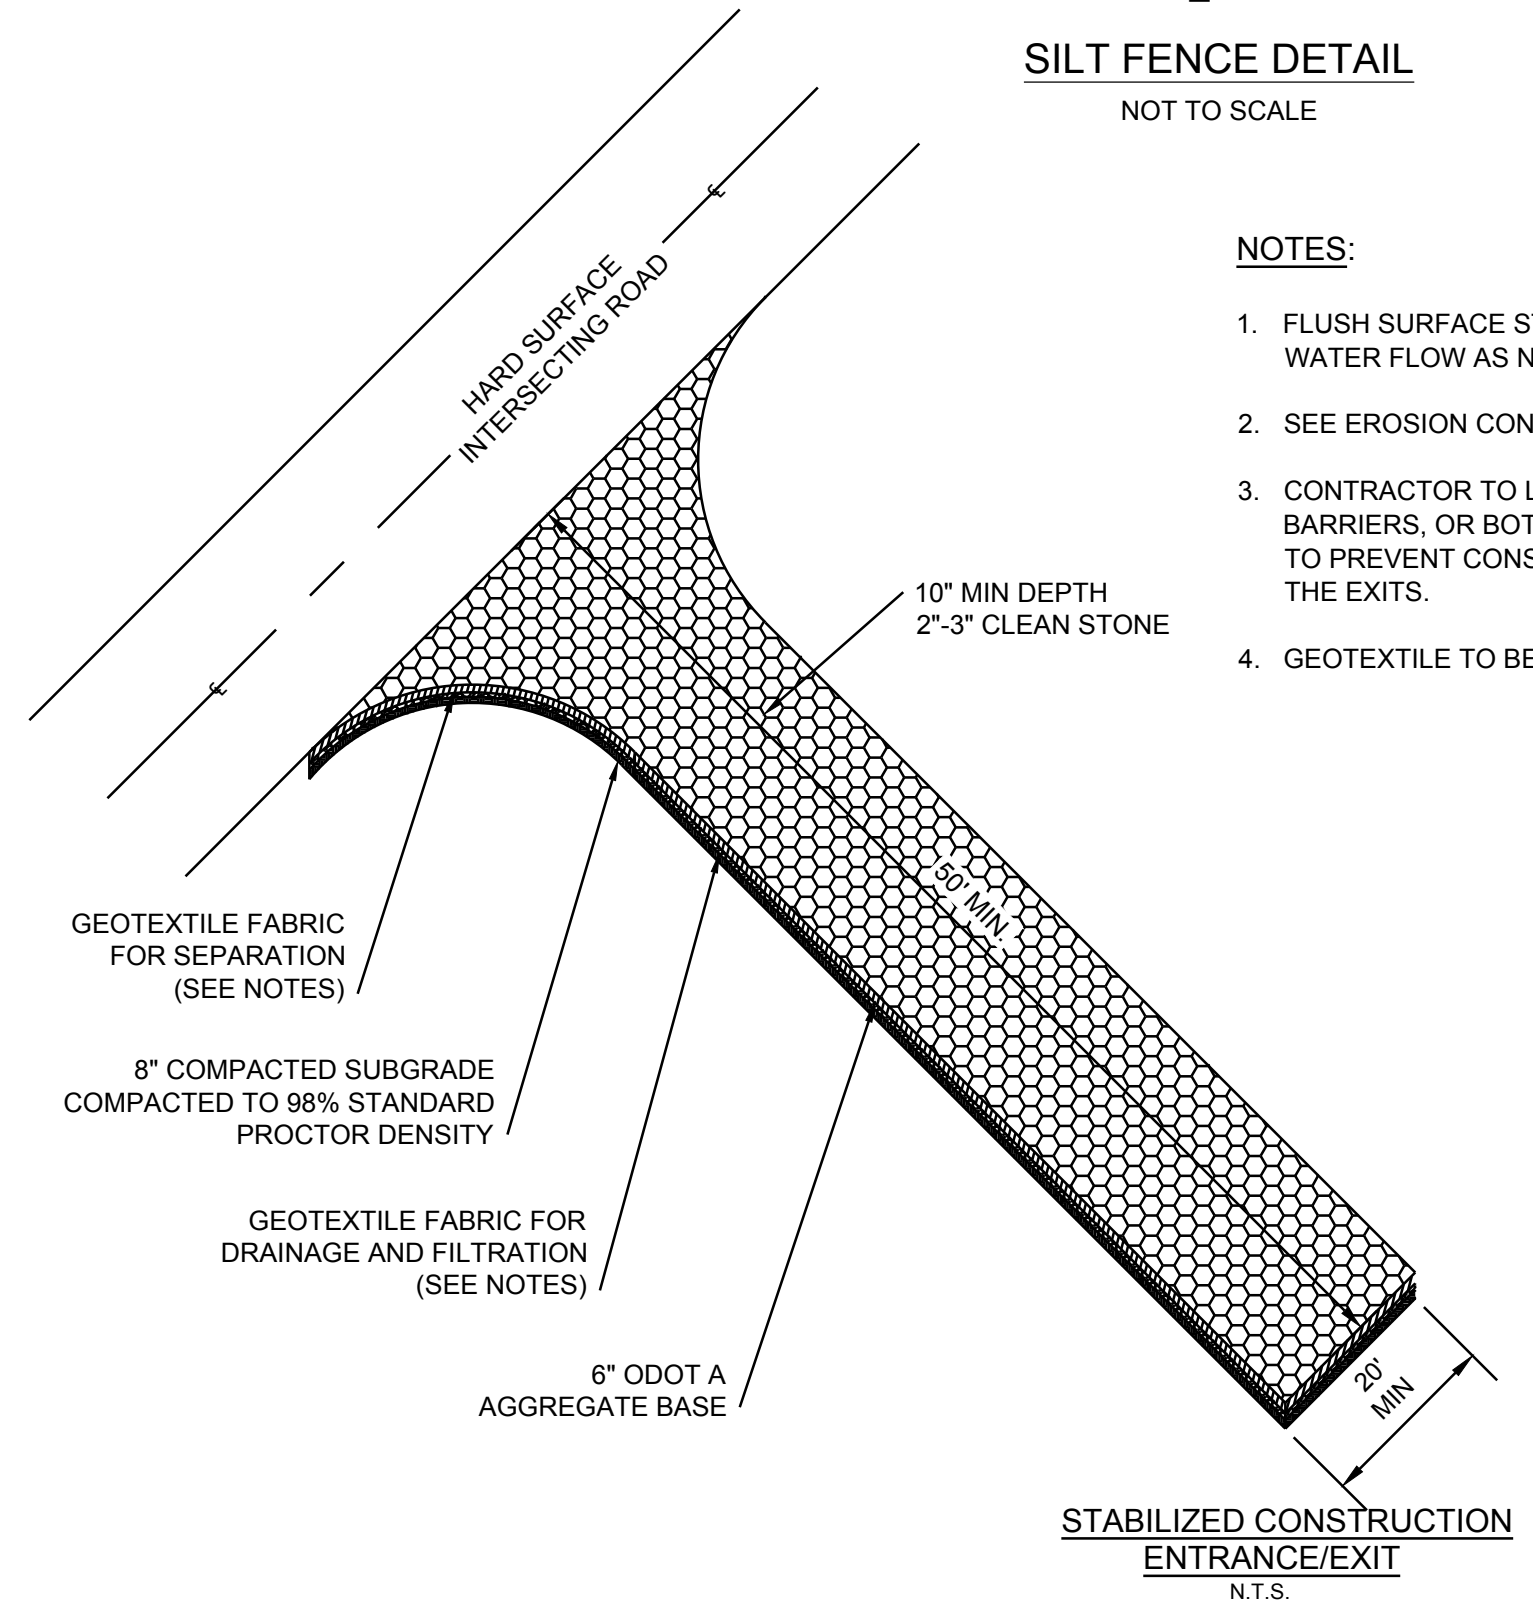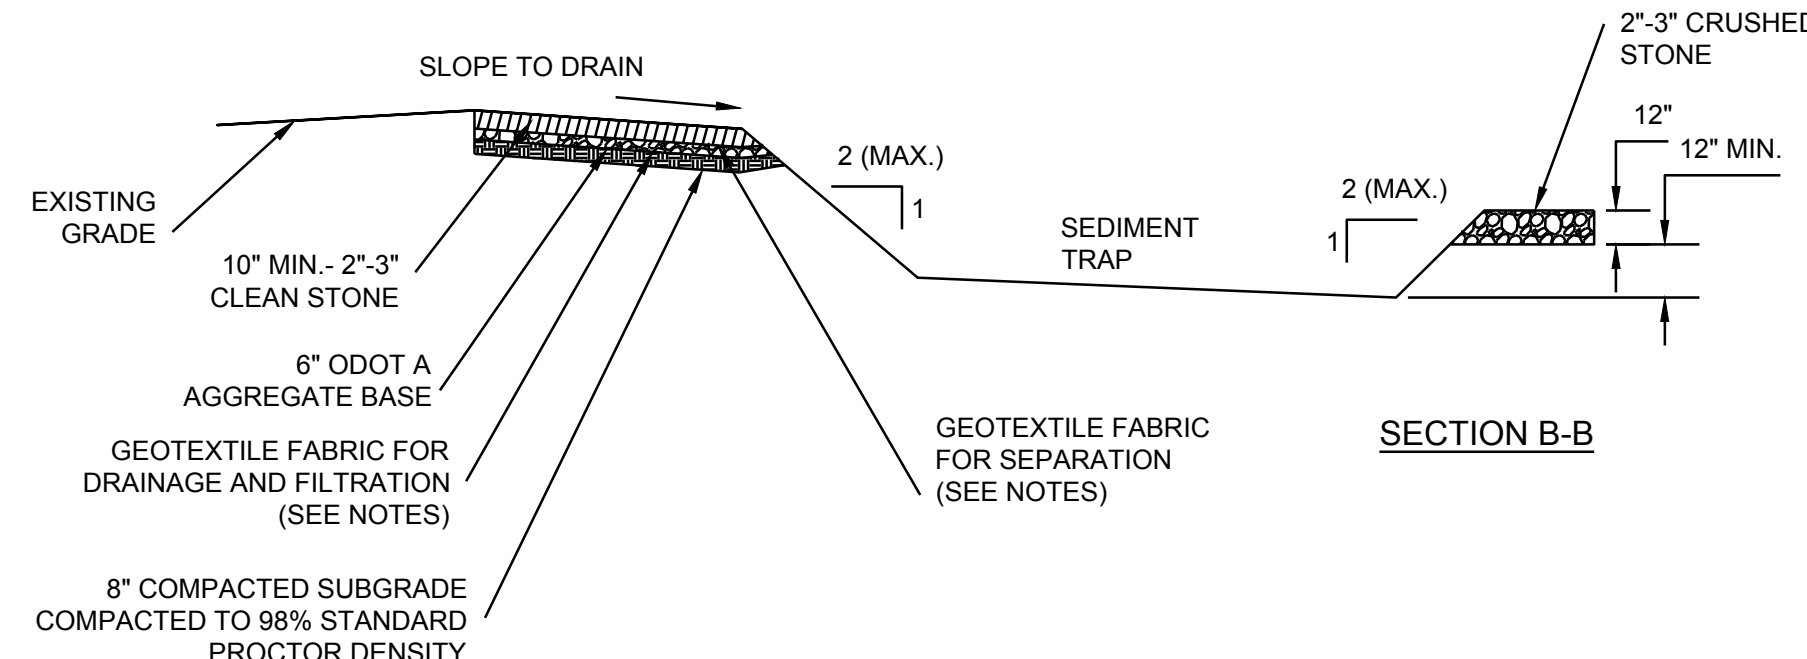

NOTES:

1. DROP INLET SEDIMENT BARRIERS ARE TO BE USED FOR SMALL, NEARLY LEVEL DRAINAGE AREAS. (LESS THAN 5%).
2. USE 2X4 WOOD OR EQUIVALENT METAL STAKES, 3' MINIMUM LENGTH.
3. INSTALL 2X4 WOOD TOP FRAME TO INSURE STABILITY.
4. THE TOP OF THE FRAME (PONDING HEIGHT), MUST BE WELL BELOW THE GROUND ELEVATION DOWNSLOPE TO PREVENT RUNOFF FROM BY-PASSING THE INLET. A TEMPORARY DIKE MAY BE NECESSARY ON THE DOWNSLOPE SIDE OF THE STRUCTURE.

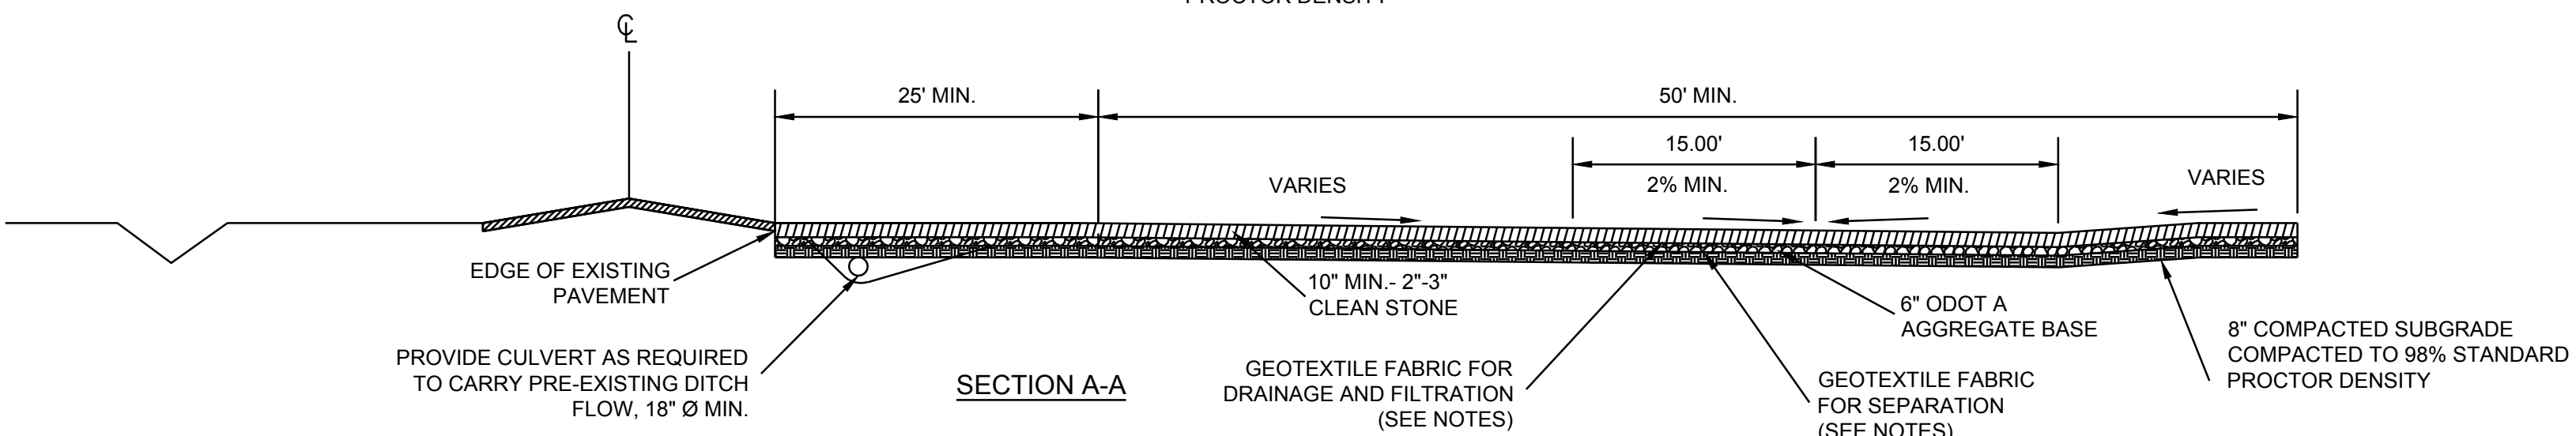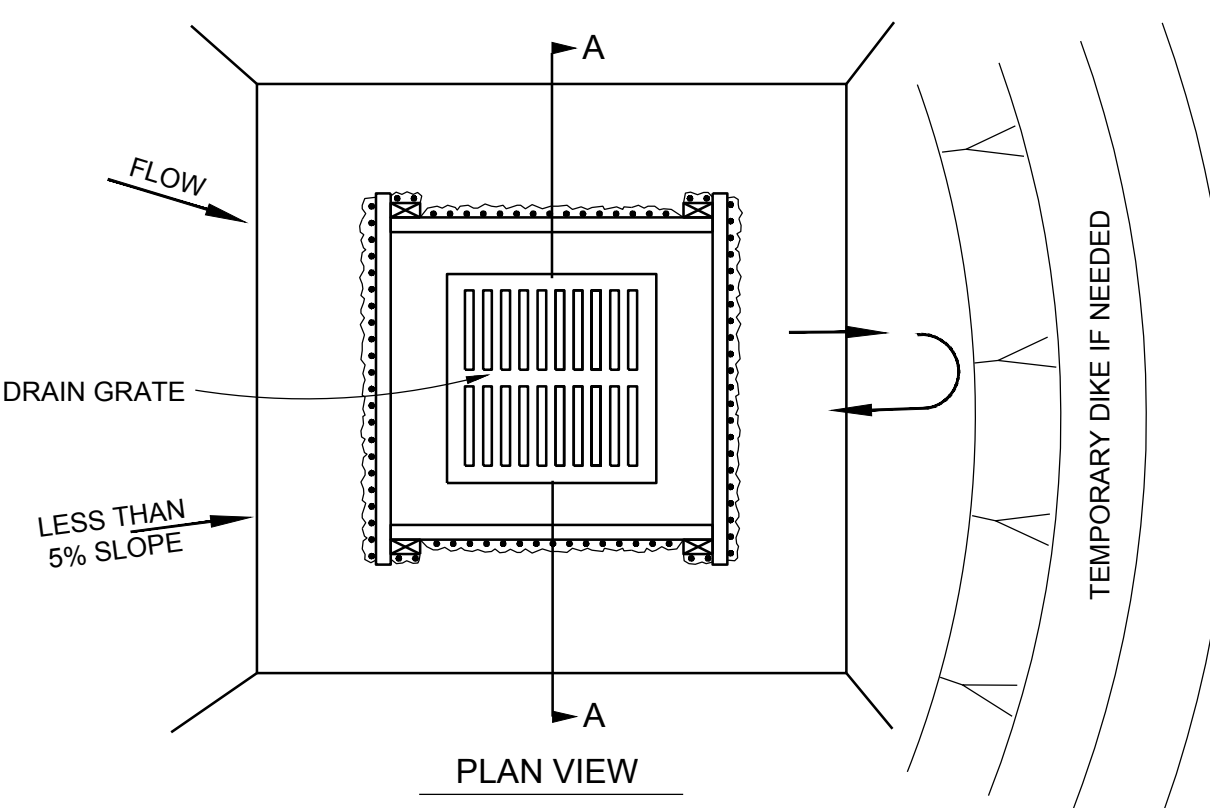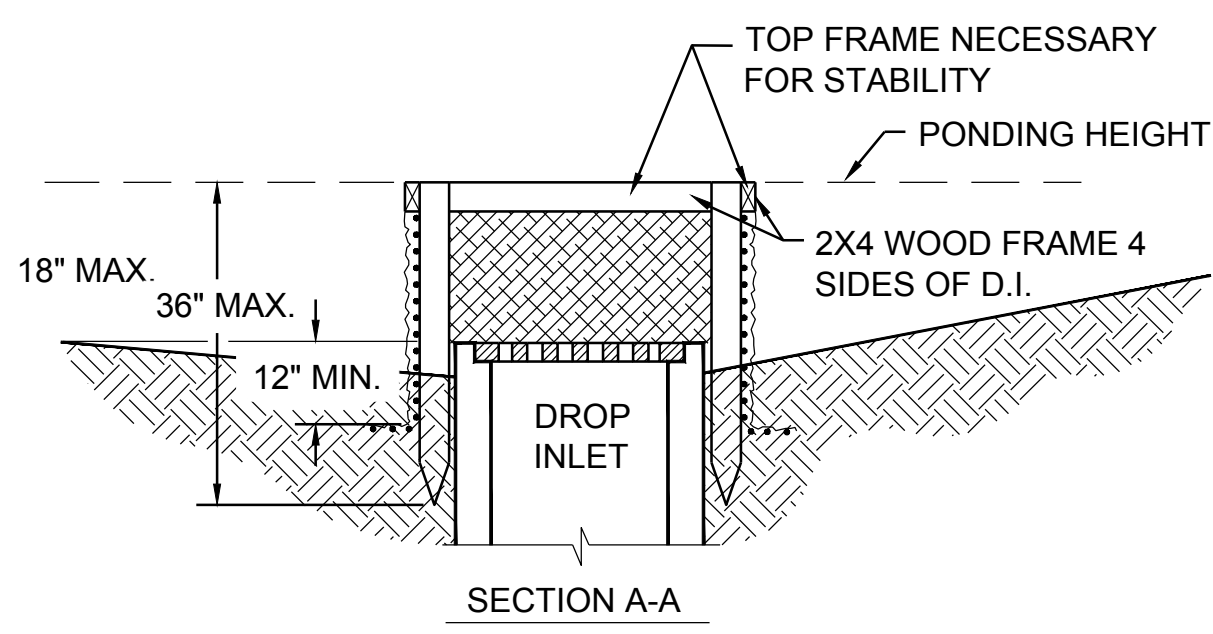

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA


KEY PLAN

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11.01.19 JOB NUMBER: 18-01.01




SHEET NUMBER:
CE500
EROSION CONTROL DETAILS

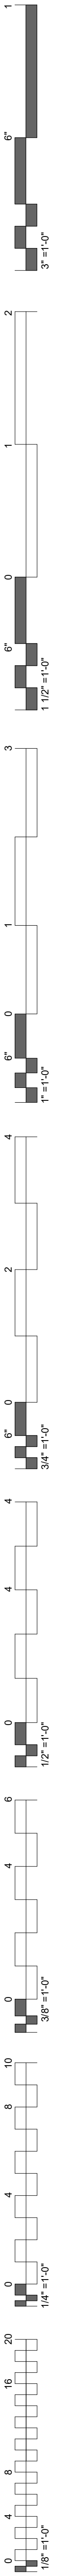

DEMOLITION LEGEND


	ITEMS SHOWN DASHED ARE TO BE REMOVED.
	ITEMS SHOWN SCREENED ARE TO REMAIN.
	ITEMS SHOWN SOLID ARE NEW CONSTRUCTION.

- GENERAL DEMOLITION NOTES**
- ENTIRE BUILDING SHOWN IN DASHED LINE TO BE DEMOLISHED. REFER TO SPECIFICATION DIVISION 02 FOR SPECIFIC PROJECT DEMOLITION REQUIREMENTS.
 - REFER TO DEMOLITION SYMBOL LEGEND ON DRAWINGS.
 - CONTRACTOR TO COORDINATE DEMOLITION WORK SEQUENCE. DEMOLITION DRAWINGS REPRESENT EXISTING CONDITIONS BASED ON LIMITED EXISTING DRAWINGS AND SITE OBSERVATIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING BUILDING AND SITE CONDITIONS. DEMOLITIONS DRAWINGS GENERALLY INDICATE EXISTING SCOPE OF WORK TO BE DEMOLISHED AND ARE NOT INTENDED TO LIMIT OR FULLY DEFINE THE SCOPE OF WORK TO BE REMOVED IN ORDER TO ACCOMPLISH SCOPE OF NEW CONSTRUCTION. WHERE THESE CONDITIONS OCCUR OUTSIDE OF THE DEMOLITION LIMITS, AREAS SHALL BE RETURNED TO THEIR ORIGINAL CONDITION AS PART OF THE NEW CONSTRUCTION SCOPE OF WORK.
 - CONTRACTOR SHALL NOTIFY ARCHITECT OF ANY CONFLICTS BETWEEN EXISTING CONSTRUCTION AND CONSTRUCTION DOCUMENTS. REFERENCE STRUCTURAL, CIVIL, AND MEP DRAWINGS FOR OTHER DISCIPLINE DEMOLITION SCOPE OF WORK.
 - WHERE EXISTING WALL MOUNTED DEVICES, FIXTURES OR OTHER WALL MOUNTED ITEMS ARE SCHEDULED TO BE SALVAGED, REFERENCE CONSTRUCTION DRAWINGS FOR NEW LOCATIONS OR COORDINATE WITH OWNER FOR STORAGE LOCATION.
 - PARTITIONS SCHEDULED TO BE REMOVED. DEMOLITION SHOULD INCLUDE MISCELLANEOUS BRACING, TRACK, ETC. TO BOTTOM OF STRUCTURE.
 - CONTRACTOR SHALL MAINTAIN ALL REQUIRED EXITS UNOBSTRUCTED, ILLUMINATED AND PROTECTED FROM CONSTRUCTION ACTIVITIES.
 - CONTRACTOR TO CLEAN AREAS ADJACENT TO DEMOLITION AREA OF DUST, DIRT AND DEBRIS CAUSED BY DEMOLITIONS OPERATIONS. PROMPTLY DISPOSE OF DEMOLISHED MATERIALS. DO NOT ALLOW DEMOLISHED MATERIALS TO ACCUMULATE ON-SITE. TRANSPORT DEMOLISHED MATERIALS AND LEGALLY DISPOSE OF THEM.

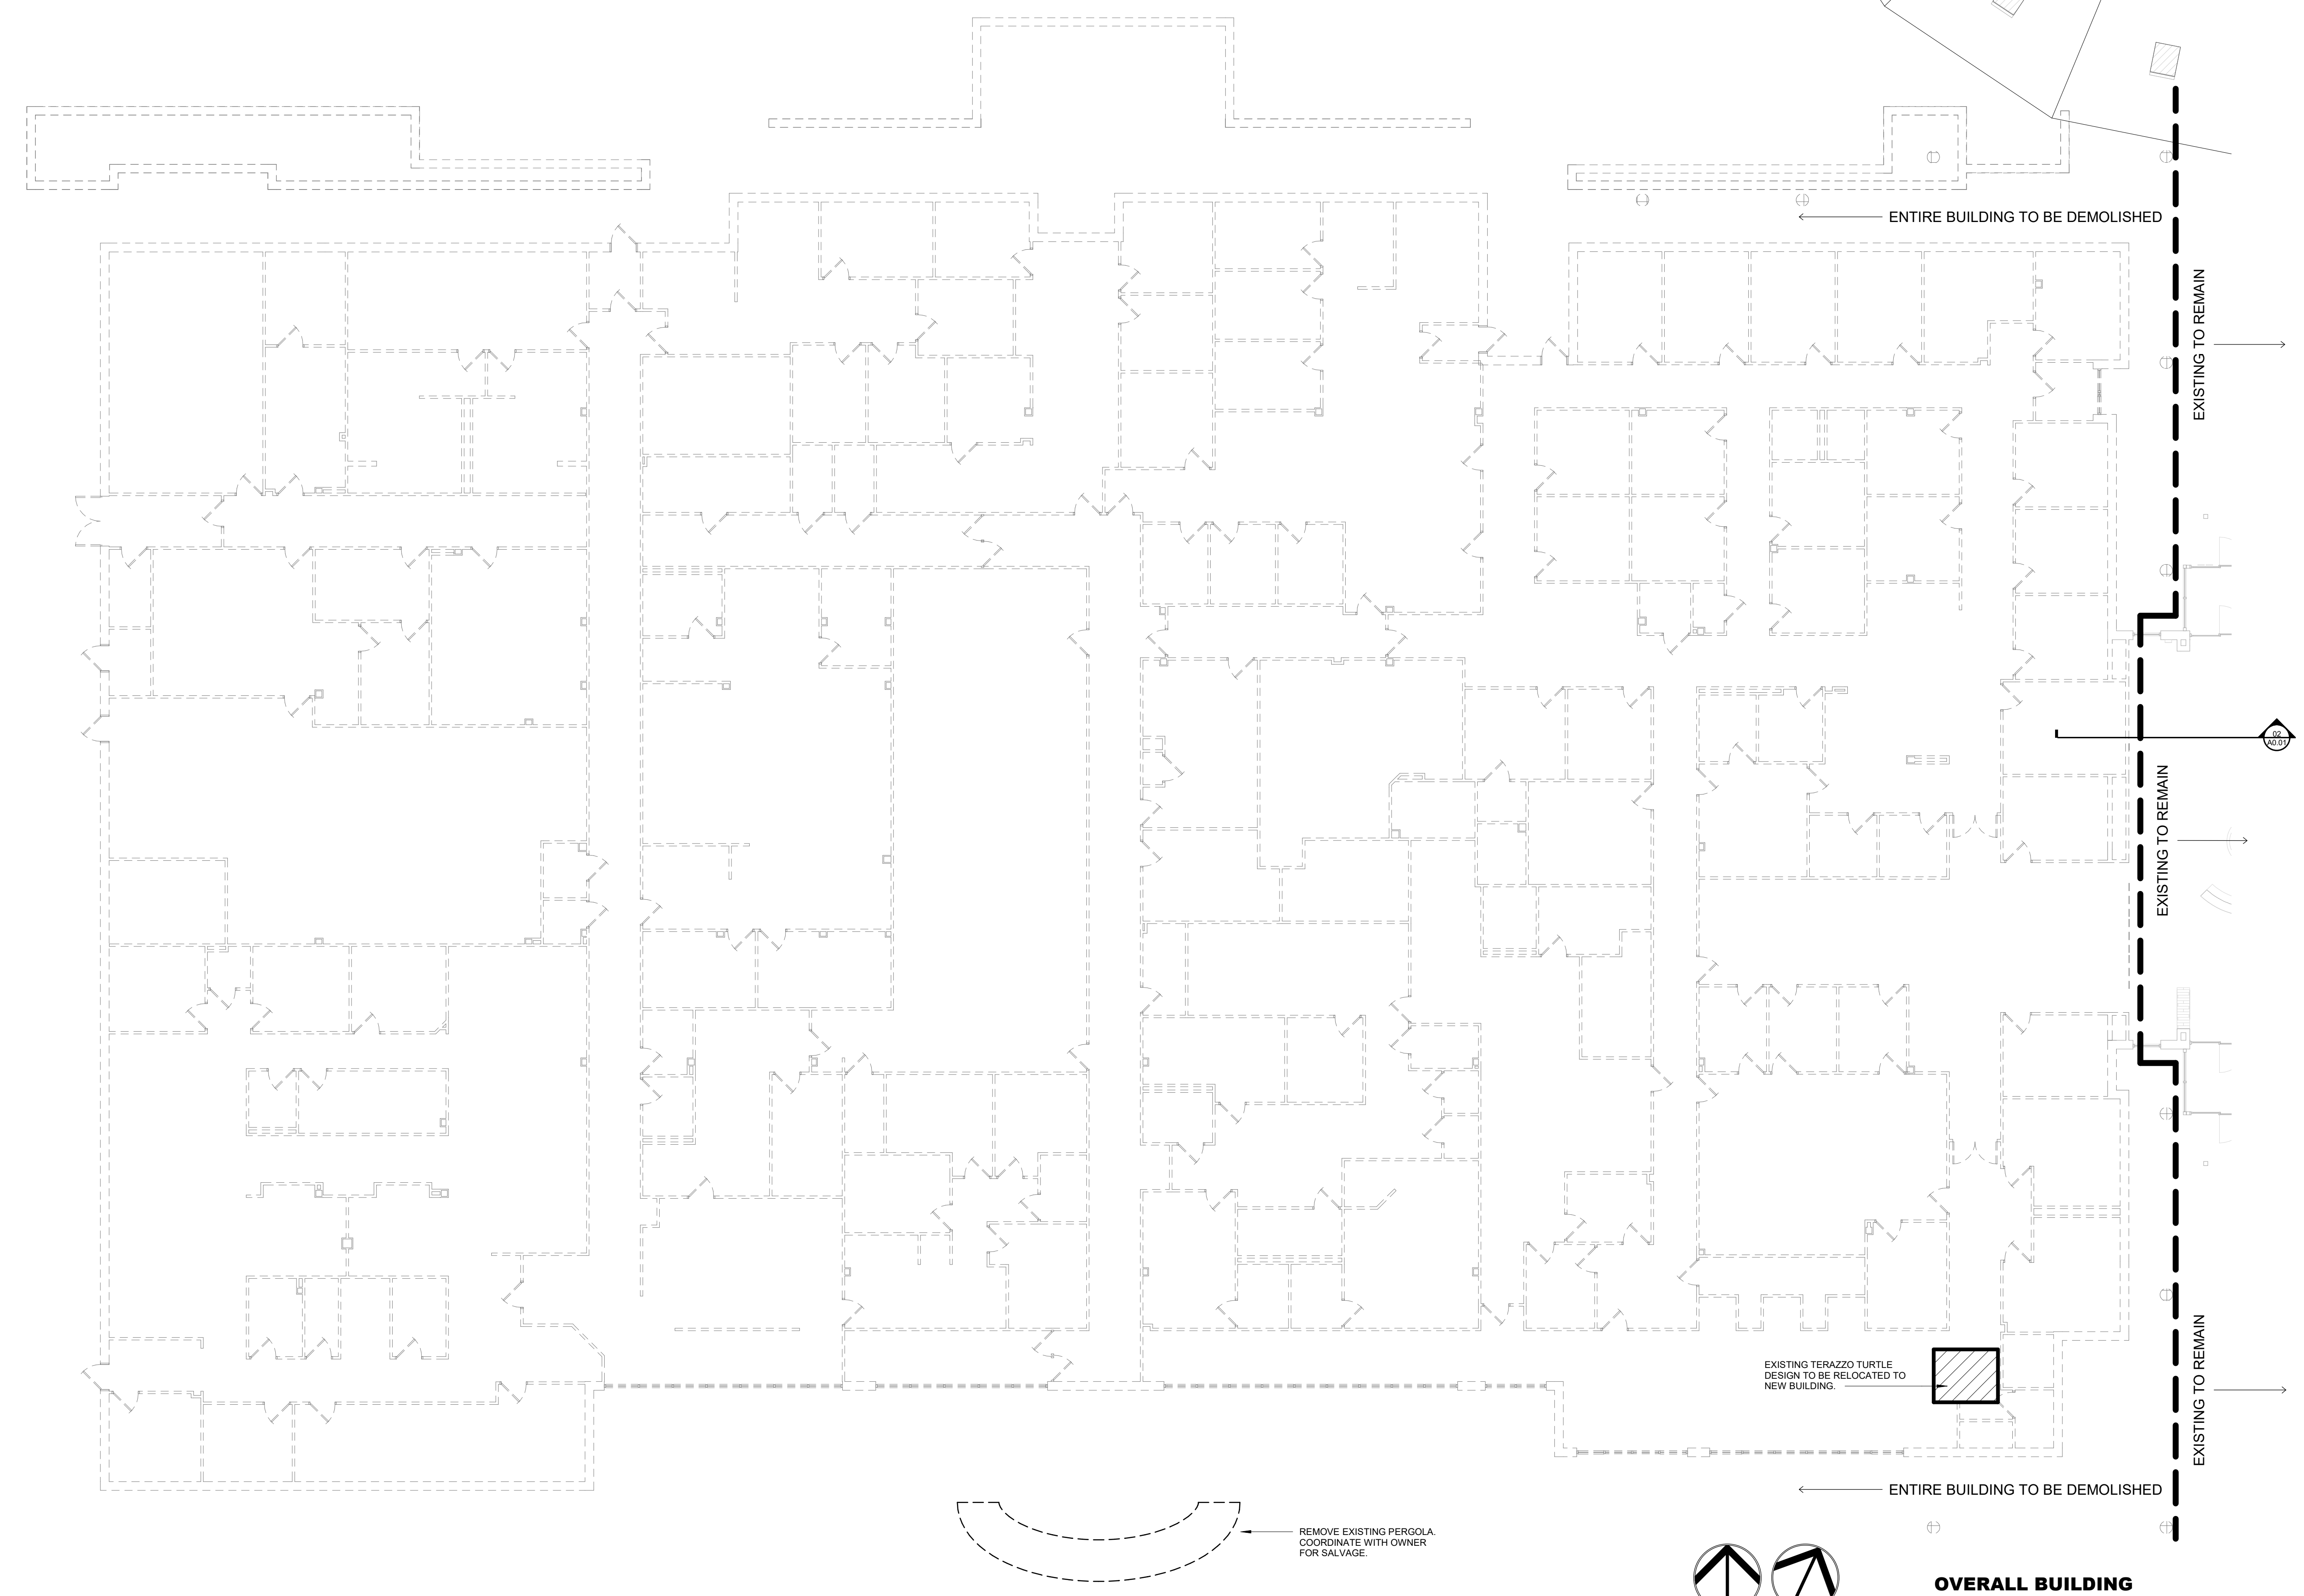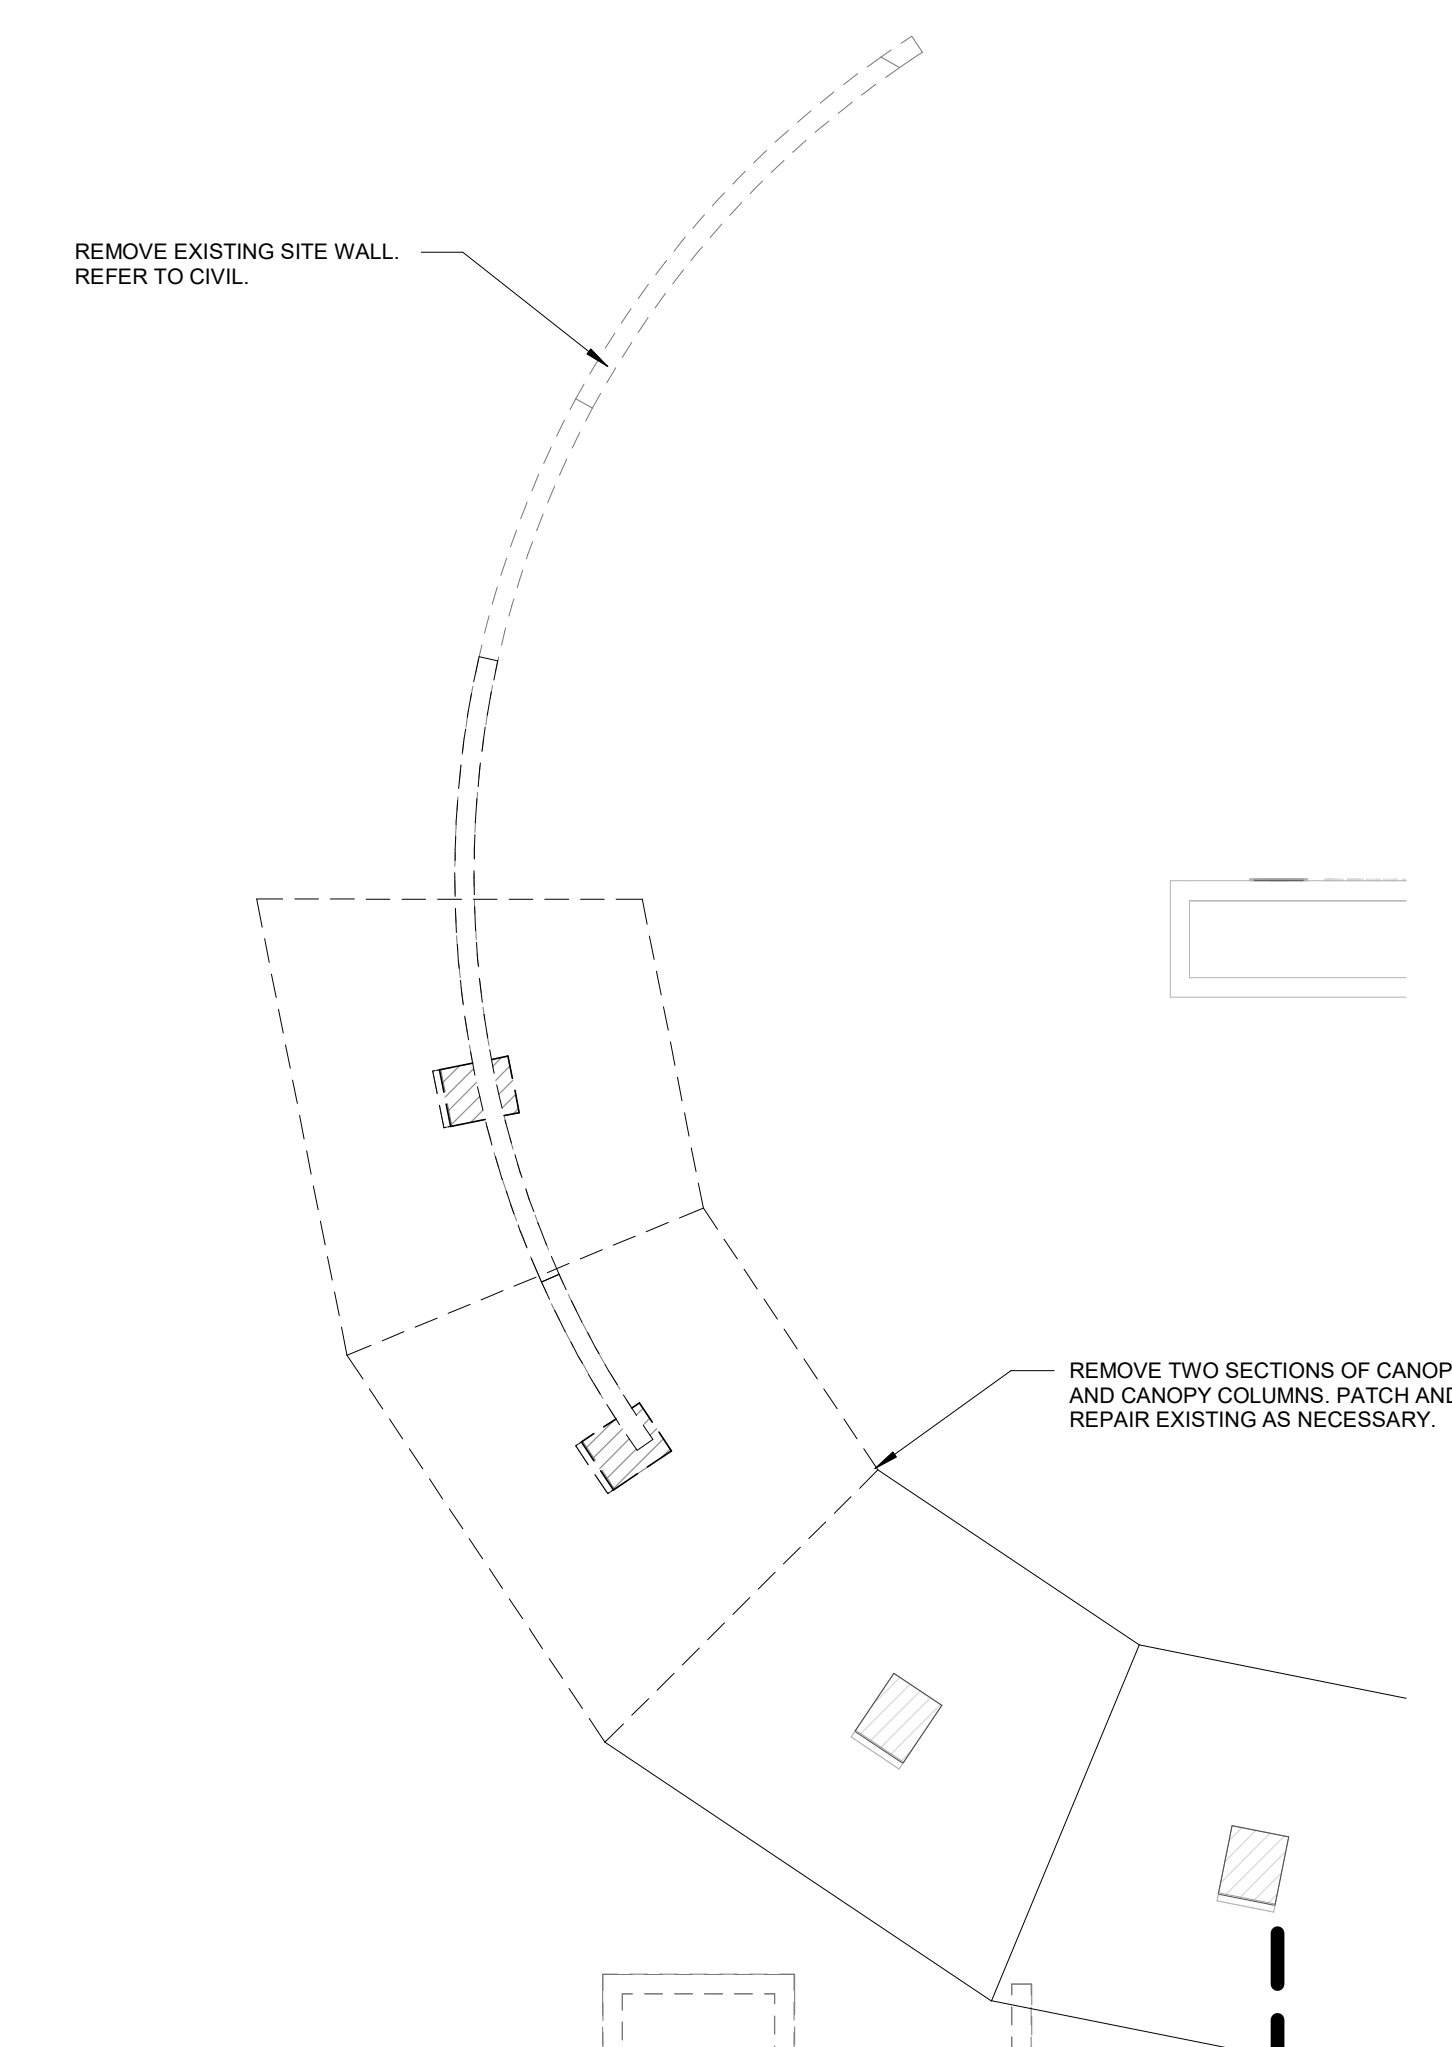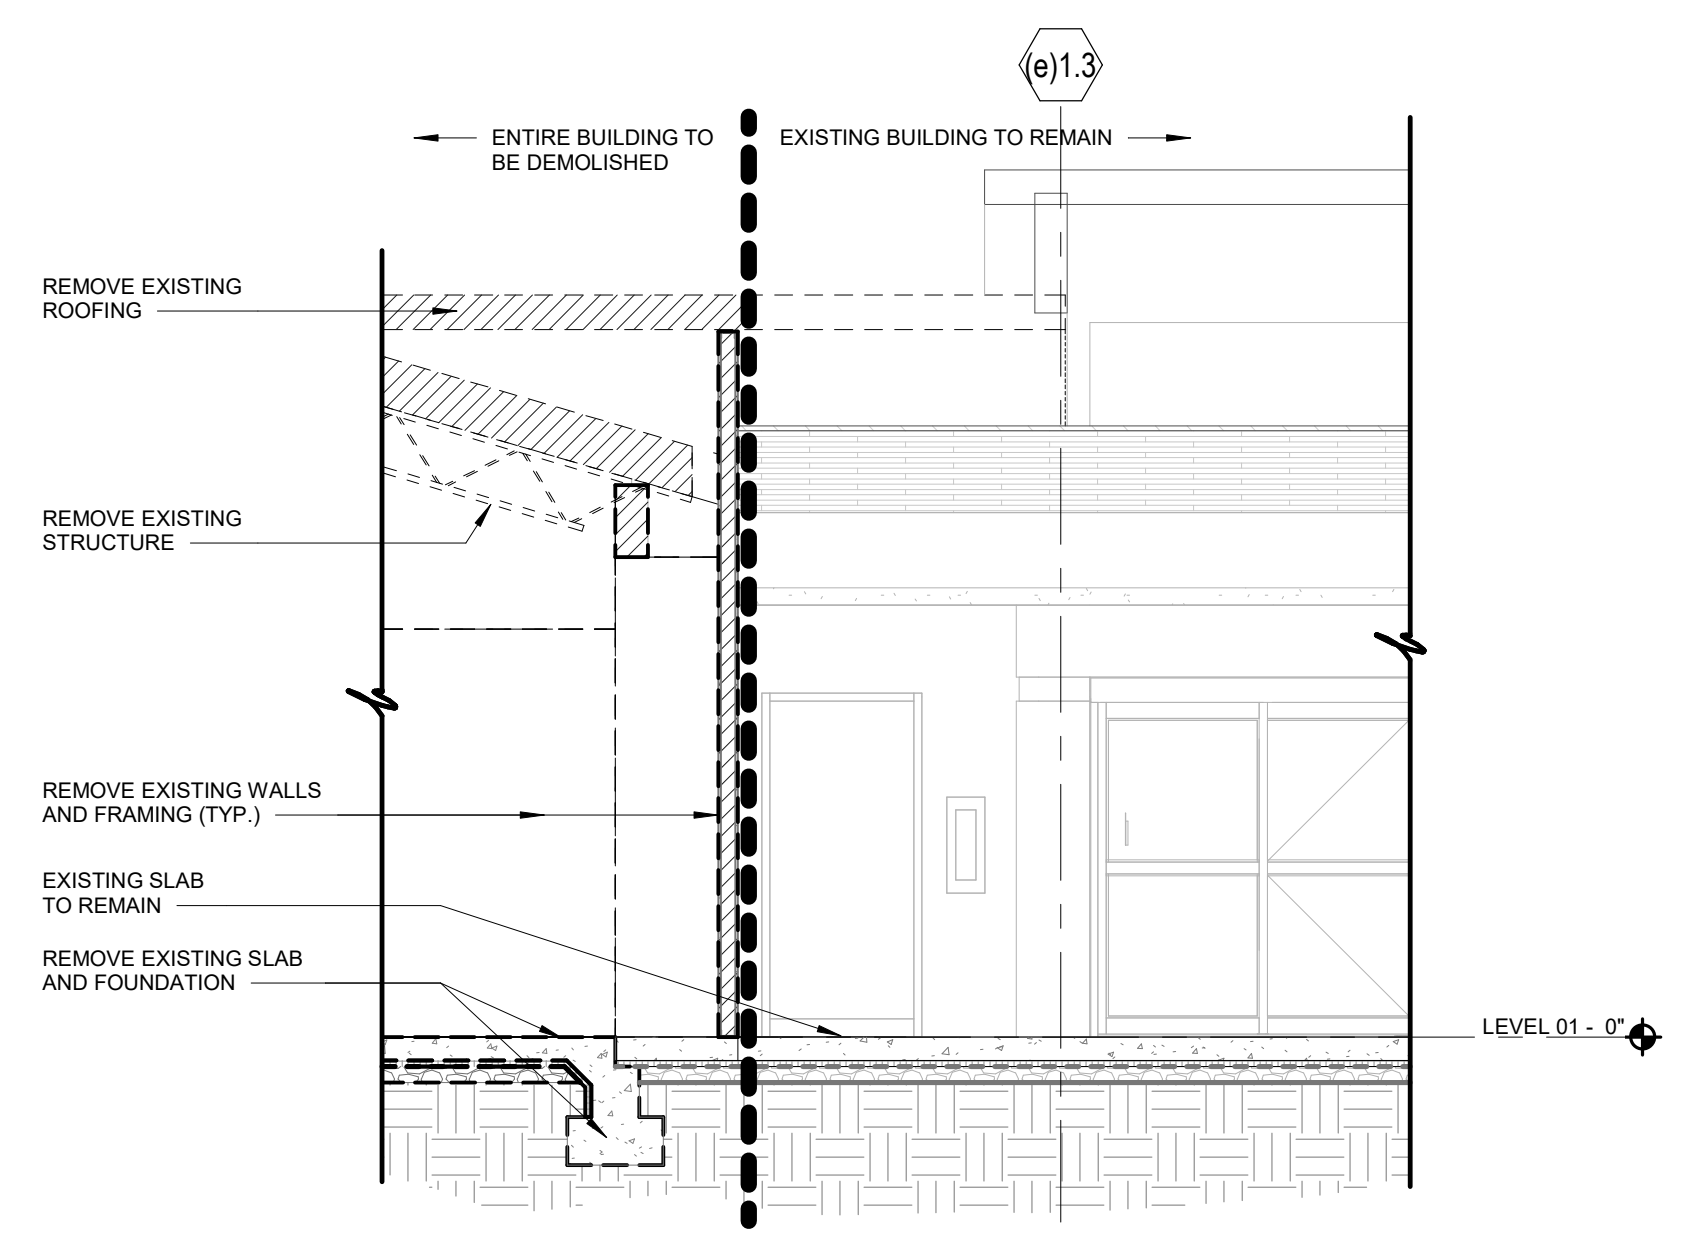


EXISTING PRE-FAB BUILDINGS TO BE DEMOLISHED. COORDINATE WITH OWNER FOR SALVAGE



REMOVE EXISTING PERGOLA. COORDINATE WITH OWNER FOR SALVAGE.

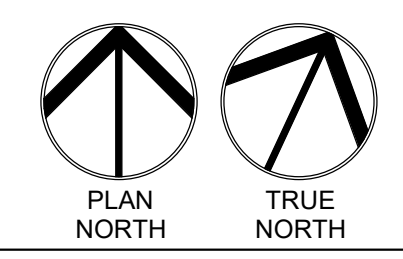

01 OVERALL BUILDING DEMOLITION PLAN
1" = 10'-0"

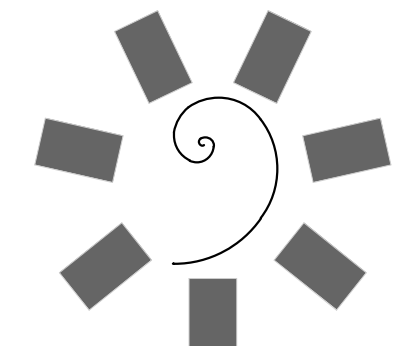

James R. Childers Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com

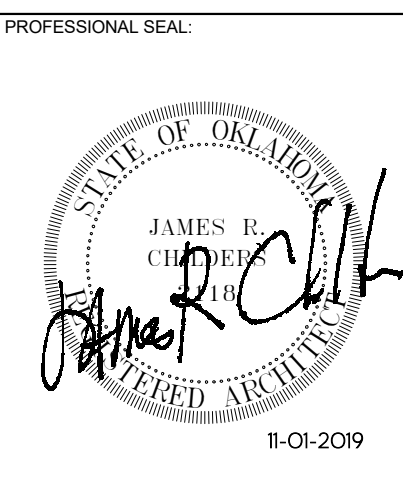

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
A0.01


OVERALL BUILDING DEMOLITION PLAN

STRUCTURAL GRAPHIC SYMBOLS


SECTION CROSS-REFERENCE SYMBOL

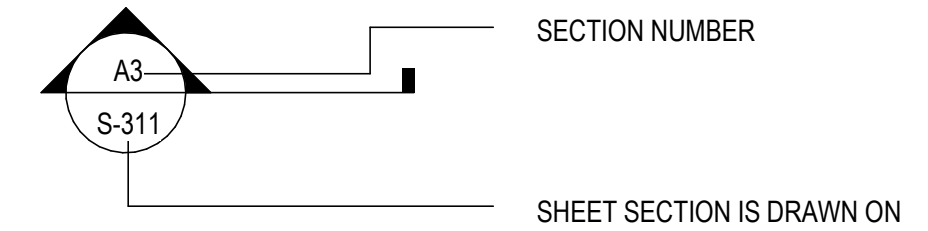


EXTERIOR ELEVATION CROSS-REFERENCE SYMBOL

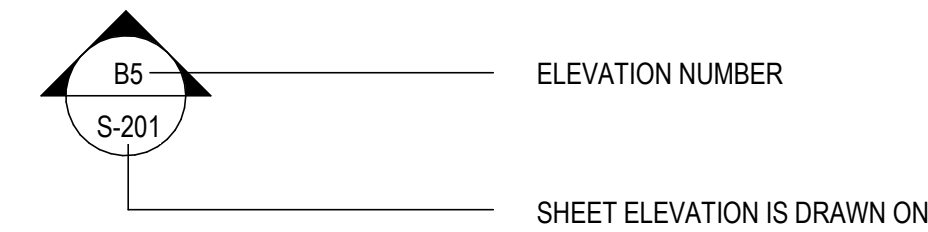


INTERIOR ELEVATION CROSS-REFERENCE SYMBOL

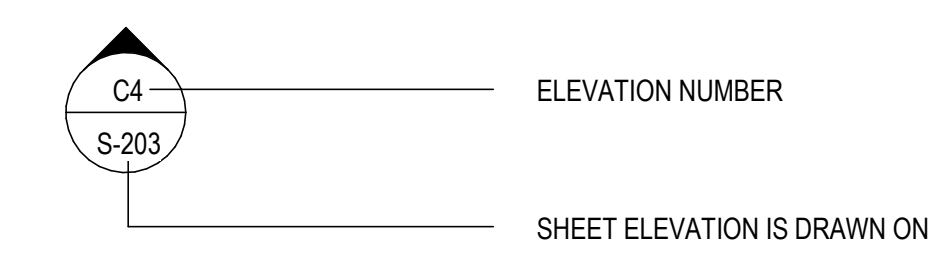


PLAN DETAIL CROSS-REFERENCE SYMBOL

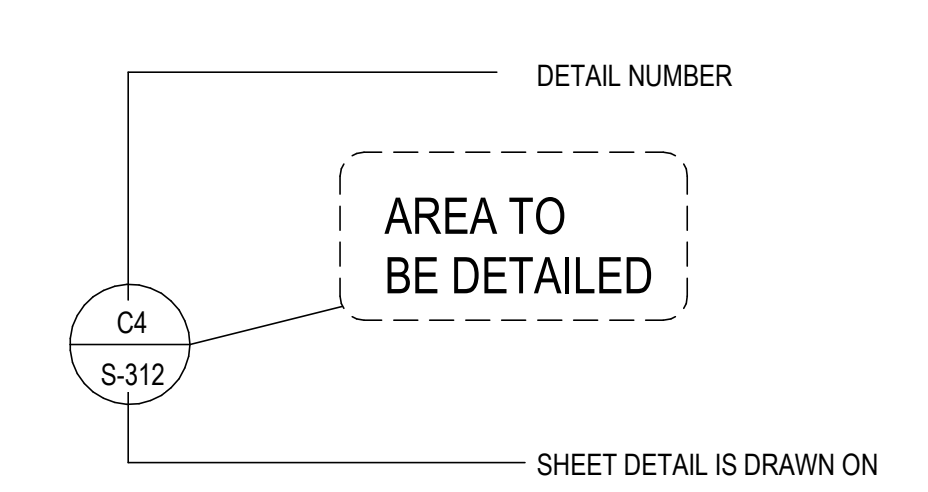


DETAIL CROSS-REFERENCE SYMBOL

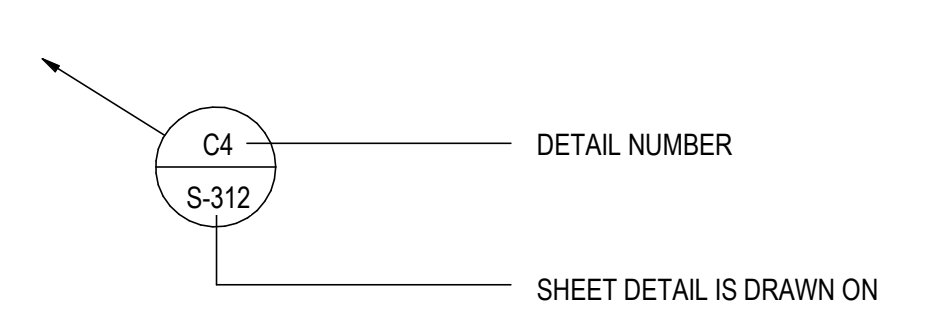


NORTH ARROW SYMBOL

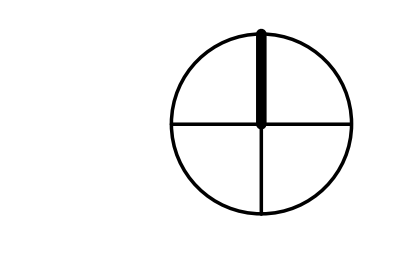


KEYNOTE SYMBOL

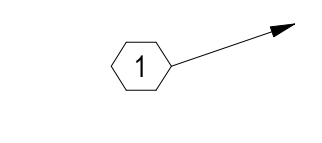


ELEVATION TARGET SYMBOL

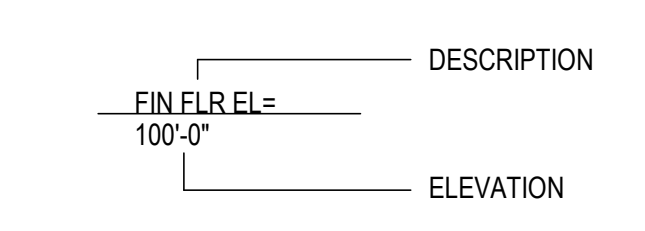


MATCH LINE SYMBOL




DRAWING TITLE SYMBOL

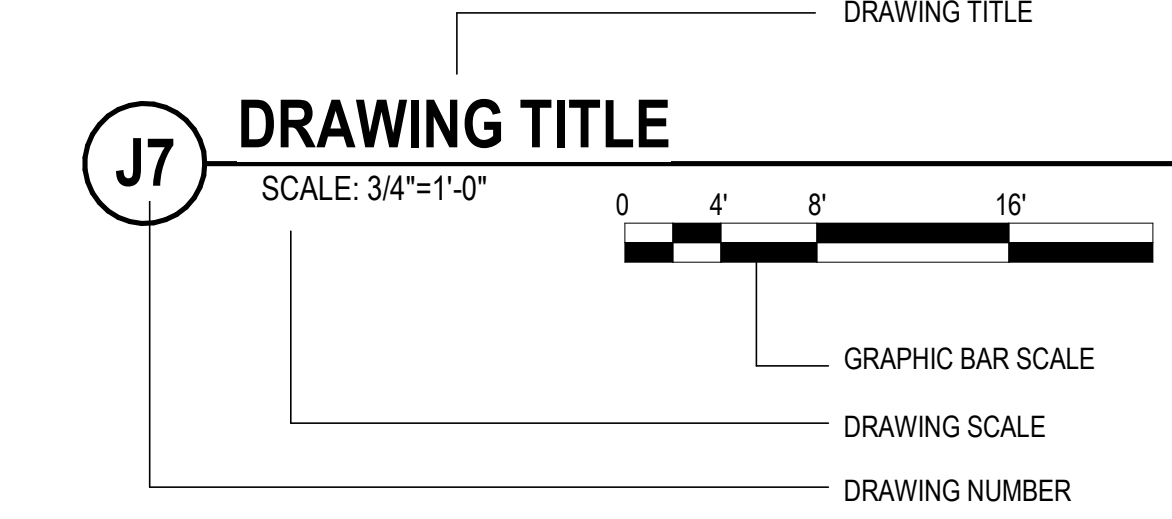


GRAPHIC BAR SCALE SYMBOL



STRUCTURAL GRID REFERENCE SYMBOL

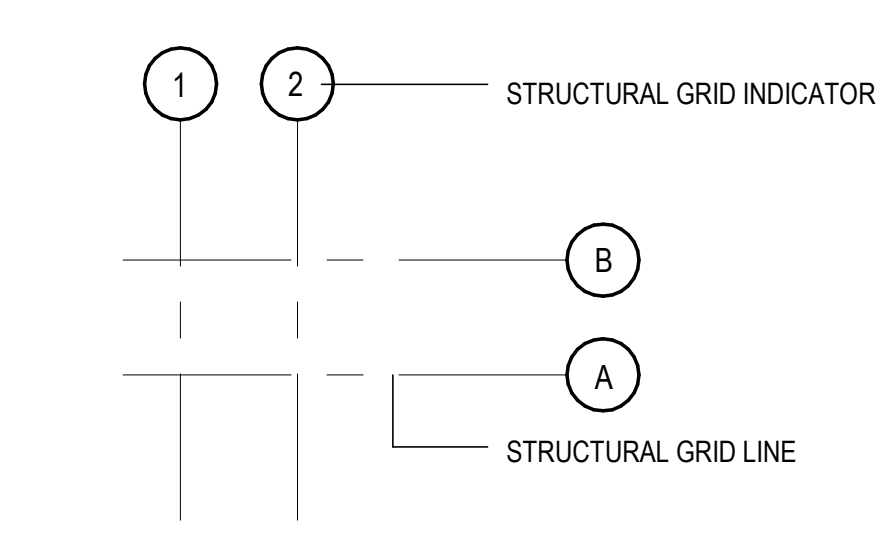


REVISION INDICATOR SYMBOL

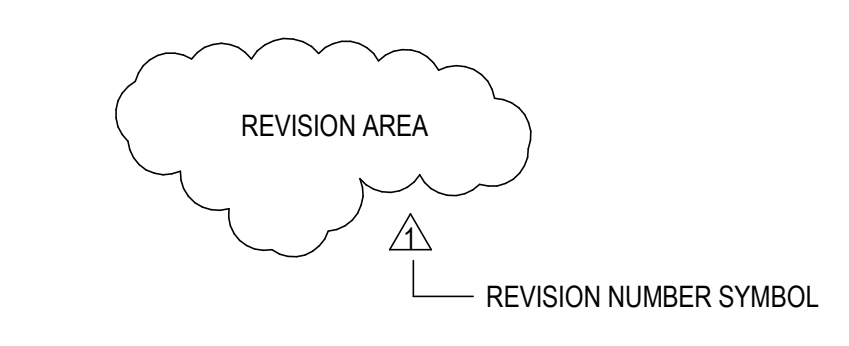


BASE PLATE MARK SYMBOL




SPOT FOOTING MARK SYMBOL



CONTINUOUS FOOTING MARK SYMBOL




WALL MARK SYMBOL

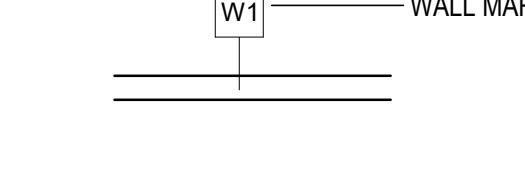


MOMENT CONNECTION SYMBOL



SIDEPLATE MOMENT CONNECTION SYMBOL, SEE SIDEPLATE DRAWINGS



STRUCTURAL MATERIALS LEGEND

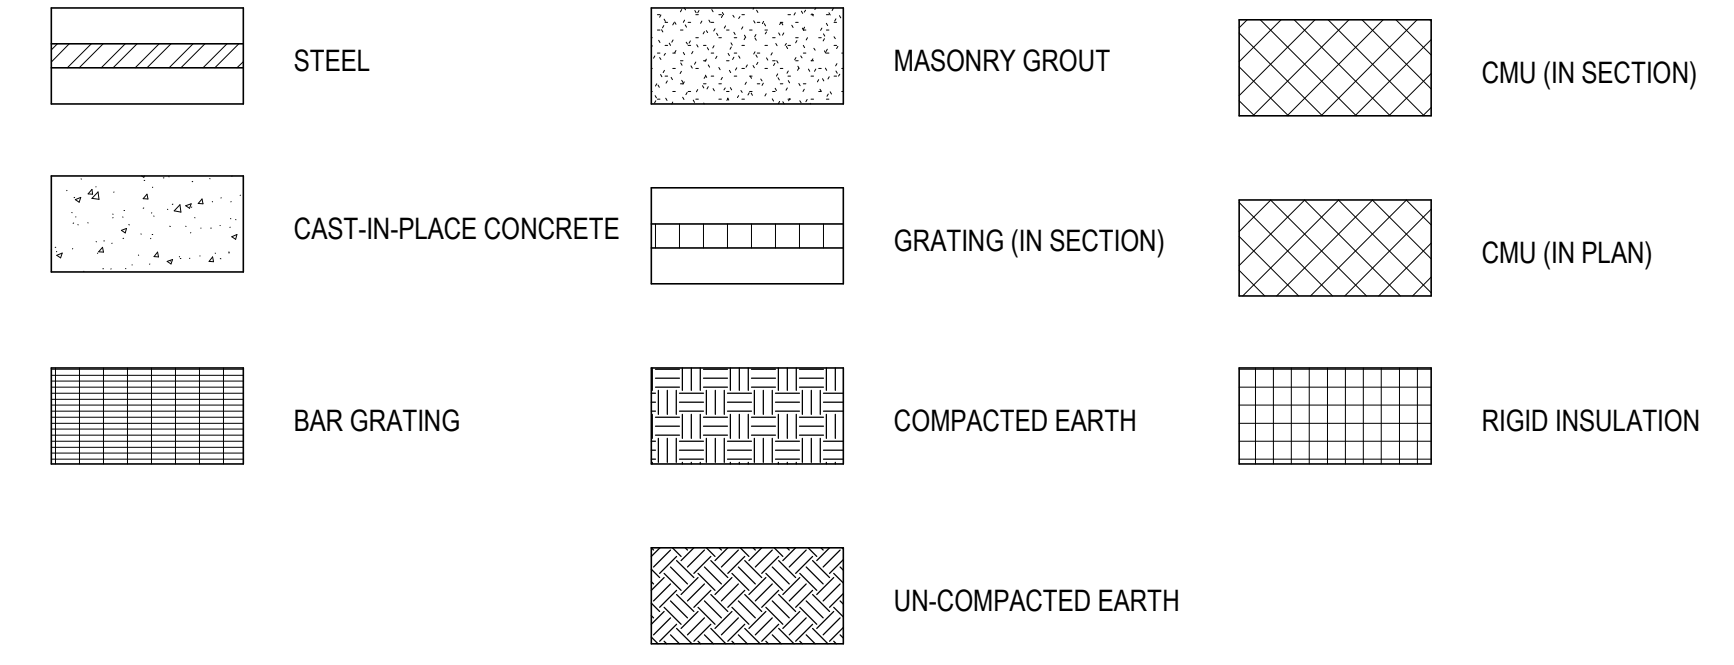

ABBREVIATIONS

Table of abbreviations with columns for abbreviation and full name, including terms like ARCHITECT, ANCHOR BOLT, ABANDON, etc.

ABBREVIATIONS

Table of abbreviations with columns for abbreviation and full name, including terms like EACH WAY, EXAMPLE, EXCAVATE, etc.

ABBREVIATIONS

Table of abbreviations with columns for abbreviation and full name, including terms like PLATE, PLATFORM, PLUMBING, etc.

GENERAL FOUNDATION NOTES:

FOUNDATION NOTES
GENERAL:
A SUBSURFACE SOIL INVESTIGATION HAS BEEN MADE BY BUILDING AND EARTH. PROJECT NO. 0K180172.
A REPORT OF THAT INVESTIGATION DATED AUGUST 30, 2018 IS AVAILABLE FOR VIEWING AT THE OFFICE OF THE ARCHITECT
THE FOUNDATION SYSTEM FOR THIS PROJECT IS SPREAD FOOTINGS OVER AGGREGATE PIERS / STONE COLUMNS FOR THE MAIN BUILDING. THE FOUNDATION SYSTEM FOR THE PRE-ENGINEERED METAL BUILDING IS SPREAD FOOTINGS OVER OVER-EXCAVATED SOILS AND COMPACTED STRUCTURAL FILL.

ADDITIONAL INFORMATION CONCERNING SPECIFIC SOIL CONDITIONS TO BE ENCOUNTERED IS AVAILABLE IN THE SOILS REPORTS AND SHALL BE REVIEWED BY THE CONTRACTOR.
FIELD OBSERVATION AND TESTS:
THE OWNER SHALL EMPLOY THE SERVICES OF A REGISTERED, LICENSED GEOTECHNICAL ENGINEER TO OBSERVE ALL CONTROLLED EARTHWORK. THE GEOTECHNICAL ENGINEER SHALL PROVIDE CONTINUOUS ON-SITE OBSERVATION BY EXPERIENCED PERSONNEL DURING CONSTRUCTION OF CONTROLLED EARTHWORK. THE CONTRACTOR SHALL NOTIFY THE GEOTECHNICAL ENGINEER AT LEAST TWO WORKING DAYS IN ADVANCE OF ANY FIELD OPERATIONS OF THE CONTROLLED EARTHWORK.

TESTS OF MATERIALS SHALL BE MADE AT THE FOLLOWING MINIMUM RATES. THE ON-SITE GEOTECHNICAL ENGINEER SHALL DETERMINE THE ACTUAL TESTING RATES:
ONE FIELD DENSITY TEST PER 2500 SQUARE FEET OF COMPACTED SUBGRADE, PRIOR TO PLACING STRUCTURAL FILL OR SLAB-ON-GRADE, WITH A MINIMUM OF 3 TESTS.
ONE FIELD DENSITY TEST PER 2500 SQUARE FEET OF STRUCTURAL FILL PLACED OR EACH HORIZONTAL LAYER OF STRUCTURAL FILL, WHICHEVER IS GREATER.

ONE MOISTURE-DENSITY CURVE FOR EACH TYPE OF MATERIAL USED, AS INDICATED BY THE SIEVE ANALYSIS AND THE PLASTICITY INDEX.
THE GEOTECHNICAL ENGINEER SHALL SUBMIT THE RESULTS OF ALL REQUIRED TESTS.
CLEARING AND GRUBBING:
ALL EXISTING STRUCTURE AND PAVEMENT SHALL BE REMOVED FROM THE PROPOSED CONSTRUCTION AREA PRIOR TO ANY FILL PLACEMENT OR NEW CONSTRUCTION. SOILS DISTURBED DURING THIS PROCESS SHALL BE UNDERCUT AND REPLACED WITH STRUCTURAL FILL.

REMOVE ALL TREES, VEGETATION, ROOTS, TOPSOIL, AND OTHER DELETERIOUS MATERIALS SHALL BE REMOVED FROM THE PROPOSED CONSTRUCTION AREAS. ANY DESICCATED CLAYS ENCOUNTERED SHALL BE UNDERCUT AND REPLACED WITH STRUCTURAL FILL.

DURING SITE CLEARING AND PREPARATION THE CONTRACTOR SHALL IDENTIFY BORROW SOURCE MATERIALS THAT WILL BE USED AS STRUCTURAL FILL AND PROVIDE SAMPLES TO THE TESTING LABORATORY SO THAT CONFORMANCE TO THE STRUCTURAL FILL REQUIREMENTS CAN BE DETERMINED.
SITE, SUBFLOOR AND BEARING SURFACE PREPARATION:
A REPRESENTATIVE OF THE GEOTECHNICAL ENGINEER SHALL BE PRESENT TO CONFIRM COMPLETE EXCAVATION OF ANY UNCONTROLLED FILL OF THE MAIN BUILDING.

AGGREGATE PIERS/STONE COLUMN GROUND IMPROVEMENT IS REQUIRED UNDER COLUMN FOOTINGS AND CONTINUOUS WALL FOOTINGS OF THE MAIN BUILDING. OVER-EXCAVATE AND REPLACE SOIL BELOW THE PRE-ENGINEERED METAL BUILDING FOUNDATION WITH 3 FEET OF LOW VOLUME CHANGE STRUCTURAL FILL.

SCARIFY ALL EXPOSED SUBGRADE SOILS TO A DEPTH OF 12 INCHES, MOISTEN TO OPTIMUM MOISTURE CONTENT (+/- 2%) AND COMPACT TO THE DENSITY SPECIFIED HEREINAFTER.
PLACE ALL STRUCTURAL FILL IN APPROXIMATELY HORIZONTAL LAYERS NOT GREATER THAN 8 INCHES IN LOOSE THICKNESS, MOISTEN TO OPTIMUM MOISTURE CONTENT (+/- 2%) AND COMPACT TO DENSITY SPECIFIED HEREINAFTER.

ALL EARTHWORK FOR THE BUILDING PAD SHALL EXTEND A MINIMUM OF 5 FEET BEYOND THE PERIMETER FOOTINGS.
STRUCTURAL FILL REQUIREMENTS:
GRADATION (ASTM D422):
SIEVE SIZE PERCENT PASSING BY WEIGHT
3" 100
NO. 200 >15

PLASTICITY INDEX (ASTM D4318): 17 MAXIMUM
LIQUID LIMIT (ASTM D4318): 39 MAXIMUM
MATERIAL LARGER THAN 3 INCHES SHALL NOT BE PLACED IN THE STRUCTURAL FILL.
NO BRUSH, SOD, FROZEN MATERIAL OR OTHER UNSUITABLE MATERIAL SHALL BE PLACED IN THE STRUCTURAL FILL. MATERIAL SHALL BE PLACED IN SUCH A MANNER AS TO RESULT IN A UNIFORMLY COMPACTED FILL.

THE ON-SITE FILL MATERIALS AND RESIDUAL SOILS ARE NOT SUITABLE FOR USE AS STRUCTURAL FILL WITHIN THE BUILDING AREA, WITHIN 5 FEET OF THE BUILDING PERIMETER.
IMPORTED FILL SHALL BE USED FOR THE LOWER PLASTICITY STRUCTURAL FILL. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO DETERMINE THE MOST APPROPRIATE METHOD TO OBTAIN AND PROVIDE THE REQUIRED STRUCTURAL FILL TO THE PROJECT.

GRANULAR BASE COURSE REQUIREMENTS:
#57 STONE.
COMPACTION REQUIREMENTS:
IN ACCORDANCE WITH ASTM D698 (STANDARD PROCTOR), SUBGRADE SOILS AND STRUCTURAL FILL MATERIALS SHALL BE COMPACTED TO THE FOLLOWING PERCENTAGES OF THE MAXIMUM DRY DENSITY AT +/- 2% OPTIMUM MOISTURE CONTENT:



Table with columns for MATERIAL and PERCENT COMPACTION, listing values for structural fill, subbase, and miscellaneous backfill.

Table with columns for SITE RETAINING WALL DESIGN CRITERIA, showing loading conditions and equivalent fluid pressures.

AGGREGATE PIERS / STONE COLUMNS:
AGGREGATE PIERS / STONE COLUMNS SHALL BE DESIGNED AND INSTALLED TO PROVIDE AN EQUIVALENT SOIL BEARING PRESSURE OF 6000 PSF AT MAIN BUILDING FOOTINGS.
DESIGN LOADS CAN EITHER BE DETERMINED BY THE SIZE OF THE FOOTINGS INDICATED ON THE DRAWINGS OR BY CONTACTING THE ENGINEER DIRECTLY.

SEISMIC OR WIND UPLIFT LOADS SHOWN ON THE DRAWINGS MUST BE RESISTED BY THE AGGREGATE PIERS / STONE COLUMNS WITH AN EMBEDDED ELEMENT PROVIDING POSITIVE ATTACHMENT TO FOOTINGS.

PORTIONS OF THE BUILDING AREA ALONG THE SOUTH AND WEST COULD ENCOUNTER AUGER REFUSAL MATERIAL (LIMESTONE) WITHIN 1 TO 2 FEET BELOW THE FOOTING BEARING ELEVATION. INSTALLATION OF AGGREGATE PIERS IS NOT PRACTICAL AT THESE LOCATIONS. FOR THESE LOCATIONS THE FILL RESIDUAL SOILS SHALL BE UNDERCUT TO THE TOP OF THE LIMESTONE UNIT. A GEOTECHNICAL REPRESENTATIVE SHALL EVALUATE THE CONDITION OF THE EXPOSED BEARING MATERIALS IN THE BOTTOM OF THE FOUNDATION EXCAVATION AT THE UNDERCUT LEVEL AFTER COMPLETION OF THE RECOMMENDED UNDERCUTTING AND EVALUATION BY THE GEOTECHNICAL REPRESENTATIVE. THE FOOTING EXCAVATIONS CAN BE BROUGHT BACK UP TO DESIGN BEARING ELEVATION USING LEAN CONCRETE OR COMPACTED GRADED BASE. THE AGGREGATE BASE MUST BE PLACED IN LIFTS NOT EXCEEDING 6 INCHES IN THICKNESS AND COMPACTED TO AT LEAST 98 PERCENT OF THE MATERIAL'S STANDARD PROCTOR MAXIMUM DRY DENSITY.

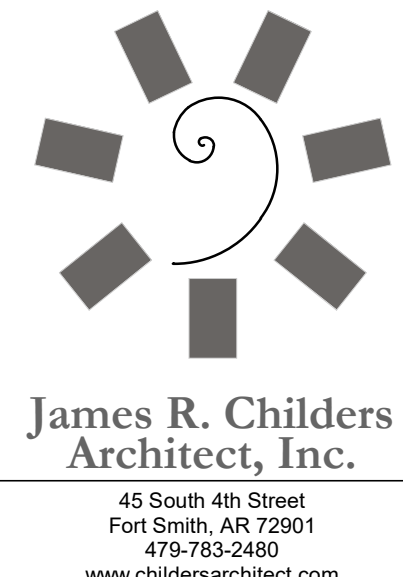

WILMA P. MANKILLER HEALTH CENTER EXPANSION STILLWELL, OKLAHOMA



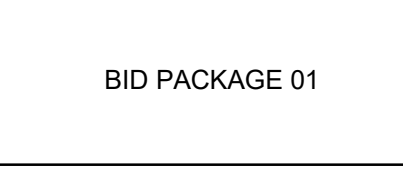


Table with columns for REVISIONS, including Date, Description, and a blank row for further revisions.


Table with columns for DATE and JOB NUMBER, showing 11-01-19 and 18-01.01 respectively.

S0.01

ABBREVIATIONS AND LEGENDS

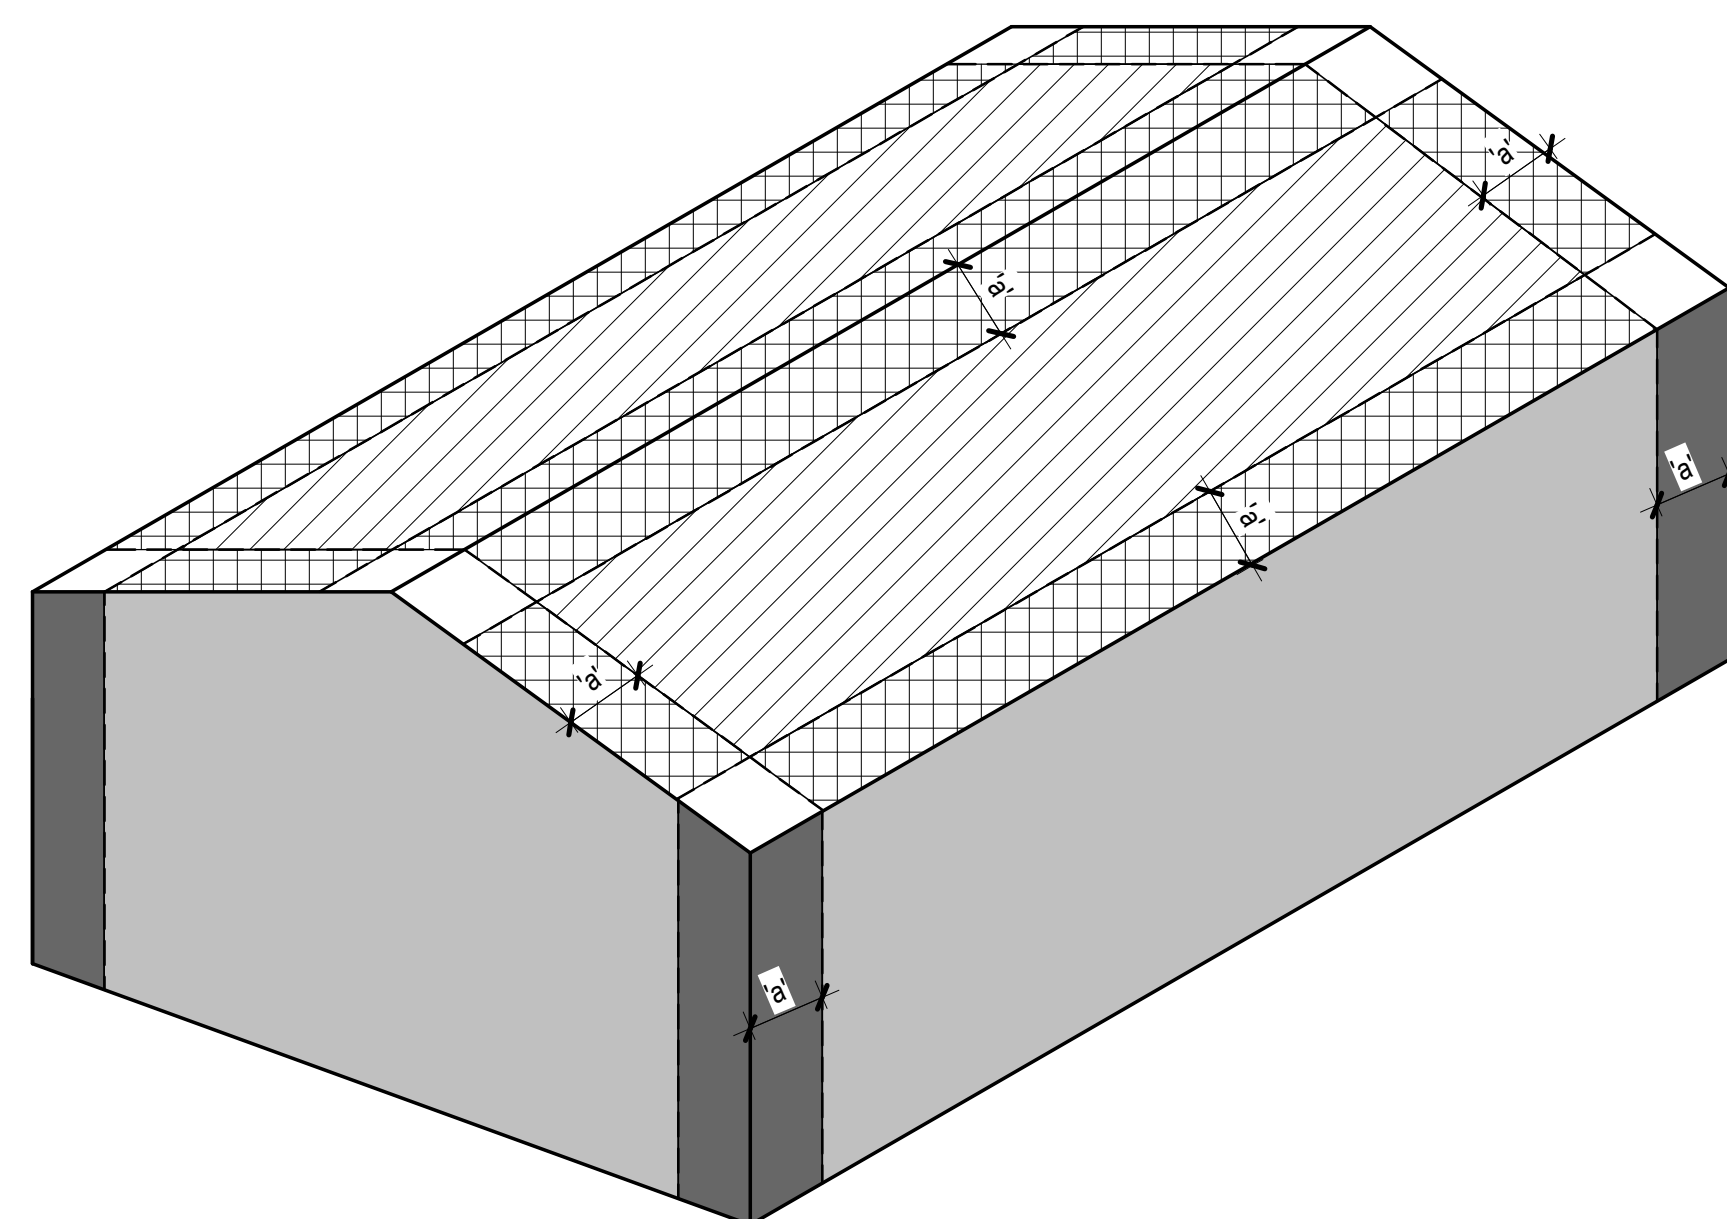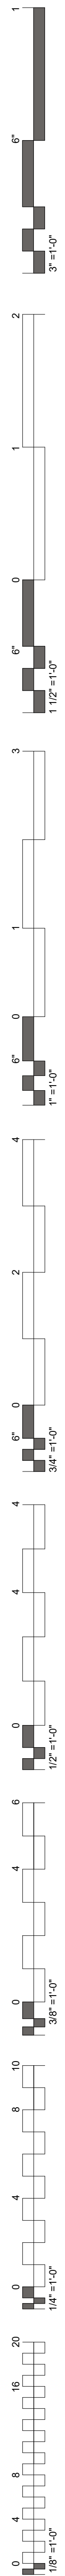

COMPONENTS AND CLADDING WIND PRESSURES (PSF) CALCULATED AT MEAN ROOF HEIGHT = {} FEET			
a = {} FT	EFFECTIVE WIND AREA (FT ²)		
ZONE	10	100	500
1	34.0	32.0	30.6
2	59.1	52.0	47.3
1 AND 2 OVERHANGS	59.1	59.1	59.1
3	87.5	77.0	70.0
3 OVERHANGS	100.7	94.6	90.6
4	40.3	33.5	28.2
4 PARAPETS	96.3	79.9	67.4
5	62.3	51.7	43.6
5 PARAPETS	121.5	100.9	85.1

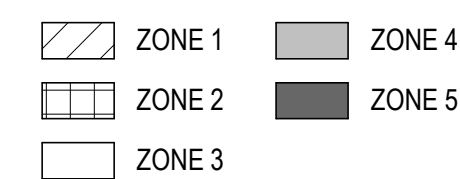

A1 COMPONENT AND CLADDING WIND LOADING DIAGRAM
SCALE: 3/8" = 1'-0"

GENERAL STRUCTURAL NOTES


ELEVATORS:
THE STRUCTURE HAS BEEN DESIGNED FOR A KONE ELEVATOR.
ALL STRUCTURAL SUPPORTS, FLOOR PENETRATION SIZES AND PIT DIMENSIONS HAVE BEEN DESIGNED BASED ON THE ABOVE INFORMATION. SHOULD THE ACTUAL ELEVATOR(S) SELECTED DIFFER FROM THE INFORMATION PROVIDED ABOVE, THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY ADDITIONAL CONSTRUCTION AND REDESIGN COSTS ASSOCIATED WITH THE ALTERNATE ELEVATOR(S).
THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL ELEVATOR PIT AND FLOOR PENETRATION LOCATIONS AND DIMENSIONS.
THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL ELEVATOR OVERRUN REQUIREMENTS.
ELEVATOR CAR RAIL AND COUNTERWEIGHT RAIL SUPPORTS SHALL BE PROVIDED BY THE CONTRACTOR. CAR RAIL AND COUNTERWEIGHT RAIL SUPPORTS SHALL BE PROVIDED AT AND BETWEEN ALL FLOOR LEVELS SERVICED BY THE ELEVATOR, ABOVE THE LAST STOP OF THE ELEVATOR, AND BETWEEN THE BASEMENT AND THE GROUND FLOOR AS REQUIRED BY THE ELEVATOR MANUFACTURER. IF THE ELEVATOR MANUFACTURER REQUIRES RAIL SUPPORTS THAT DIFFER FROM THOSE PROVIDED, THE ELEVATOR MANUFACTURER SHALL BE RESPONSIBLE FOR ADDITIONAL CONSTRUCTION COST AND DESIGN COST.
THE CONTRACTOR SHALL VERIFY THE DESIGN OF THE HOIST/SAFETY BEAM AND CONNECTIONS AS REQUIRED PER THE ELEVATOR MANUFACTURER.
STRUCTURAL ELEMENTS AFFECTED BY THE ELEVATOR LAYOUT SHALL NOT BE FABRICATED PRIOR TO APPROVAL OF ELEVATOR SHOP DRAWINGS.
SPECIAL INSPECTION:
THE OWNER SHALL PROVIDE FOR SERVICES OF A CERTIFIED INSPECTOR (APPROVED BY THE BUILDING OFFICIAL OR THE ENGINEER OF RECORD) IN ACCORDANCE WITH CHAPTER 17 OF THE INTERNATIONAL BUILDING CODE FOR THE SPECIAL INSPECTION ITEMS NOTED ON SHEET S0.03.
DEFERRED SUBMITTALS:
THE DEFERRED SUBMITTALS LISTED BELOW ARE THOSE PORTIONS OF THE DESIGN THAT ARE NOT COMPLETED AT THE TIME OF APPLICATION AND ARE TO BE SUBMITTED TO THE BUILDING OFFICIAL AND APPROVED PRIOR TO THE INSTALLATION OF THOSE ITEMS. THE MANUFACTURER, CONSULTANT, OR CONTRACTOR, AS APPROPRIATE, SHALL PROVIDE SUBMITTALS TO THE ENGINEER OF RECORD FOR REVIEW FOR THE FOLLOWING ITEMS:
SPECIAL STEEL JOISTS
METAL STAIRS
EXTERIOR COLD-FORMED METAL FRAMING
INTERIOR COLD-FORMED METAL FRAMING
TEMPORARY SHORING
HANDRAILS
CURTAIN WALL AND STOREFRONT
AGGREGATE PIERS / STONE COLUMN GROUND IMPROVEMENT
PRECAST CONCRETE COLUMNS AND ASSOCIATED ATTACHMENTS AND ANCHORAGE

SCHEDULE OF STRUCTURAL SPECIAL INSPECTIONS

- SPECIAL INSPECTIONS / TESTING - "SPECIAL STRUCTURAL INSPECTION" SHALL NOT RELIEVE THE OWNER OR THEIR AGENT FROM HAVING THE INSPECTIONS OF THE JURISDICTION BUILDING DEPARTMENT PER SECTION 110 OF THE IBC PERFORMED, BOTH THE JURISDICTION BUILDING DEPARTMENT INSPECTIONS AND "SPECIAL STRUCTURAL INSPECTION" SHALL BE PERFORMED.
- THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING THE JURISDICTION BUILDING OFFICIAL AND SPECIAL INSPECTOR WHEN WORK IS READY FOR INSPECTION.
- REPORTING FOR SPECIAL INSPECTION - SPECIAL INSPECTION AND TESTING REPORTS SHALL BE COMPLETED AND DISTRIBUTED AT THE COMPLETION OF EACH TASK. IF A TASK IS TO TAKE LONGER THAN THREE (3) DAYS, PROVIDE REPORTS FOR EACH DAY. PROVIDE COPIES OF REPORTS TO CONTRACTOR, OWNER, ARCHITECT AND STRUCTURAL ENGINEER OF RECORD. SPECIAL INSPECTOR TO KEEP A NON-COMPLIANCE LIST DOCUMENTING ITEMS INSPECTED NOT MEETING APPROVED CONSTRUCTION DOCUMENTS AND WHEN / HOW RESOLVED.
- SEE ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING CONSTRUCTION DOCUMENTS FOR ADDITIONAL NON-STRUCTURAL SPECIAL INSPECTION ITEMS.
- SPECIAL INSPECTION OF SHOP FABRICATED MEMBERS AND ASSEMBLIES SHALL BE IN ACCORDANCE WITH SECTION 1704.2, UNLESS FABRICATOR IS APPROVED TO PERFORM WORK WITHOUT SPECIAL INSPECTION.
- IN ACCORDANCE WITH IBC CHAPTER 17, THE OWNER OR THE OWNER'S AGENT, OTHER THAN THE CONTRACTOR, SHALL EMPLOY ONE OR MORE APPROVED AGENCIES TO PROVIDE SPECIAL INSPECTIONS AND TESTS, DURING CONSTRUCTION FOR THE TYPES OF WORK LISTED BELOW THESE SPECIAL INSPECTIONS AND TESTS ARE IN ADDITION TO THE INSPECTIONS BY THE BUILDING OFFICIAL IDENTIFIED IN IBC SECTION 110.
- DEFINITIONS:
* **SPECIAL INSPECTION:** INSPECTION AS HEREIN REQUIRED BY A QUALIFIED SPECIAL INSPECTOR COMPETENT WITH THE MATERIALS, INSTALLATION, FABRICATION, ERECTION OR PLACEMENT OF COMPONENTS AND CONNECTIONS REQUIRING SPECIAL EXPERTISE TO ENSURE COMPLIANCE WITH APPROVED CONSTRUCTION DOCUMENTS AND REFERENCED STANDARDS (SEE SECTION 1704).
* **CONTINUOUS SPECIAL INSPECTION:** FULL-TIME OBSERVATION OF WORK REQUIRING SPECIAL INSPECTION BY AN APPROVED SPECIAL INSPECTOR WHO IS PRESENT IN THE AREA WHERE THE WORK IS BEING PERFORMED.
* **PERIODIC SPECIAL INSPECTION:** THE PART-TIME OR INTERMITTENT OBSERVATION OF WORK REQUIRING SPECIAL INSPECTION BY AN APPROVED SPECIAL INSPECTOR WHO IS PRESENT IN THE AREA WHERE THE WORK HAS BEEN OR IS BEING PERFORMED AND AT THE COMPLETION OF THE WORK.

ITEM	DESCRIPTION OF REQUIREMENTS	REQUIRED (YES/NO)
SPECIAL INSPECTION OF STRUCTURAL STEEL	TO BE PERFORMED IN ACCORDANCE WITH CHAPTER N OF AISC 360-10	YES
SPECIAL INSPECTION AND VERIFICATION OF STEEL CONSTRUCTION OTHER THAN STRUCTURAL STEEL	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTION 1705.2	YES
SPECIAL INSPECTIONS AND VERIFICATIONS FOR CONCRETE CONSTRUCTION	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTION 1705.3	YES
SPECIAL INSPECTIONS AND VERIFICATIONS FOR MASONRY CONSTRUCTION	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTION 1705.4 AND REFERENCED STANDARDS	YES
SPECIAL INSPECTIONS AND VERIFICATIONS FOR WOOD CONSTRUCTION	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTION 1705.5	NO
SPECIAL INSPECTIONS AND VERIFICATIONS OF SOILS	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTION 1705.6, THE GEOTECHNICAL REPORT LISTED IN THE GENERAL FOUNDATION NOTES, AND ANY OTHER REQUIREMENTS LISTED IN THE GENERAL FOUNDATION NOTES	YES
SPECIAL INSPECTIONS AND VERIFICATIONS FOR DEEP FOUNDATIONS (DRIVEN PILES, CAST-IN-PLACE, OR HELICAL PILES AS APPLICABLE)	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTIONS 1705.7-1705.9 AS APPLICABLE, THE GEOTECHNICAL REPORT LISTED IN THE GENERAL FOUNDATION NOTES, AND ANY OTHER REQUIREMENTS LISTED IN THE CONSTRUCTION DOCUMENTS	NO
SPECIAL INSPECTIONS FOR WIND RESISTANCE (REQUIRED ONLY FOR V _W = 155MPH OR GREATER IN EXPOSURE CATEGORY B, OR V _W = 142MPH OR GREATER IN EXPOSURE CATEGORY C OR D)	TO BE PERFORMED IN ACCORDANCE WITH IBC SECTION 1705.11	NO
SPECIAL INSPECTIONS AND VERIFICATIONS FOR SEISMIC RESISTANCE (REQUIRED FOR STRUCTURES ASSIGNED TO CATEGORIES C, D, E, OR F)	TO BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE PORTIONS OF IBC SECTIONS 1705.12 AND 1705.13	NO

ADDITIONAL INSPECTIONS REQUIRED PER SIDEPLATE SYSTEMS ON SHEET S8.01

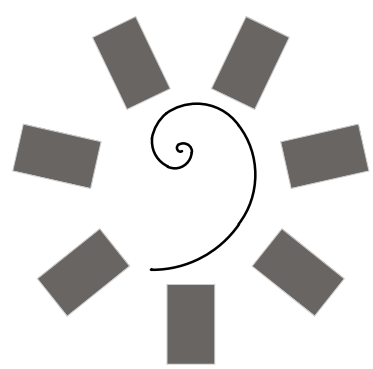

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com



WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA


PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S0.03

GENERAL STRUCTURAL NOTES AND SPECIAL INSPECTIONS

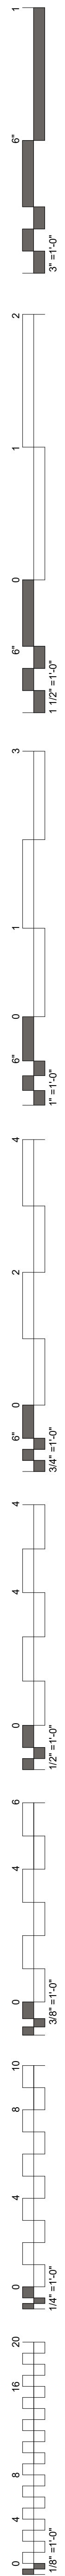

GENERAL STRUCTURAL NOTES

GENERAL:

STRUCTURAL DRAWINGS ARE NOT STAND-ALONE DOCUMENTS AND ARE INTENDED TO BE USED IN CONJUNCTION WITH CIVIL, ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND DRAWINGS FROM OTHER DISCIPLINES. THE CONTRACTOR SHALL COORDINATE ALL REQUIREMENTS OF THE CONTRACT DOCUMENTS INTO THE SHOP DRAWINGS AND FIELD WORK.

COORDINATE DIMENSIONS OF ALL OPENINGS, DEPRESSIONS, BLOCKOUTS, ETC. WITH ARCHITECTURAL DRAWINGS, DRAWINGS FROM OTHER DISCIPLINES, PROJECT SHOP DRAWINGS, AND FIELD CONDITIONS PRIOR TO SHOP DRAWING SUBMITTAL. THE STRUCTURAL DRAWINGS ONLY REPRESENT A PORTION OF THE REQUIREMENTS FOR THE PROJECT.

SEE ARCHITECTURAL PLANS FOR INTERIOR NON-BEARING PARTITION WALLS. PARTITION FRAMING SHALL BE CONNECTED TO THE PRIMARY STRUCTURE TO ALLOW FOR VERTICAL LIVE LOAD DEFLECTIONS OF SPAN/60 FOR FLOOR FRAMING AND SPAN/240 FOR ROOF FRAMING.

CONTRACTOR'S CONSTRUCTION AND/OR ERECTION SEQUENCES SHALL RECOGNIZE AND CONSIDER THE EFFECTS OF THERMAL MOVEMENTS OF STRUCTURAL ELEMENTS DURING THE CONSTRUCTION PERIOD.

THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS IN THE FIELD.

SHOP DRAWINGS SHALL BE FURNISHED AND REVIEWED BEFORE ANY FABRICATION OR ERECTION IS STARTED. THE CONTRACTOR SHALL REVIEW AND APPROVE SHOP DRAWINGS PRIOR TO SUBMITTAL TO THE ARCHITECT FOR REVIEW. POORLY EXECUTED SHOP DRAWINGS WILL BE REJECTED AND SHALL BE RESUBMITTED.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING SAFE AND ADEQUATE SHORING FOR ALL PARTS OF THE STRUCTURE DURING CONSTRUCTION.

TEMPORARY PROVISIONS SHALL BE MADE FOR STRUCTURAL STABILITY DURING CONSTRUCTION. THE STRUCTURE SHOWN ON THE DRAWINGS HAS BEEN DESIGNED FOR STABILITY UNDER FINAL CONFIGURATION.

NOTCHING OR CUTTING ANY STRUCTURAL MEMBER IN THE FIELD IS PROHIBITED.

THE CONTRACTOR SHALL VERIFY THE SIZE AND LOCATION OF FOUNDATIONS UNDER MECHANICAL AND ELECTRICAL EQUIPMENT AS REQUIRED. NO CONCRETE PADS SHALL BE LOCATED ON ROOF UNLESS SHOWN ON THE STRUCTURAL DRAWINGS.

BACKFILL SHALL NOT BE PLACED BEHIND RETAINING WALLS UNTIL CONCRETE HAS ATTAINED 100 PERCENT OF DESIGN STRENGTH.

BACKFILL SHALL NOT BE PLACED BEHIND BASEMENT WALLS UNTIL THE CONCRETE HAS ATTAINED 100 PERCENT OF DESIGN STRENGTH AND THE ELEVATED FLOOR PROVIDING LATERAL SUPPORT AT THE TOP OF THE WALL IS COMPLETELY CONSTRUCTED, OR TEMPORARY BRACING/SHORING OF THE WALL IS PROVIDED. DESIGN OF ANY TEMPORARY WALL BRACING/SHORING IS THE RESPONSIBILITY OF THE CONTRACTOR.

REMOVAL OF FORMS AND SHORING SHALL BE IN ACCORDANCE WITH ACI 347. WHERE CONCRETE MUST SUPPORT SUPERIMPOSED LOADS PRIOR TO ATTAINING THE SPECIFIED DESIGN STRENGTH, RESHORE CONCRETE IN ACCORDANCE WITH ACI 347. RESHORING SHALL NOT BE REMOVED SOONER THAN 28 DAYS FROM THE DATE OF POUR OR UNTIL CONCRETE HAS ATTAINED THE SPECIFIED DESIGN STRENGTH.

THE CONTRACTOR SHALL SUBMIT FOR PRIOR APPROVAL THE END OF FOUR LOCATIONS FOR CONCRETE GRADE BEAMS, CONCRETE COLUMNS, AND CONCRETE BEAMS.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADHERING TO ALL APPLICABLE STANDARDS SET FORTH BY OSHA, INCLUDING THE FOLLOWING REQUIREMENTS FROM STANDARDS - 29 CFR, SECTION 1926, SUBPART R:

A. THE STEEL ERECTION CONTRACTOR SHALL NOT ERECT STEEL UNLESS THEY HAVE RECEIVED WRITTEN NOTIFICATION FROM THE CONTRACTOR THAT THE CONCRETE IN THE FOOTINGS, PIERS AND WALLS OR THE MORTAR IN THE MASONRY PIERS AND WALLS HAS ATTAINED, ON THE BASIS OF AN APPROPRIATE ASTM STANDARD TEST METHOD OF FIELD-CURED SAMPLES, EITHER 75 PERCENT OF THE INTENDED MINIMUM COMPRESSIVE DESIGN STRENGTH OR SUFFICIENT STRENGTH TO SUPPORT THE LOADS IMPOSED DURING STEEL ERECTION. PROVIDE STRUCTURAL ENGINEER A COPY OF WRITTEN NOTIFICATION WHEN IT IS PROVIDED TO THE STEEL ERECTOR.

B. ANCHOR RODS (ANCHOR BOLTS) SHALL NOT BE REPAIRED, REPLACED OR FIELD-MODIFIED WITHOUT THE APPROVAL OF THE PROJECT STRUCTURAL ENGINEER OF RECORD.

PRIOR TO ERECTION OF COLUMNS, THE CONTRACTOR SHALL PROVIDE WRITTEN NOTIFICATION TO THE STEEL ERECTOR IF THERE HAS BEEN ANY REPAIR, REPLACEMENT OR MODIFICATION OF THE ANCHOR RODS (ANCHOR BOLTS).

PROVIDE STRUCTURAL ENGINEER A COPY OF WRITTEN NOTIFICATION WHEN IT IS PROVIDED TO THE STEEL ERECTOR.

C. NO MODIFICATION THAT AFFECTS THE STRENGTH OF A STEEL JOIST OR STEEL JOIST GIRDER SHALL BE MADE WITHOUT THE APPROVAL OF THE PROJECT STRUCTURAL ENGINEER OF RECORD.

D. METAL DECKING HOLES AND OPENINGS SHALL NOT BE CUT UNTIL IMMEDIATELY PRIOR TO BEING PERMANENTLY FILLED WITH THE EQUIPMENT OR STRUCTURE, OR SHALL BE IMMEDIATELY COVERED.

PROTECTION: PROPER PRECAUTIONS SHALL BE TAKEN AT ALL TIMES TO PROTECT VEHICULAR AND PEDESTRIAN TRAFFIC FROM ANY DAMAGE OR INJURY WHICH MAY BE CAUSED, EITHER DIRECTLY OR INDIRECTLY, BY THE WORK INCLUDED ON THESE DRAWINGS. SUCH PRECAUTIONS SHALL INCLUDE THE ERECTION AND MAINTENANCE OF FENCES, BARRICADES, RAILINGS, GUARDS, SIGNS, COVERINGS, LIGHTS, AND OTHER PRECAUTIONS AS MAY BE REQUIRED. IF AT ANY TIME, IN THE OPINION OF THE OWNER OR THE OWNER'S REPRESENTATIVE, PROPER PRECAUTIONS ARE NOT BEING TAKEN TO SECURE THIS PROTECTION, THE CONTRACTOR SHALL AT NO ADDITIONAL COST TO THE OWNER, INSTALL AND MAINTAIN SUCH ADDITIONAL PROTECTION AS MAY BE DIRECTED BY THE OWNER.

POLLUTION CONTROLS: USE WATER SPRINKLING, TEMPORARY ENCLOSURES, AND OTHER SUITABLE METHODS TO LIMIT DUST AND DIRT RISING AND SCATTERING IN THE AIR TO LOWEST PRACTICAL LEVEL. COMPLY WITH GOVERNING REGULATIONS PERTAINING TO ENVIRONMENTAL PROTECTION.

DRAWINGS:

DO NOT SCALE DRAWINGS.

WHERE DISCREPANCIES OCCUR BETWEEN PLANS, DETAILS, GENERAL NOTES, AND SPECIFICATIONS, THE MORE STRINGENT REQUIREMENTS SHALL GOVERN. DETAILS ON DRAWINGS TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS. DETAILS NOTED "TYPICAL" APPLY TO ALL SIMILAR CONDITIONS, WHERE NO SPECIFIC DETAILS ARE SHOWN, CONSTRUCTION SHALL CONFORM TO SIMILAR WORK ELSEWHERE ON THE PROJECT.

DEMOLITION:

NOTCHING OR CUTTING ANY STRUCTURAL MEMBER IN THE FIELD IS PROHIBITED, UNLESS DETAILED OTHERWISE ON THE STRUCTURAL PLANS.

CONTRACTOR SHALL BE RESPONSIBLE FOR ADHERING TO ALL APPLICABLE STANDARDS SET FORTH BY OSHA.

PRIOR TO STARTING DEMOLITION WORK, THE CONTRACTOR SHALL MAKE AN INSPECTION OF ALL SURROUNDING IMPROVEMENTS TO REMAIN, TO DETERMINE AND RECORD THEIR EXISTING PHYSICAL CONDITION.

SHORING AND BRACING: THE CONTRACTOR SHALL FURNISH ALL SHORING, BRACING, AND INCIDENTALS NECESSARY AND REQUIRED FOR THE PROPER SUPPORT AND SAFETY OF ALL MEMBERS AFFECTED BY DEMOLITION WORK.

WHERE DEMOLITION WOULD AFFECT THE STRUCTURAL INTEGRITY OF THE REMAINING STRUCTURE, THE CONTRACTOR SHALL PROVIDE TEMPORARY SUPPORTS. THE CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY FIELD CONDITION WHICH WOULD PRESENT A HAZARDOUS CONDITION TO THE STRUCTURE BEFORE PROCEEDING.

PROTECTION: PROPER PRECAUTIONS SHALL BE TAKEN AT ALL TIMES TO PROTECT VEHICULAR AND PEDESTRIAN TRAFFIC FROM ANY DAMAGE OR INJURY WHICH MAY BE CAUSED, EITHER DIRECTLY OR INDIRECTLY, BY THE WORK INCLUDED ON THESE DRAWINGS. SUCH PRECAUTIONS SHALL INCLUDE THE ERECTION AND MAINTENANCE OF FENCES, BARRICADES, RAILINGS, GUARDS, SIGNS, COVERINGS, LIGHTS, AND OTHER PRECAUTIONS AS MAY BE REQUIRED. IF AT ANY TIME, IN THE OPINION OF THE OWNER OR THE OWNER'S REPRESENTATIVE, PROPER PRECAUTIONS ARE NOT BEING TAKEN TO SECURE THIS PROTECTION, THE CONTRACTOR SHALL AT NO ADDITIONAL COST TO THE OWNER, INSTALL AND MAINTAIN SUCH ADDITIONAL PROTECTION AS MAY BE DIRECTED BY THE OWNER.

POLLUTION CONTROLS: USE WATER SPRINKLING, TEMPORARY ENCLOSURES, AND OTHER SUITABLE METHODS TO LIMIT DUST AND DIRT RISING AND SCATTERING IN THE AIR TO LOWEST PRACTICAL LEVEL. COMPLY WITH GOVERNING REGULATIONS PERTAINING TO ENVIRONMENTAL PROTECTION.


REMOVE DEBRIS FROM THE SITE AS IT ACCUMULATES. UNLESS OTHERWISE NOTED, DO NOT STORE, SELL, BURN, OR OTHERWISE DISPOSE OF DEBRIS ON THE SITE. REMOVAL OF DEBRIS INCLUDES CLEARING OF ALL LOWER LEVELS AND SIMILAR BELOW GRADE STRUCTURES. REMOVE ALL DEBRIS IN SUCH A MANNER AS TO PREVENT SPILLAGE. KEEP ALL PAVEMENTS AND AREAS ADJACENT TO THE SITE CLEAN AND FREE FROM MUD, DIRT, AND DEBRIS AT ALL TIMES.

USE OF EXPLOSIVES: THE CONTRACTOR IS ABSOLUTELY PROHIBITED FROM USING DYNAMITE OR ANY OTHER EXPLOSIVES IN ANY OF THE WORK OR OPERATIONS SHOWN ON THESE PLANS AT THE PROJECT SITE.


DEMOLITION SHALL BE PERFORMED IN A MANNER THAT WILL NOT DAMAGE ADJOINING SURFACES INDICATED TO REMAIN. SURFACES SHALL BE PATCHED, IF REQUIRED, TO PROVIDE A SUITABLE SUBSTRATE FOR NEW CONSTRUCTION.

SPECIFIC DEMOLITION NOTES ARE NOT TO BE CONSIDERED ALL INCLUSIVE OR COMPLETE IN THEMSELVES. CONTRACTOR SHALL PROVIDE ALL DEMOLITION INCIDENTALS TO OR REQUIRED FOR CONSTRUCTION WHETHER SPECIFICALLY NOTED OR NOT.

STRUCTURAL DEMOLITION DRAWINGS SHOW STRUCTURAL DEMOLITION ONLY. SEE ARCHITECTURAL DRAWINGS FOR DEMOLITION OF EXISTING ARCHITECTURAL ELEMENTS.

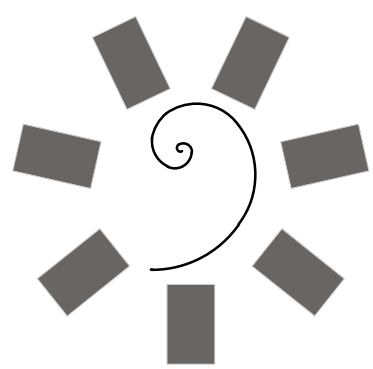

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2460
www.childersarchitect.com

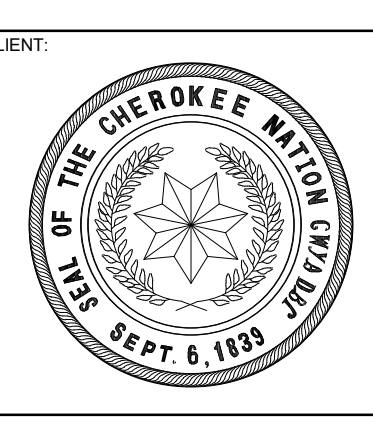

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
 STILWELL, OKLAHOMA

KEY PLAN:

PROJECT PHASE:

BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE:	JOB NUMBER:
11-01-19	18-01.01

SHEET NUMBER:


SD0.01

DEMOLITION GENERAL
STRUCTURAL NOTES

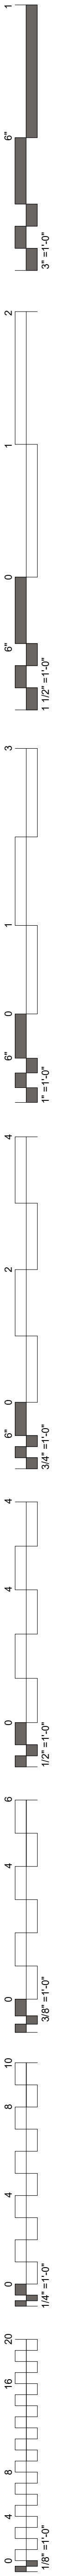


NOTE: CONTRACTOR TO CONFIRM WITH ARCH, PLUMBING AND CIVIL BEFORE REMOVAL OF UNDERGROUND PLUMBING AND UTILITIES. ANY PIPING OR OTHER UNDERGROUND CONDUIT TO BE ABANDONED SHALL BE CONFIRMED WITH THE GEOTECHNICAL ENGINEER FOR REQUIREMENTS TO MEET THE SPECIFIED BEARING STRATA FOR THE NEW STRUCTURAL FOUNDATIONS.

SEE SD0.01 FOR GENERAL DEMOLITION NOTES.

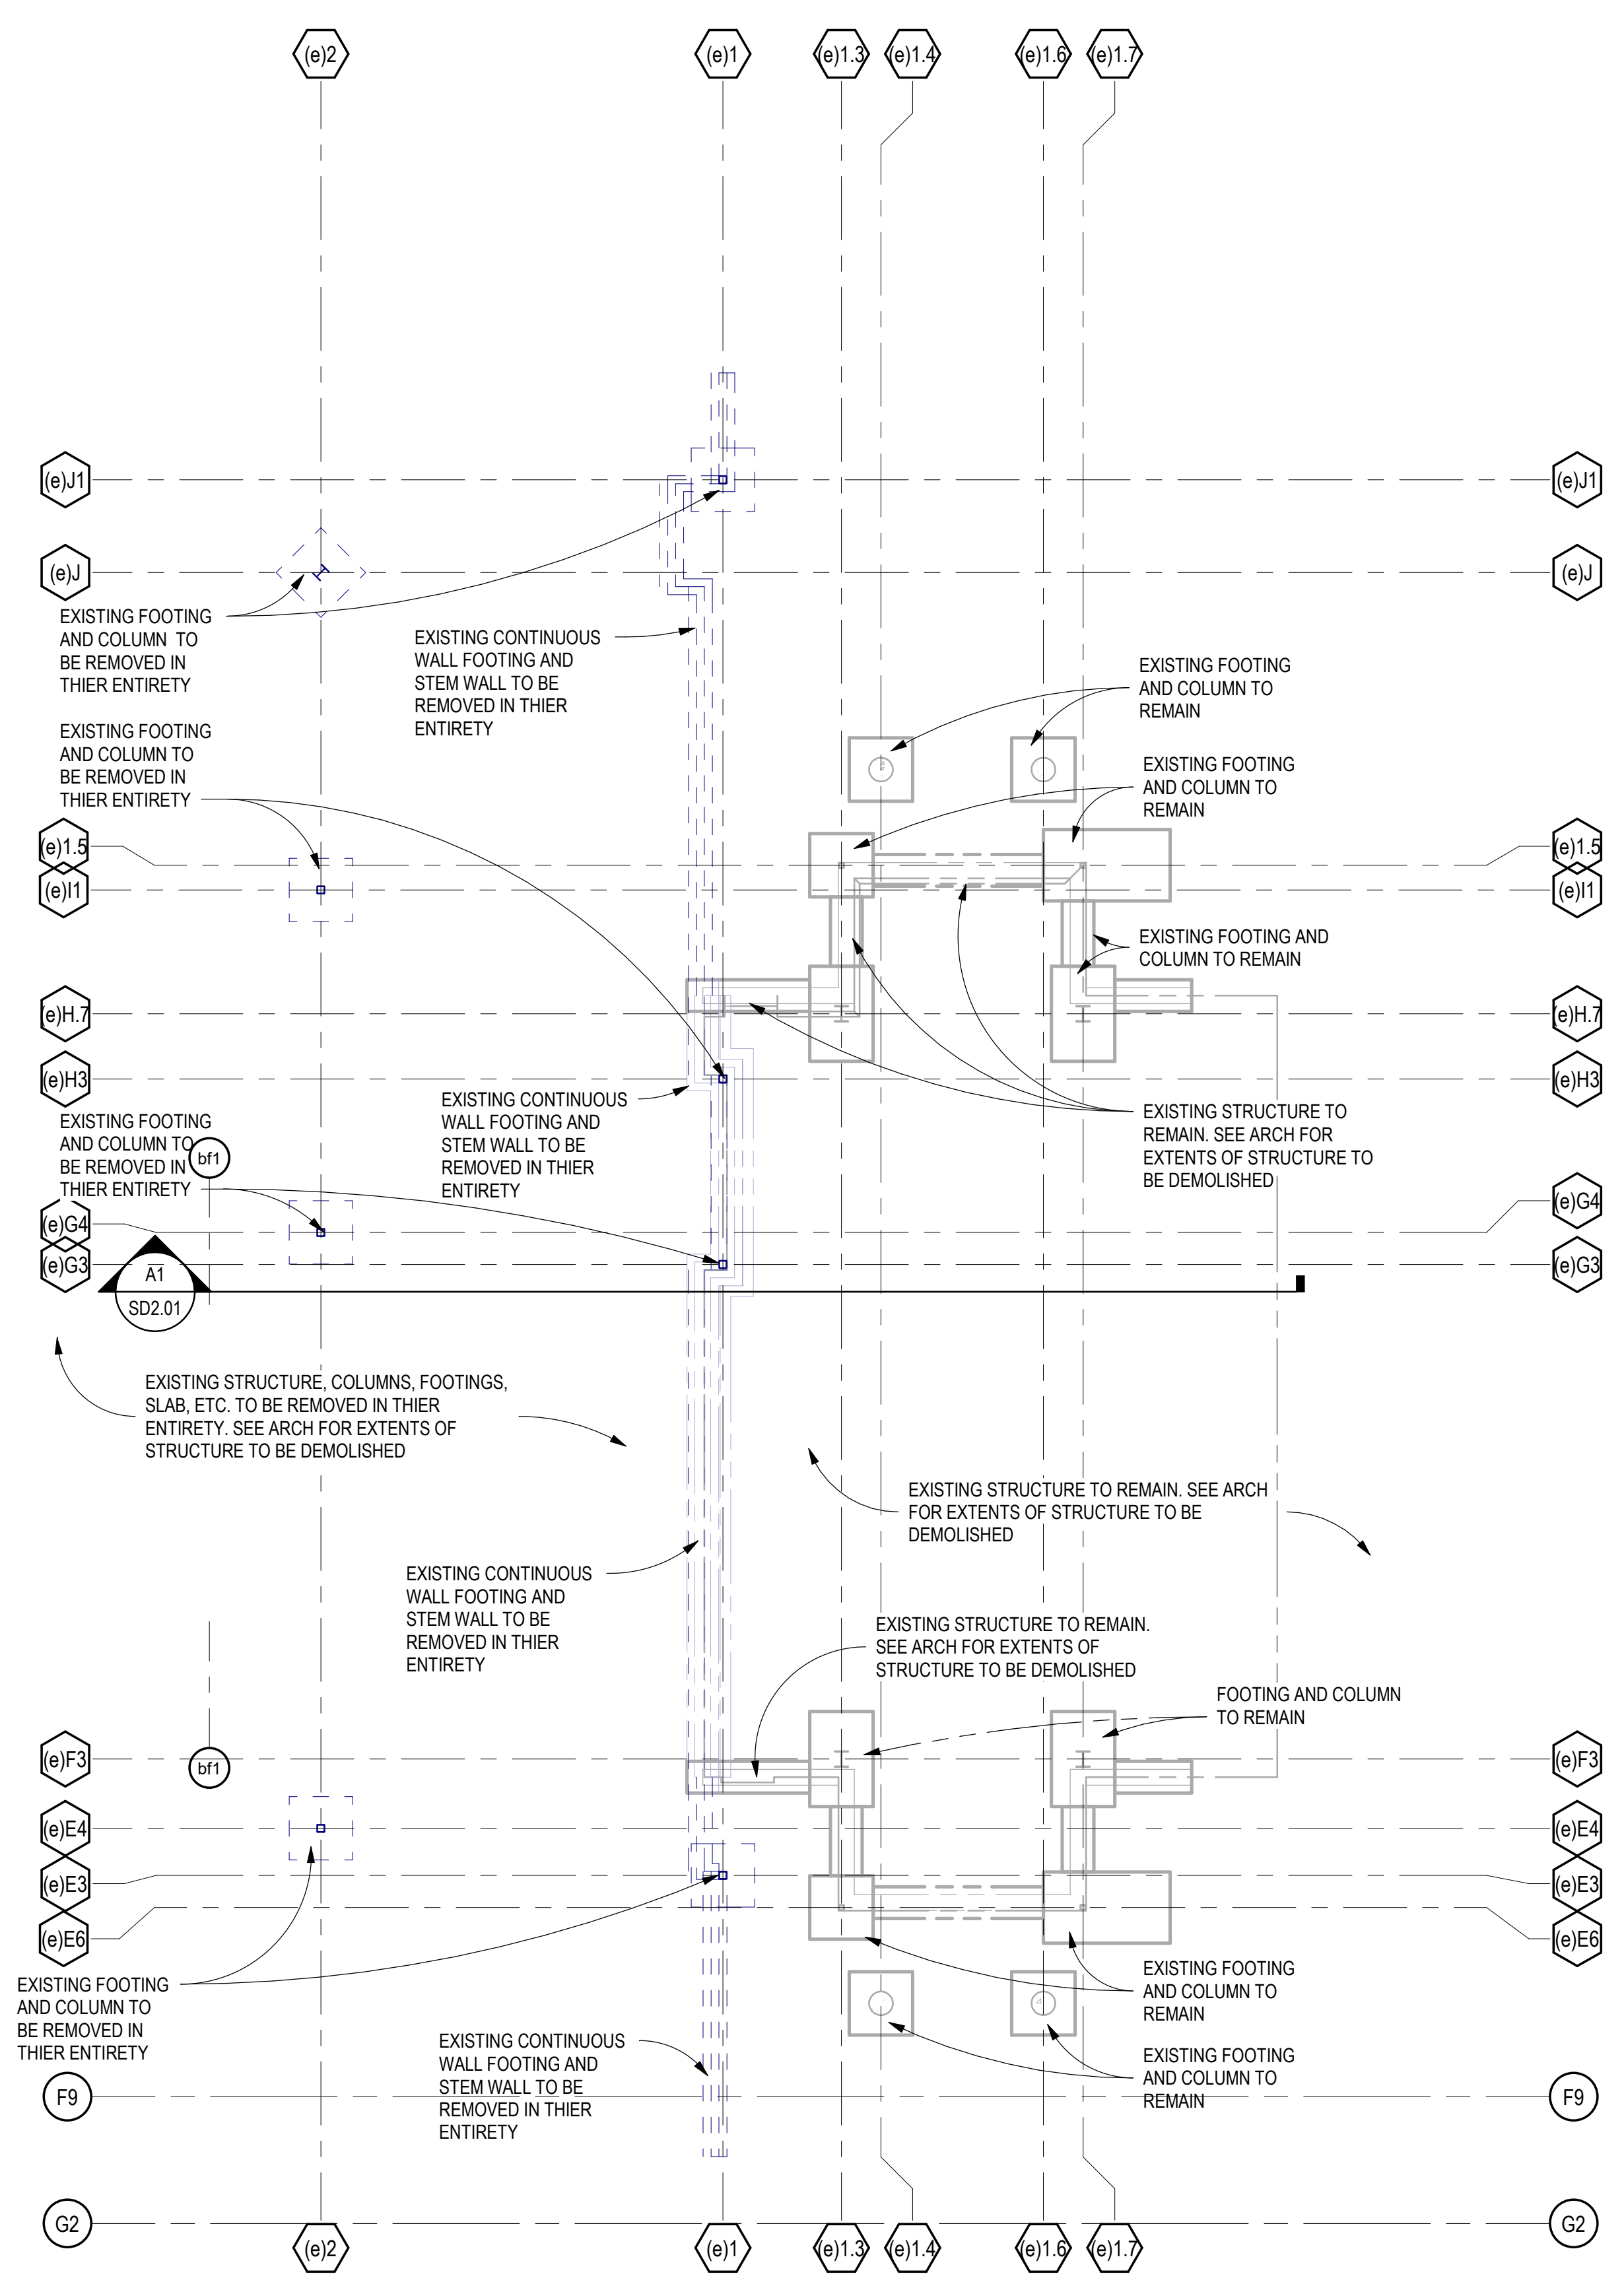

A1 EXISTING FOUNDATION DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

NOTE: CONTRACTOR TO FIELD VERIFY THE LOCATION OF THE EXISTING EXPANSION JOINT.
SEE SD0.01 FOR GENERAL DEMOLITION NOTES.

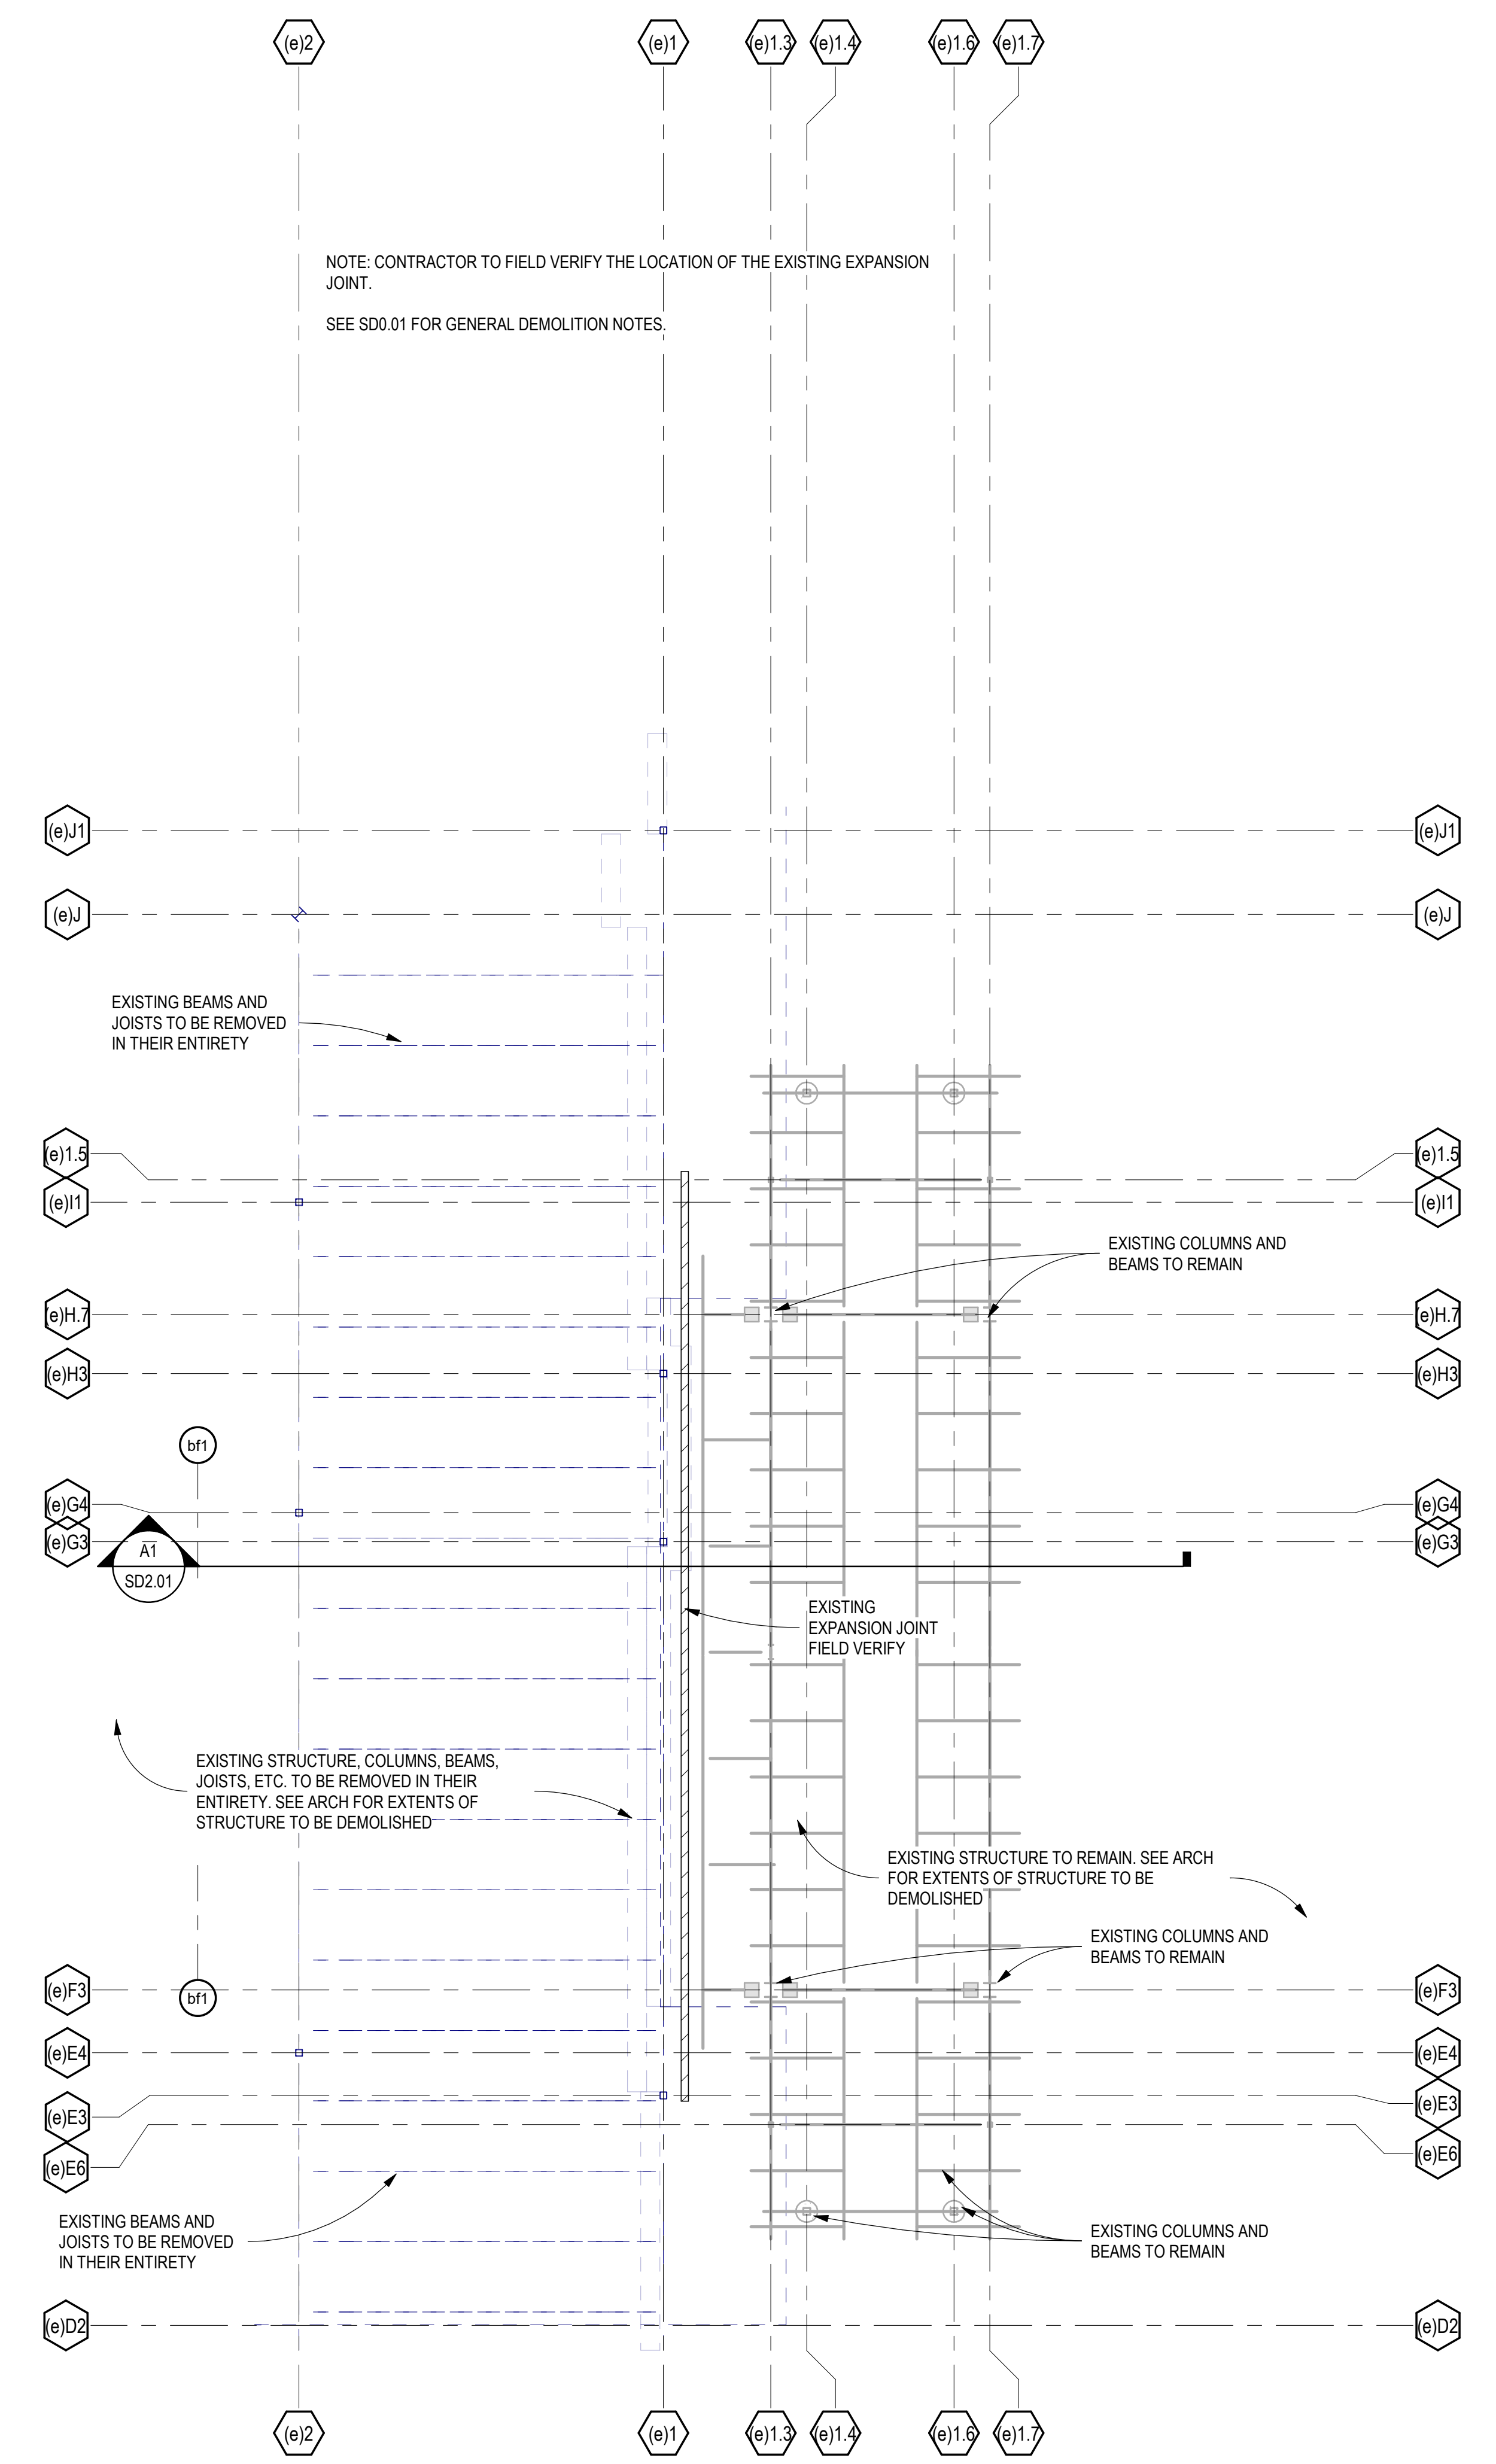

A3 EXISTING ROOF DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

GENERAL SHEET NOTES

- EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTRACT ENGINEER BEFORE PROCEEDING.
- NO STRUCTURAL MEMBERS SHALL BE CUT OR REMOVED UNLESS SPECIFICALLY INDICATED ON THESE DRAWINGS. NOTIFY ARCHITECT AND ENGINEER IF CONDITIONS DIFFER FROM THOSE SHOWN HERE.

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com

PROFESSIONAL SEAL
CHRIS S. ROMBERG
22574
11.01.19

CG
Chavez-Grievens
consulting engineers, inc.
4700 Lincoln Road, Suite 102, Arkadelphia, AR 72001
501-344-4000 501-343-8759 (fax)

CLIENT
THE CHEROKEE NATION
EST. SEPT. 6, 1925

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN



PROJECT PHASE
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
SD1.01

DEMOLITION PLANS -
SECTOR 1

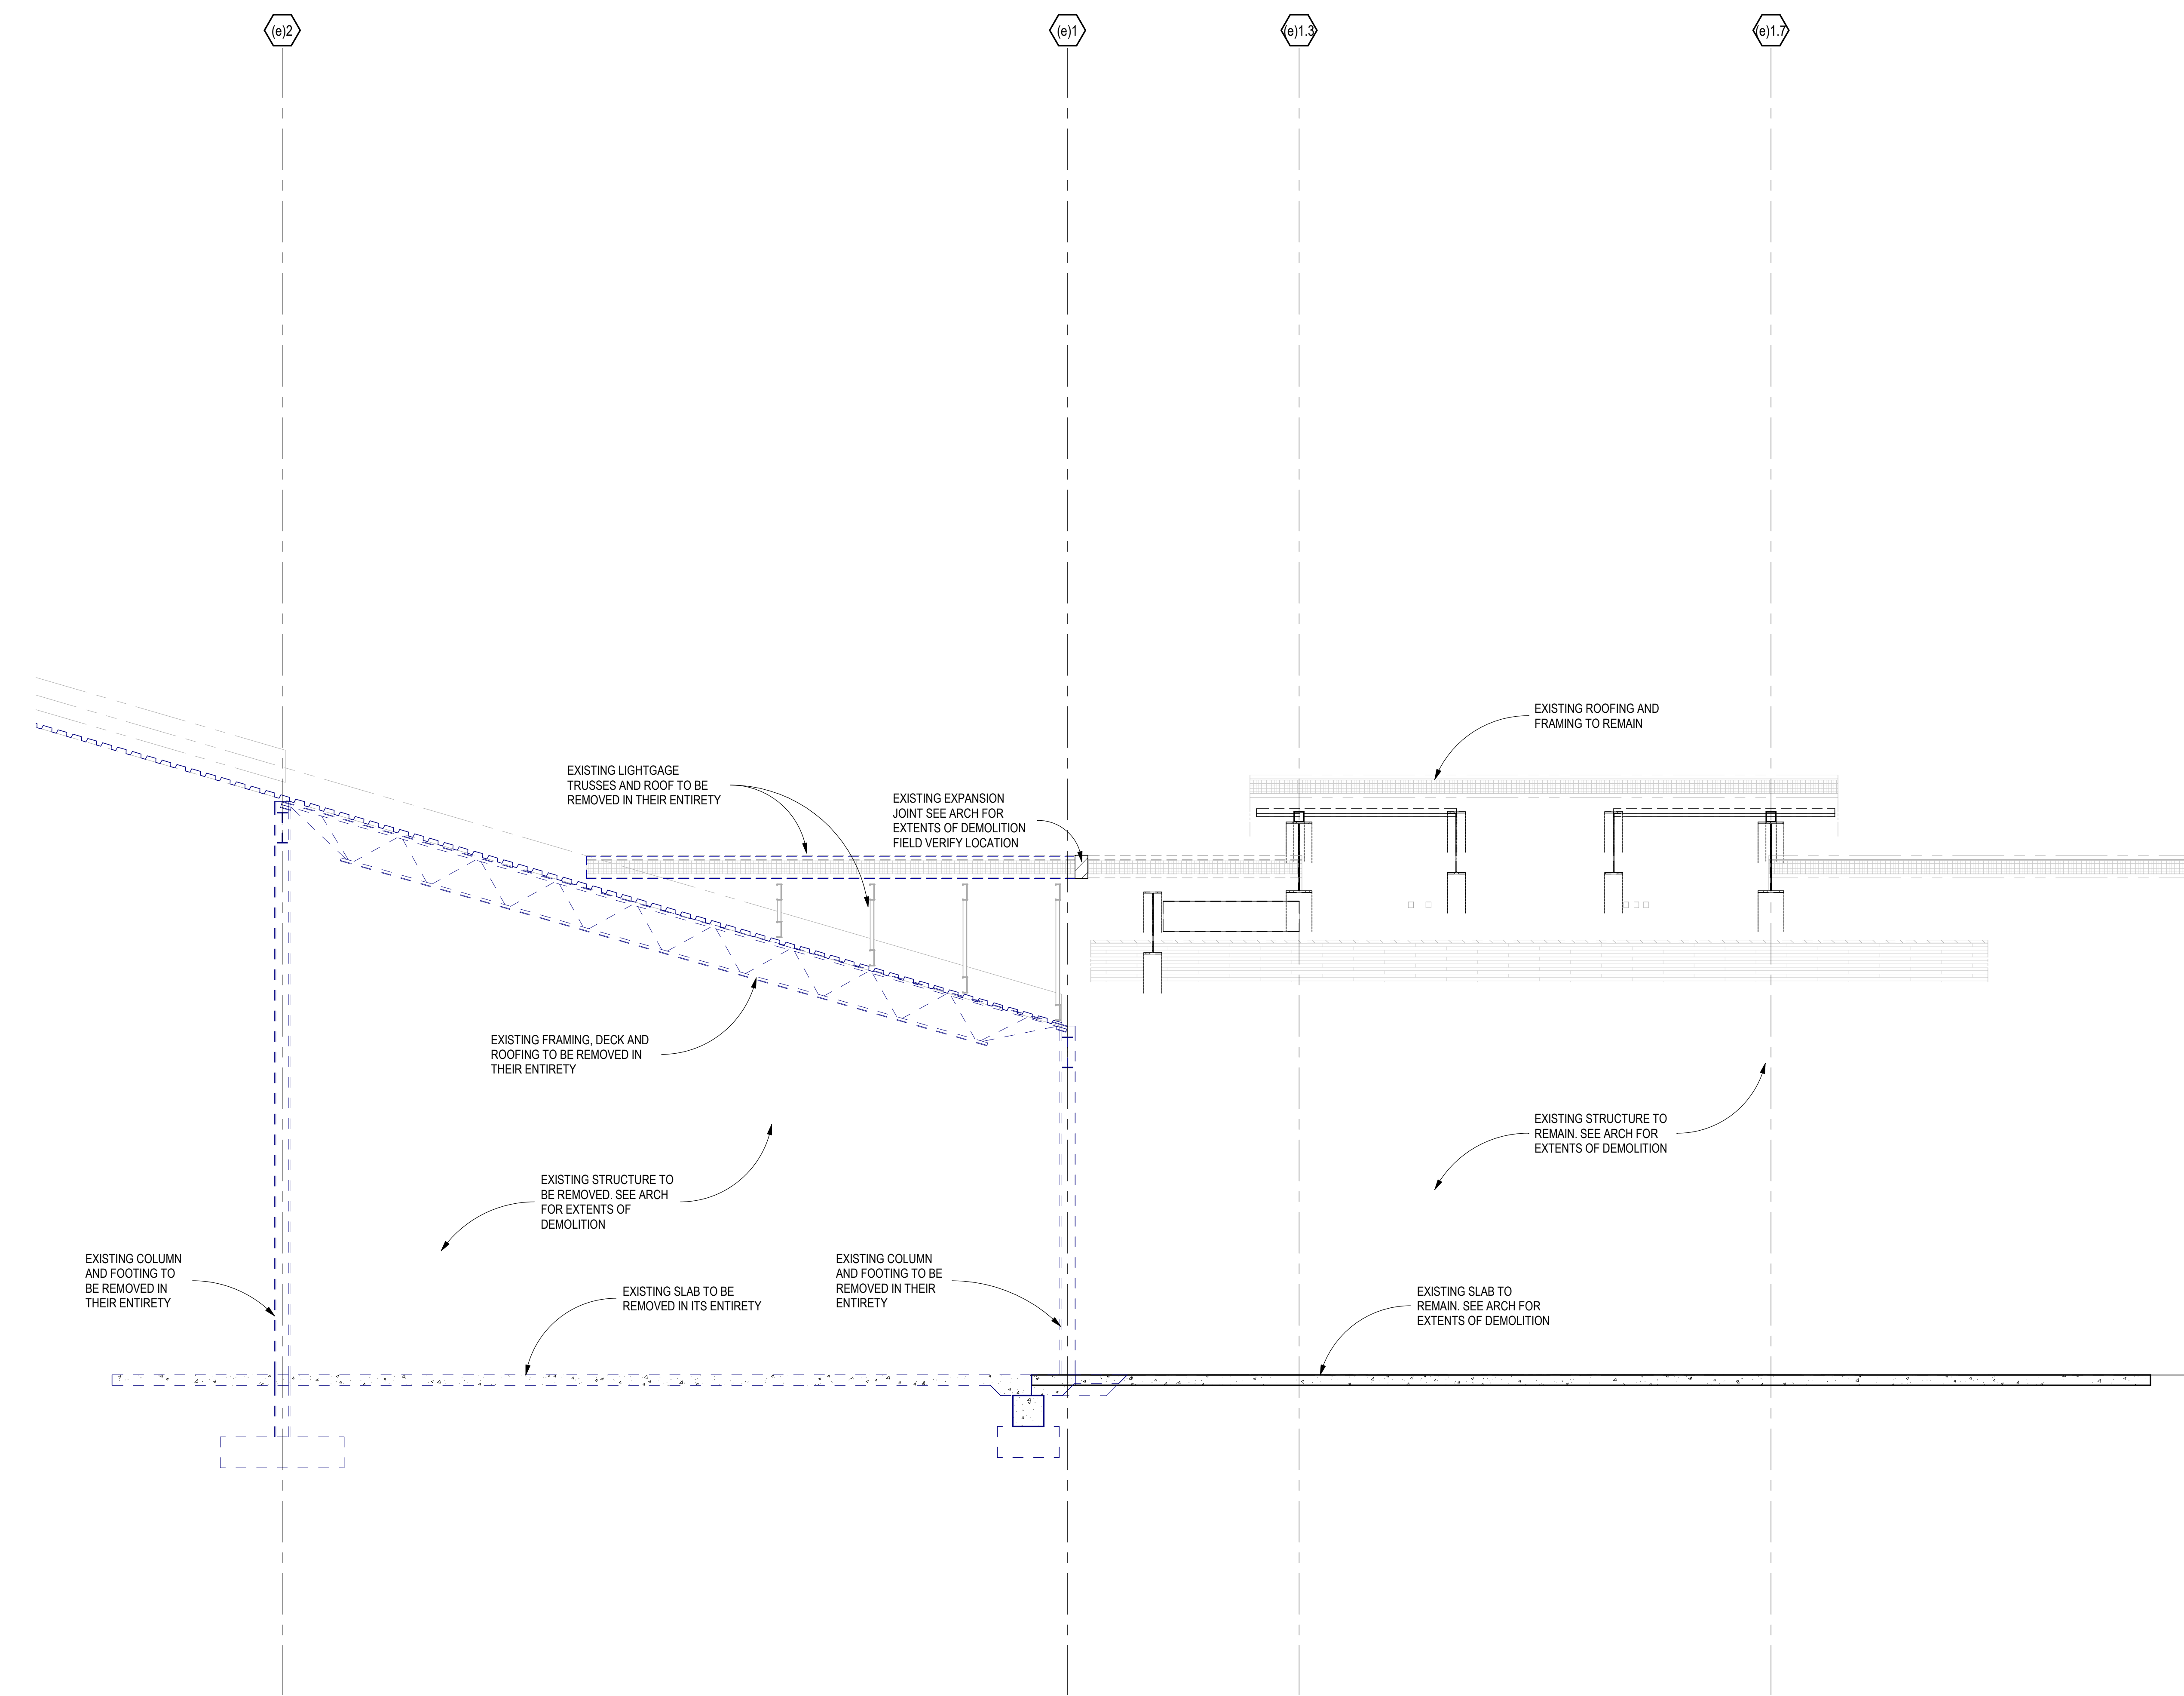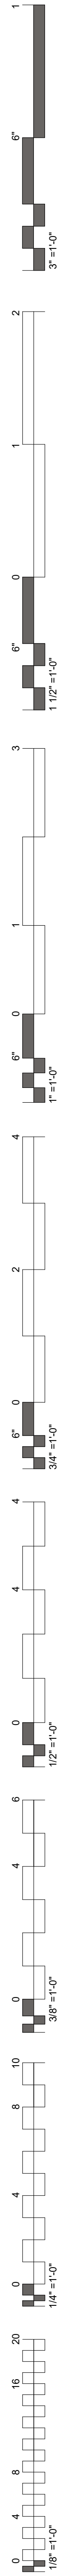

A1 EXISTING DEMOLITION SECTION
SCALE: 3/8" = 1'-0"



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:



PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
SD2.01

DEMOLITION SECTIONS

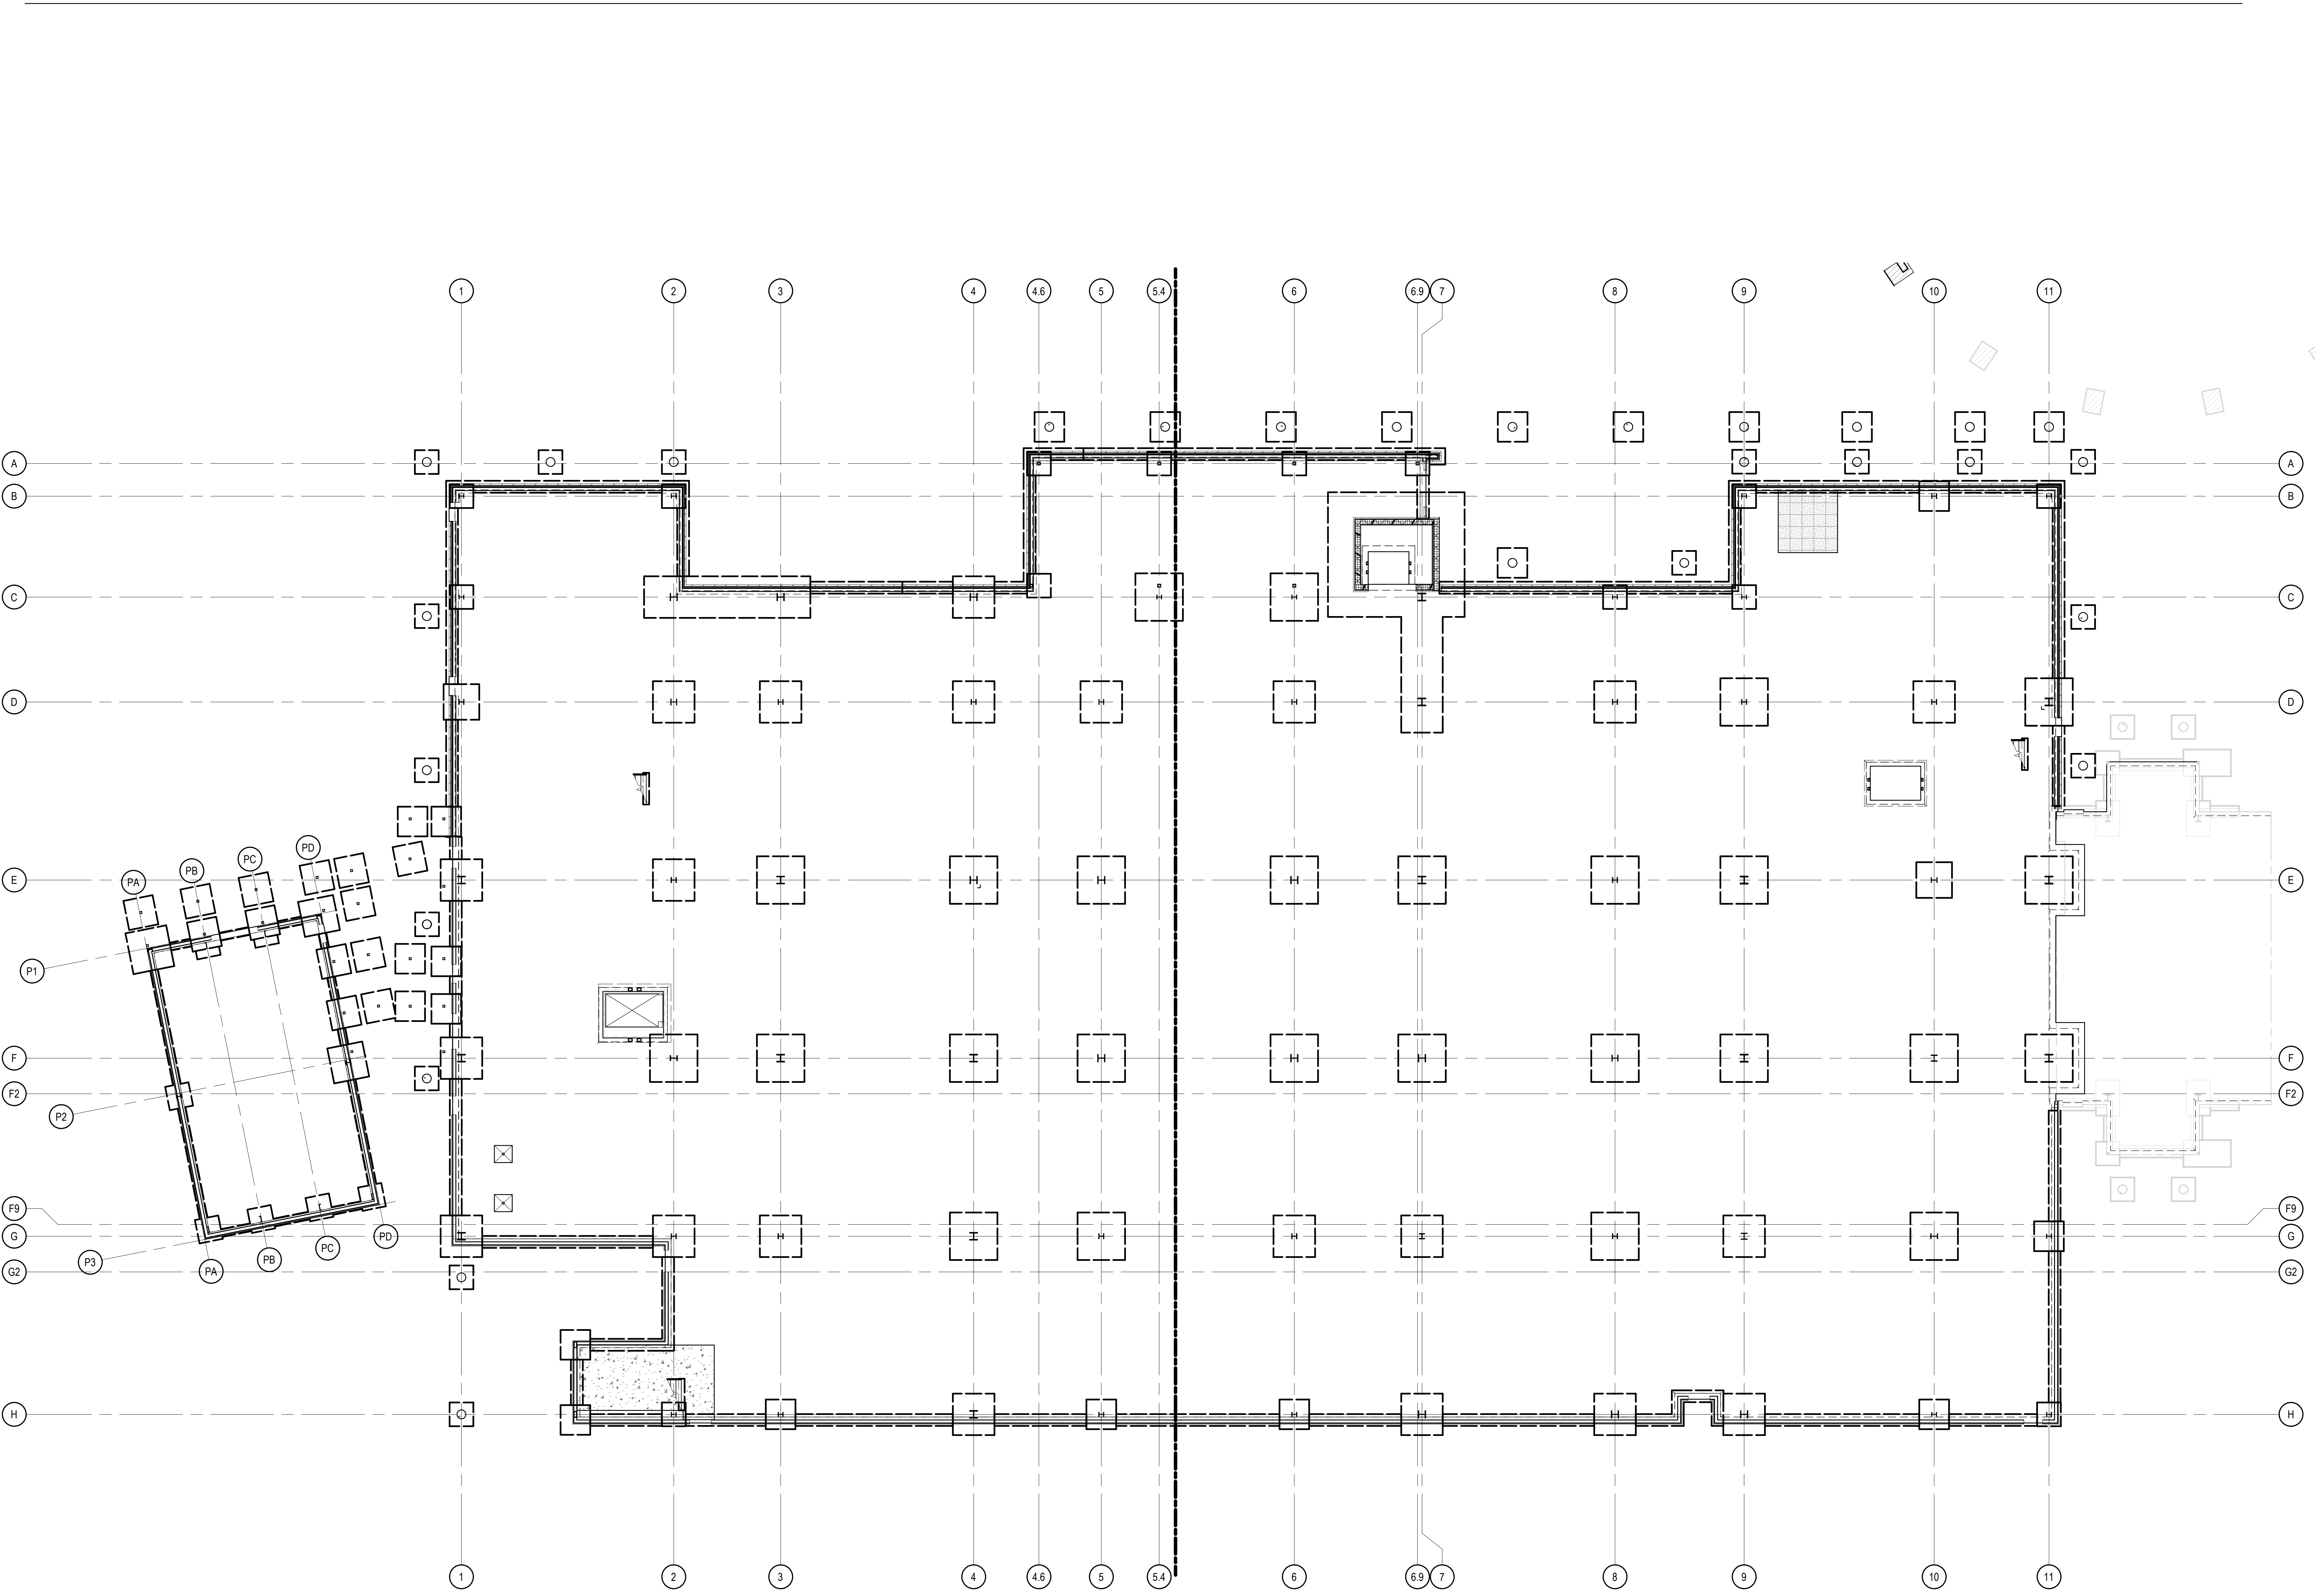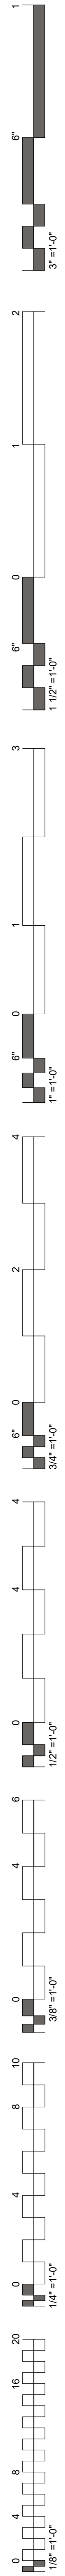

A1 FOUNDATION PLAN - OVERALL
SCALE: 3/32" = 1'-0"

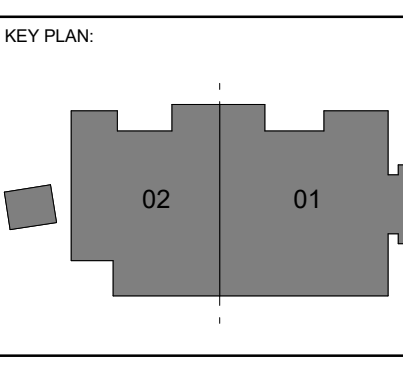


PROJECT PHASE:
 BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S1.00

OVERALL PLAN -
 FOUNDATION

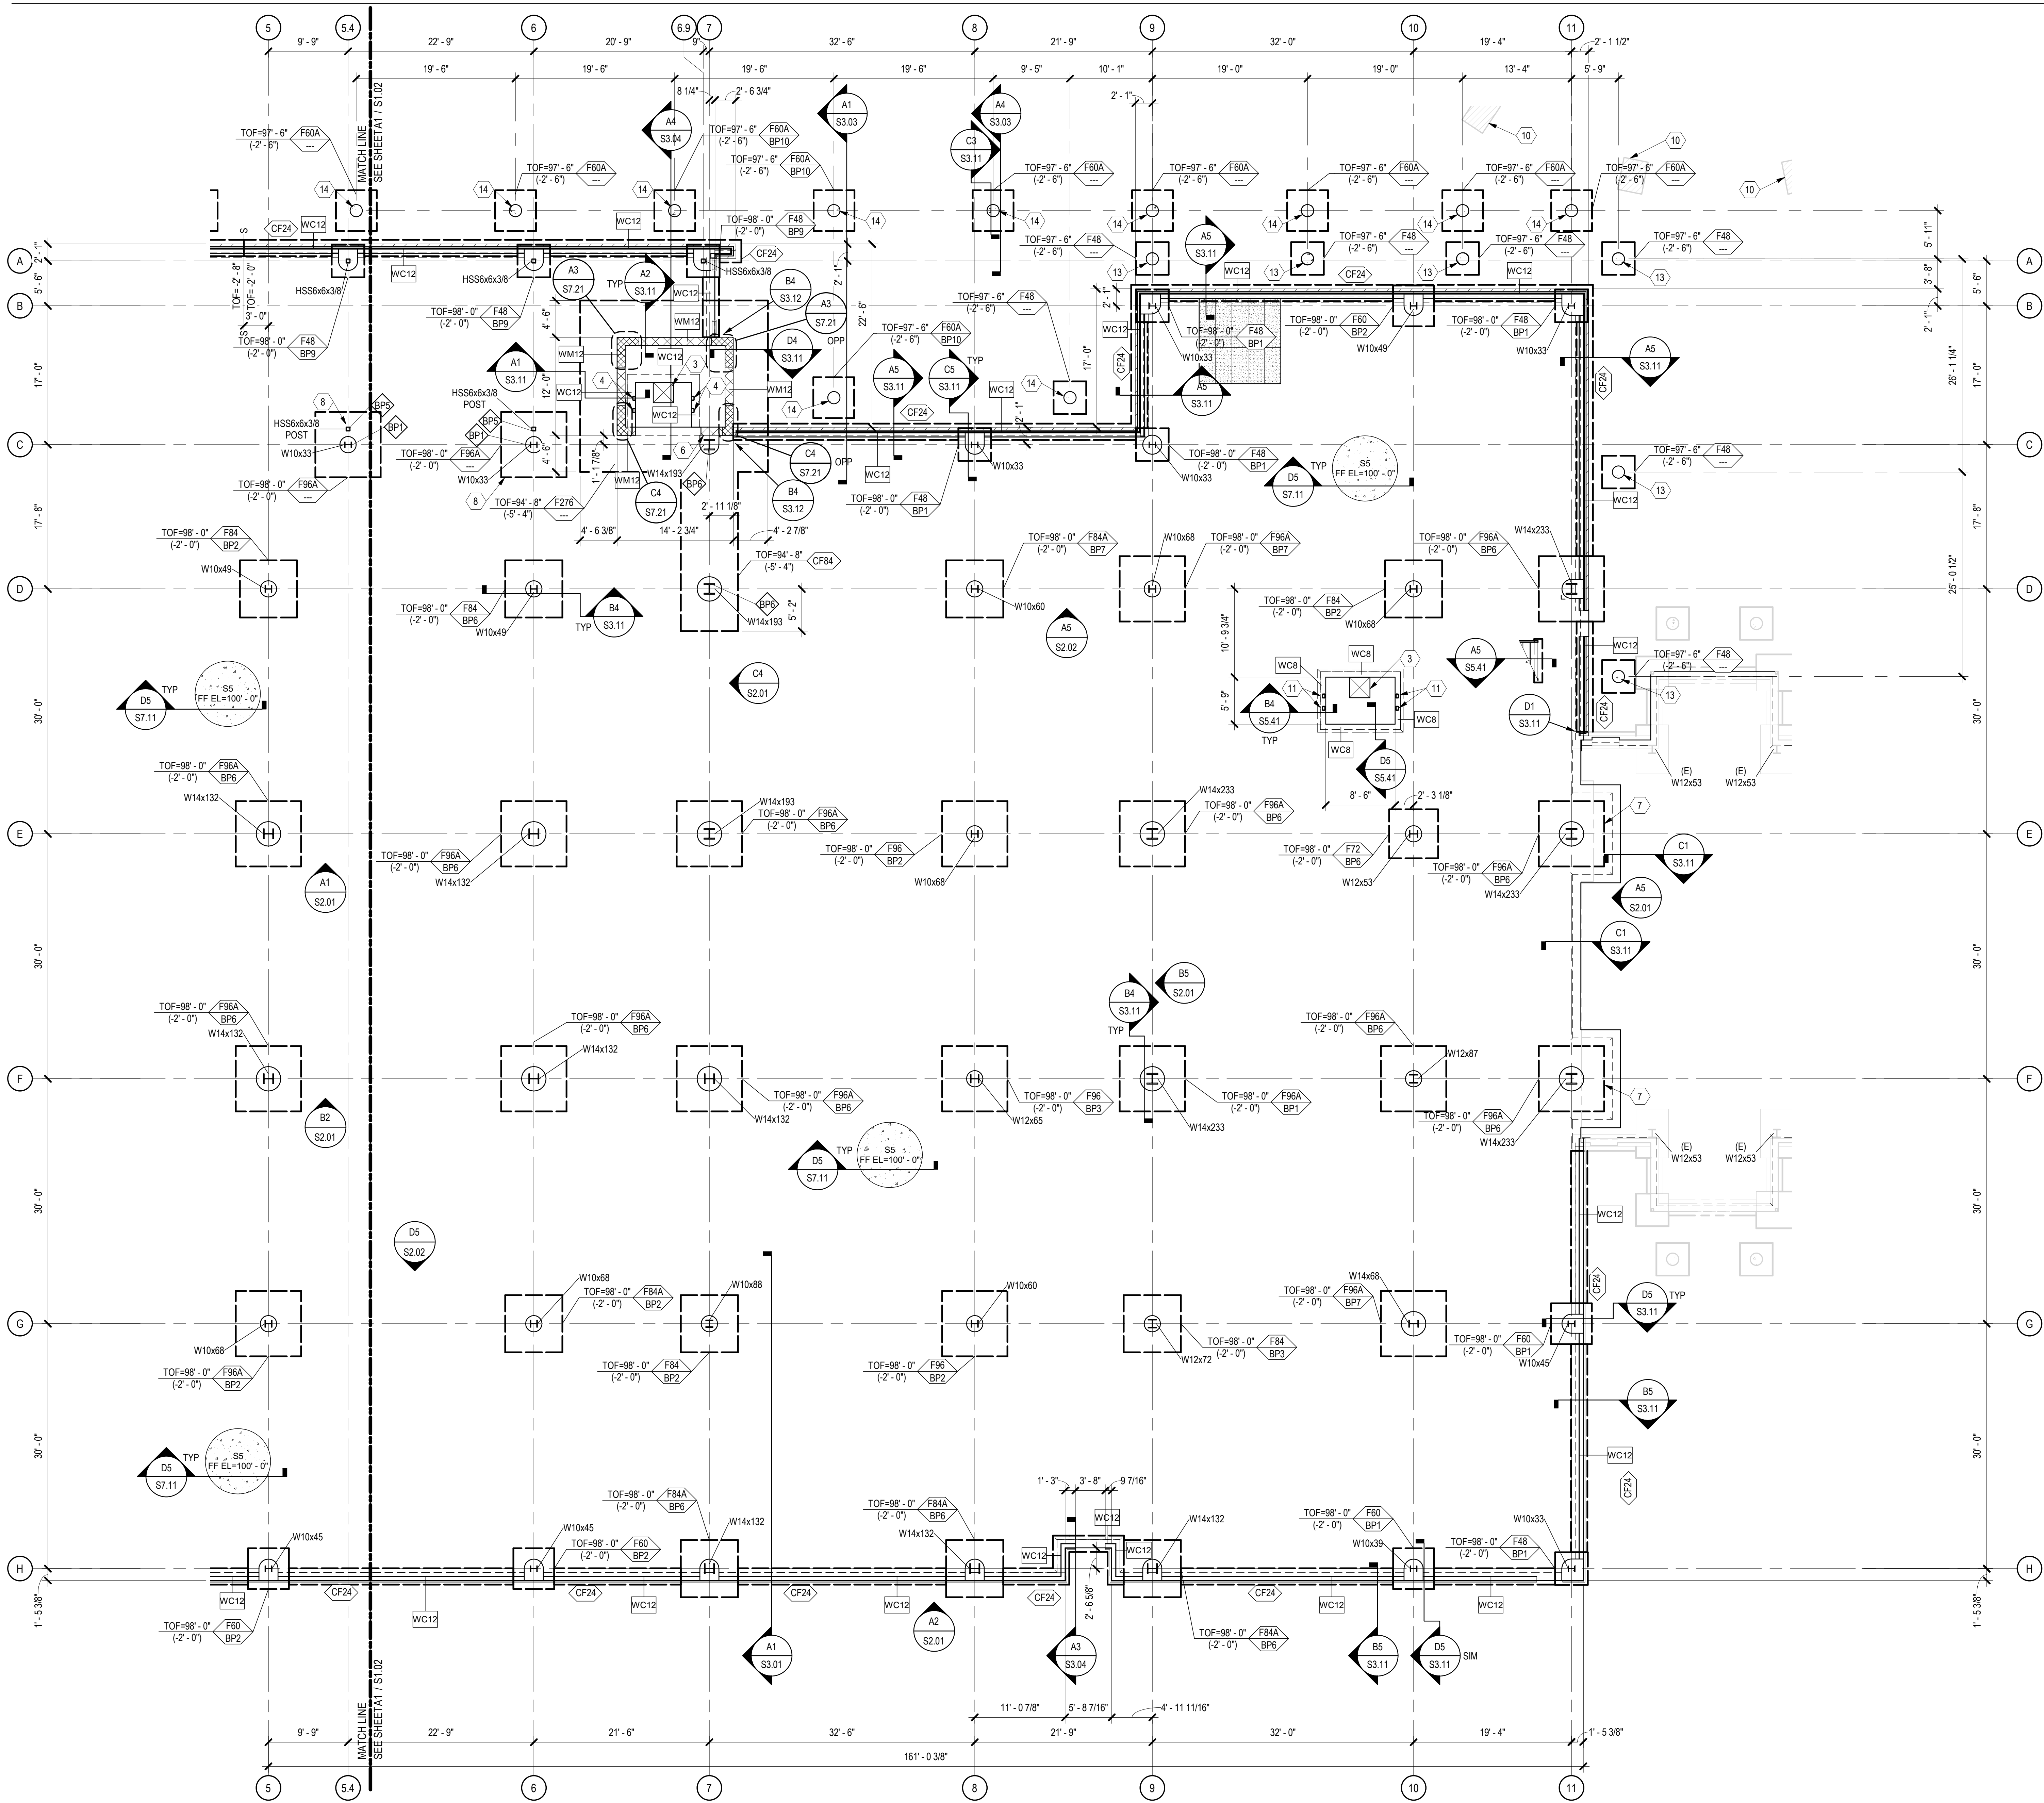

A1 FOUNDATION PLAN - SECTOR 1
SCALE: 1/8" = 1'-0"


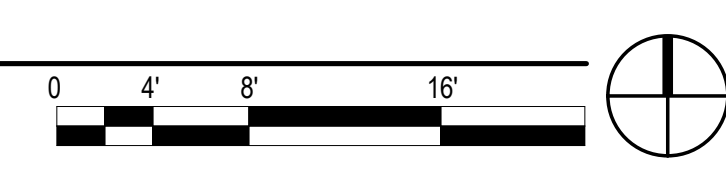


GENERAL SHEET NOTES


- SOME SHEET KEYNOTES MAY NOT APPLY TO THIS SHEET.
- REFERENCE FINISH FLOOR ELEVATION 100'-0" = MEAN SEA FINISH FLOOR ELEVATION. SEE CIVIL DRAWINGS.
- TOP OF FOOTING ELEVATION = 98'-0" (-2'-0"), UNLESS NOTED OTHERWISE ON PLAN.
- NOTE TO CONTRACTOR: ENLARGED SLAB BLOCKOUTS MAY BE REQUIRED AT FRAME COLUMNS FOR MOMENT FRAME BASE PLATE CLEARANCE.
- NOTE TO ERECTOR: LATERAL STABILITY OF THE STEEL FRAME IS DEPENDENT UPON THE MOMENT FRAMES. THE ERECTOR SHALL PROVIDE TEMPORARY BRACING OF THE STEEL FRAME IN ACCORDANCE WITH SECTION 7.10 OF THE AISC CODE OF STANDARD PRACTICES.
- DIMENSIONS ARE TO THE FACE OF STUD UNLESS NOTED OTHERWISE.
- SEE ARCHITECTURAL DRAWINGS FOR MASONRY DIMENSIONS NOT SHOWN.
- EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTACT ENGINEER BEFORE PROCEEDING.
- PROVIDE SLAB JOINTS AT 10'-0" ON CENTER MAXIMUM. THE AREA OF THE CONTROL JOINT SHALL NOT EXCEED A 2:1 RATIO. CONTROL JOINTS SHALL BE LOCATED AT COLUMN LINES WHERE THE LAYOUT PERMITS. AT RE-ENTRANT CORNERS THAT DO NOT HAVE CONTROL JOINTS, PROVIDE 2#4 x 3'-0" DIAGONAL TO THE RE-ENTRANT CORNER.
- STRUCTURAL COLD FORMED METAL STUDS SHALL BE 6" WIDE UNLESS NOTED OTHERWISE. STUD THICKNESS AND SPACING BY OTHERS.
- SEE SHEET S7.00 SERIES SHEETS FOR TYPICAL FOUNDATION SECTIONS AND DETAILS.
- SEE SHEET S6.01 FOR SCHEDULES.

SHEET KEYNOTE

- FLOOR DRAIN: SLOPE SLAB TO DRAIN 1/8" PER FOOT. COORDINATE EXACT SIZE AND LOCATION WITH ARCHITECTURAL AND MECHANICAL DRAWINGS.
- POST AND FOUNDATION AS REQUIRED FOR STAIR SUPPORT. STAIR ENGINEER TO PROVIDE REQUIRED LOADS AND LOCATIONS.
- ELEVATOR SUMP PIT. COORDINATE EXACT SIZE AND LOCATION WITH ELEVATOR MANUFACTURER. SEE A4 / S5.41
- HSS6x4x1/2 ELEVATOR RAIL SUPPORT POST. COORDINATE LOCATION AND SPACING WITH ELEVATOR MANUFACTURER. SEE B4 / S5.41
- PRE-ENGINEERED METAL BUILDING STEEL AND ANCHORAGE BY OTHERS. CONTRACTOR TO CONFIRM LOCATIONS OF FOUNDATIONS WITH FINAL PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS.
- NOTCH MASONRY AS REQUIRED TO FACILITATE BASEPLATE INSTALLATION. STEP BOND BEAM AT THIS LOCATION.
- CUT AND REMOVE EXISTING SLAB AS REQUIRED TO PLACE NEW FOOTING. NEW SLAB TO POUR UP TO REMAINING SLAB.
- CENTER FOOTING ON GRID C.
- F60A PRE-MANUFACTURED SUNSHADE CONCRETE FOOTING. TOP OF FOOTING = 99'-0" (-1'-0"). SEE SHEET S6.01 FOR FOOTING SCHEDULE. COORDINATE FINAL LOCATION WITH SUNSHADE MANUFACTURER.
- EXISTING CANOPY: SEE ARCHITECTURAL DEMOLITION PLANS FOR EXTENT OF DEMOLITION.
- HSS6x6x1/2 ELEVATOR SUPPORT POST. COORDINATE EXACT LOCATION AND SPACING WITH ELEVATOR MANUFACTURER. SEE B4 / S5.41, D3 / S5.41, A2 / S5.41, B2 / S5.41, AND C2 / S5.41
- 1 1/2" RECESSED SLAB AT ADA SHOWER. COORDINATE EXACT SIZE, LOCATION, AND SLOPE REQUIREMENTS WITH ARCHITECTURAL DRAWINGS. SEE C4 / S7.11
- 18" DIAMETER PRECAST CONCRETE COLUMN BY OTHERS.
- 18" DIAMETER PRECAST CONCRETE CANOPY COLUMN BY OTHERS.

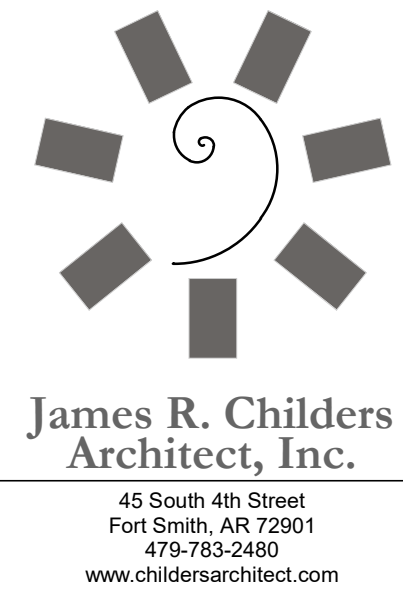

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

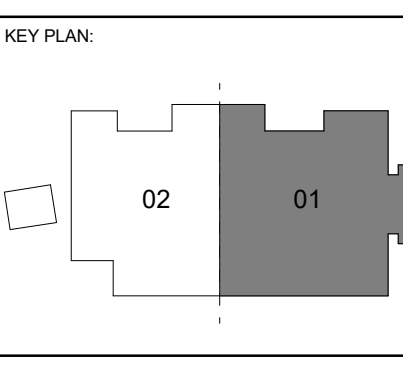


PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01
SHEET NUMBER:

S1.01
FOUNDATION PLAN
SECTOR 1

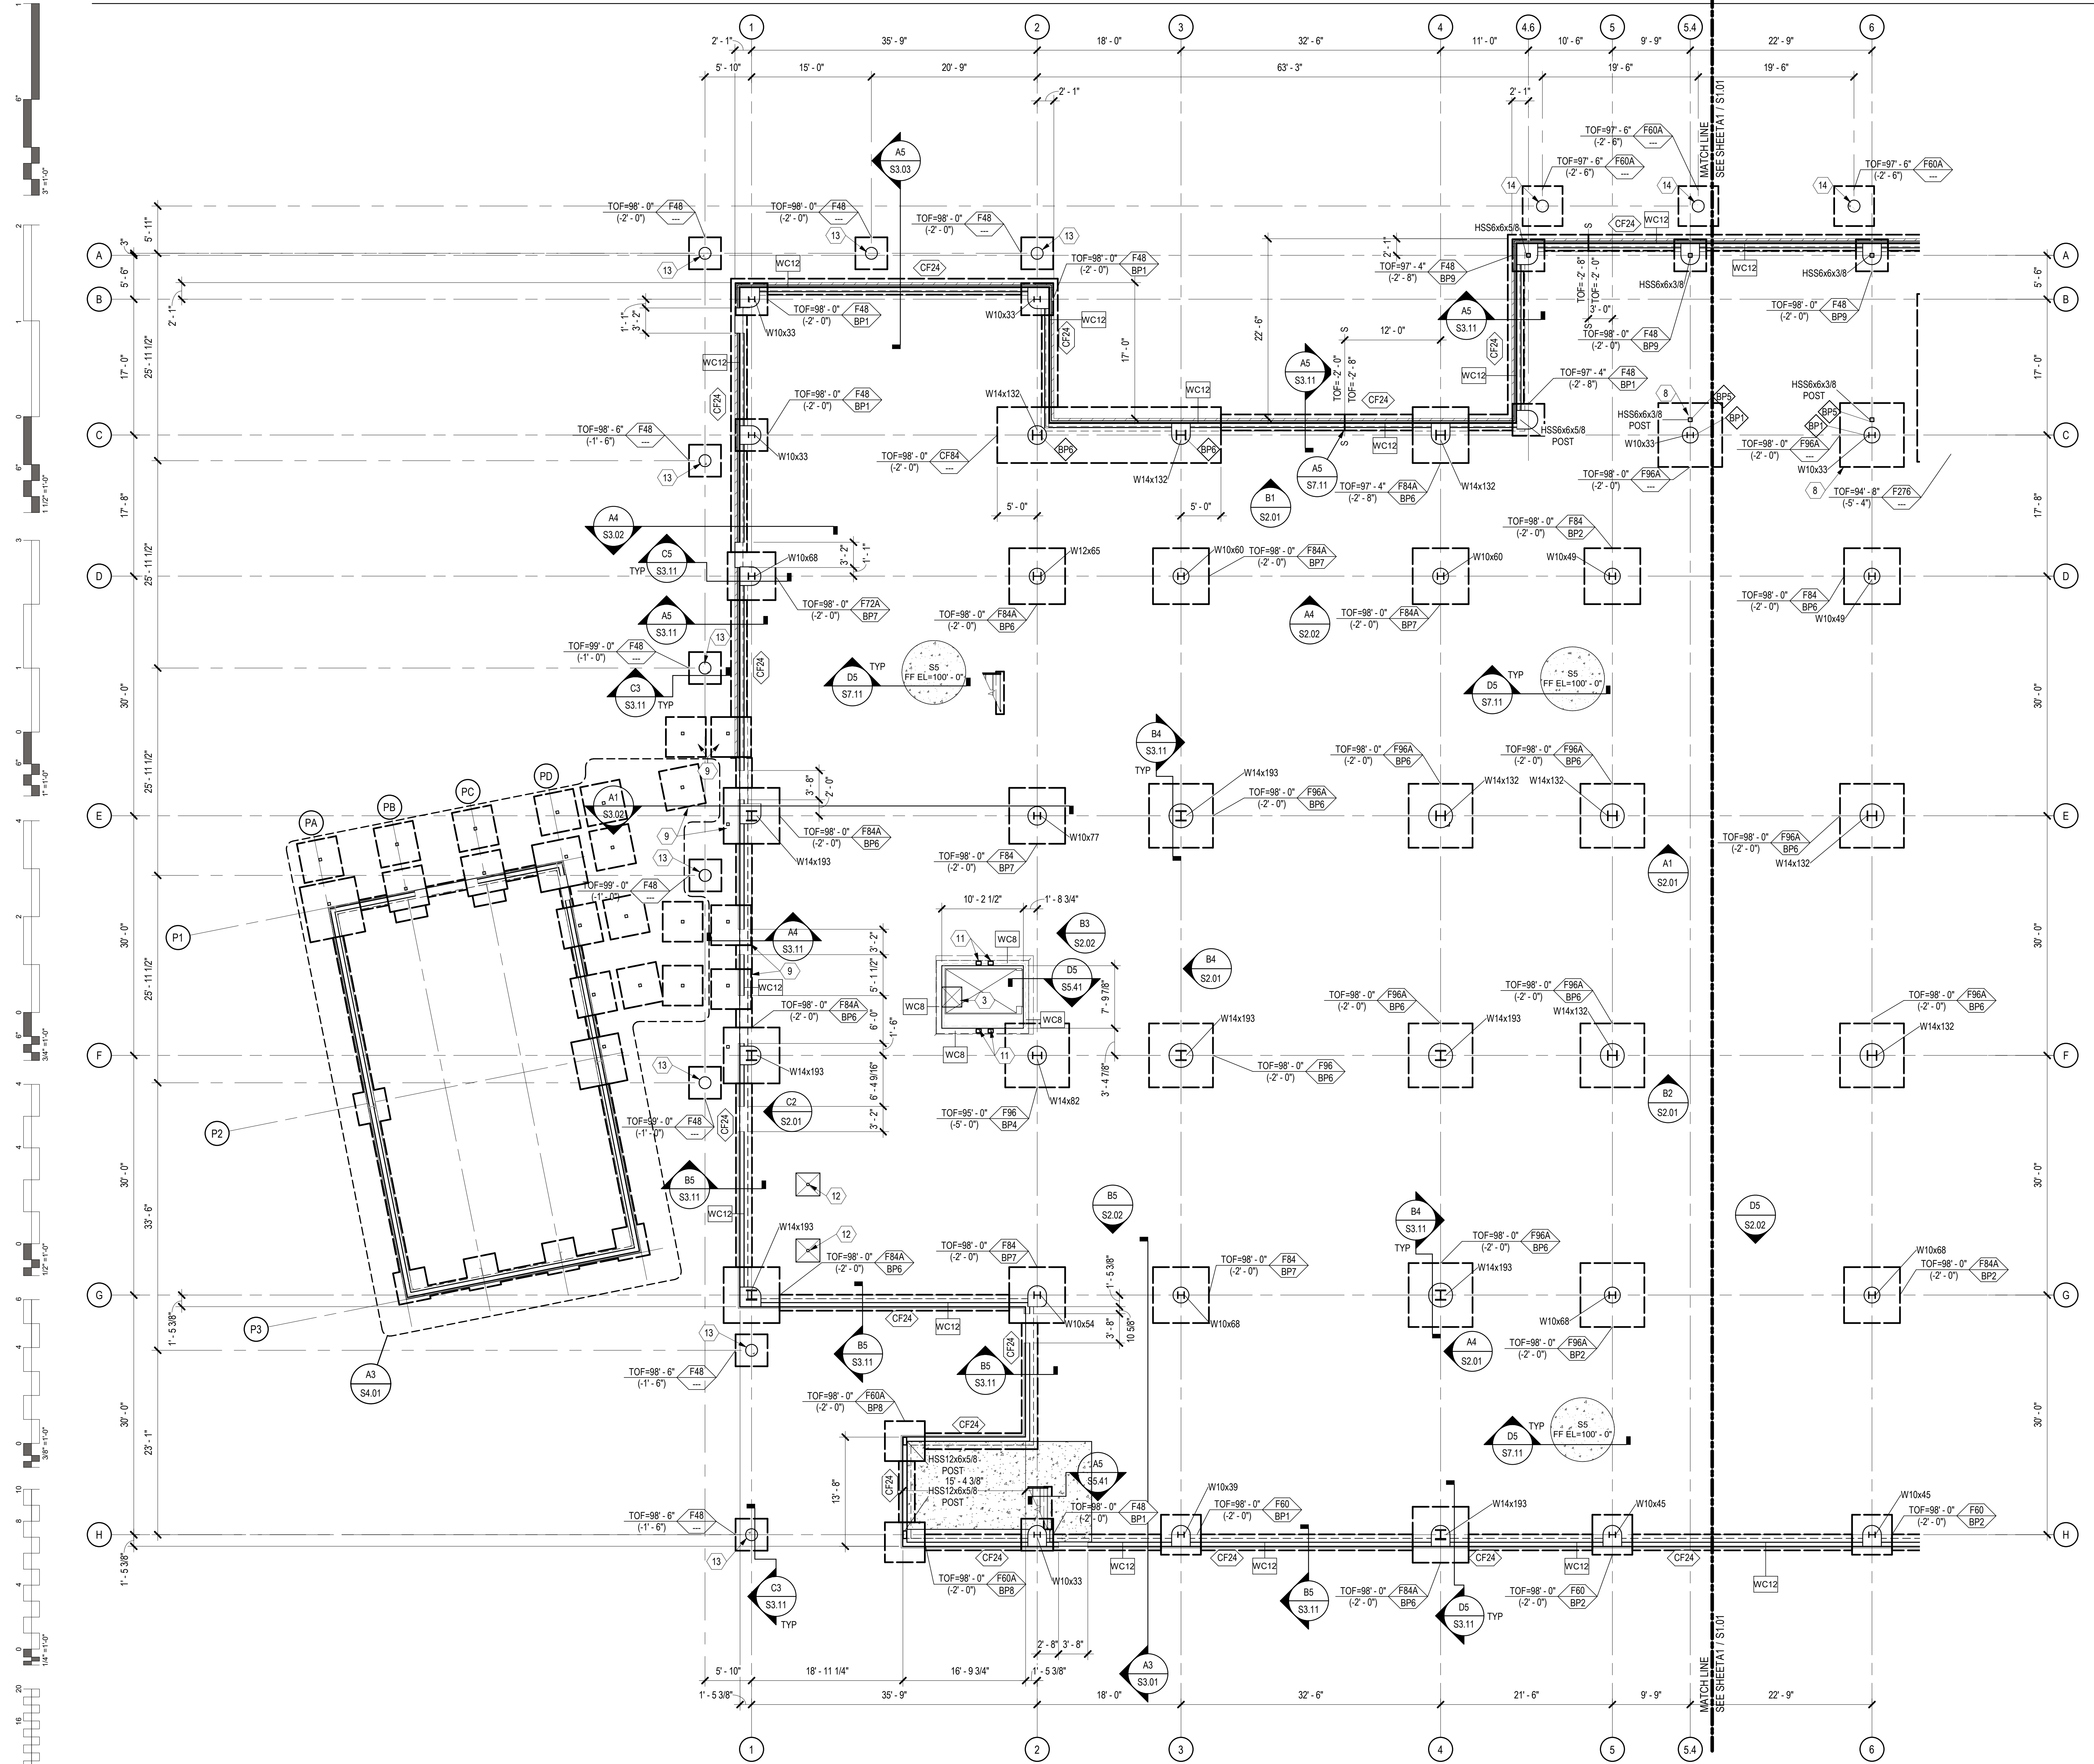



GENERAL SHEET NOTES

- SOME SHEET KEYNOTES MAY NOT APPLY TO THIS SHEET.
- REFERENCE FINISH FLOOR ELEVATION 100'-0" = MEAN SEA FINISH FLOOR ELEVATION. SEE CIVIL DRAWINGS.
- TOP OF FOOTING ELEVATION = 98'-0" (-2'-0"), UNLESS NOTED OTHERWISE ON PLAN.
- NOTE TO CONTRACTOR: ENLARGED SLAB BLOCKOUTS MAY BE REQUIRED AT FRAME COLUMNS FOR MOMENT FRAME BASE PLATE CLEARANCE.
- NOTE TO ERECTOR: LATERAL STABILITY OF THE STEEL FRAME IS DEPENDENT UPON THE MOMENT FRAMES. THE ERECTOR SHALL PROVIDE TEMPORARY BRACING OF THE STEEL FRAME IN ACCORDANCE WITH SECTION 7.10 OF THE AISC CODE OF STANDARD PRACTICES.
- DIMENSIONS ARE TO THE FACE OF STUD UNLESS NOTED OTHERWISE.
- SEE ARCHITECTURAL DRAWINGS FOR MASONRY DIMENSIONS NOT SHOWN.
- EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTACT ENGINEER BEFORE PROCEEDING.
- PROVIDE SLAB JOINTS AT 10'-0" ON CENTER MAXIMUM. THE AREA OF THE CONTROL JOINT SHALL NOT EXCEED A 2:1 RATIO. CONTROL JOINTS SHALL BE LOCATED AT COLUMN LINES WHERE THE LAYOUT PERMITS. AT RE-ENTRANT CORNERS THAT DO NOT HAVE CONTROL JOINTS, PROVIDE 2#4 x 3'-0" DIAGONAL TO THE RE-ENTRANT CORNER.
- STRUCTURAL COLD FORMED METAL STUDS SHALL BE 6" WIDE UNLESS NOTED OTHERWISE. STUD THICKNESS AND SPACING BY OTHERS.
- SEE SHEET S7.00 SERIES SHEETS FOR TYPICAL FOUNDATION SECTIONS AND DETAILS.
- SEE SHEET S6.01 FOR SCHEDULES.


SHEET KEYNOTE

- FLOOR DRAIN, SLOPE SLAB TO DRAIN 1/8" PER FOOT. COORDINATE EXACT SIZE AND LOCATION WITH ARCHITECTURAL AND MECHANICAL DRAWINGS.
- POST AND FOUNDATION AS REQUIRED FOR STAIR SUPPORT. STAIR ENGINEER TO PROVIDE REQUIRED LOADS AND LOCATIONS.
- ELEVATOR SUMP PIT. COORDINATE EXACT SIZE AND LOCATION WITH ELEVATOR MANUFACTURER. SEE A4 / S5.41
- HSS6x4x1/2 ELEVATOR RAIL SUPPORT POST. COORDINATE LOCATION AND SPACING WITH ELEVATOR MANUFACTURER. SEE B4 / S5.41
- PRE-ENGINEERED METAL BUILDING STEEL AND ANCHORAGE BY OTHERS. CONTRACTOR TO CONFIRM LOCATIONS OF FOUNDATIONS WITH FINAL PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS.
- NOTCH MASONRY AS REQUIRED TO FACILITATE BASEPLATE INSTALLATION. STEP BOND BEAM AT THIS LOCATION.
- CUT AND REMOVE EXISTING SLAB AS REQUIRED TO PLACE NEW FOOTING. NEW SLAB TO POUR UP TO REMAINING SLAB.
- CENTER FOOTING ON GRID C.
- F60A PRE-MANUFACTURED SUNSHADE CONCRETE FOOTING. TOP OF FOOTING = 99'-0" (-1'-0"). SEE SHEET S6.01 FOR FOOTING SCHEDULE. COORDINATE FINAL LOCATION WITH SUNSHADE MANUFACTURER.
- EXISTING CANOPY. SEE ARCHITECTURAL DEMOLITION PLANS FOR EXTENT OF DEMOLITION.
- HSS6x4x1/2 ELEVATOR SUPPORT POST. COORDINATE EXACT LOCATION AND SPACING WITH ELEVATOR MANUFACTURER. SEE B4 / S5.41, D3 / S5.41, A2 / S5.41, B2 / S5.41, AND C2 / S5.41
- 1 1/2" RECESSED SLAB AT ADA SHOWER. COORDINATE EXACT SIZE, LOCATION, AND SLOPE REQUIREMENTS WITH ARCHITECTURAL DRAWINGS. SEE C4 / S7.11
- 18" DIAMETER PRECAST CONCRETE COLUMN BY OTHERS.
- 18" DIAMETER PRECAST CONCRETE CANOPY COLUMN BY OTHERS.


A1 FOUNDATION PLAN - SECTOR 2
SCALE: 1/8" = 1'-0"

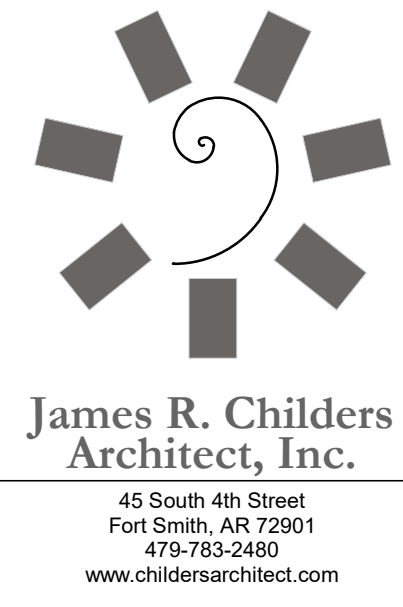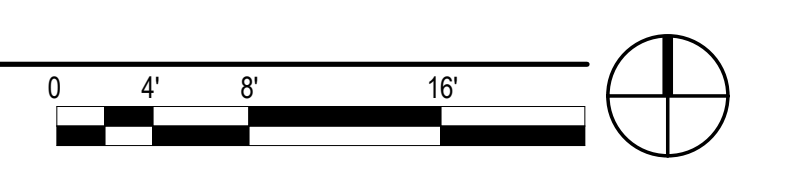

**James R. Childers
Architect, Inc.**
45 South 4th Street
Fort Smith, AR 72901
479-783-2460
www.childersarchitect.com



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

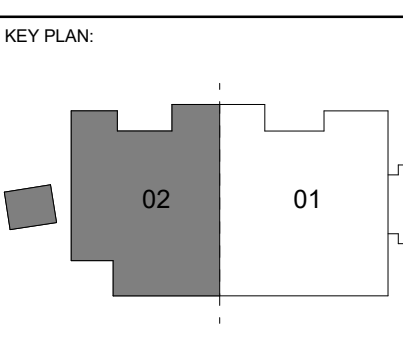



PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION



DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER: S1.02


FOUNDATION PLAN
SECTOR 2

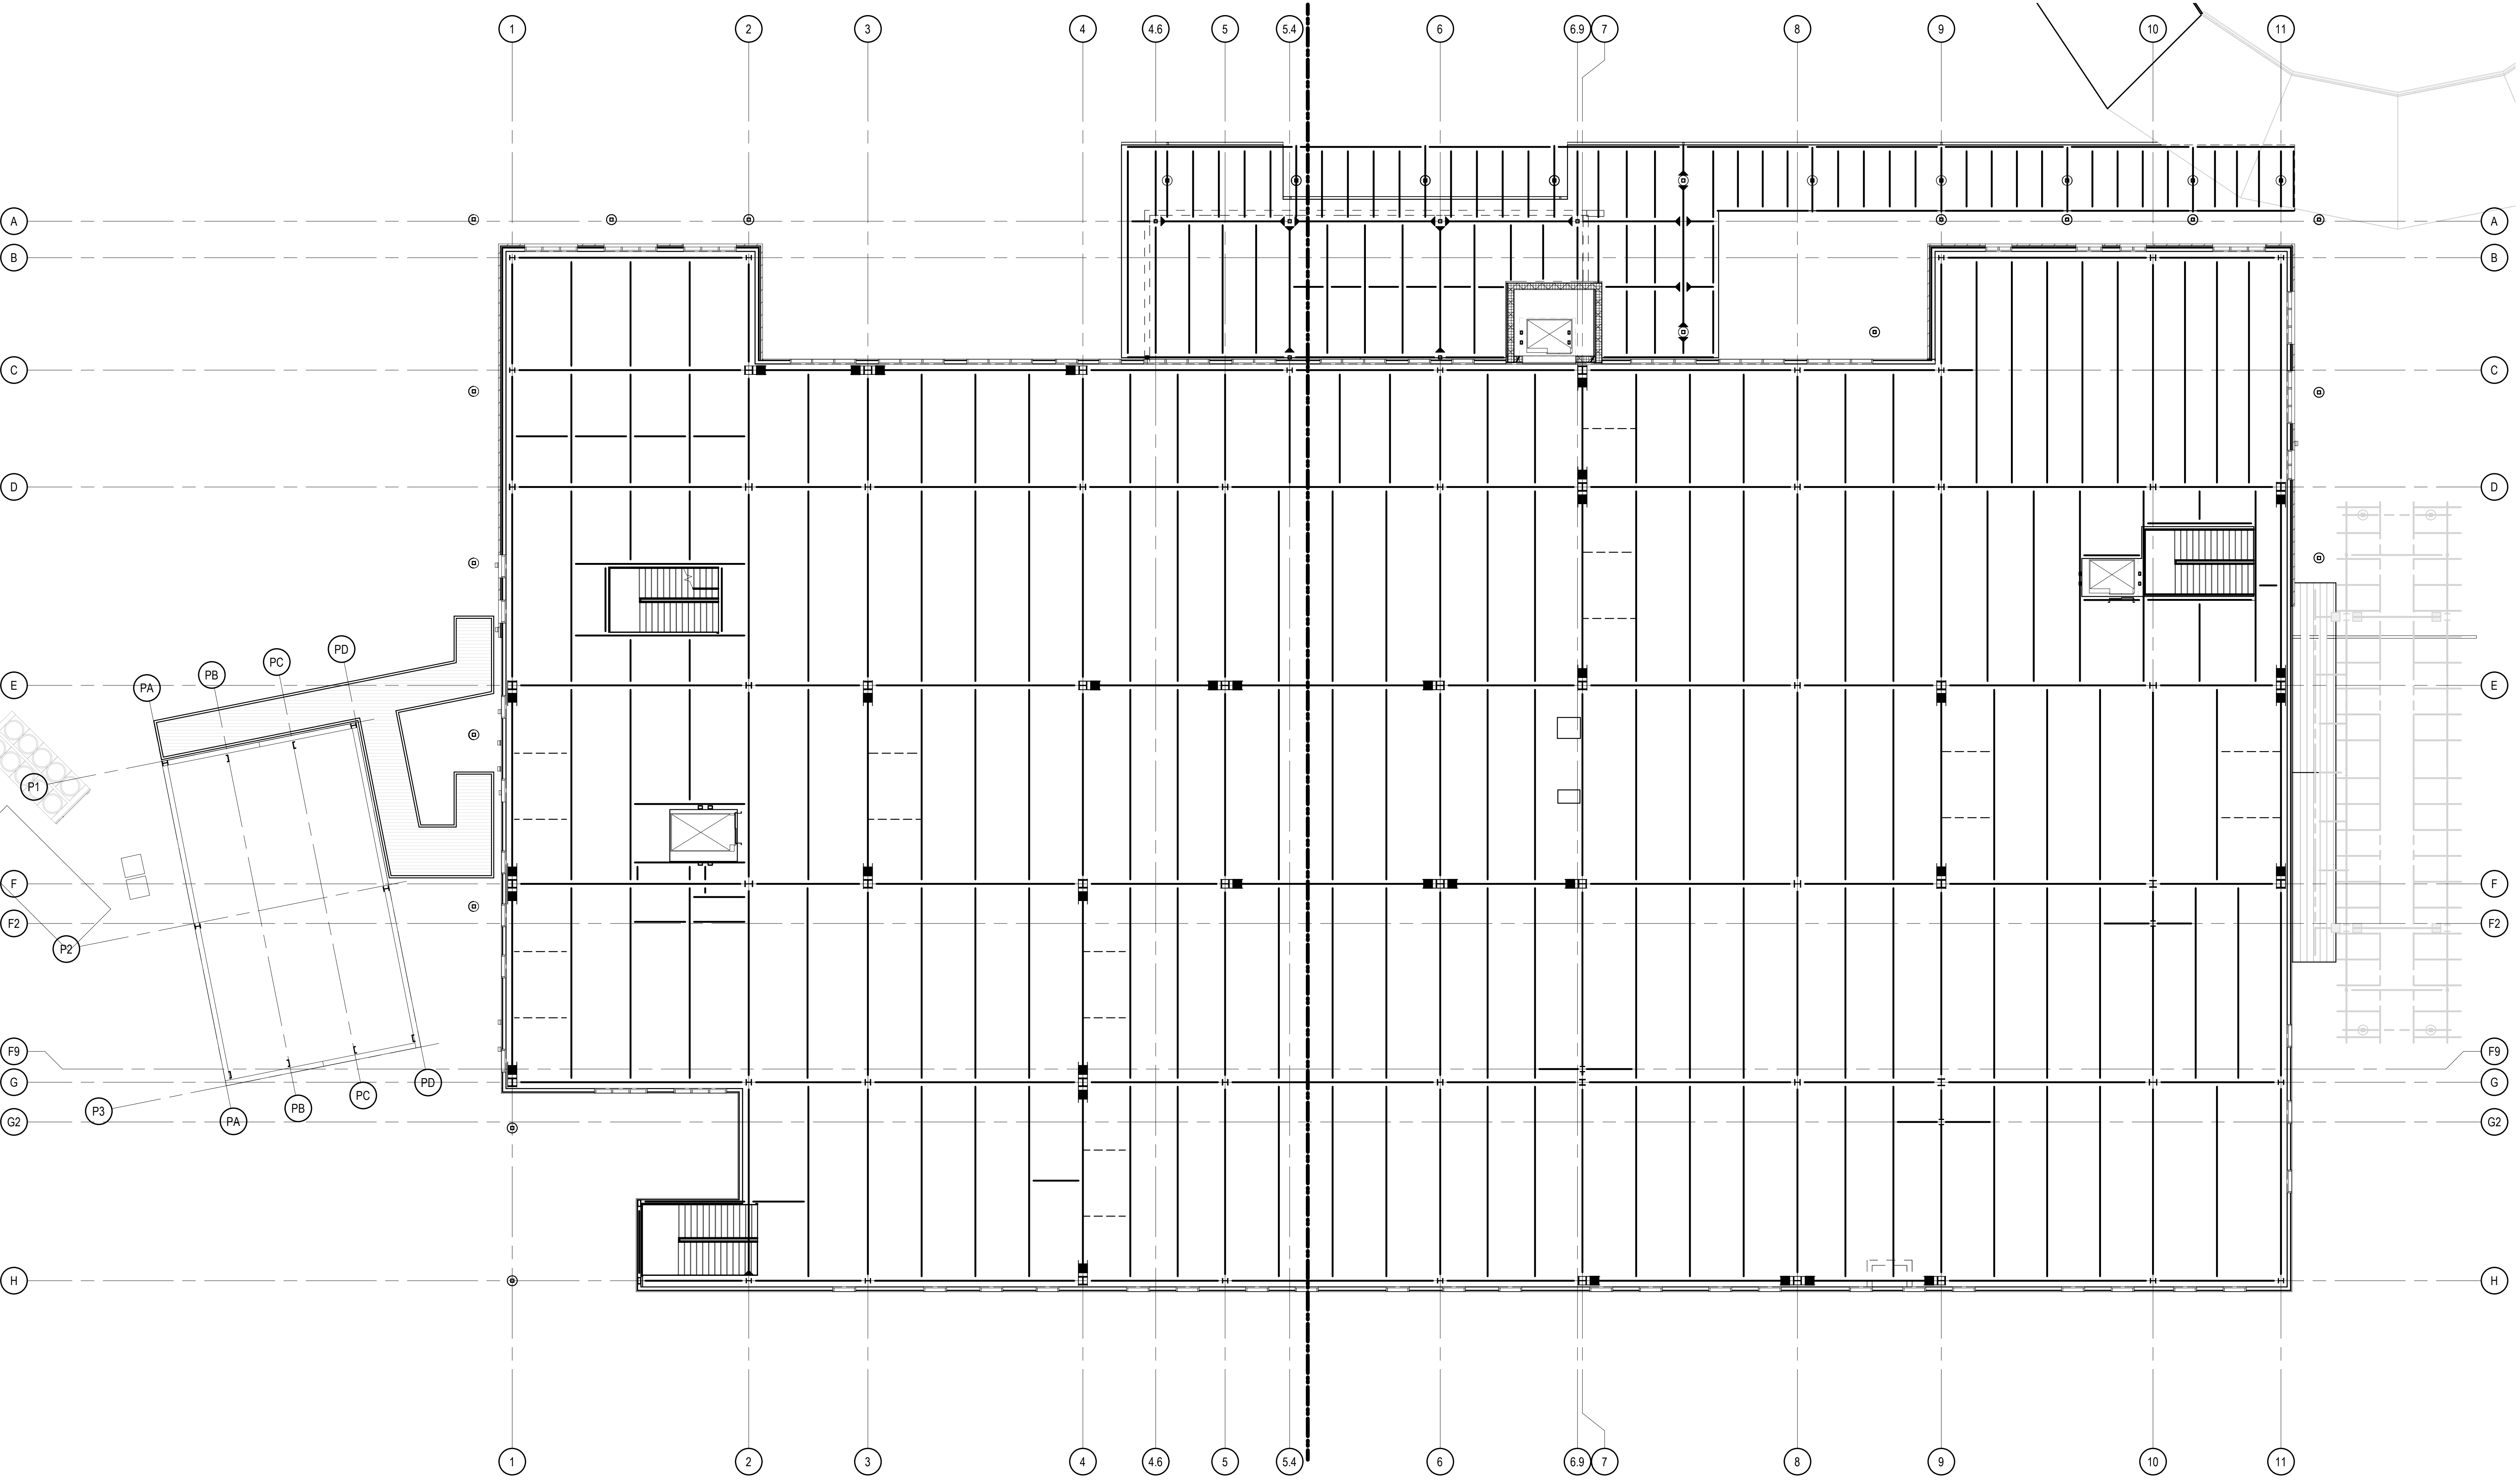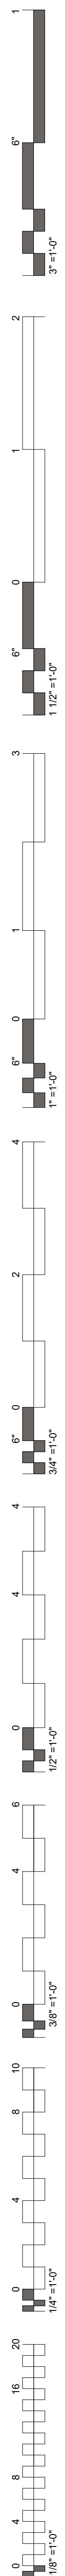

A1 FLOOR FRAMING PLAN - OVERALL
SCALE: 3/32" = 1'-0"

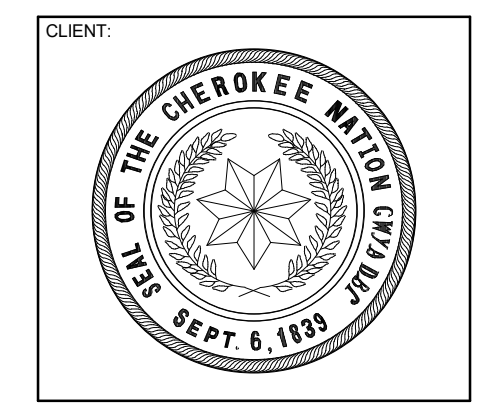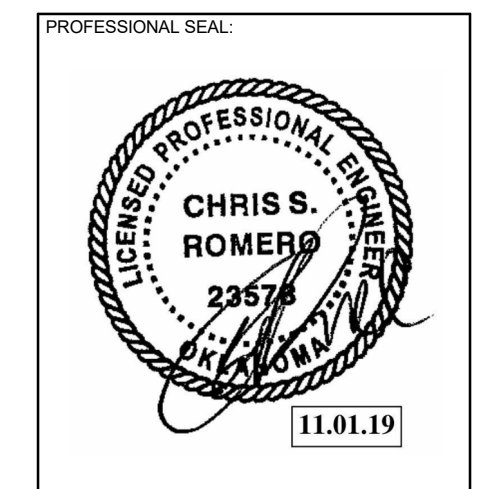

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

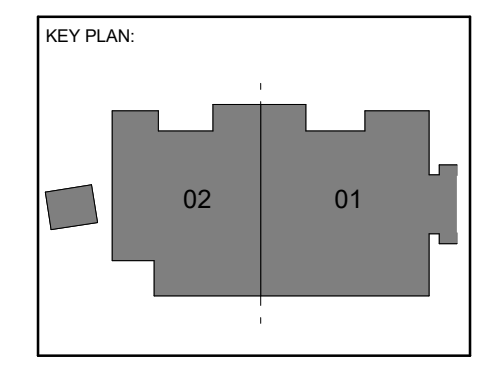


PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S1.10

OVERALL PLAN - FLOOR FRAMING



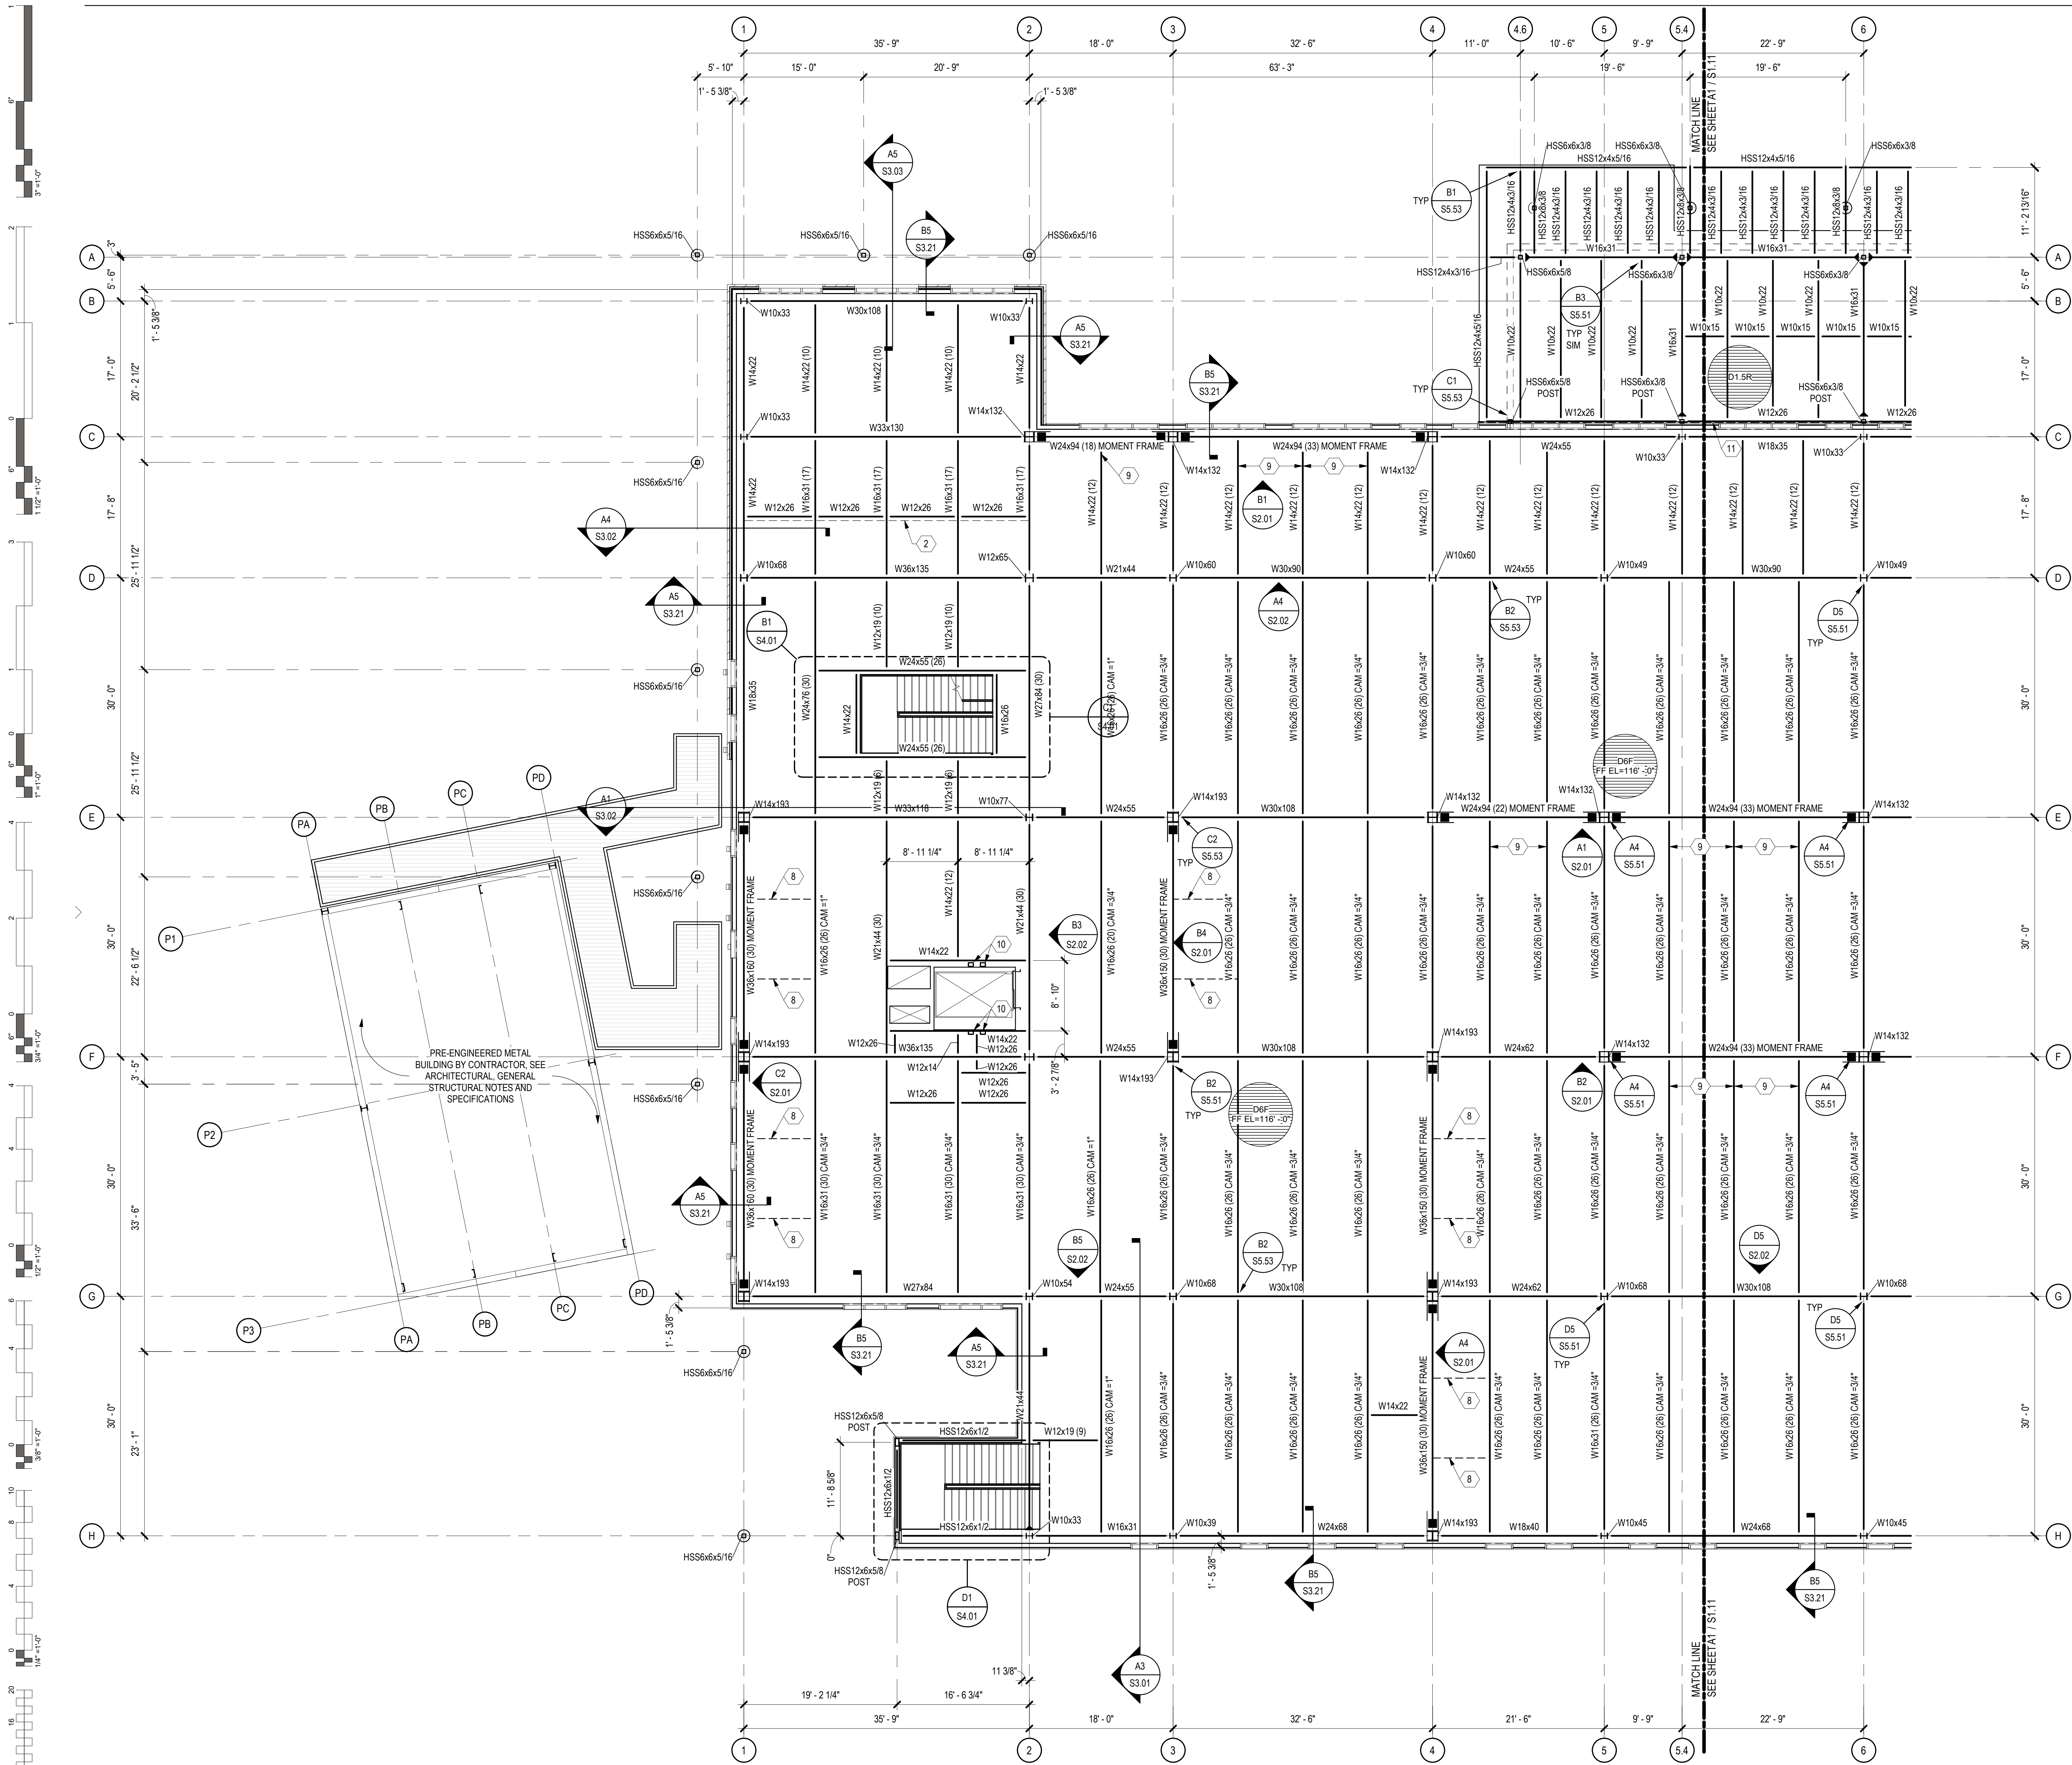


GENERAL SHEET NOTES


1. SOME SHEET KEYNOTES MAY NOT APPLY TO THIS SHEET.
2. NOTE TO ERECTOR: LATERAL STABILITY OF THE STEEL FRAME IS DEPENDENT UPON THE MOMENT FRAMES. THE ERECTOR SHALL PROVIDE TEMPORARY BRACING OF THE STEEL FRAME IN ACCORDANCE WITH SECTION 7.10 OF THE AISC CODE OF STANDARD PRACTICES.
3. DIMENSIONS ARE TO THE FACE OF STUD UNLESS NOTED OTHERWISE.
4. SEE ARCHITECTURAL DRAWINGS FOR MASONRY DIMENSIONS NOT SHOWN.
5. EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTACT ENGINEER BEFORE PROCEEDING.
6. STRUCTURAL COLD FORMED METAL STUDS SHALL BE 60S162-43 AT 16" ON CENTER UNLESS NOTED OTHERWISE.
7. BEAMS AND JOISTS ARE SPACED EQUALLY BETWEEN GRIDS AND COLUMNS UNLESS NOTED OTHERWISE.
8. SEE SHEET S7.00 SERIES SHEETS FOR TYPICAL FLOOR FRAMING SECTIONS.
9. SEE SHEET S6.01 FOR SCHEDULES.
10. DENOTES MOMENT CONNECTION PER TYPICAL DETAILS.
11. DENOTES SIDELATE MOMENT CONNECTION. SEE SIDELATE DRAWINGS.

SHEET KEYNOTE


1. MECHANICAL UNIT. COORDINATE EXACT SIZE AND LOCATION WITH MECHANICAL DRAWINGS.
2. OPERABLE PARTITION BELOW. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS. SEE A5 / S5.52 AND B5 / S5.52 FOR SUPPORT.
3. MECHANICAL OPENING. COORDINATE EXACT SIZE AND LOCATION WITH MECHANICAL DRAWINGS. SEE C5 / S7.42
4. HSS6x4x1/2 ELEVATOR RAIL SUPPORT POST. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER. SEE A2 / S5.41, B2 / S5.41, C2 / S5.41, AND D3 / S5.41
5. HSS6x4x1/4 COLLECTOR BLOCKING BETWEEN BEAMS. SEE D4 / S5.52. ATTACH BLOCKING TO DECK VALLEYS PER DECK SCHEDULE. PROVIDE 20 GAGE PLATE AS REQUIRED TO MAKE ATTACHMENT.
6. 4" HOUSEKEEPING PAD REINFORCED WITH #4 @ 18" ON CENTER EACH WAY AND #4 VERT BOWELS DRILLED AND EPOXIED 2" INTO CONCRETE SLAB BELOW @ 48" ON CENTER EACH WAY (12" FROM EDGES AND CORNERS). PAD SHALL EXTEND 6" BEYOND FACE OF MECHANICAL UNIT ALL AROUND. COORDINATE EXACT SIZE AND LOCATION OF PAD WITH MECHANICAL DRAWINGS.
7. EXISTING CANOPY. SEE ARCHITECTURAL DEMOLITION PLANS FOR EXTENT OF DEMOLITION.
8. BOTTOM FLANGE BRACING AT EQUAL SPACING. UNLESS NOTED OTHERWISE, BRACE TO BE ATTACHED TO BOTTOM FLANGE OF BEAM NOTED AS MOMENT FRAME OR BRACED FRAME TO TOP FLANGE OF ADJACENT BEAM. SEE B3 / S5.52
9. BOTTOM FLANGE BRACING. SEE A3 / S5.52
10. HSS8x6x1/2 ELEVATOR RAIL SUPPORT BEAM. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER. SEE A1 / S5.41 AND B1 / S5.41 FOR TYPICAL DETAILS.
11. 2" BUILDING EXPANSION JOINT. SEE ARCHITECTURAL DRAWINGS.
12. SLAB EDGE TO BE LOCATED AT OUTSIDE FLANGE OF BEAM. SEE S7.41 FOR SLAB EDGE DETAILS.

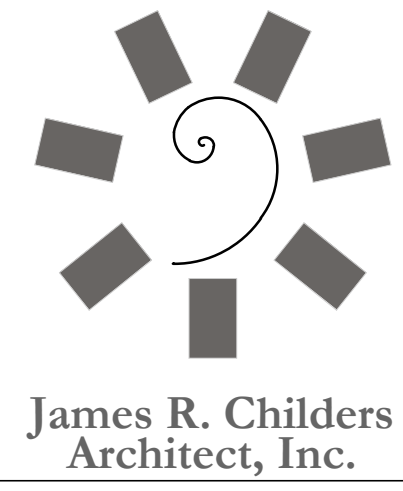

**James R. Childers
Architect, Inc.**
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

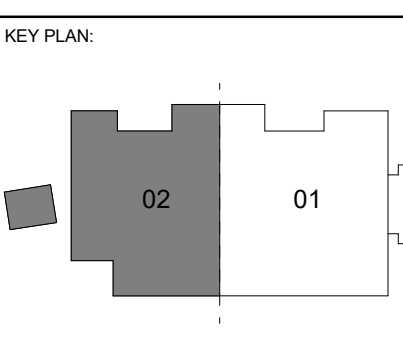

PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS	DESCRIPTION



DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER: **S1.12**

FLOOR FRAMING PLAN - SECTOR 2

A1 FLOOR FRAMING PLAN - SECTOR 2
SCALE: 1/8" = 1'-0"

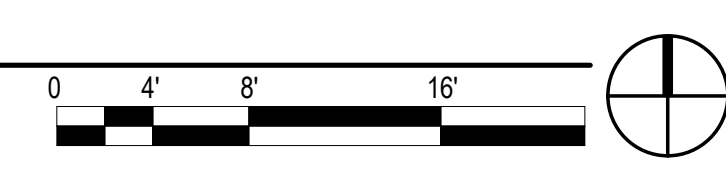

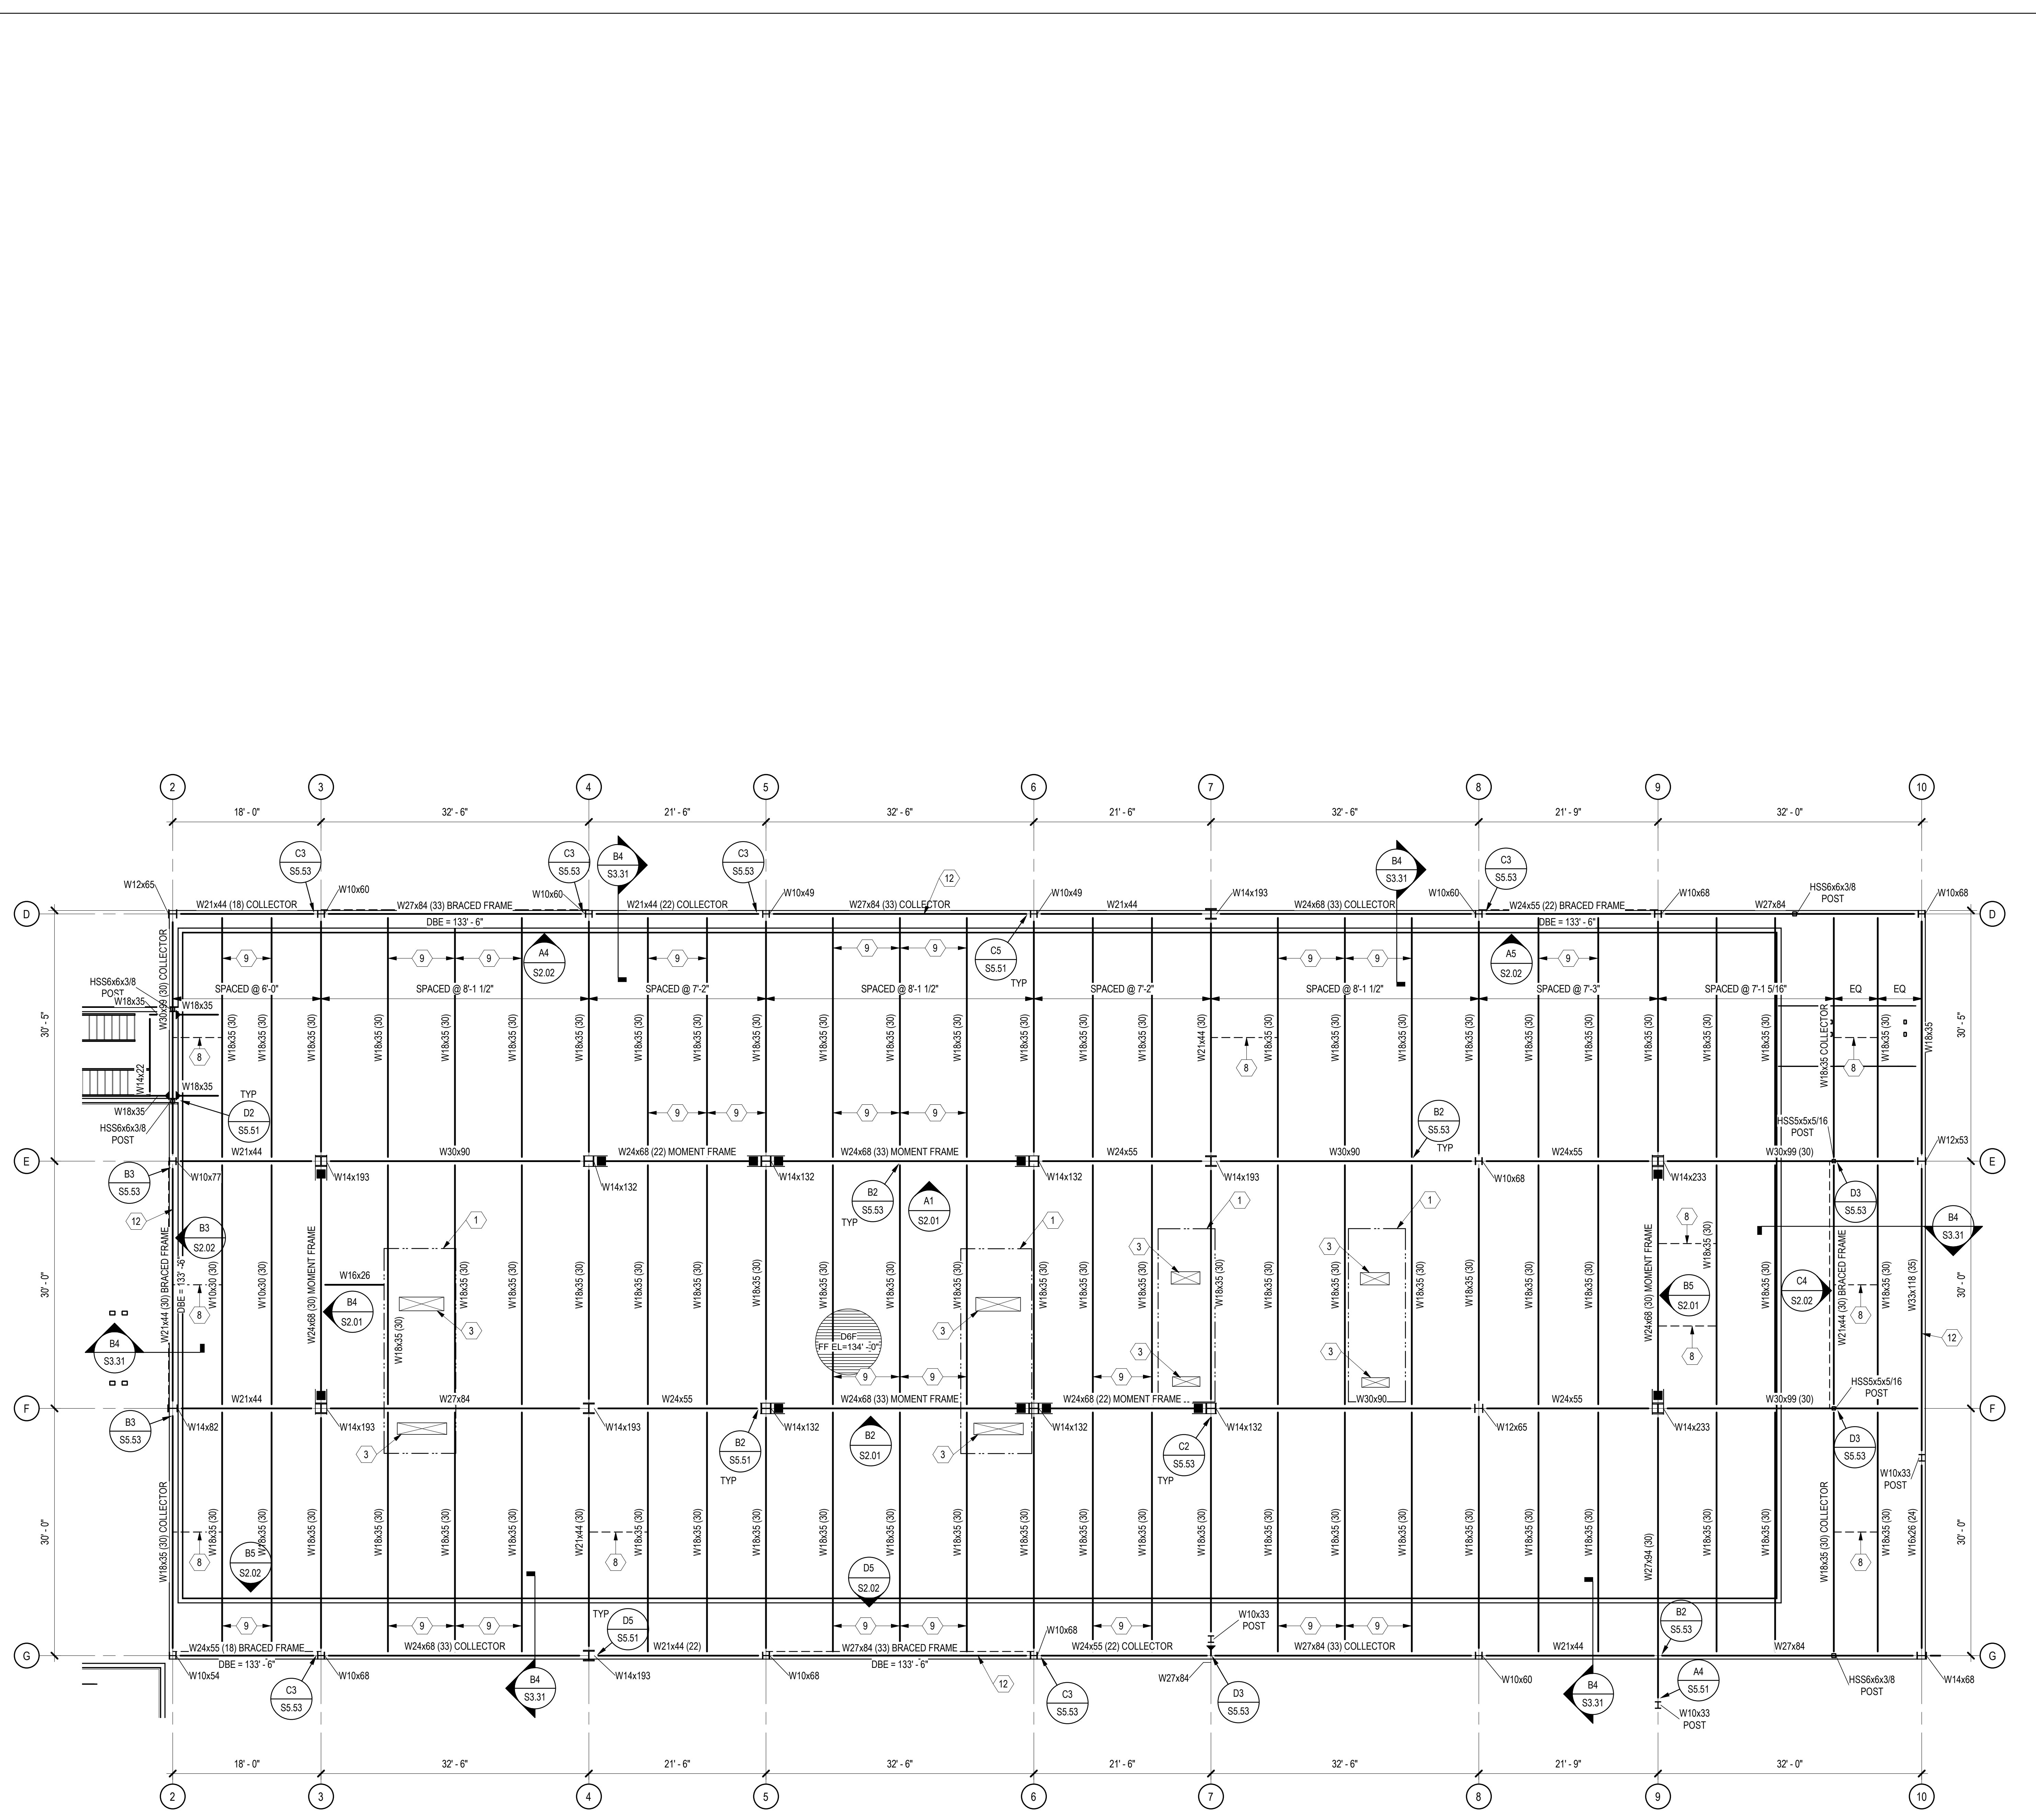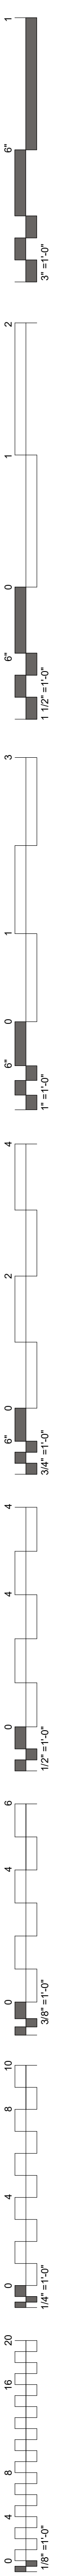

A1 LOW ROOF FRAMING PLAN
SCALE: 1/8" = 1'-0"




GENERAL SHEET NOTES


1. SOME SHEET KEYNOTES MAY NOT APPLY TO THIS SHEET.
2. NOTE TO ERECTOR: LATERAL STABILITY OF THE STEEL FRAME IS DEPENDENT UPON THE MOMENT FRAMES. THE ERECTOR SHALL PROVIDE TEMPORARY BRACING OF THE STEEL FRAME IN ACCORDANCE WITH SECTION 7.10 OF THE AISC CODE OF STANDARD PRACTICES.
3. DIMENSIONS ARE TO THE FACE OF STUD UNLESS NOTED OTHERWISE.
4. SEE ARCHITECTURAL DRAWINGS FOR MASONRY DIMENSIONS NOT SHOWN.
5. EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTACT ENGINEER BEFORE PROCEEDING.
6. STRUCTURAL COLD FORMED METAL STUDS SHALL BE 60S162-43 AT 16" ON CENTER UNLESS NOTED OTHERWISE.
7. BEAMS AND JOISTS ARE SPACED EQUALLY BETWEEN GRIDS AND COLUMNS UNLESS NOTED OTHERWISE.
8. SEE SHEET S6.01 FOR SCHEDULES.
9. SEE SHEET S6.01 FOR SCHEDULES.
10. DENOTES MOMENT CONNECTION PER TYPICAL DETAILS.
11. DENOTES SIDEPLATE MOMENT CONNECTION. SEE SIDEPLATE DRAWINGS.

SHEET KEYNOTE


1. MECHANICAL UNIT. COORDINATE EXACT SIZE AND LOCATION WITH MECHANICAL DRAWINGS.
2. OPERABLE PARTITION BELOW. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS. SEE A5 / S5.52 AND B5 / S5.52 FOR SUPPORT.
3. MECHANICAL OPENING. COORDINATE EXACT SIZE AND LOCATION WITH MECHANICAL DRAWINGS. SEE C5 / S7.42
4. HSS6x4x1/2 ELEVATOR RAIL SUPPORT POST. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER. SEE A2 / S5.41, B2 / S5.41, C2 / S5.41, AND D3 / S5.41
5. HSS6x4x1/4 COLLECTOR BRACING BETWEEN BEAMS. SEE D4 / S5.52. ATTACH BRACING TO DECK VALLEYS PER DECK SCHEDULE. PROVIDE 20 GAGE PLATE AS REQUIRED TO MAKE ATTACHMENT.
6. 4" HOUSEKEEPING PAD REINFORCED WITH #4 @ 18" ON CENTER EACH WAY AND #4 VERT DOUBLES DRILLED AND EPOXYED 2" INTO CONCRETE SLAB BELOW @ 48" ON CENTER EACH WAY (12" FROM EDGES AND CORNERS). PAD SHALL EXTEND 6" BEYOND FACE OF MECHANICAL UNIT ALL AROUND. COORDINATE EXACT SIZE AND LOCATION OF PAD WITH MECHANICAL DRAWINGS.
7. EXISTING CANOPY. SEE ARCHITECTURAL DEMOLITION PLANS FOR EXTENT OF DEMOLITION.
8. BOTTOM FLANGE BRACING AT EQUAL SPACING. UNLESS NOTED OTHERWISE, BRACE TO BE ATTACHED TO BOTTOM FLANGE OF BEAM NOTED AS MOMENT FRAME OR BRACED FRAME TO TOP FLANGE OF ADJACENT BEAM. SEE B3 / S5.52
9. BOTTOM FLANGE BRACING. SEE A3 / S5.52
10. HSS6x4x1/2 ELEVATOR RAIL SUPPORT BEAM. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER. SEE A1 / S5.41 AND B1 / S5.41 FOR TYPICAL DETAILS.
11. 2" BUILDING EXPANSION JOINT. SEE ARCHITECTURAL DRAWINGS.
12. SLAB EDGE TO BE LOCATED AT OUTSIDE FLANGE OF BEAM. SEE S7.41 FOR SLAB EDGE DETAILS.



James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2460
www.childersarchitect.com

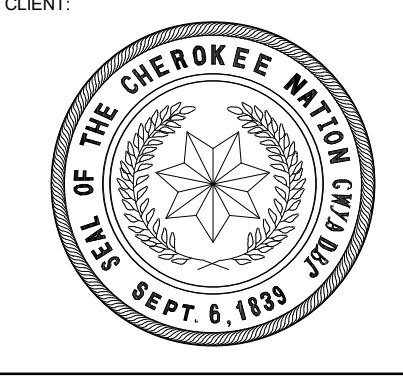

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA


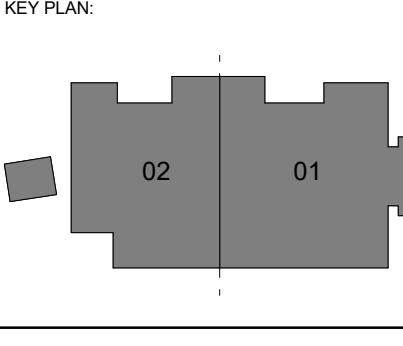


PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01
SHEET NUMBER: S1.13


LOW ROOF FRAMING PLAN

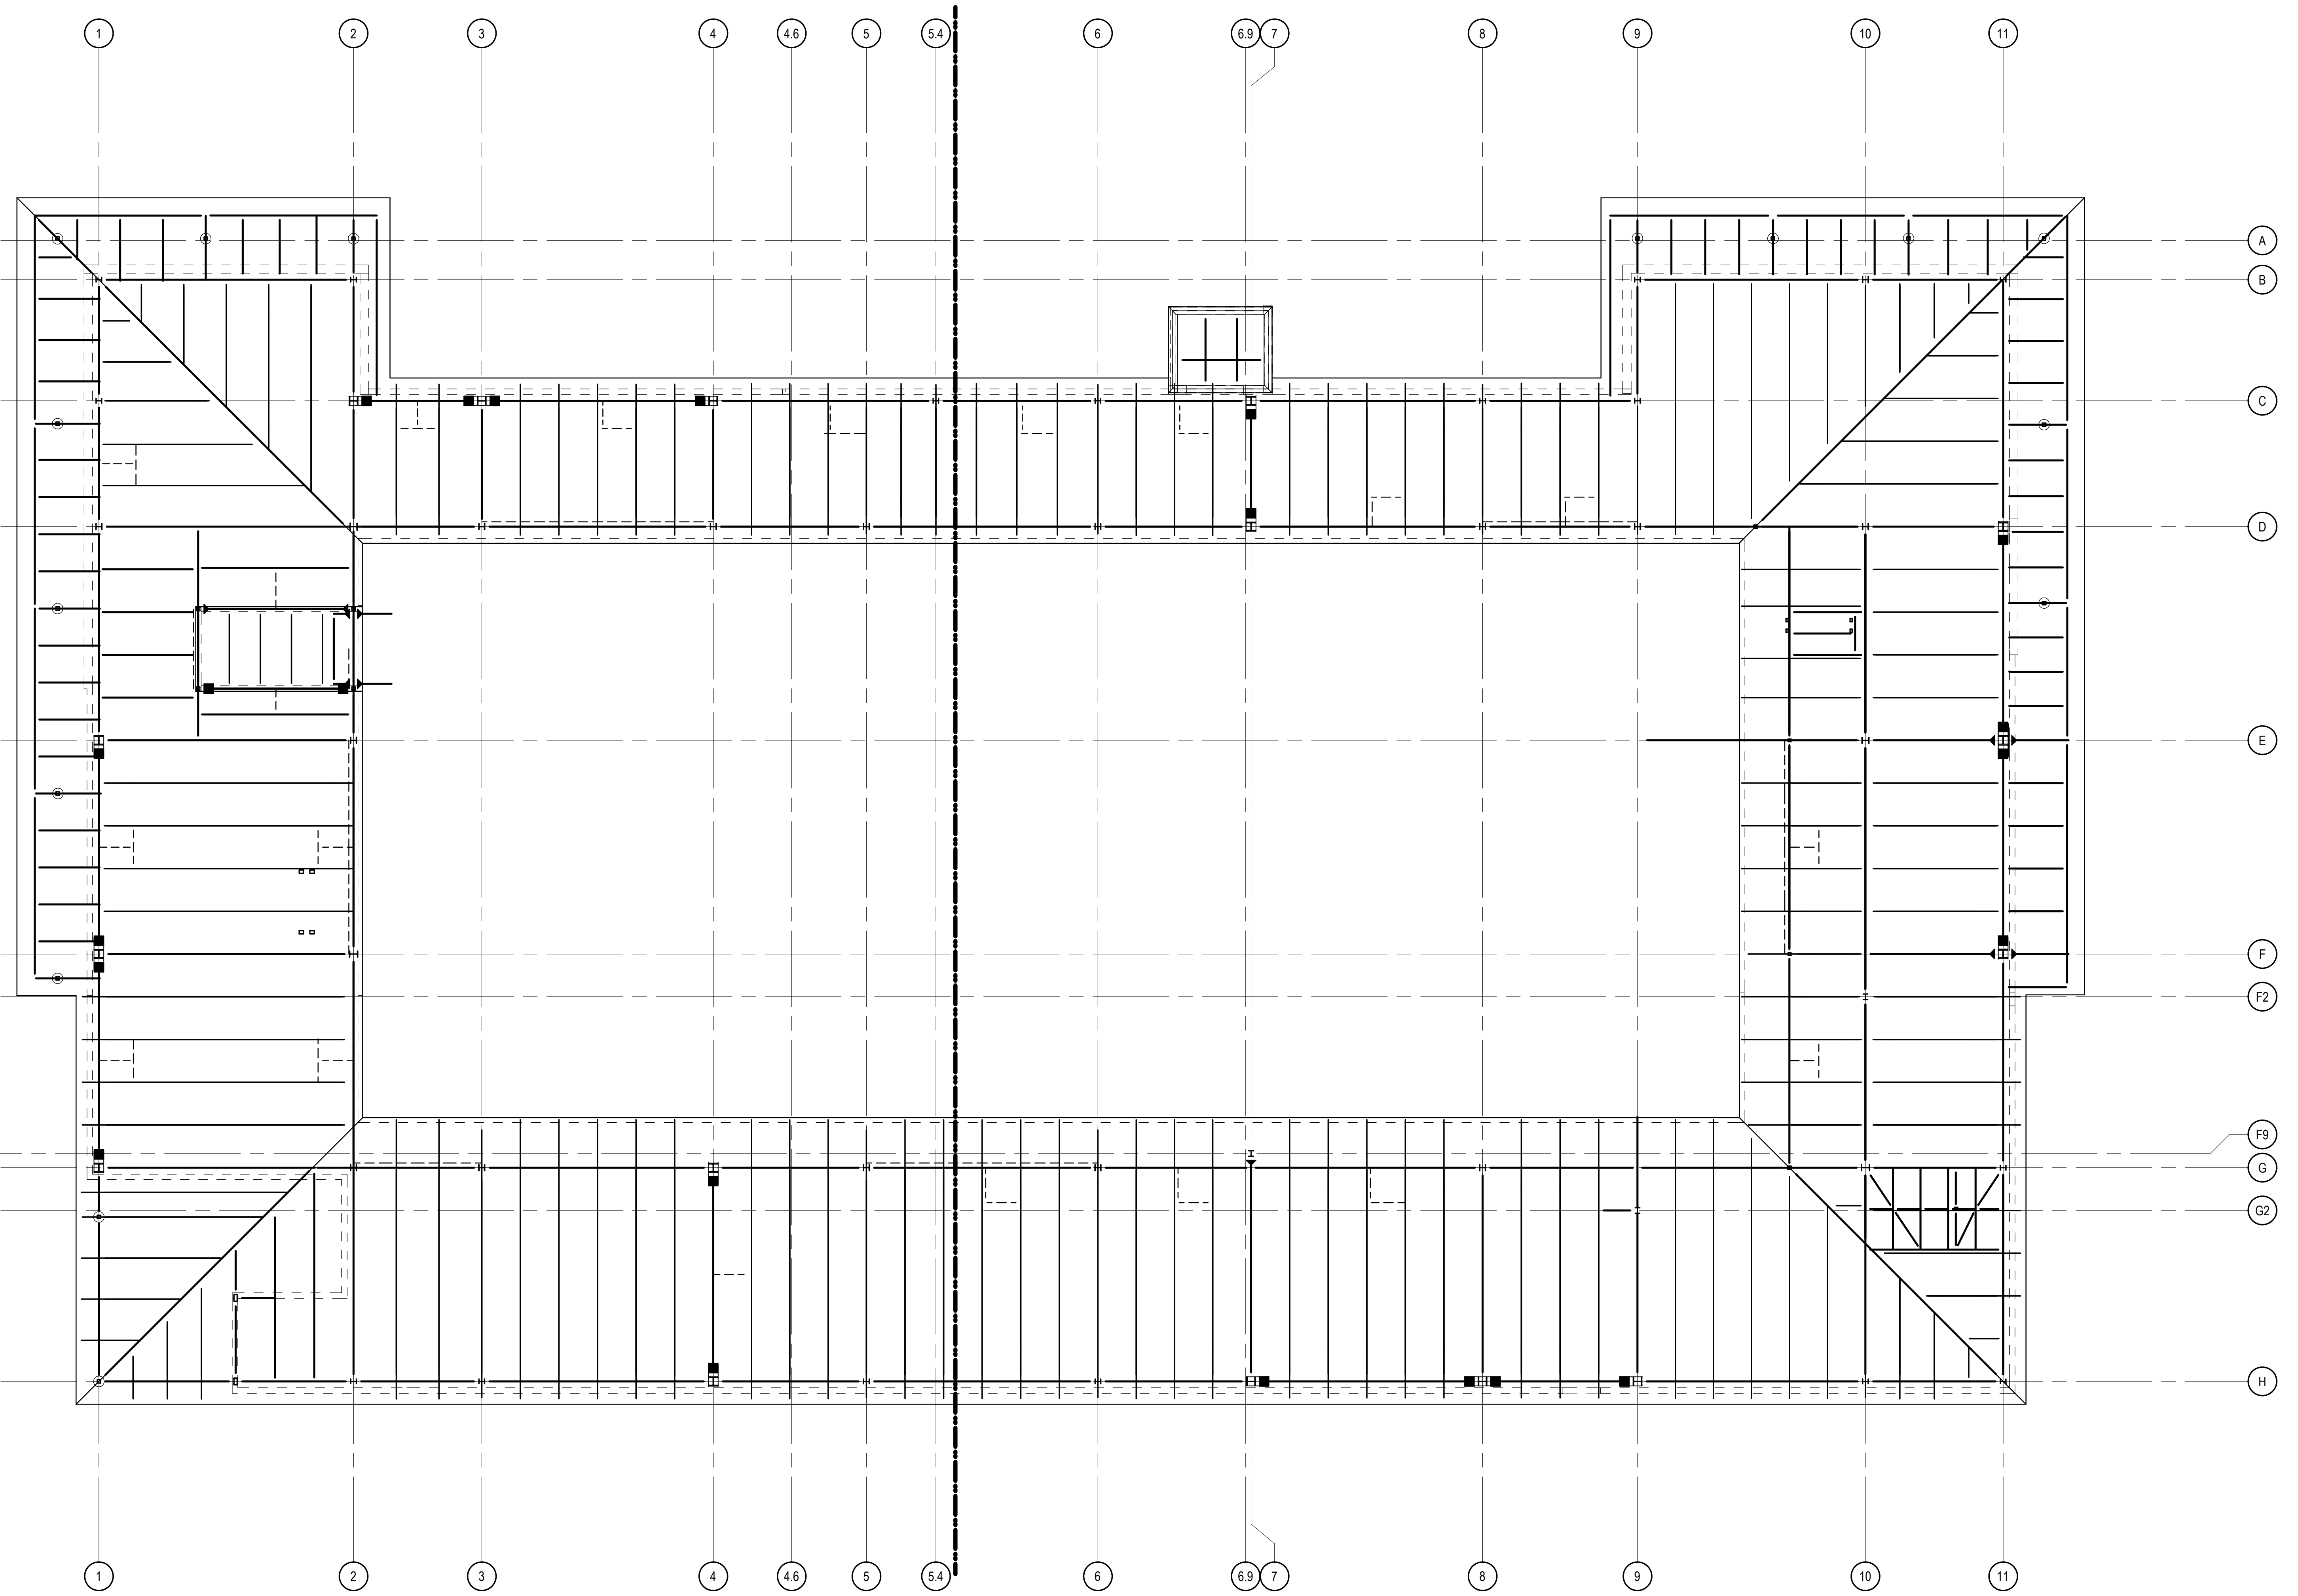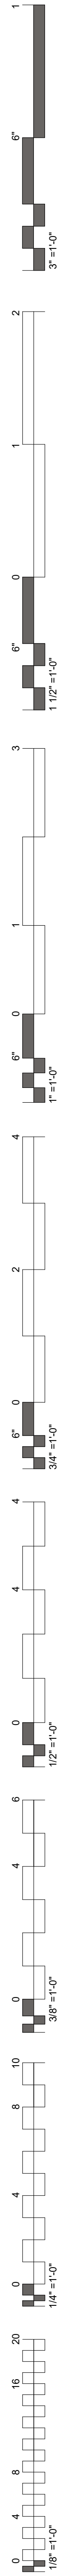

A1 ROOF FRAMING PLAN - OVERALL
SCALE: 3/32" = 1'-0"



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

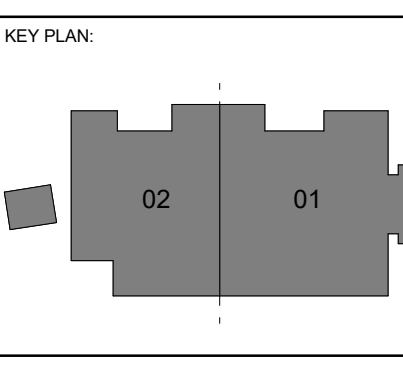


PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S1.20

OVERALL PLAN - ROOF FRAMING

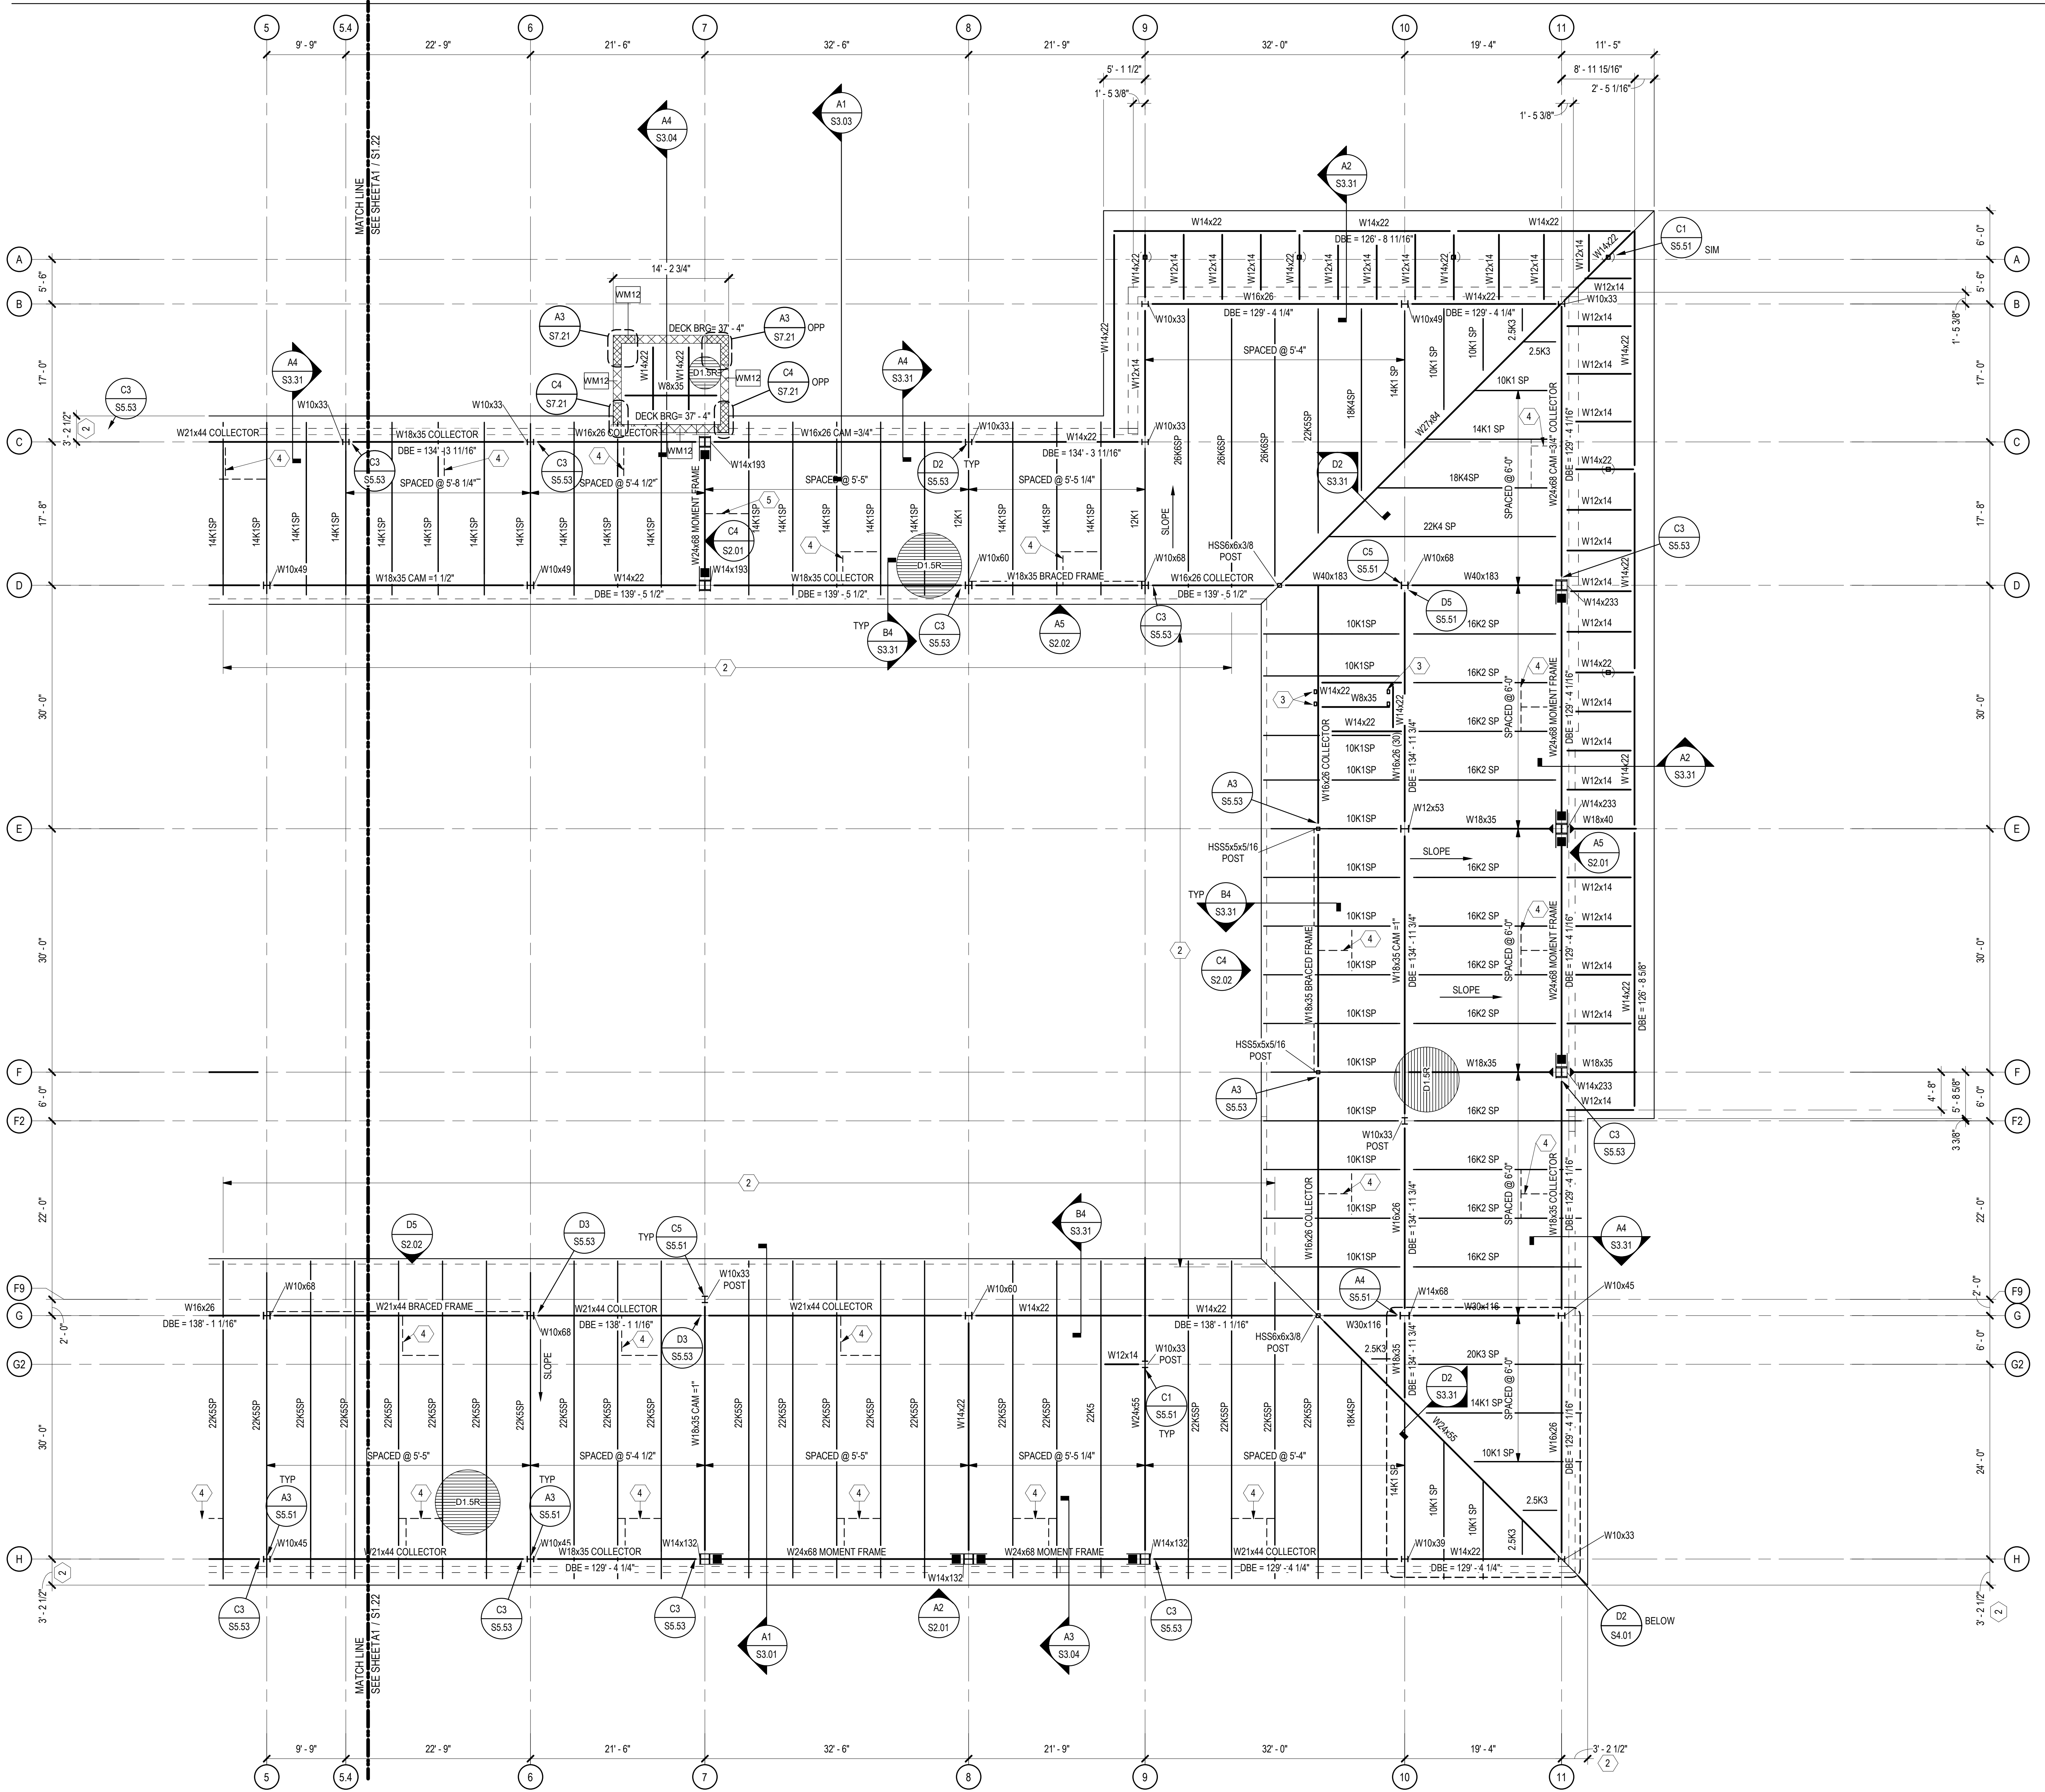


GENERAL SHEET NOTES



- SOME SHEET KEYNOTES MAY NOT APPLY TO THIS SHEET.
- NOTE TO ERECTOR: LATERAL STABILITY OF THE STEEL FRAME IS DEPENDENT UPON THE MOMENT FRAMES. THE ERECTOR SHALL PROVIDE TEMPORARY BRACING OF THE STEEL FRAME IN ACCORDANCE WITH SECTION 7.10 OF THE AISC CODE OF STANDARD PRACTICES.
- DIMENSIONS ARE TO THE FACE OF STUD UNLESS NOTED OTHERWISE.
- SEE ARCHITECTURAL DRAWINGS FOR MASONRY DIMENSIONS NOT SHOWN.
- EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTACT ENGINEER BEFORE PROCEEDING.
- BEAMS AND JOISTS ARE SPACED EQUALLY BETWEEN GRIDS AND COLUMNS UNLESS NOTED OTHERWISE.
- PROVIDE JOIST BRIDGING PER THE 42ND EDITION OF THE SJI SPECIFICATIONS AND OSHA REQUIREMENTS.
- STEEL JOIST MANUFACTURER SHALL DESIGN ROOF JOISTS AND ROOF JOIST GIRDERS SUPPORTING MECHANICAL UNITS FOR 1.2x MECHANICAL UNIT WEIGHTS SHOWN. USE 28 PSF DEAD LOAD AND 20 PSF LIVE LOAD UNLESS NOTED OTHERWISE. CONTRACTOR SHALL VERIFY ACTUAL MECHANICAL LOADS. NOTIFY STEEL JOIST MANUFACTURER OF ANY DISCREPANCIES.
- STRUCTURAL COLD FORMED METAL STUDS SHALL BE 6" IN WIDTH, UNLESS NOTED OTHERWISE.
- SEE SHEET S7.00 SERIES SHEETS FOR TYPICAL ROOF FRAMING SECTIONS.
- SEE SHEET S6.01 FOR SCHEDULES.
- NOTES MOMENT CONNECTION PER TYPICAL DETAILS.
- IDENTIFIES SIDEPLATE MOMENT CONNECTION. SEE SIDEPLATE DRAWINGS.
- PROVIDE HSSxJOIST SEAT DEPTHx1/4 BETWEEN JOISTS AT ALL BEAMS LABELED AS: MOMENT FRAME, BRACED FRAME, AND COLLECTOR. SEE C2 / S7.41

SHEET KEYNOTE


- MECHANICAL UNIT. COORDINATE EXACT SIZE AND LOCATION WITH MECHANICAL DRAWINGS.
- JOIST EXTENDED END. DESIGN EXTENDED END FOR 20 PSF DEAD LOAD, 20 PSF LIVE LOAD, AND ANY POSITIVE OR NEGATIVE WIND PRESSURES PER ROOF WIND LOADING DIAGRAM ON S0.03. DEPTH OF EXTENDED END PER JOIST MANUFACTURER.
- HSS5x5x1/8 ELEVATOR RAIL SUPPORT POST. COORDINATE EXACT LOCATION WITH ELEVATOR MANUFACTURER. SEE A2 / S5.41, B2 / S5.41, C2 / S5.41, AND D3 / S5.41
- BOTTOM FLANGE BRACE AT EQUAL SPACING, UNLESS NOTED OTHERWISE. BRACE TO BE ATTACHED TO BOTTOM FLANGE OF BEAM NOTED AS MOMENT FRAME OR BRACED FRAME AND TO TOP FLANGE OF ADJACENT BEAM OR JOIST. SEE B3 / S5.52. JOISTS TO BE DESIGNED FOR 1,500# VERTICAL (REVERSIBLE) WIND AND SEISMIC LOAD FROM BRACE.
- BOTTOM FLANGE BRACING AT EQUAL SPACING, UNLESS NOTED OTHERWISE. SEE D1 / S5.51. JOISTS TO BE DESIGNED FOR 1,500# VERTICAL (REVERSIBLE) WIND AND SEISMIC LOAD FROM BRACE.
- BOTTOM FLANGE BRACING ANGLE. SEE A3 / S5.52

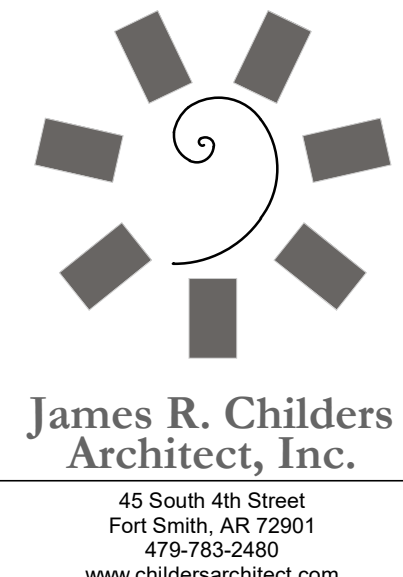

James R. Childers Architect, Inc.
 45 South 4th Street
 Fort Smith, AR 72901
 479-783-2460
 www.childersarchitect.com

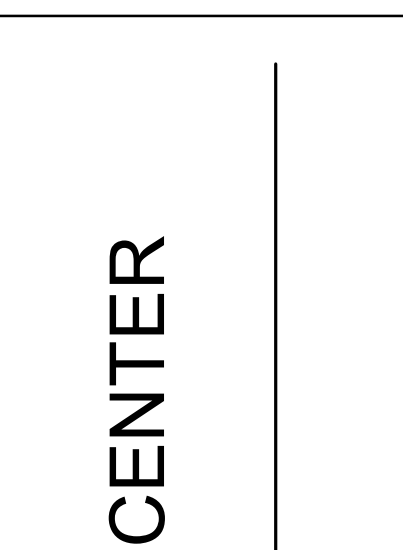

**WILMA P. MANKILLER HEALTH CENTER
 EXPANSION**
 STILLWELL, OKLAHOMA

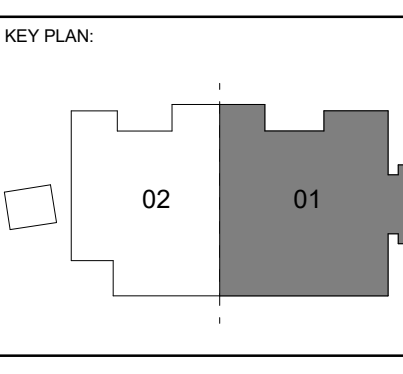

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER: **S1.21**

ROOF FRAMING PLAN - SECTOR 1

A1 ROOF FRAMING PLAN - SECTOR 1
 SCALE: 1/8" = 1'-0"




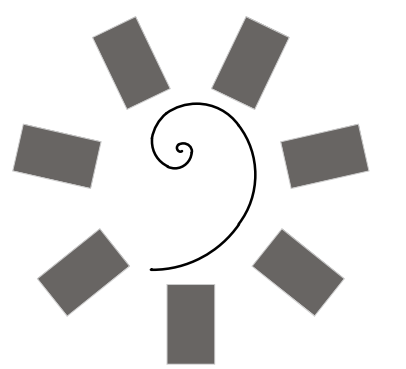

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com



CONSULTANT LOGO

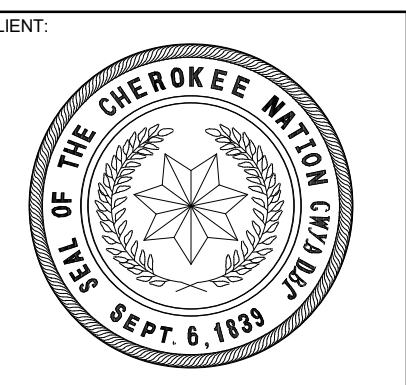

WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION





DATE: 11-01-19 JOB NUMBER: 18-01.01



SHEET NUMBER:
S2.01

MOMENT FRAME ELEVATIONS

SIDEPLATE CONNECTION NOTES


- (XX) INDICATES SIDEPLATE CONNECTION PER SHEETS XXXX - XXXX.
- (MX) INDICATES MISCELLANEOUS SIDEPLATE DETAIL PER SHEETS XXXX - XXXX.

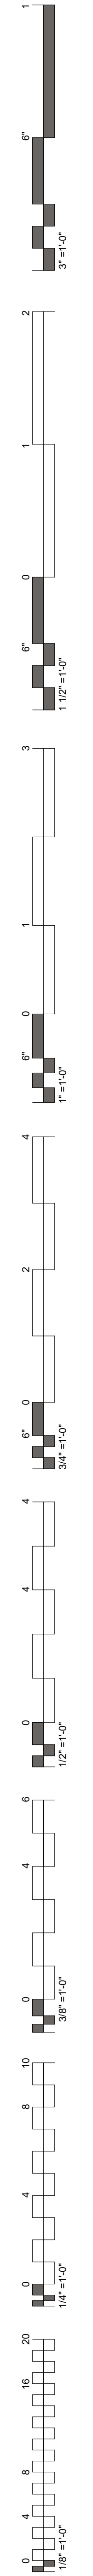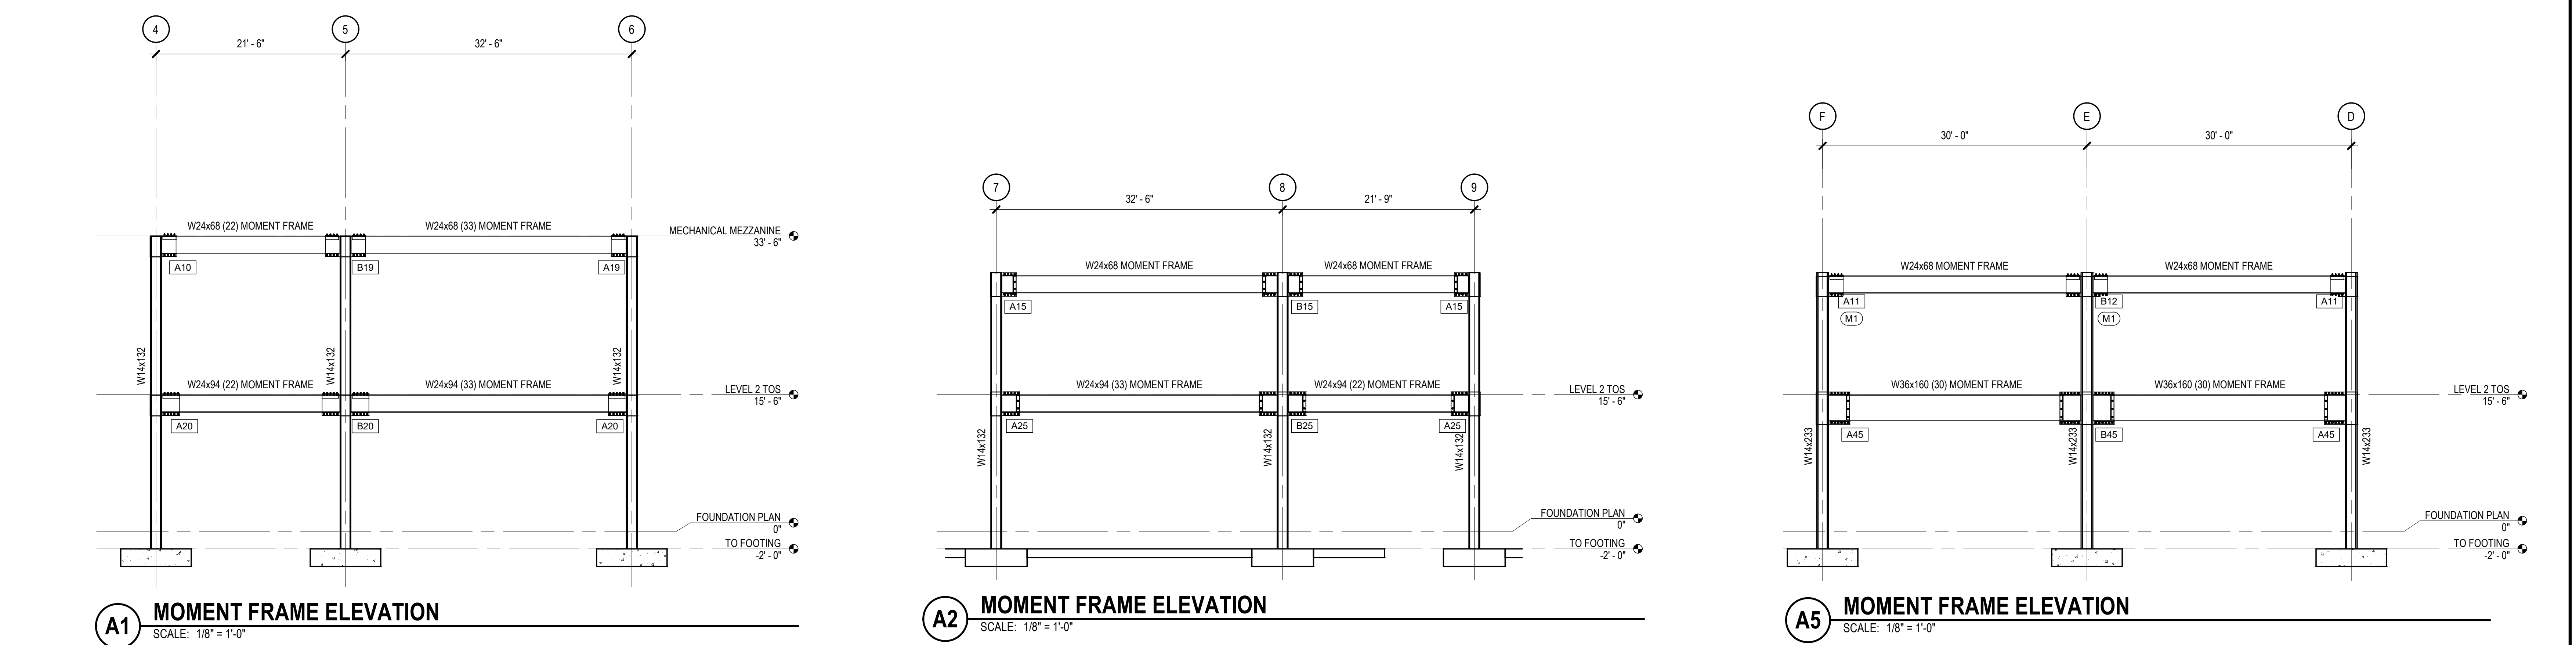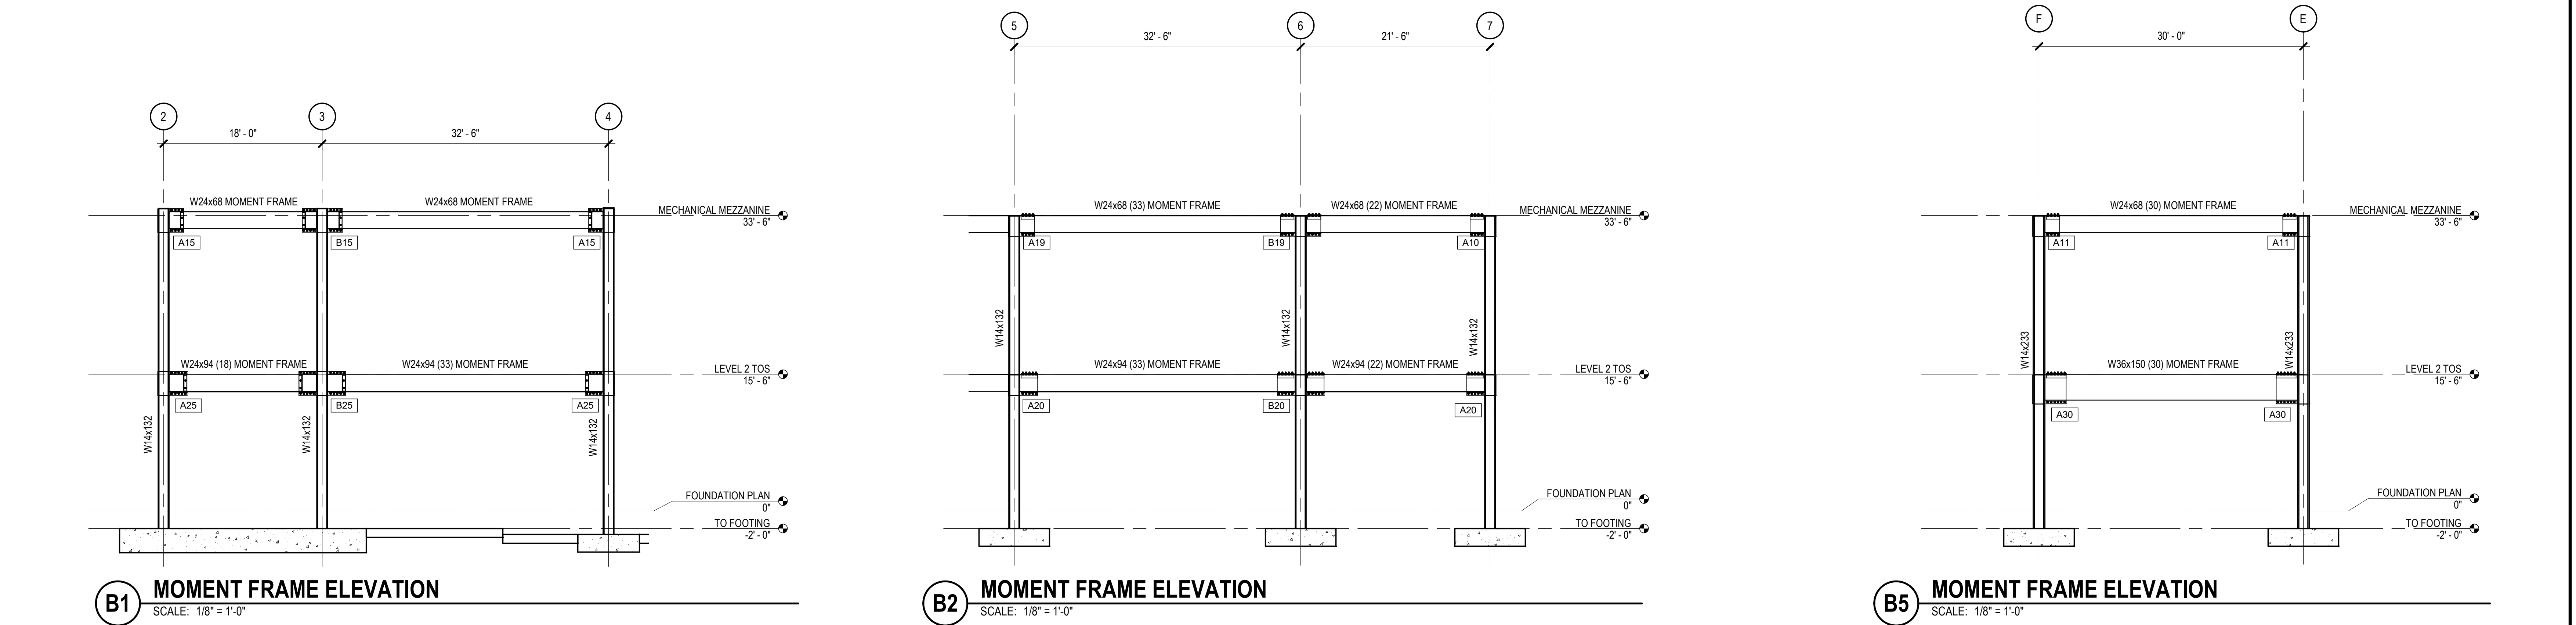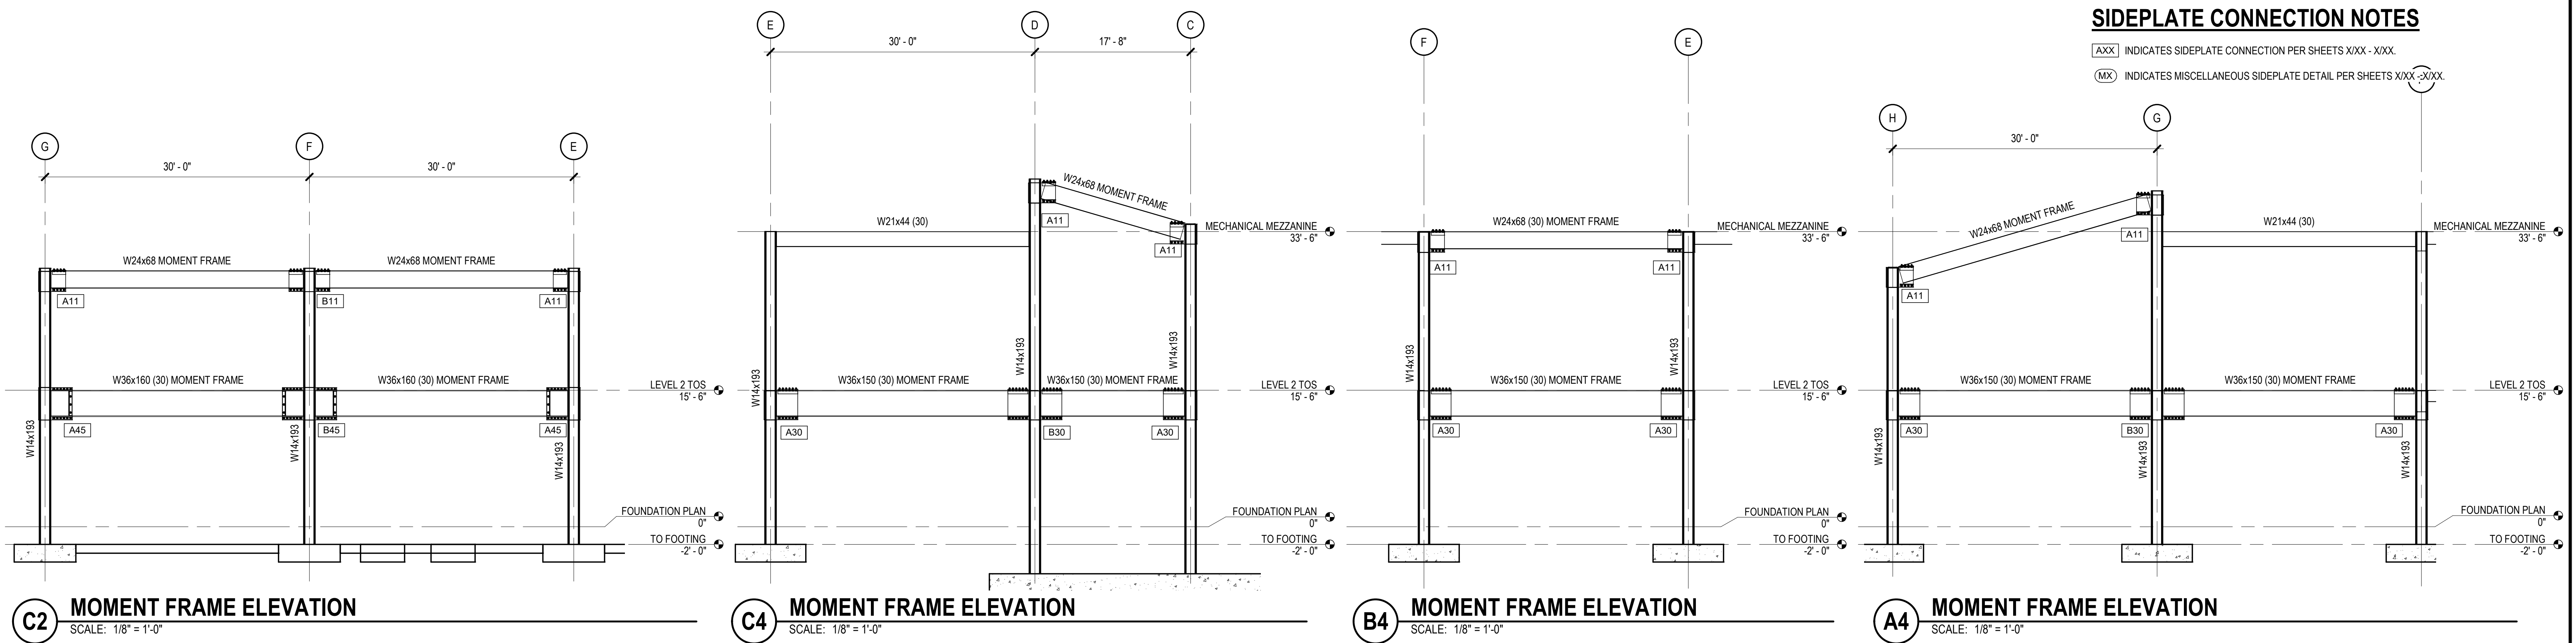

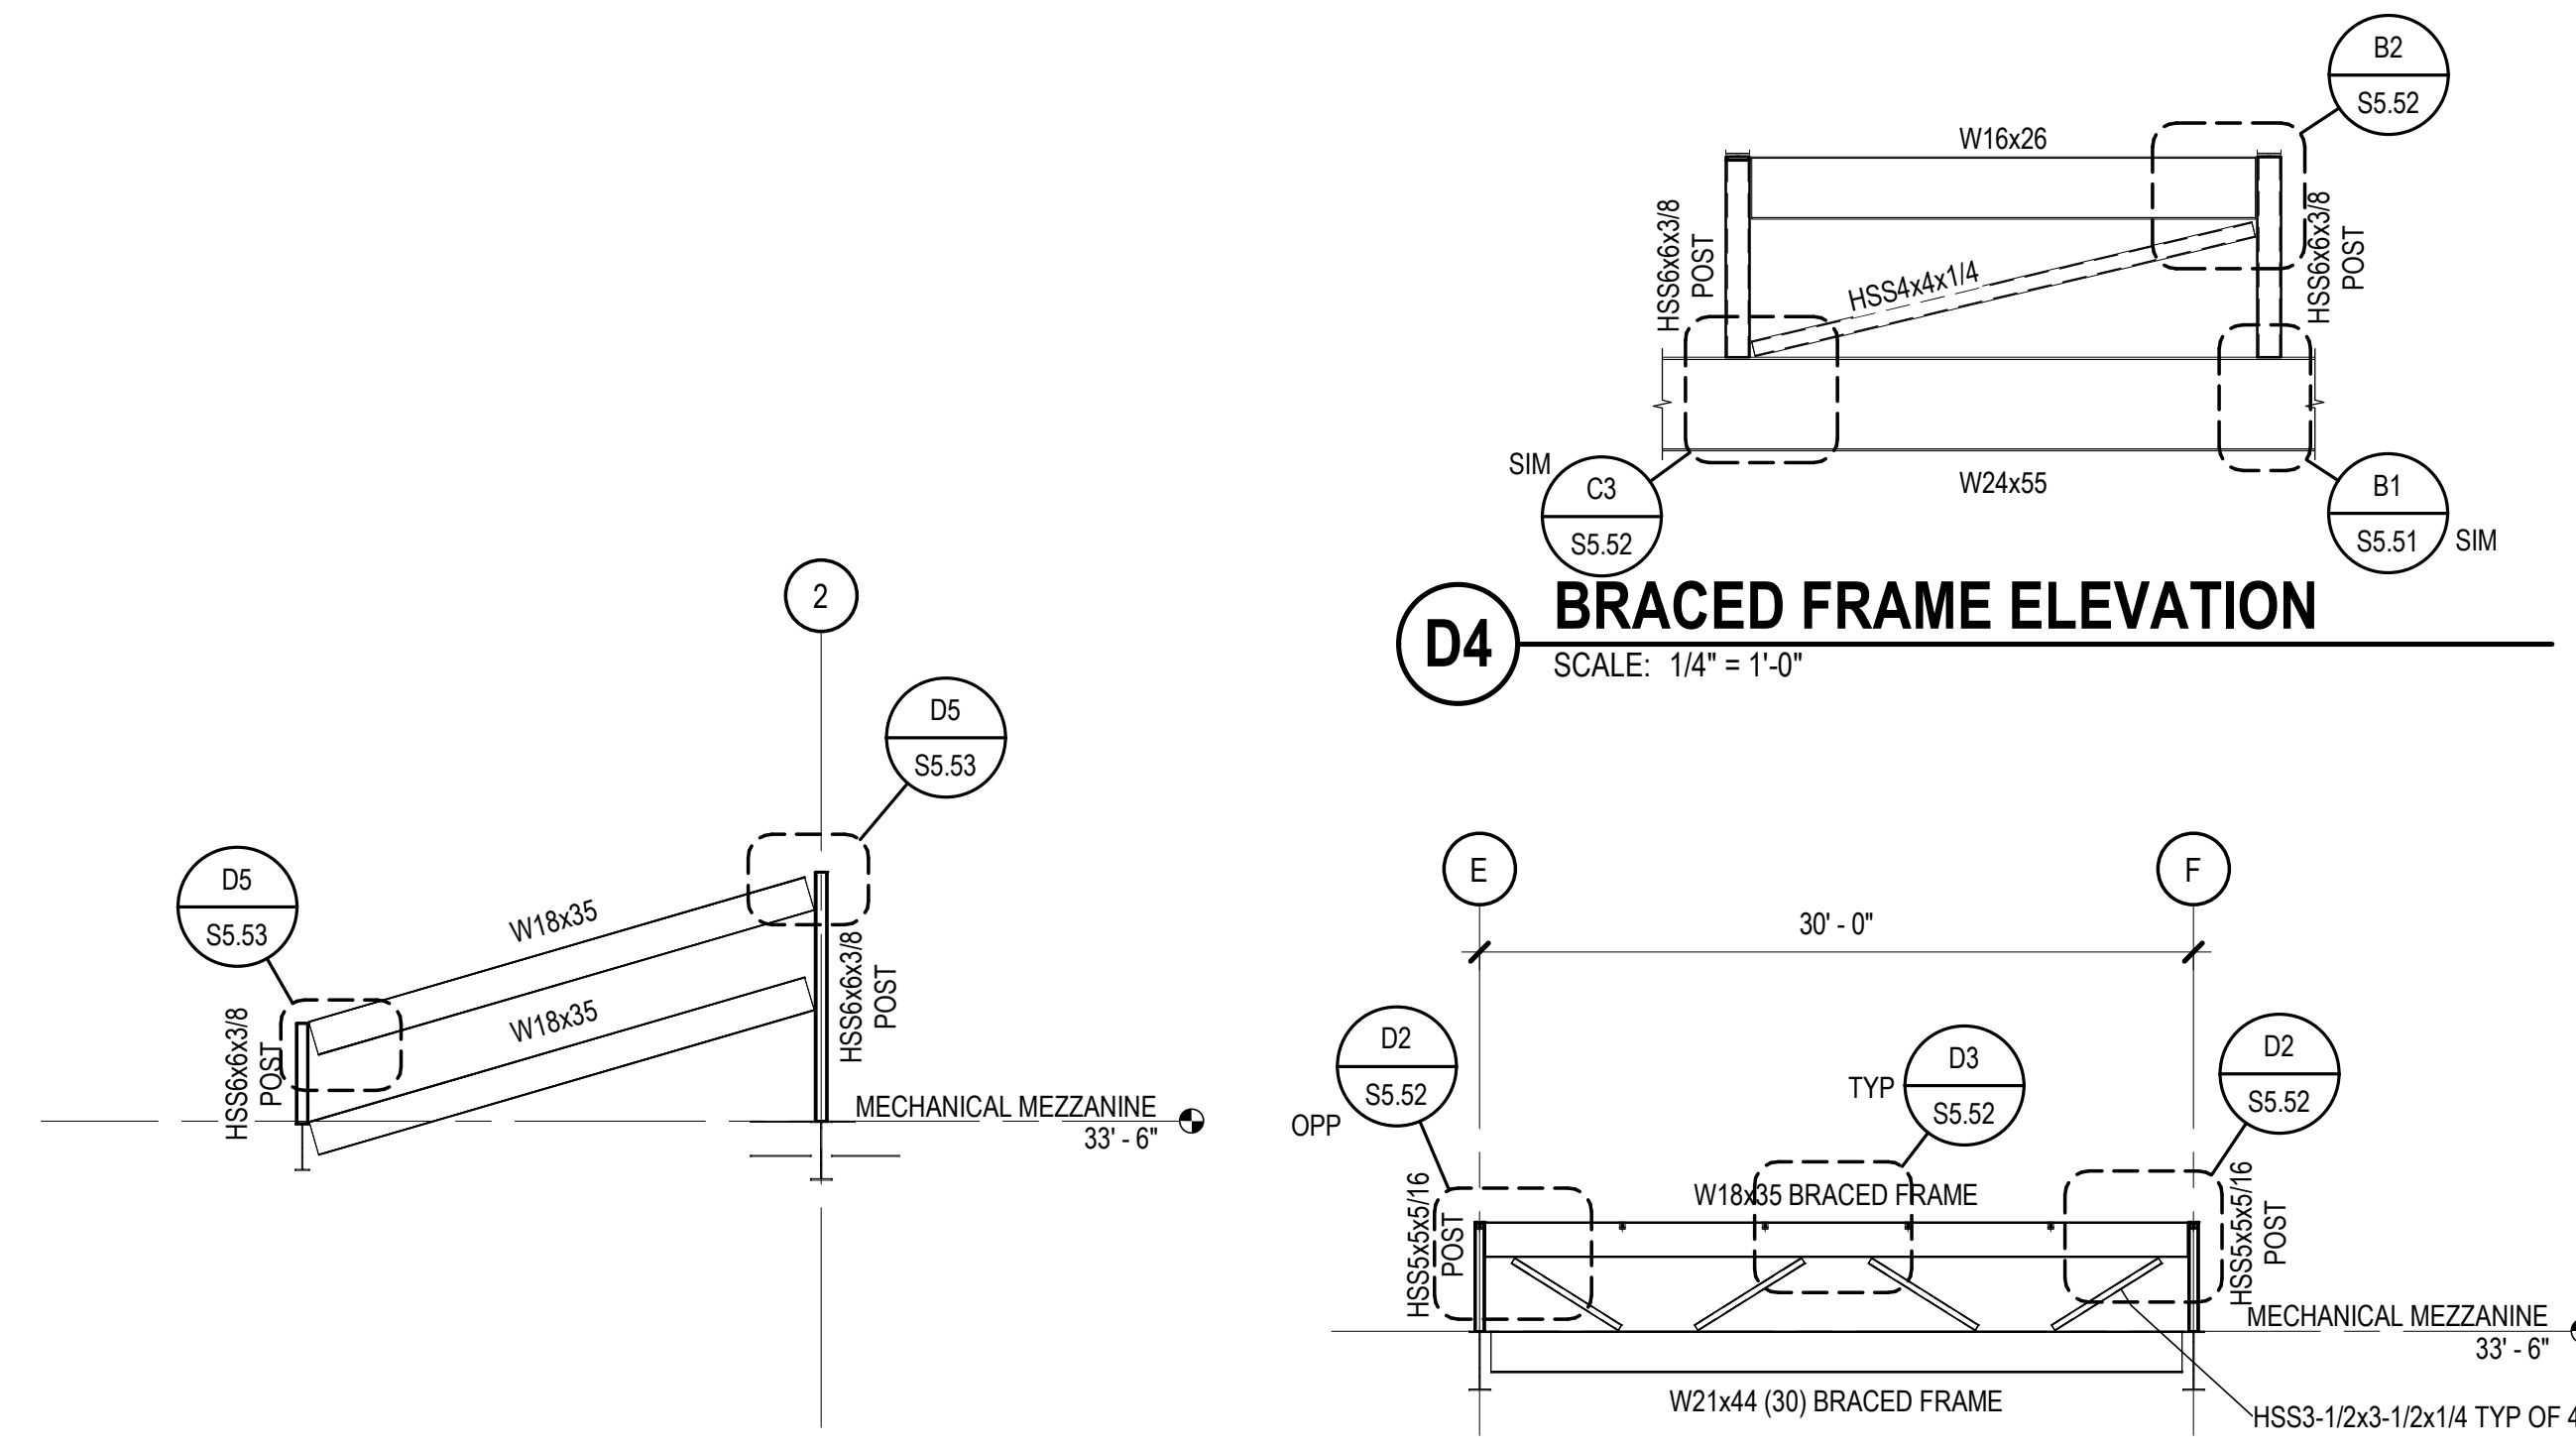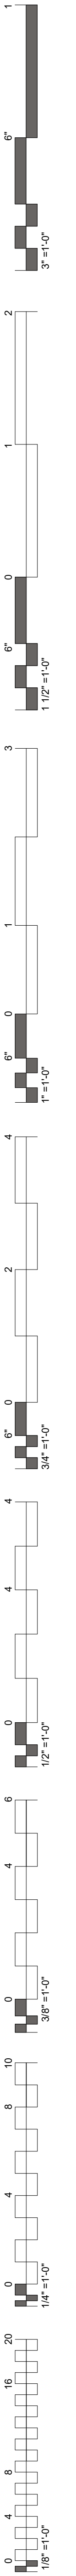


C3 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"


D4 BRACED FRAME ELEVATION
SCALE: 1/4" = 1'-0"

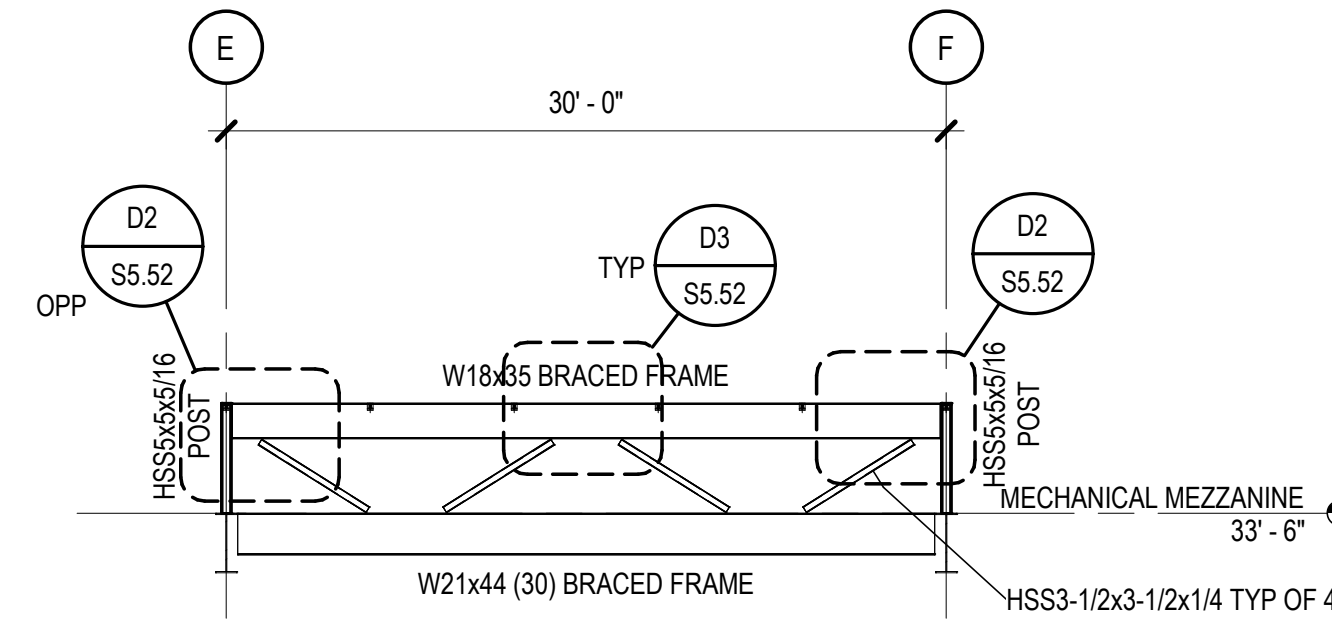


C4 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"

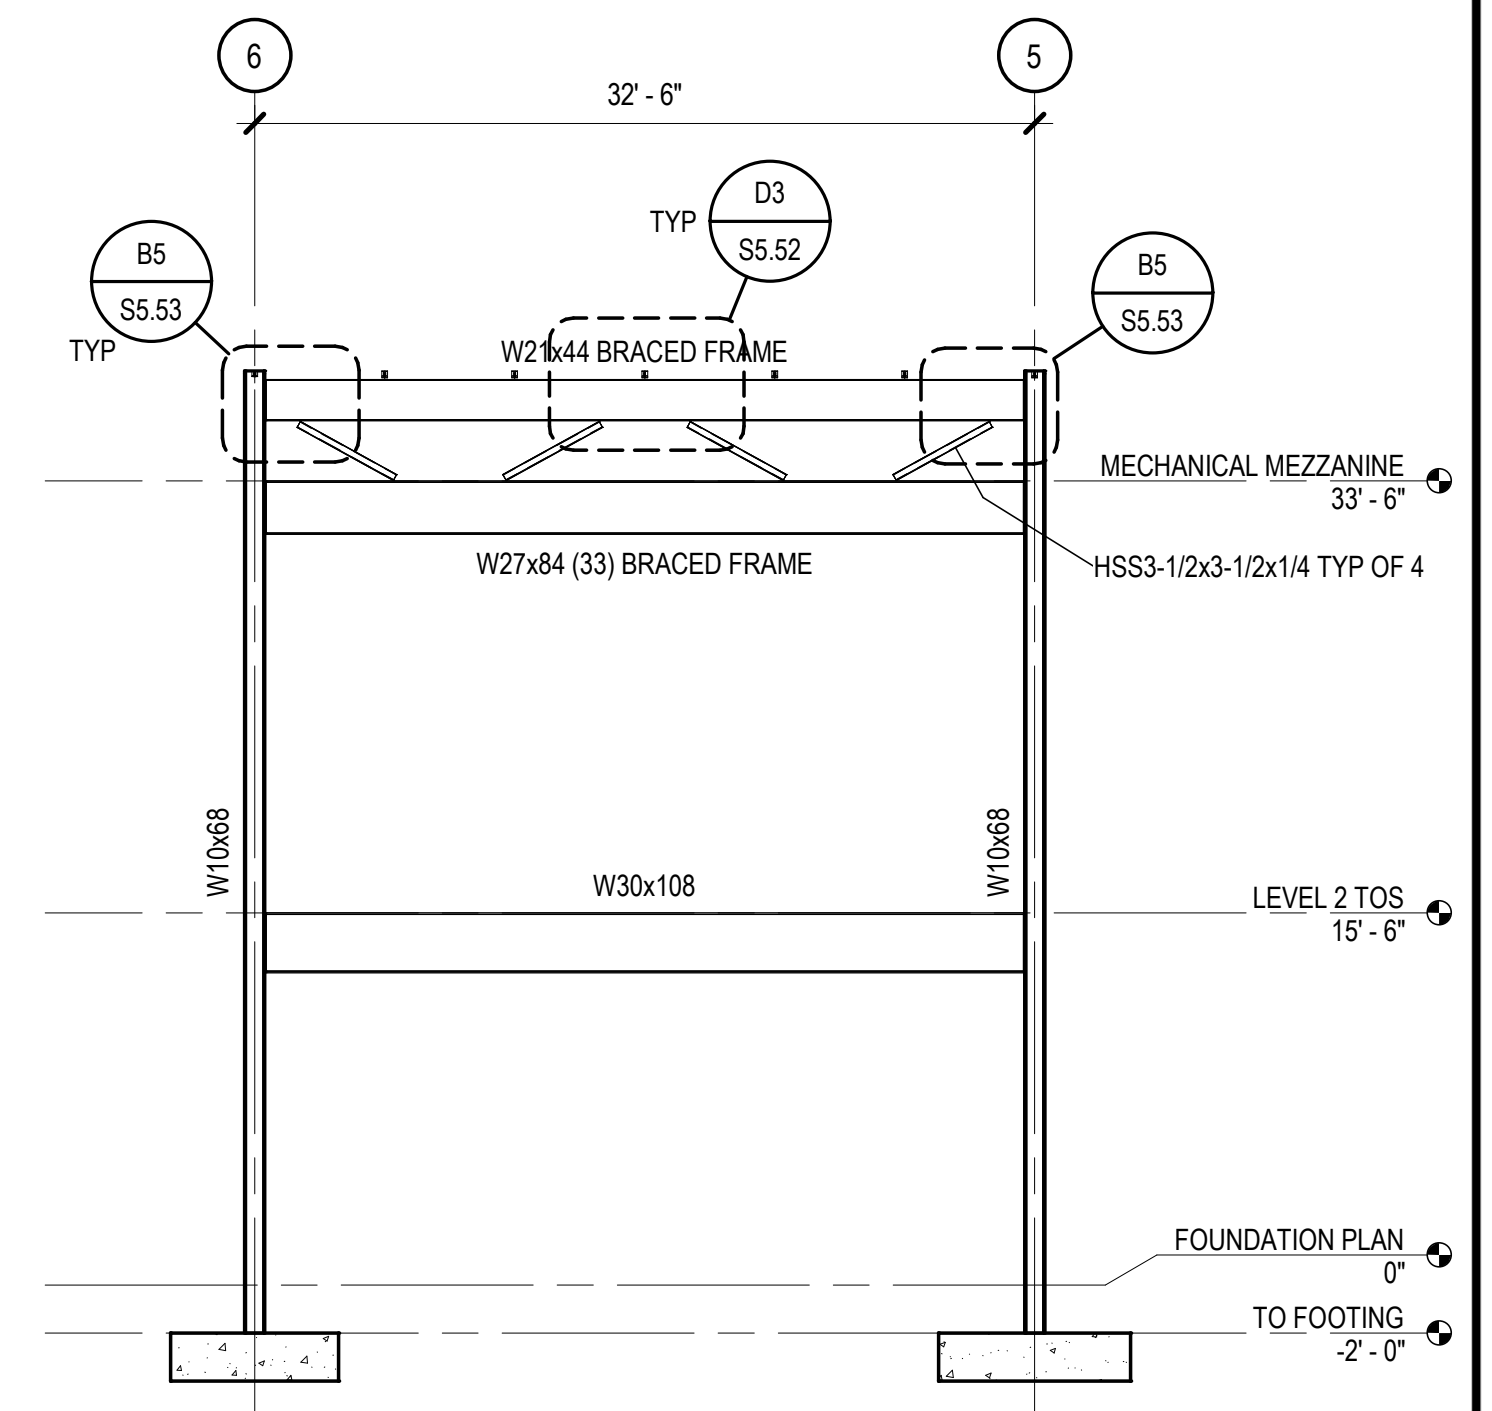


D5 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"

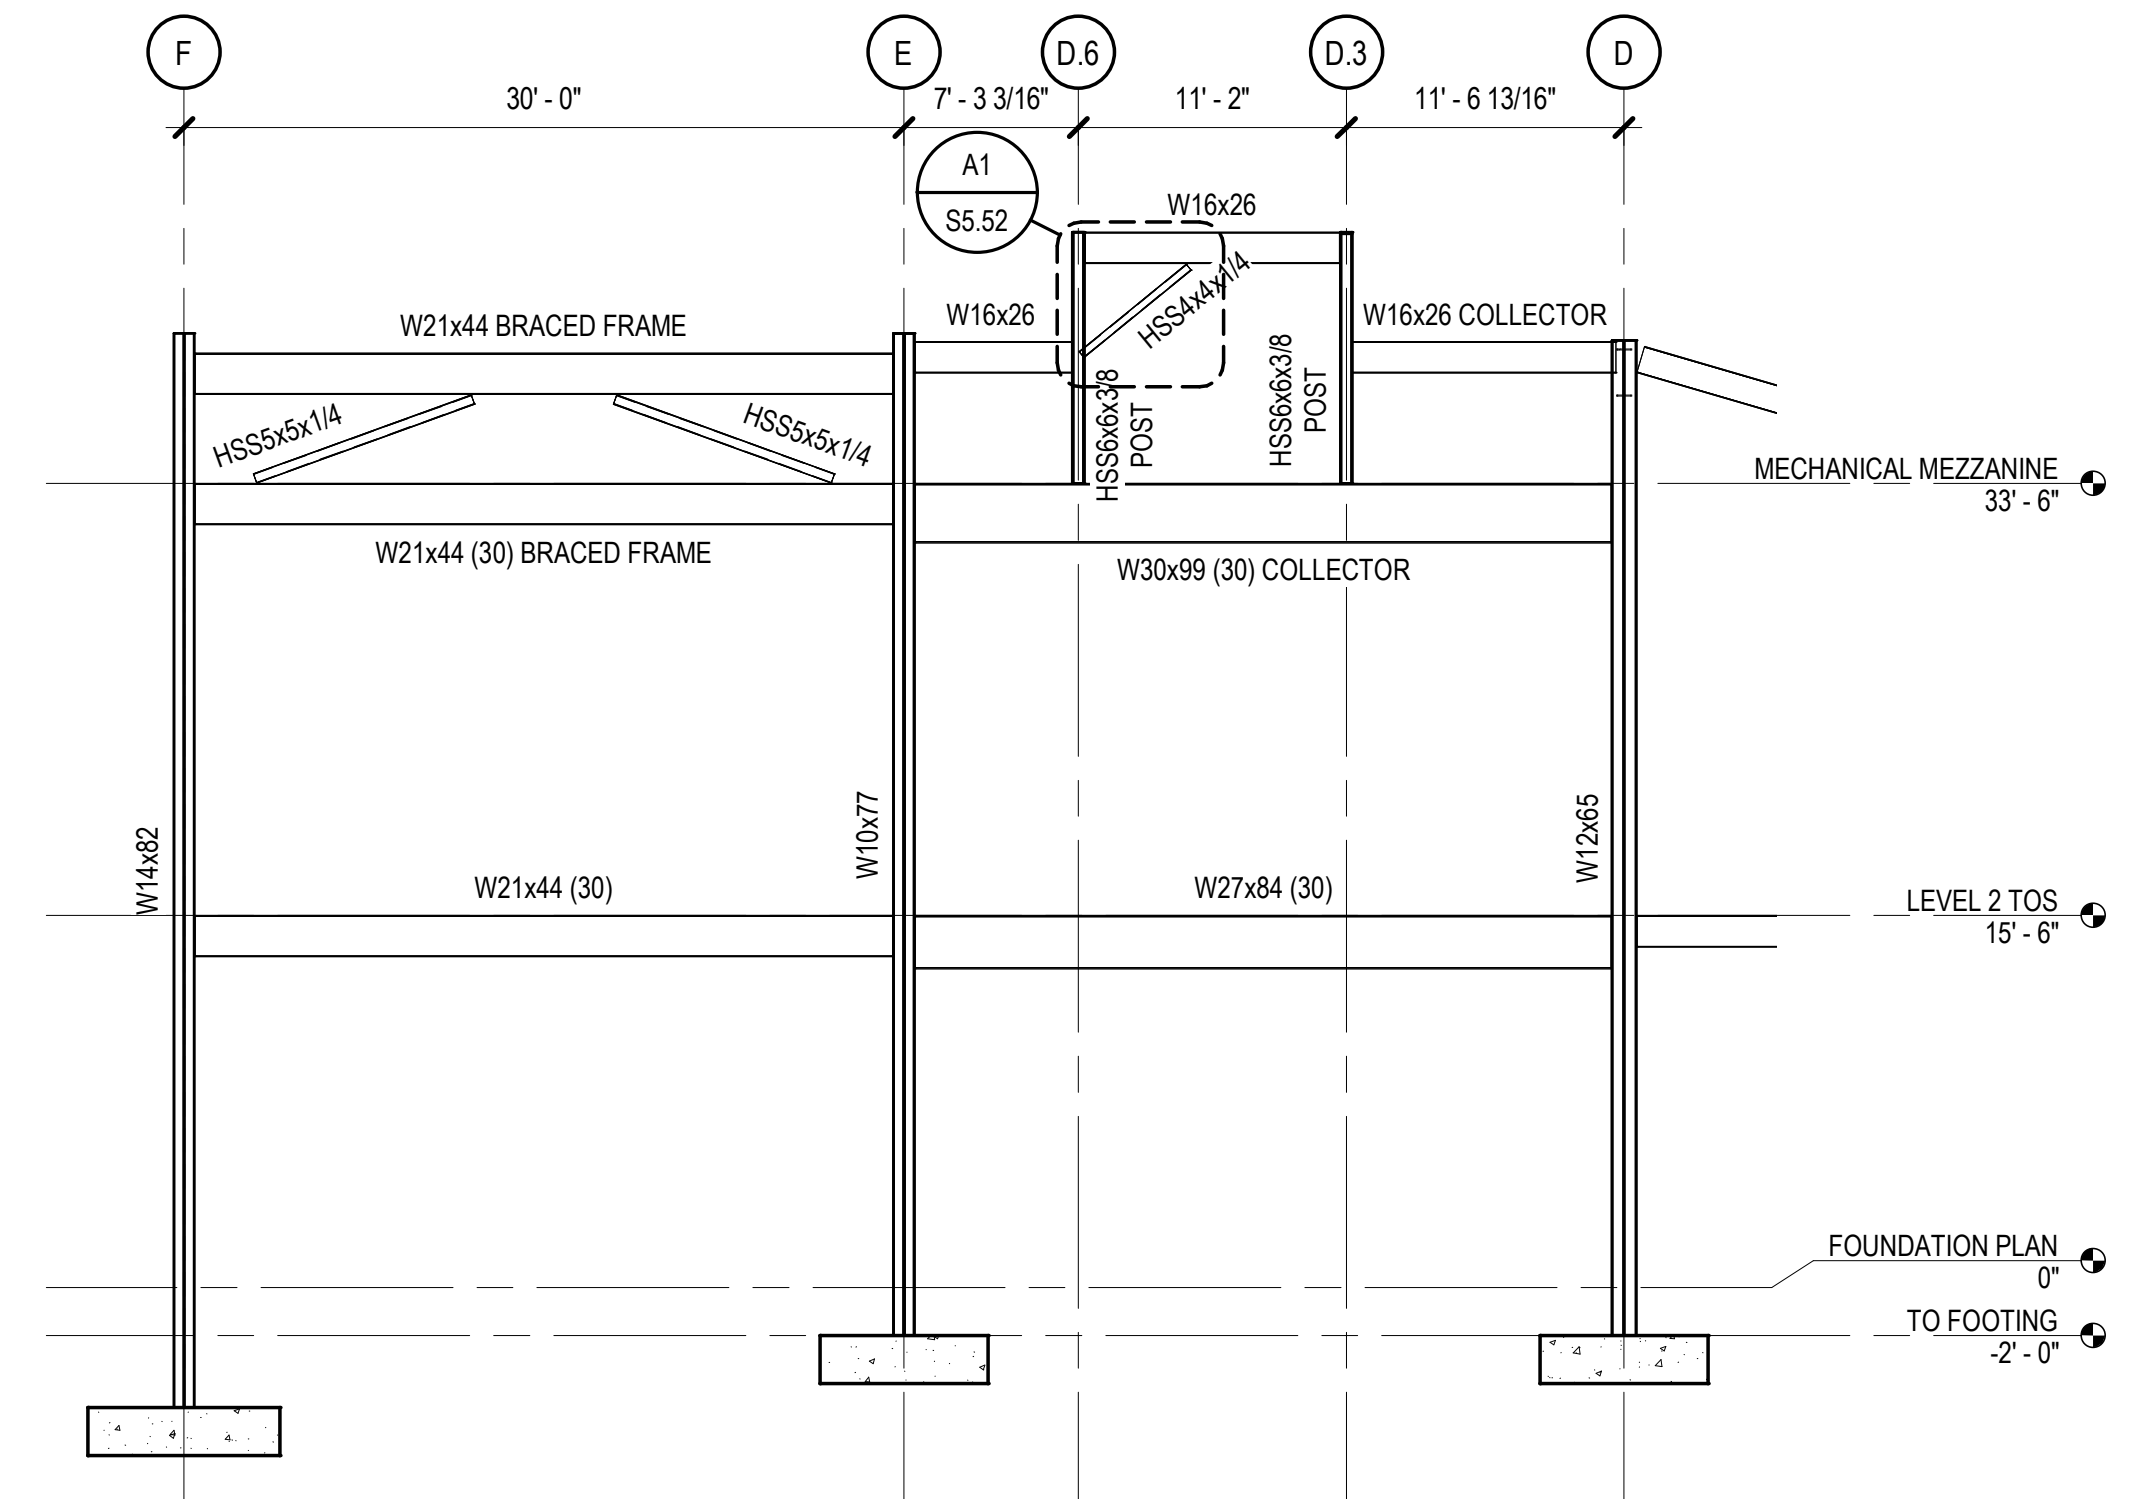


B3 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"

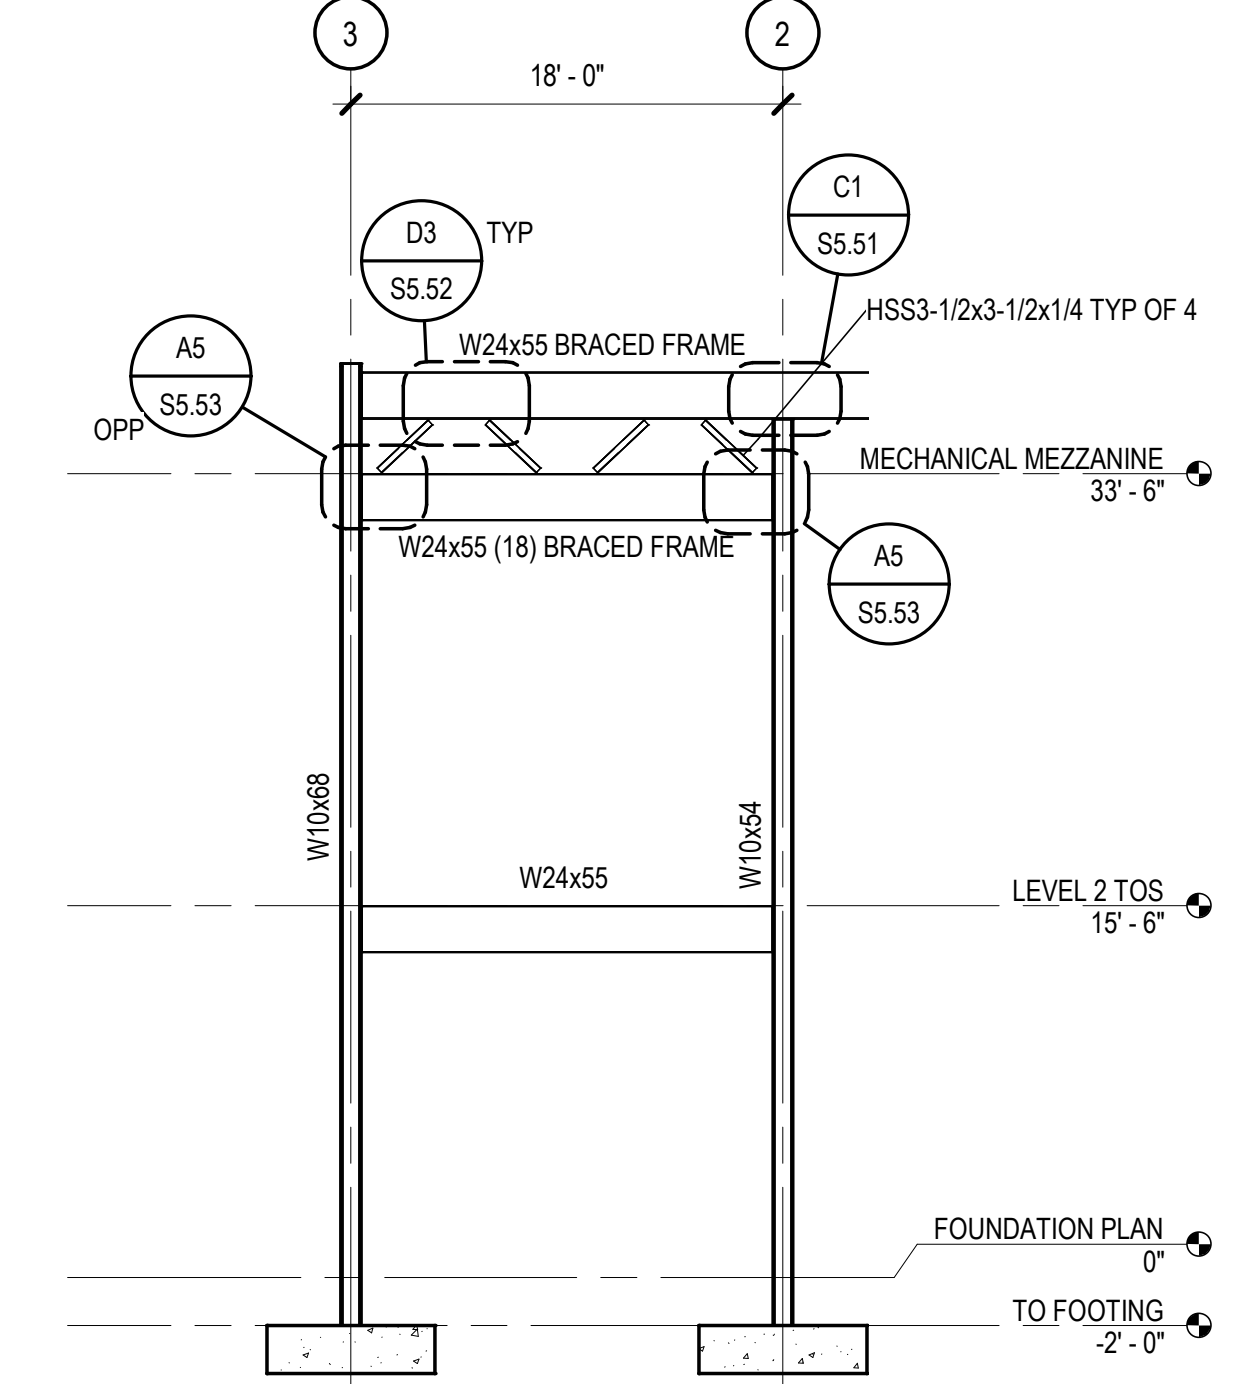


B5 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"

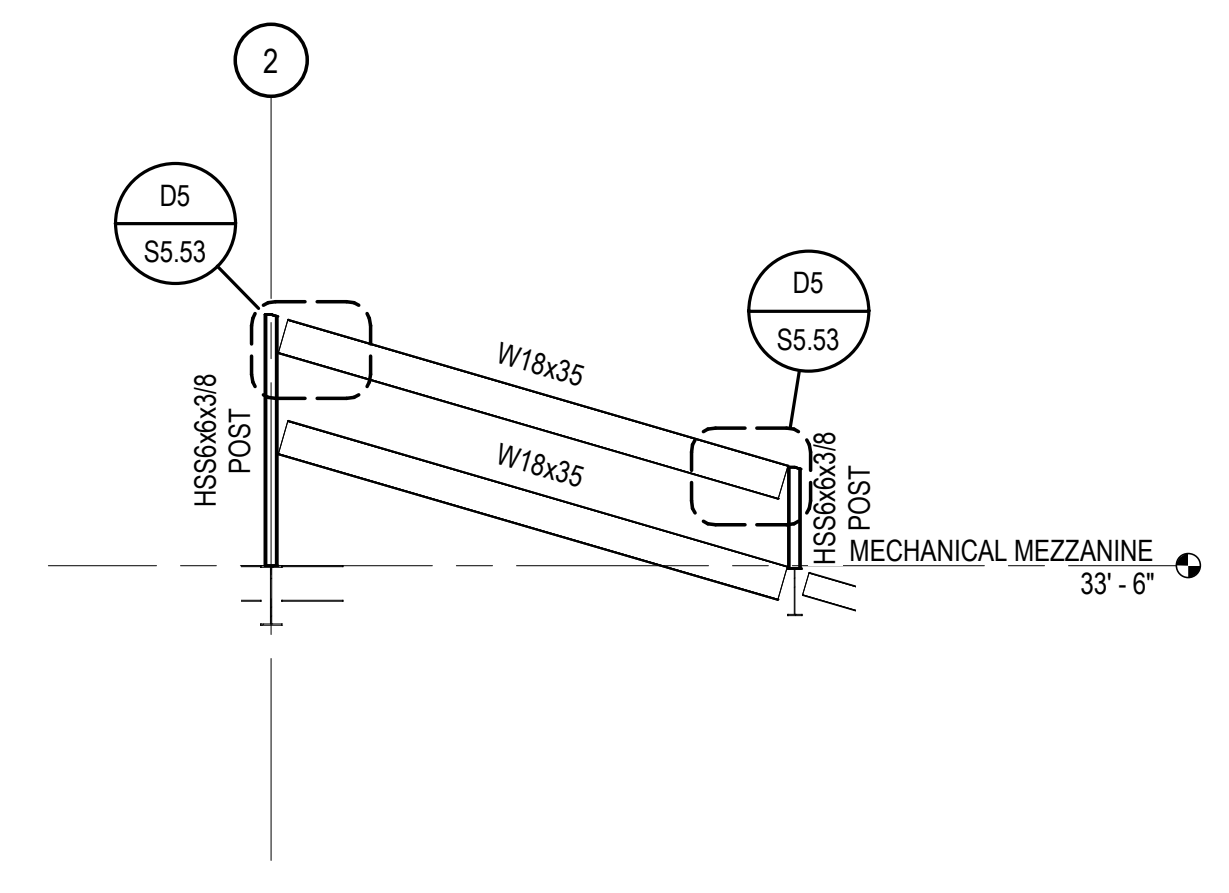



A3 MOMENT FRAME ELEVATION
SCALE: 1/8" = 1'-0"

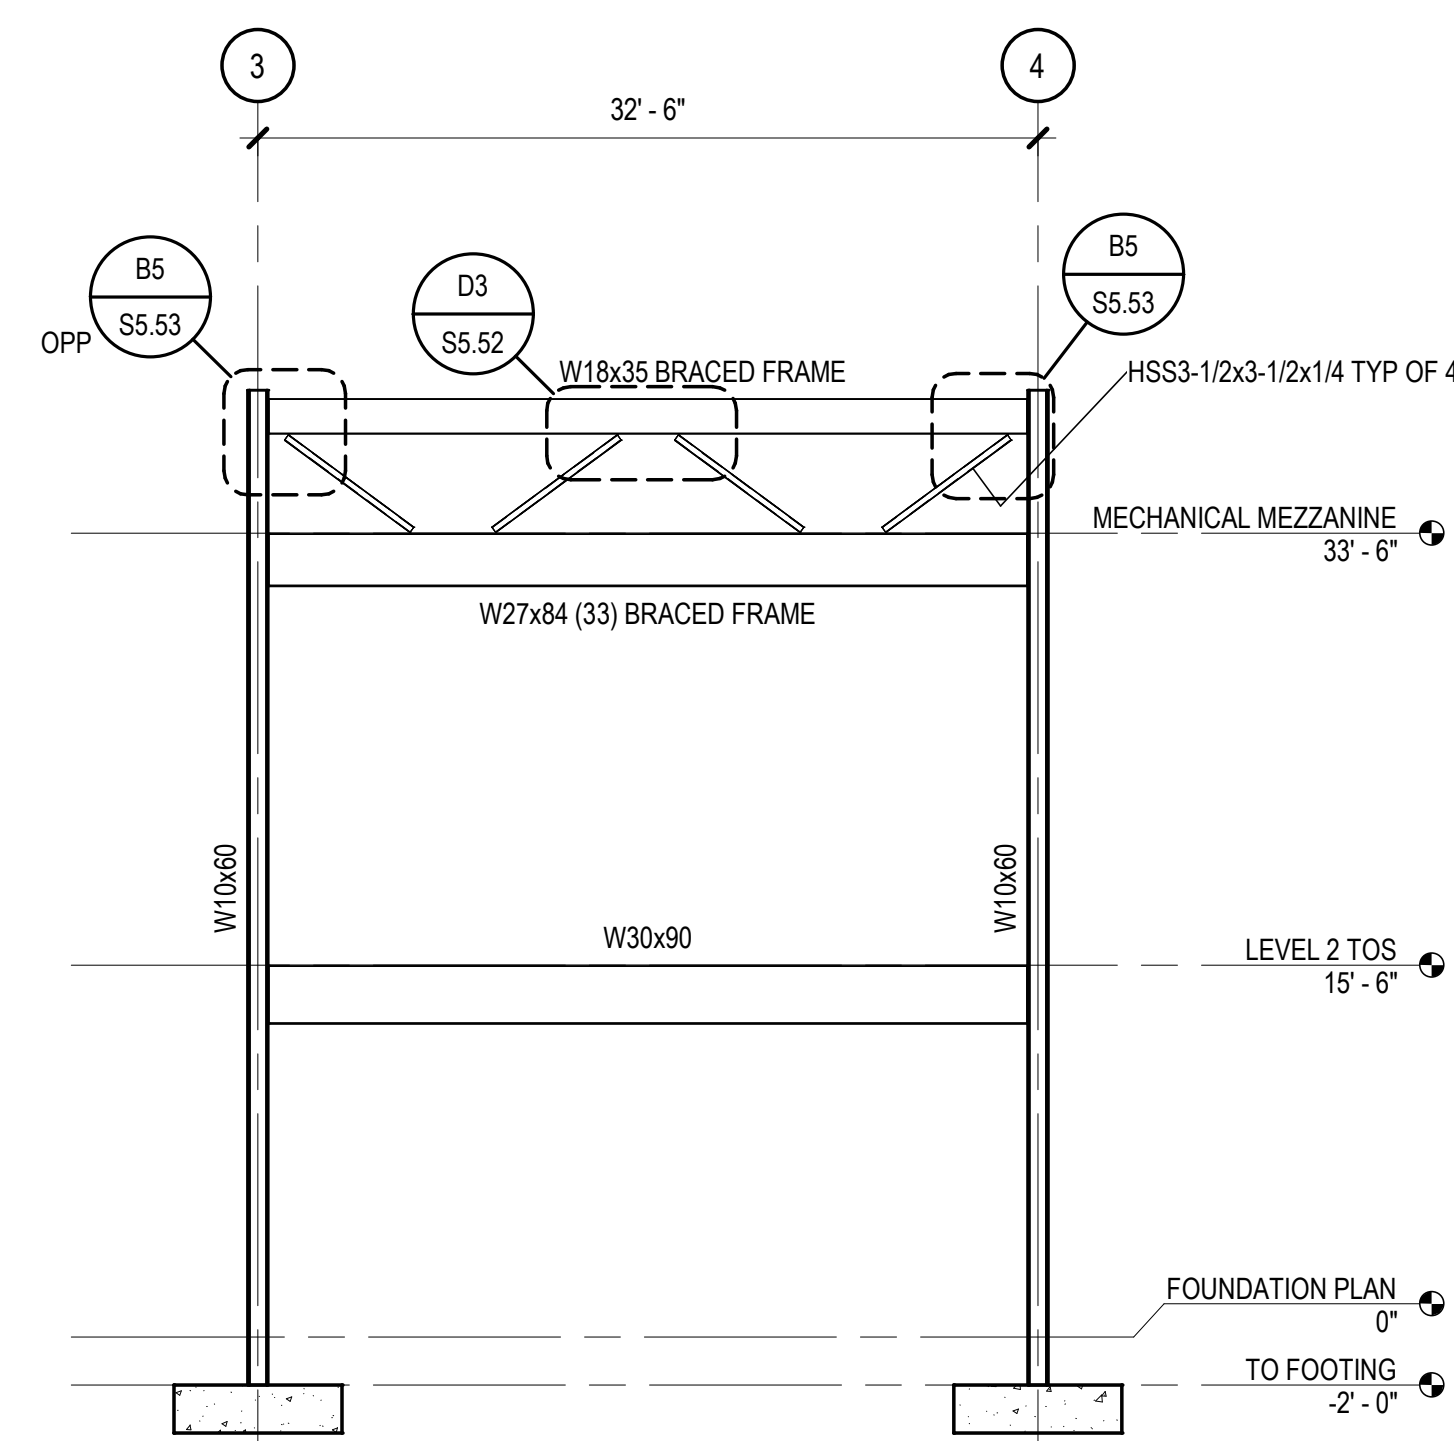


A4 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"

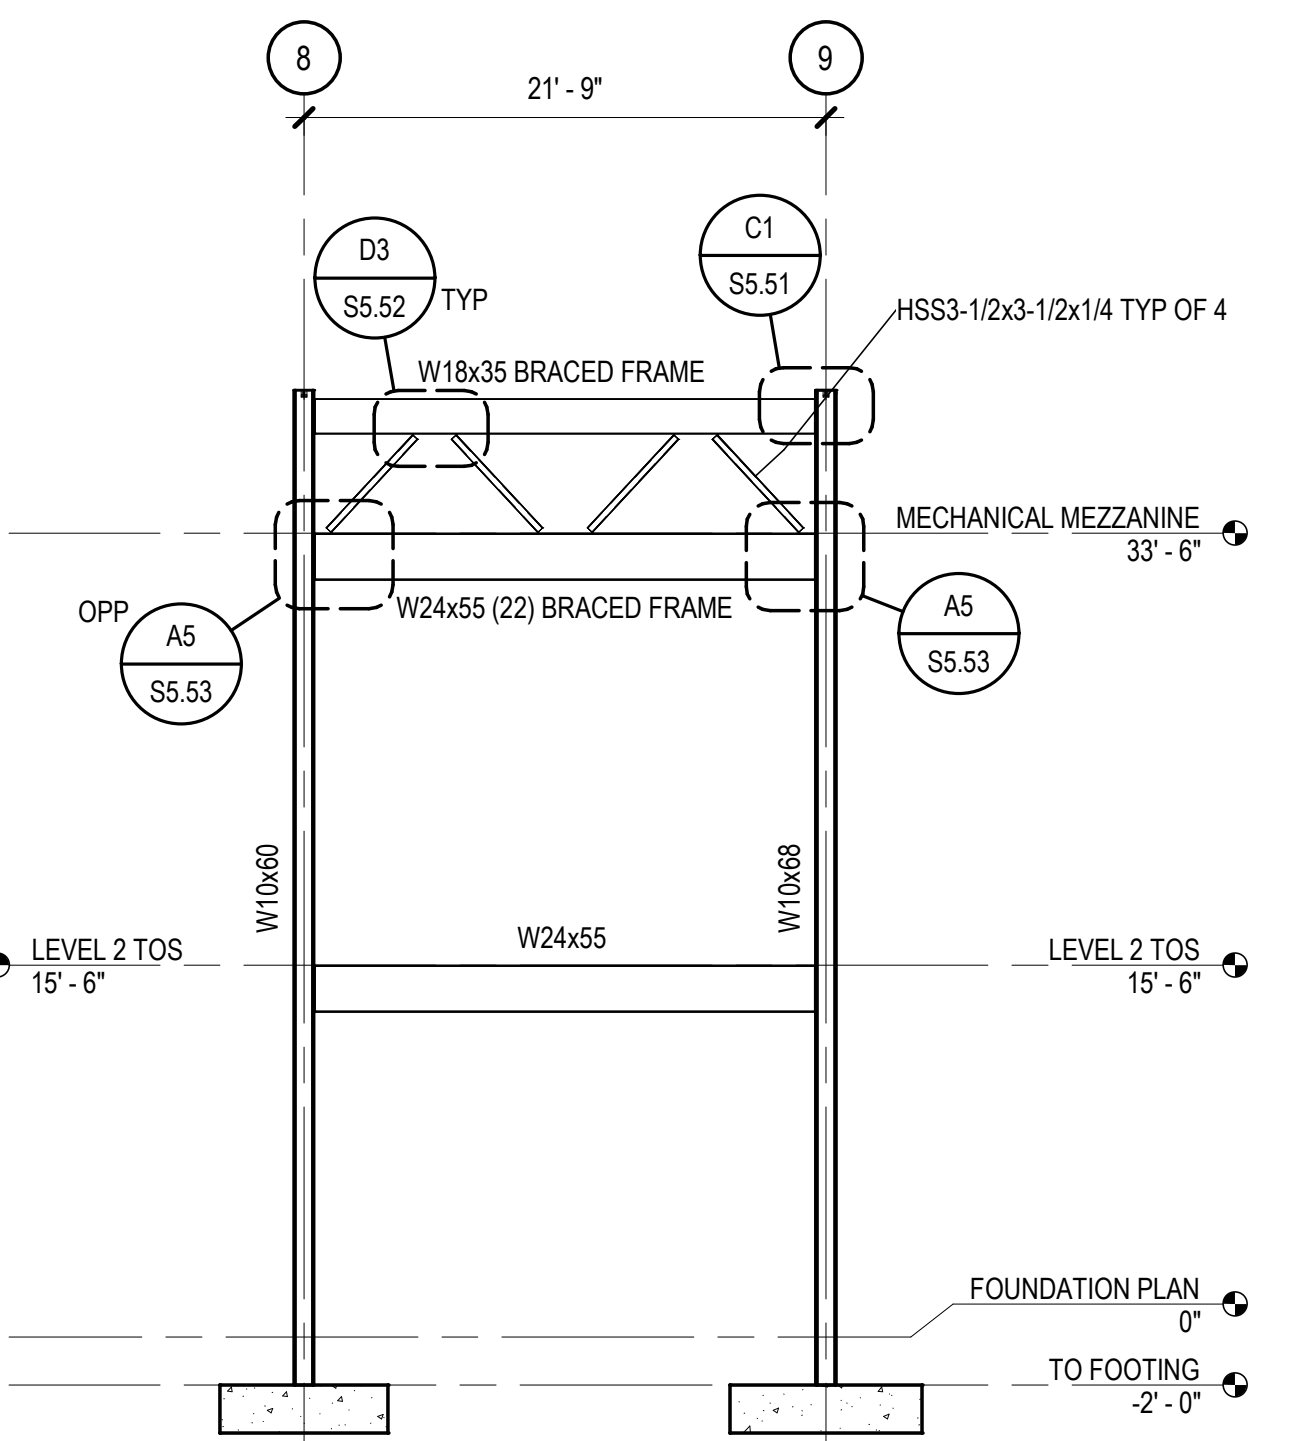


A5 BRACED FRAME ELEVATION
SCALE: 1/8" = 1'-0"

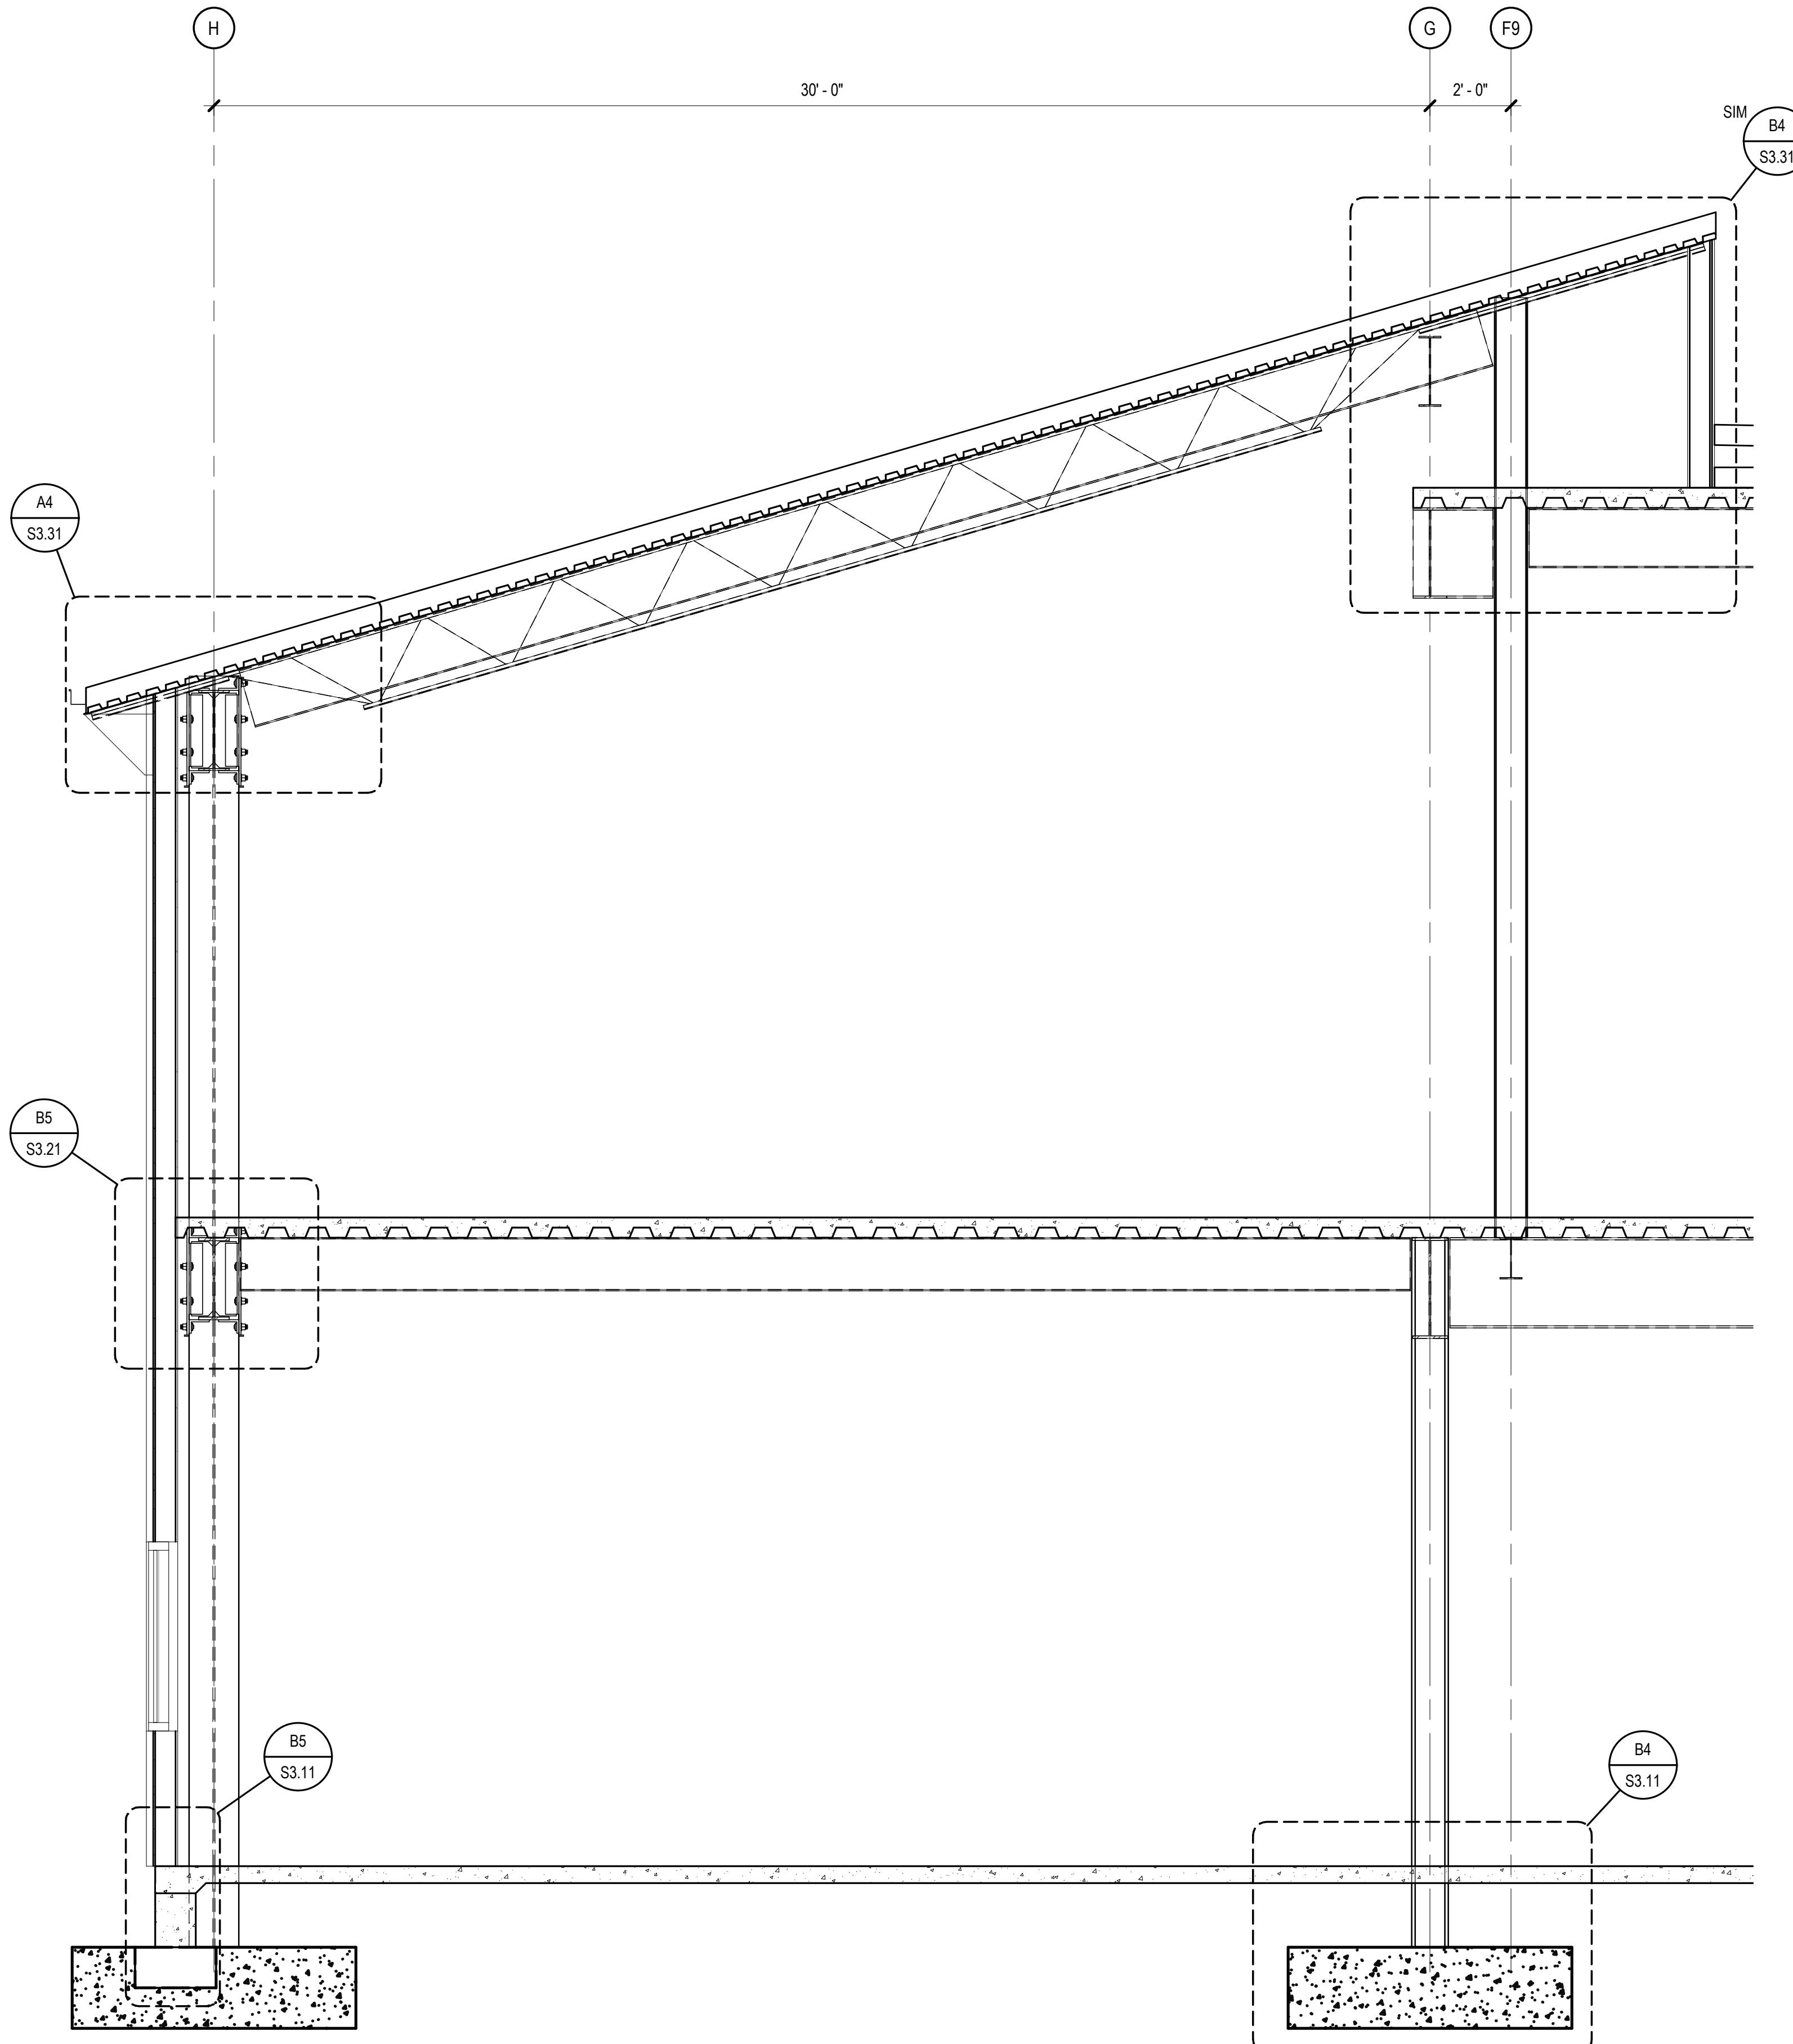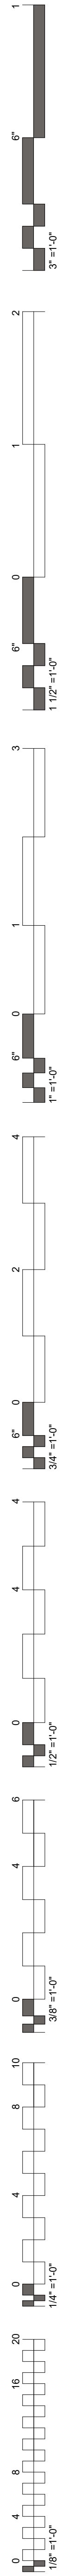


A1 WALL SECTION
SCALE: 3/8" = 1'-0"

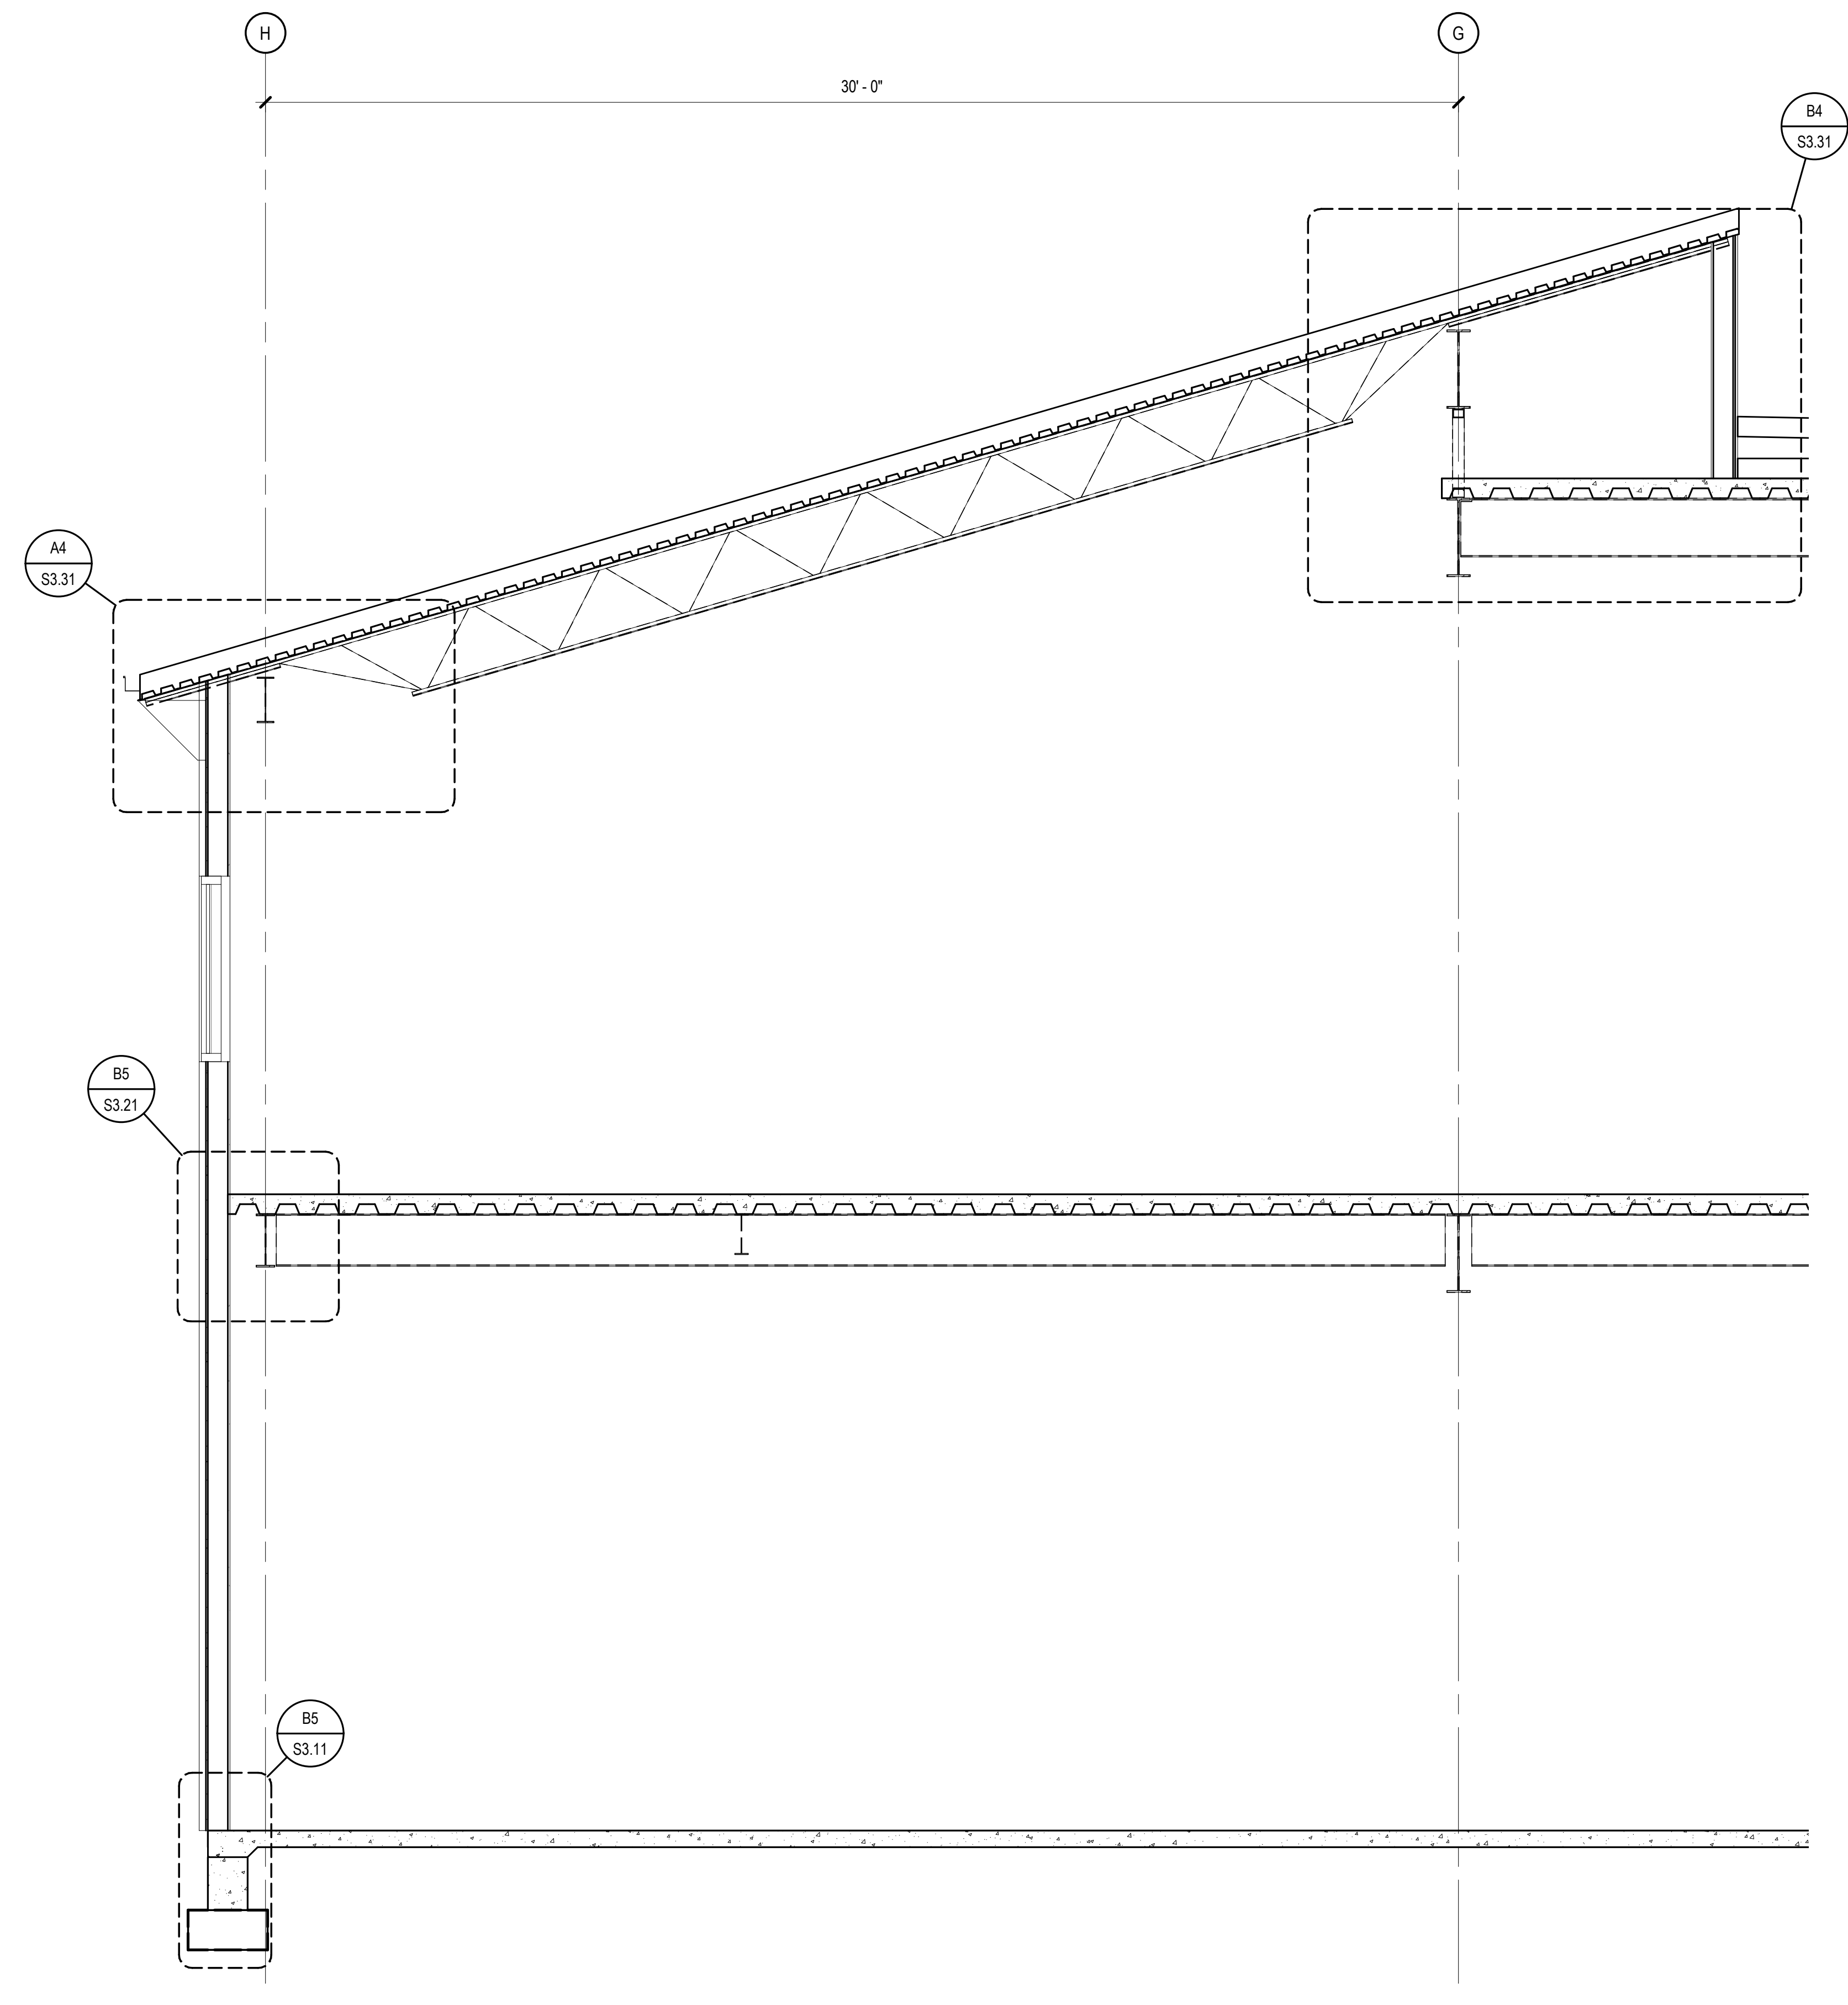

A3 WALL SECTION
SCALE: 3/8" = 1'-0"

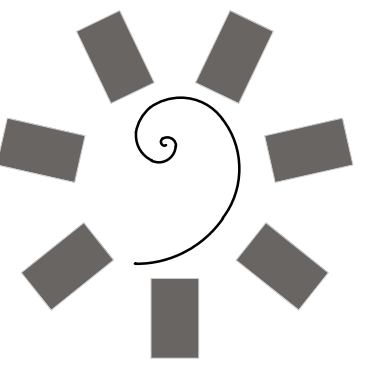

**James R. Childers
Architect, Inc.**
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com

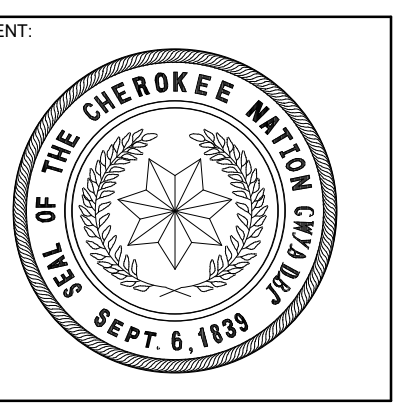

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:



PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S3.01


WALL SECTIONS

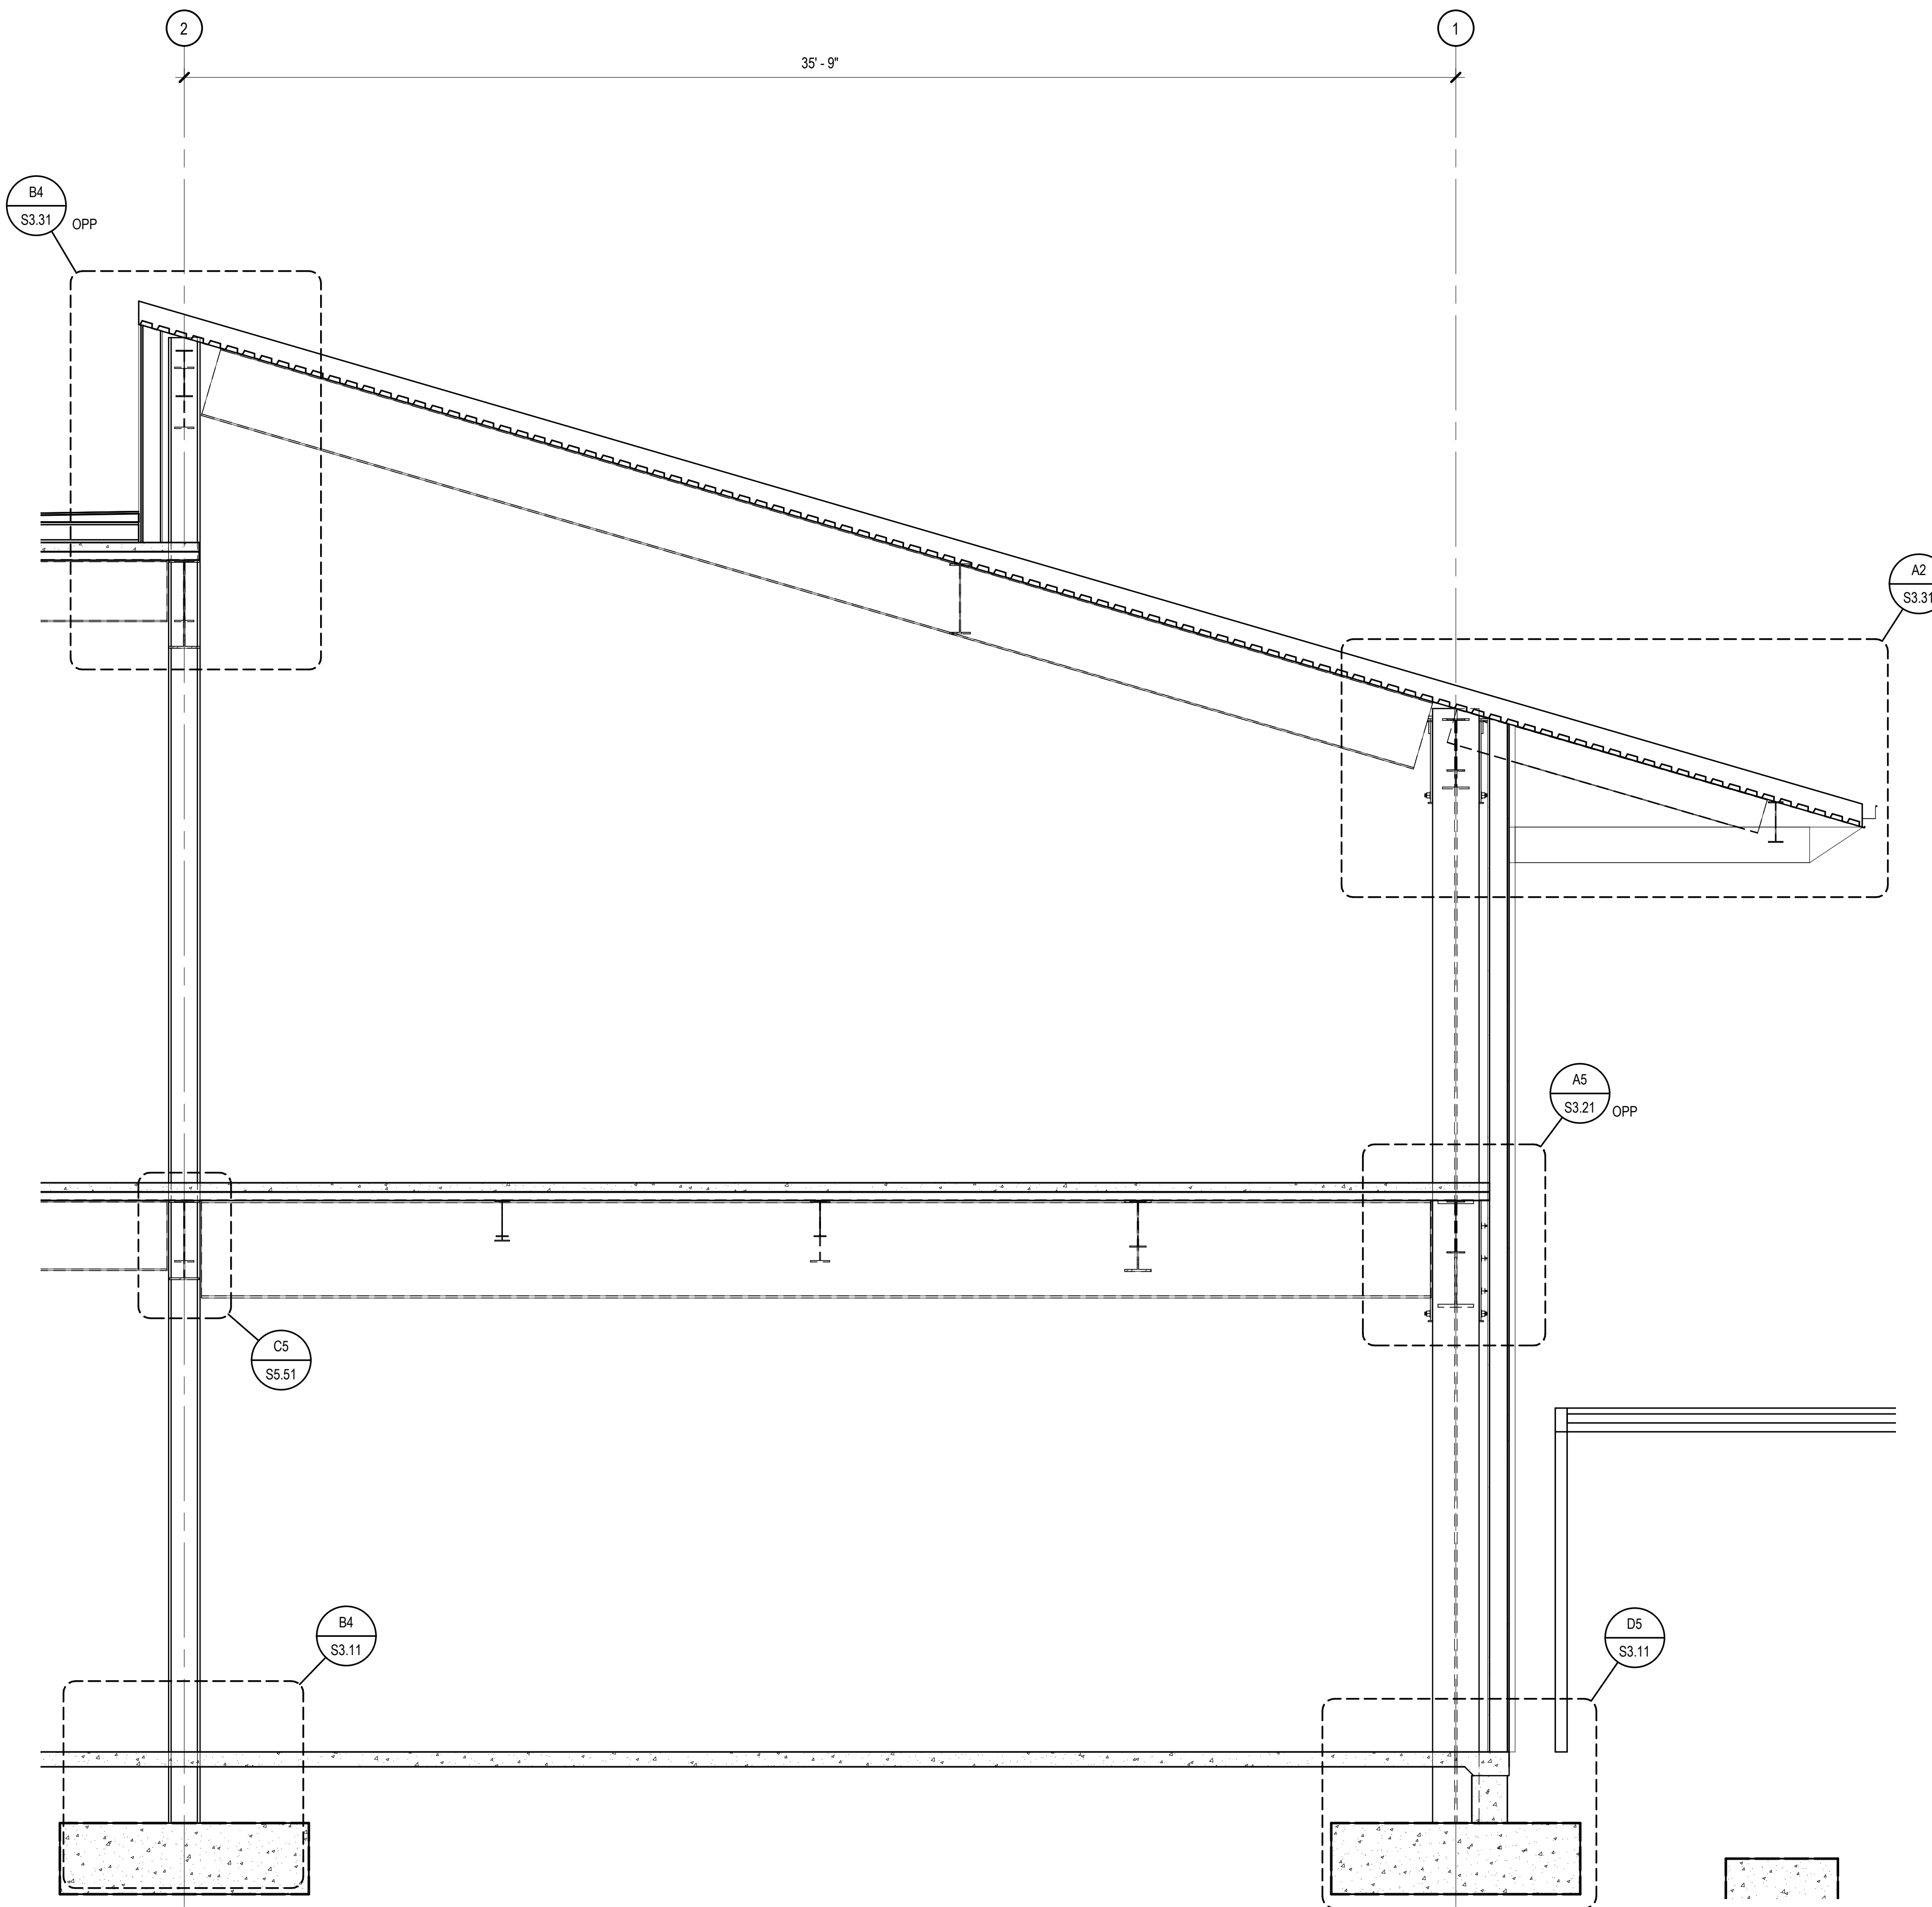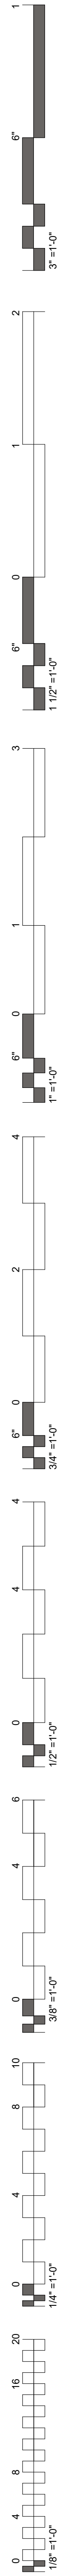

A1 WALL SECTION
SCALE: 3/8" = 1'-0"

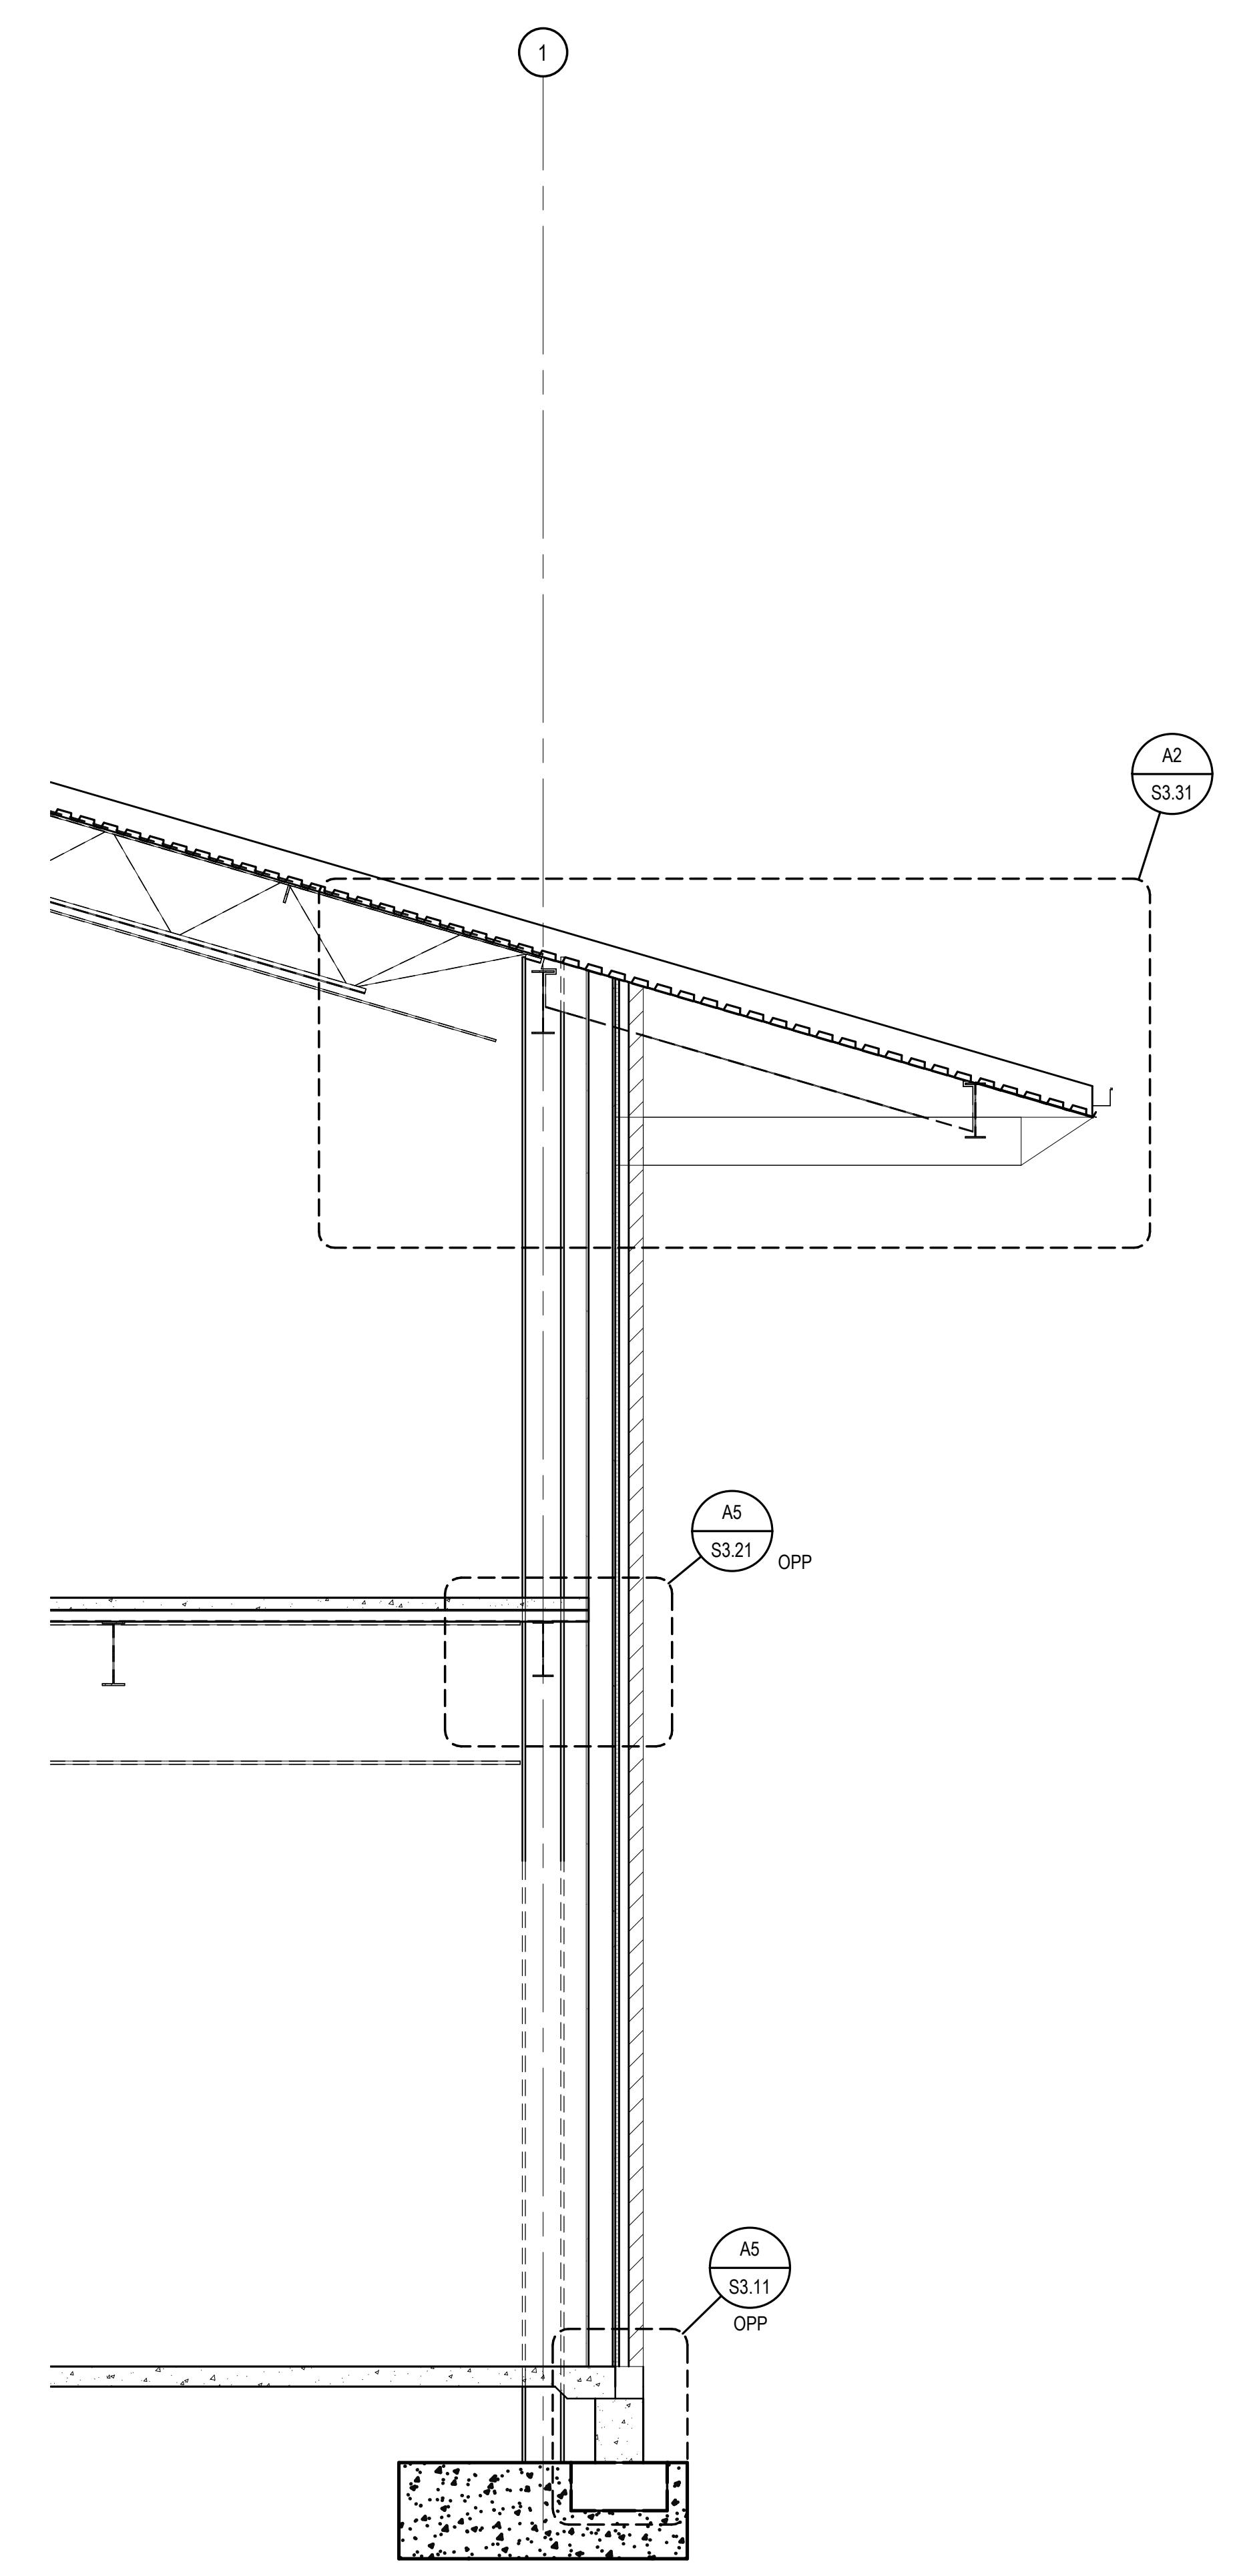

A4 WALL SECTION
SCALE: 3/8" = 1'-0"



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:




PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S3.02

WALL SECTIONS

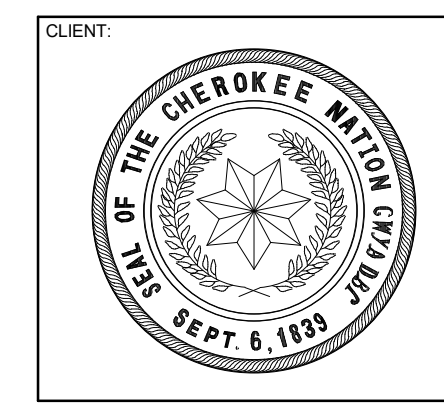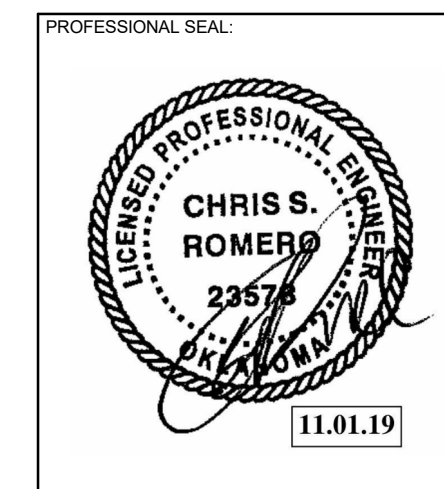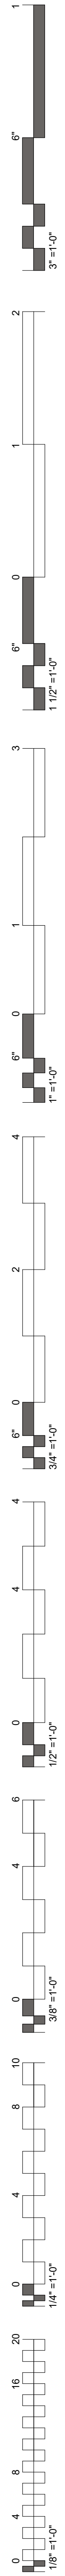

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:
[Blank space for key plan]


PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S3.03


WALL SECTIONS

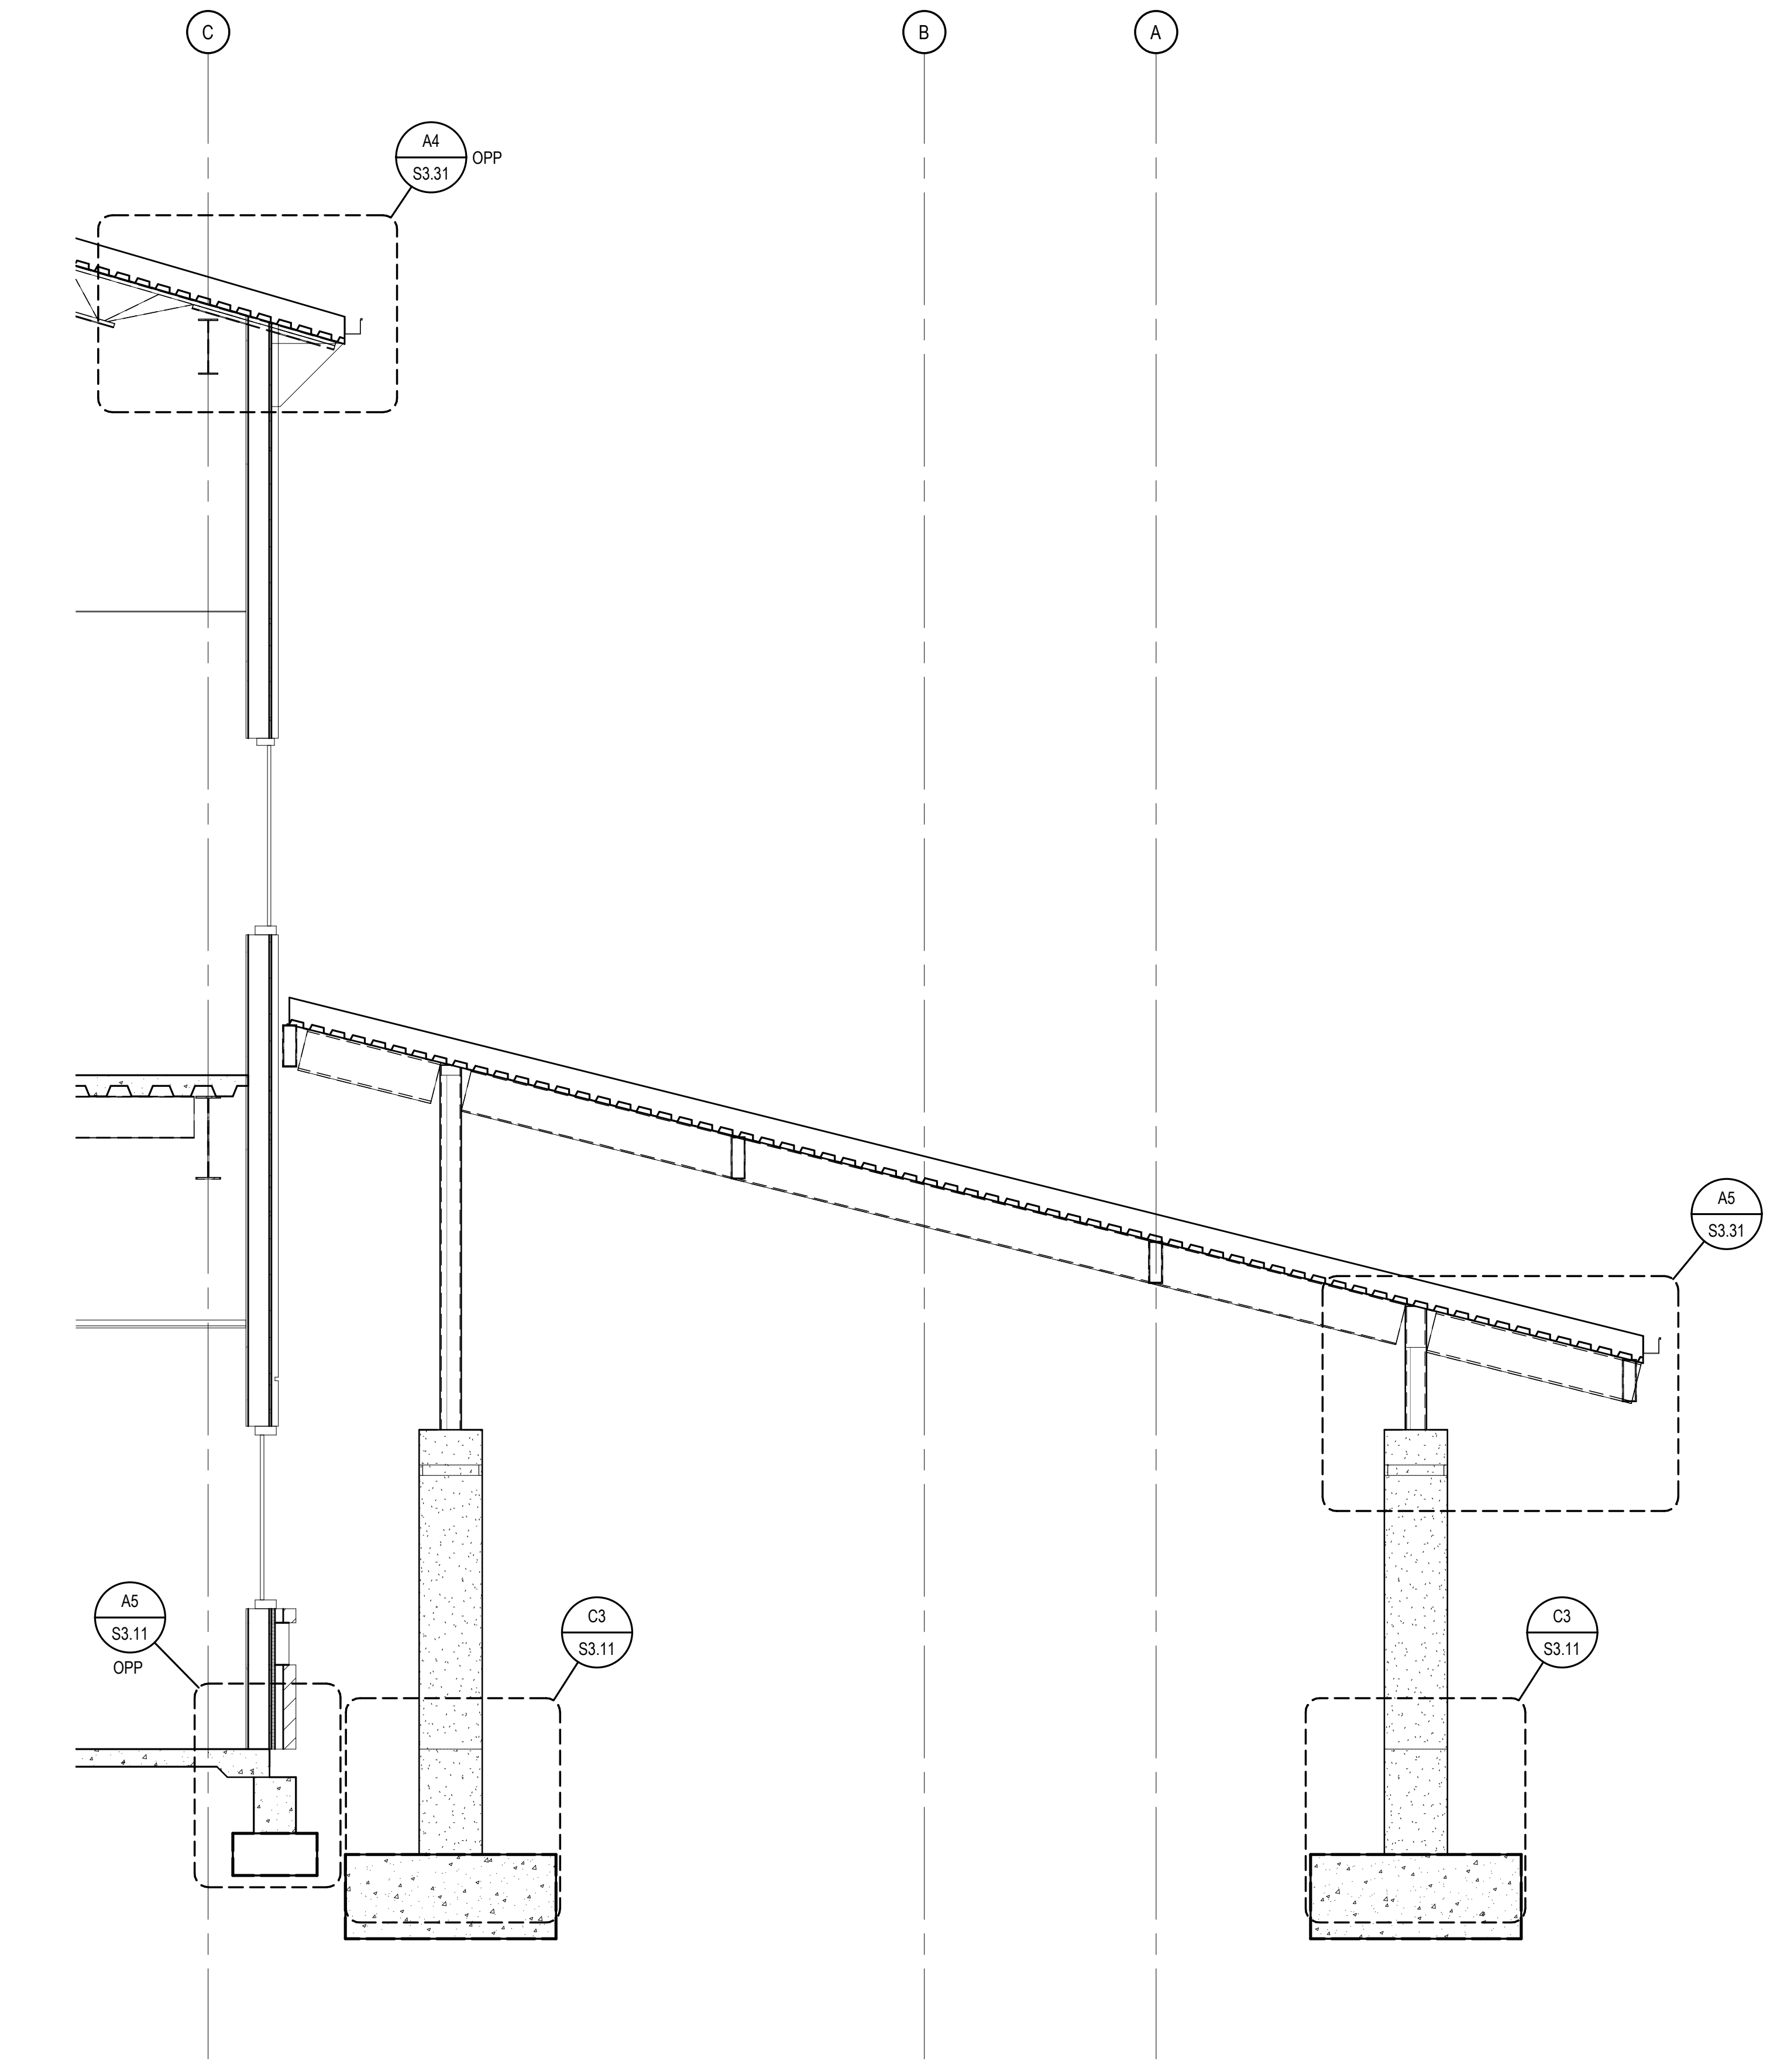



A1 WALL SECTION
SCALE: 3/8" = 1'-0"

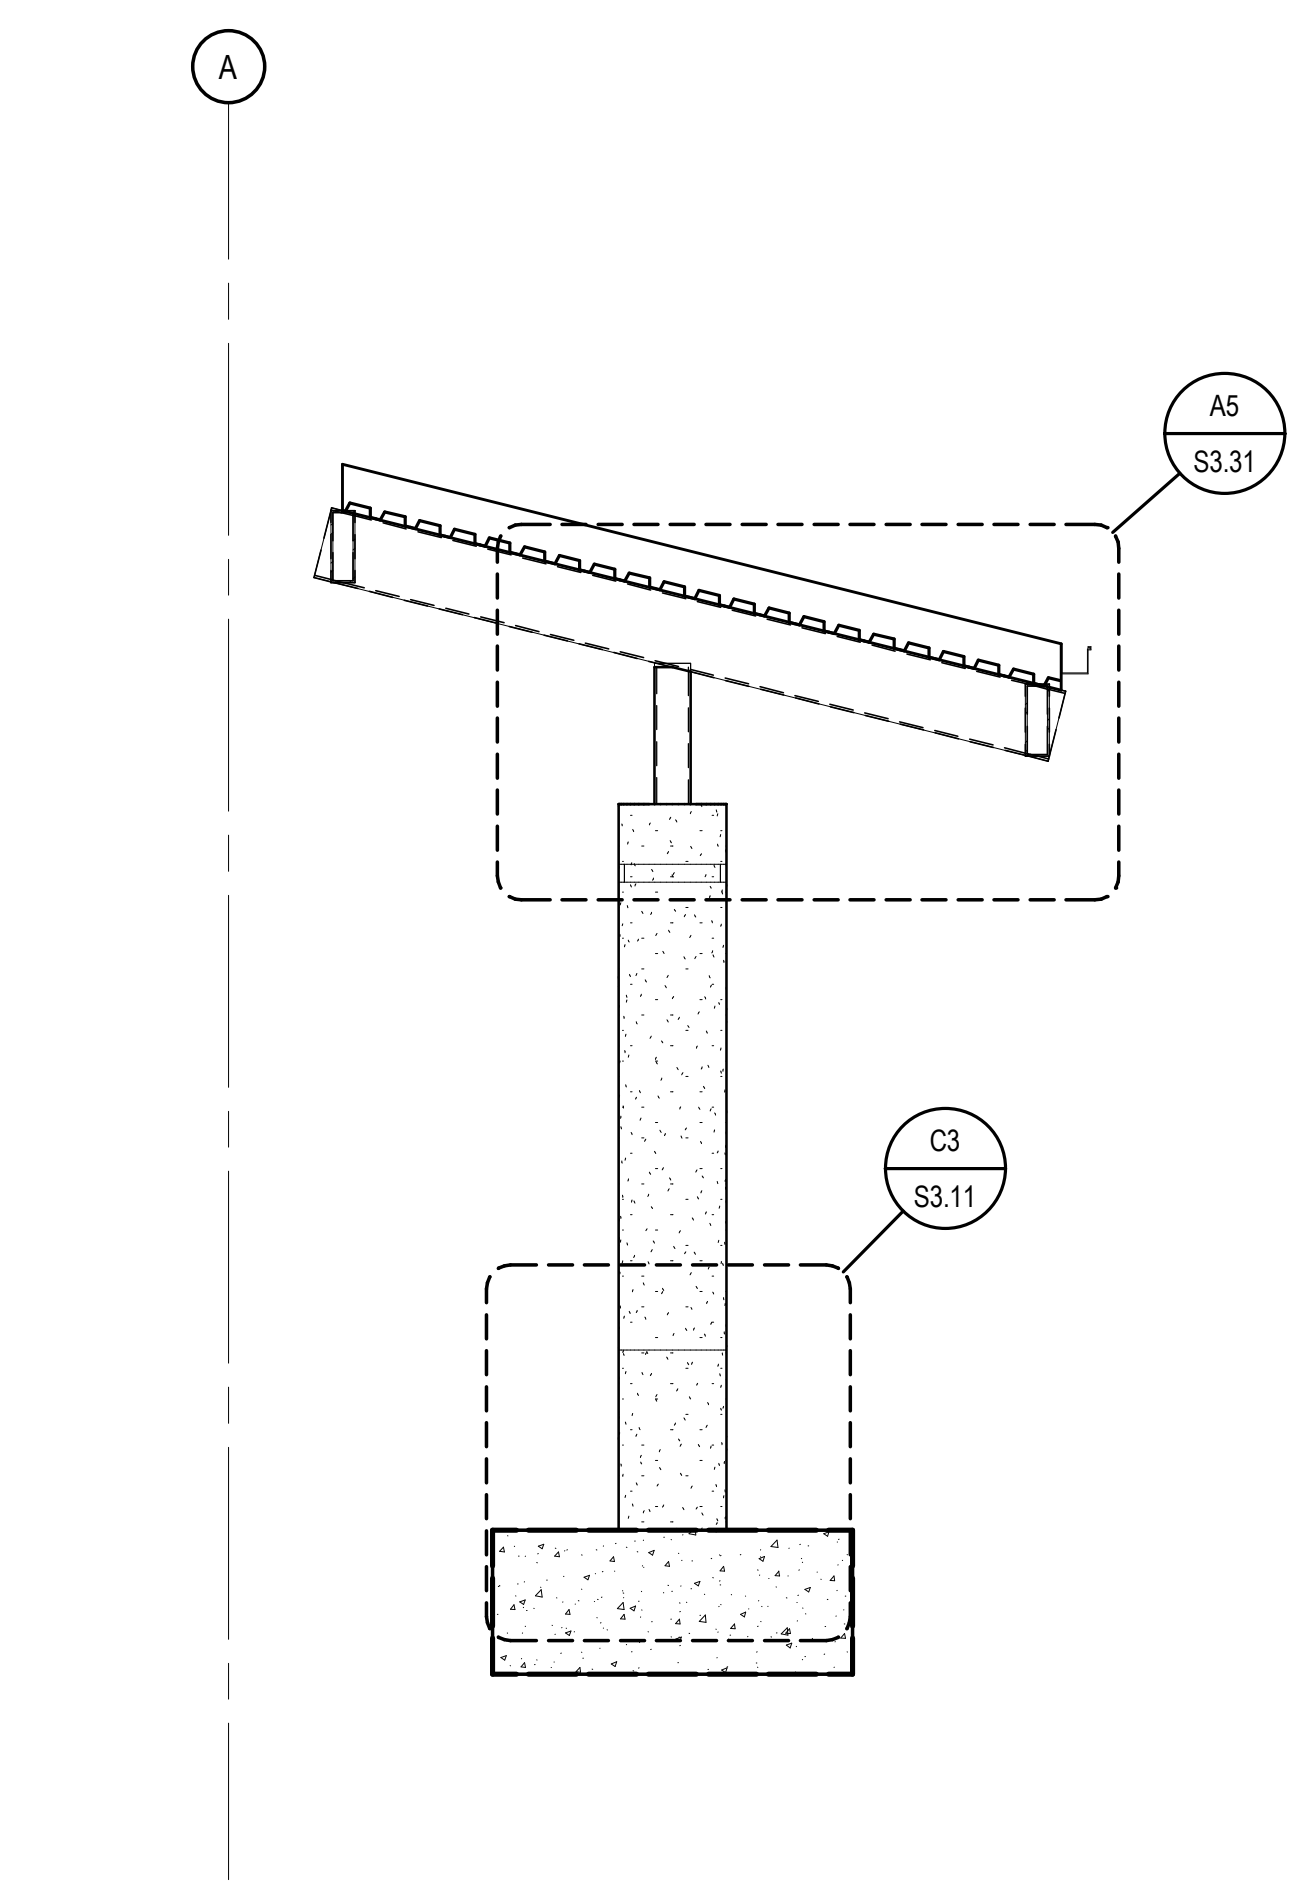


A4 WALL SECTION
SCALE: 3/8" = 1'-0"

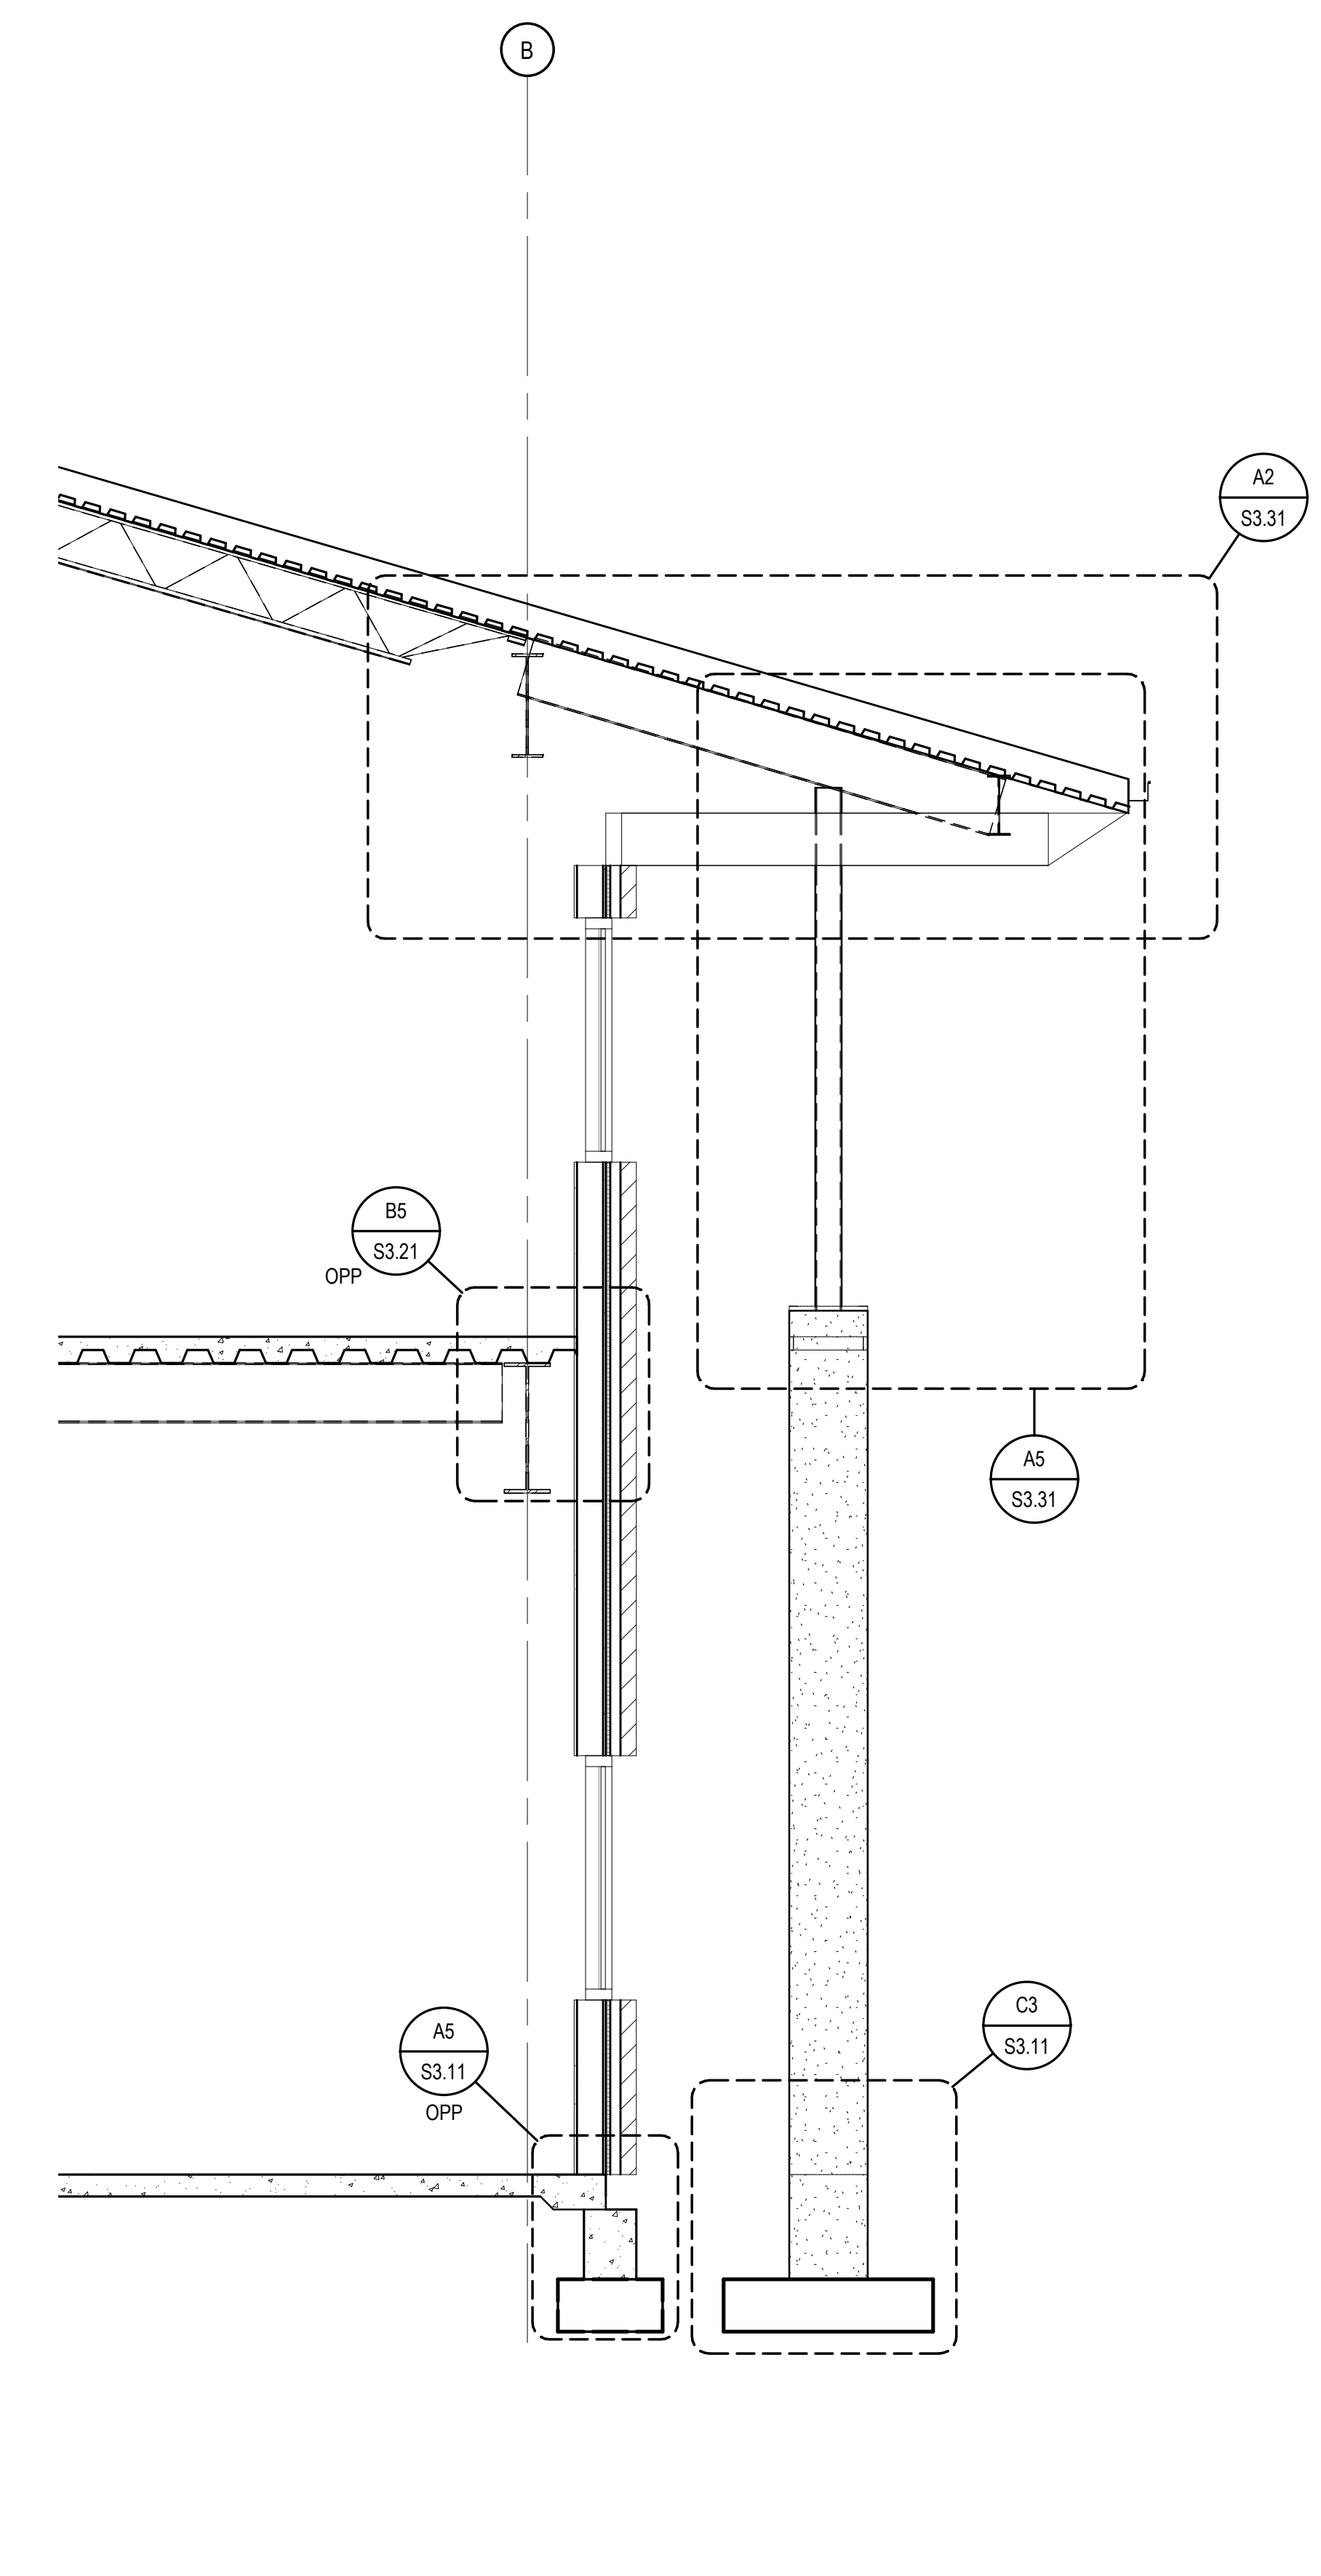

A5 WALL SECTION
SCALE: 3/8" = 1'-0"

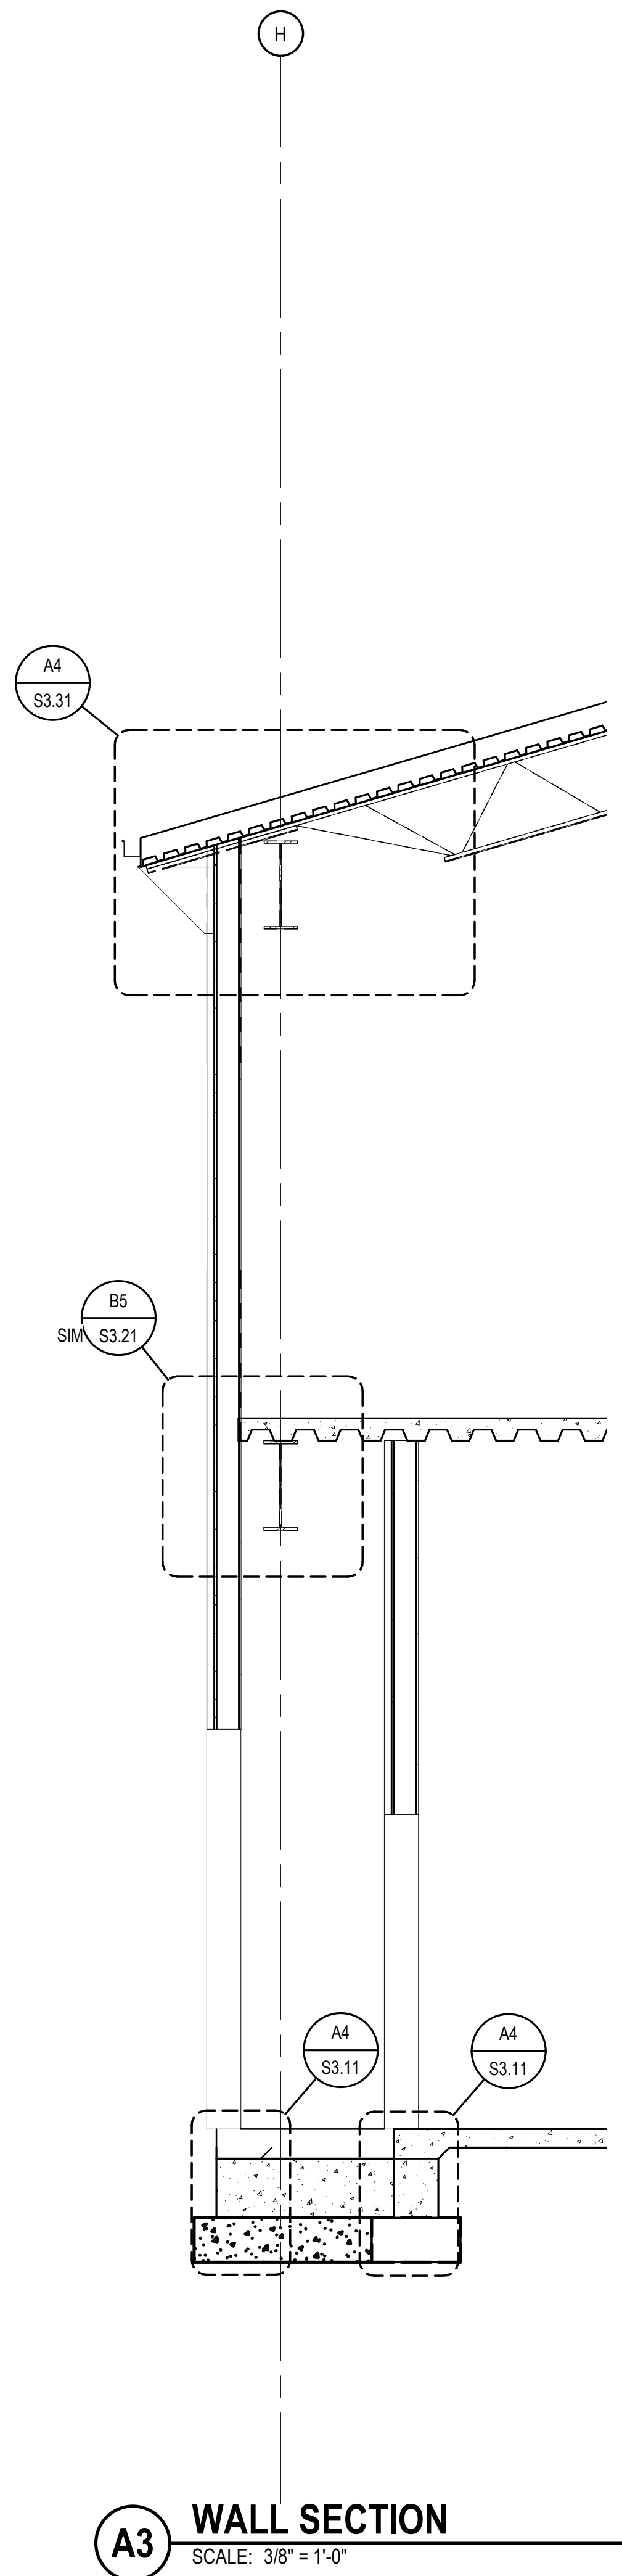
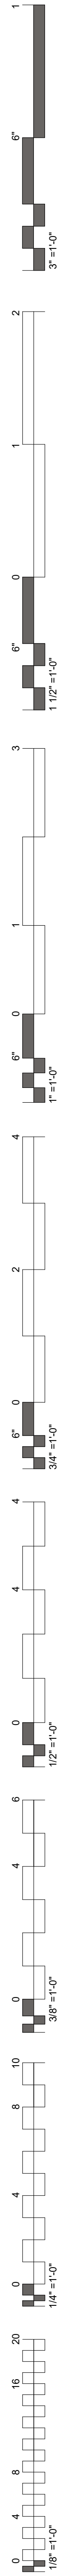


A3 WALL SECTION
SCALE: 3/8" = 1'-0"

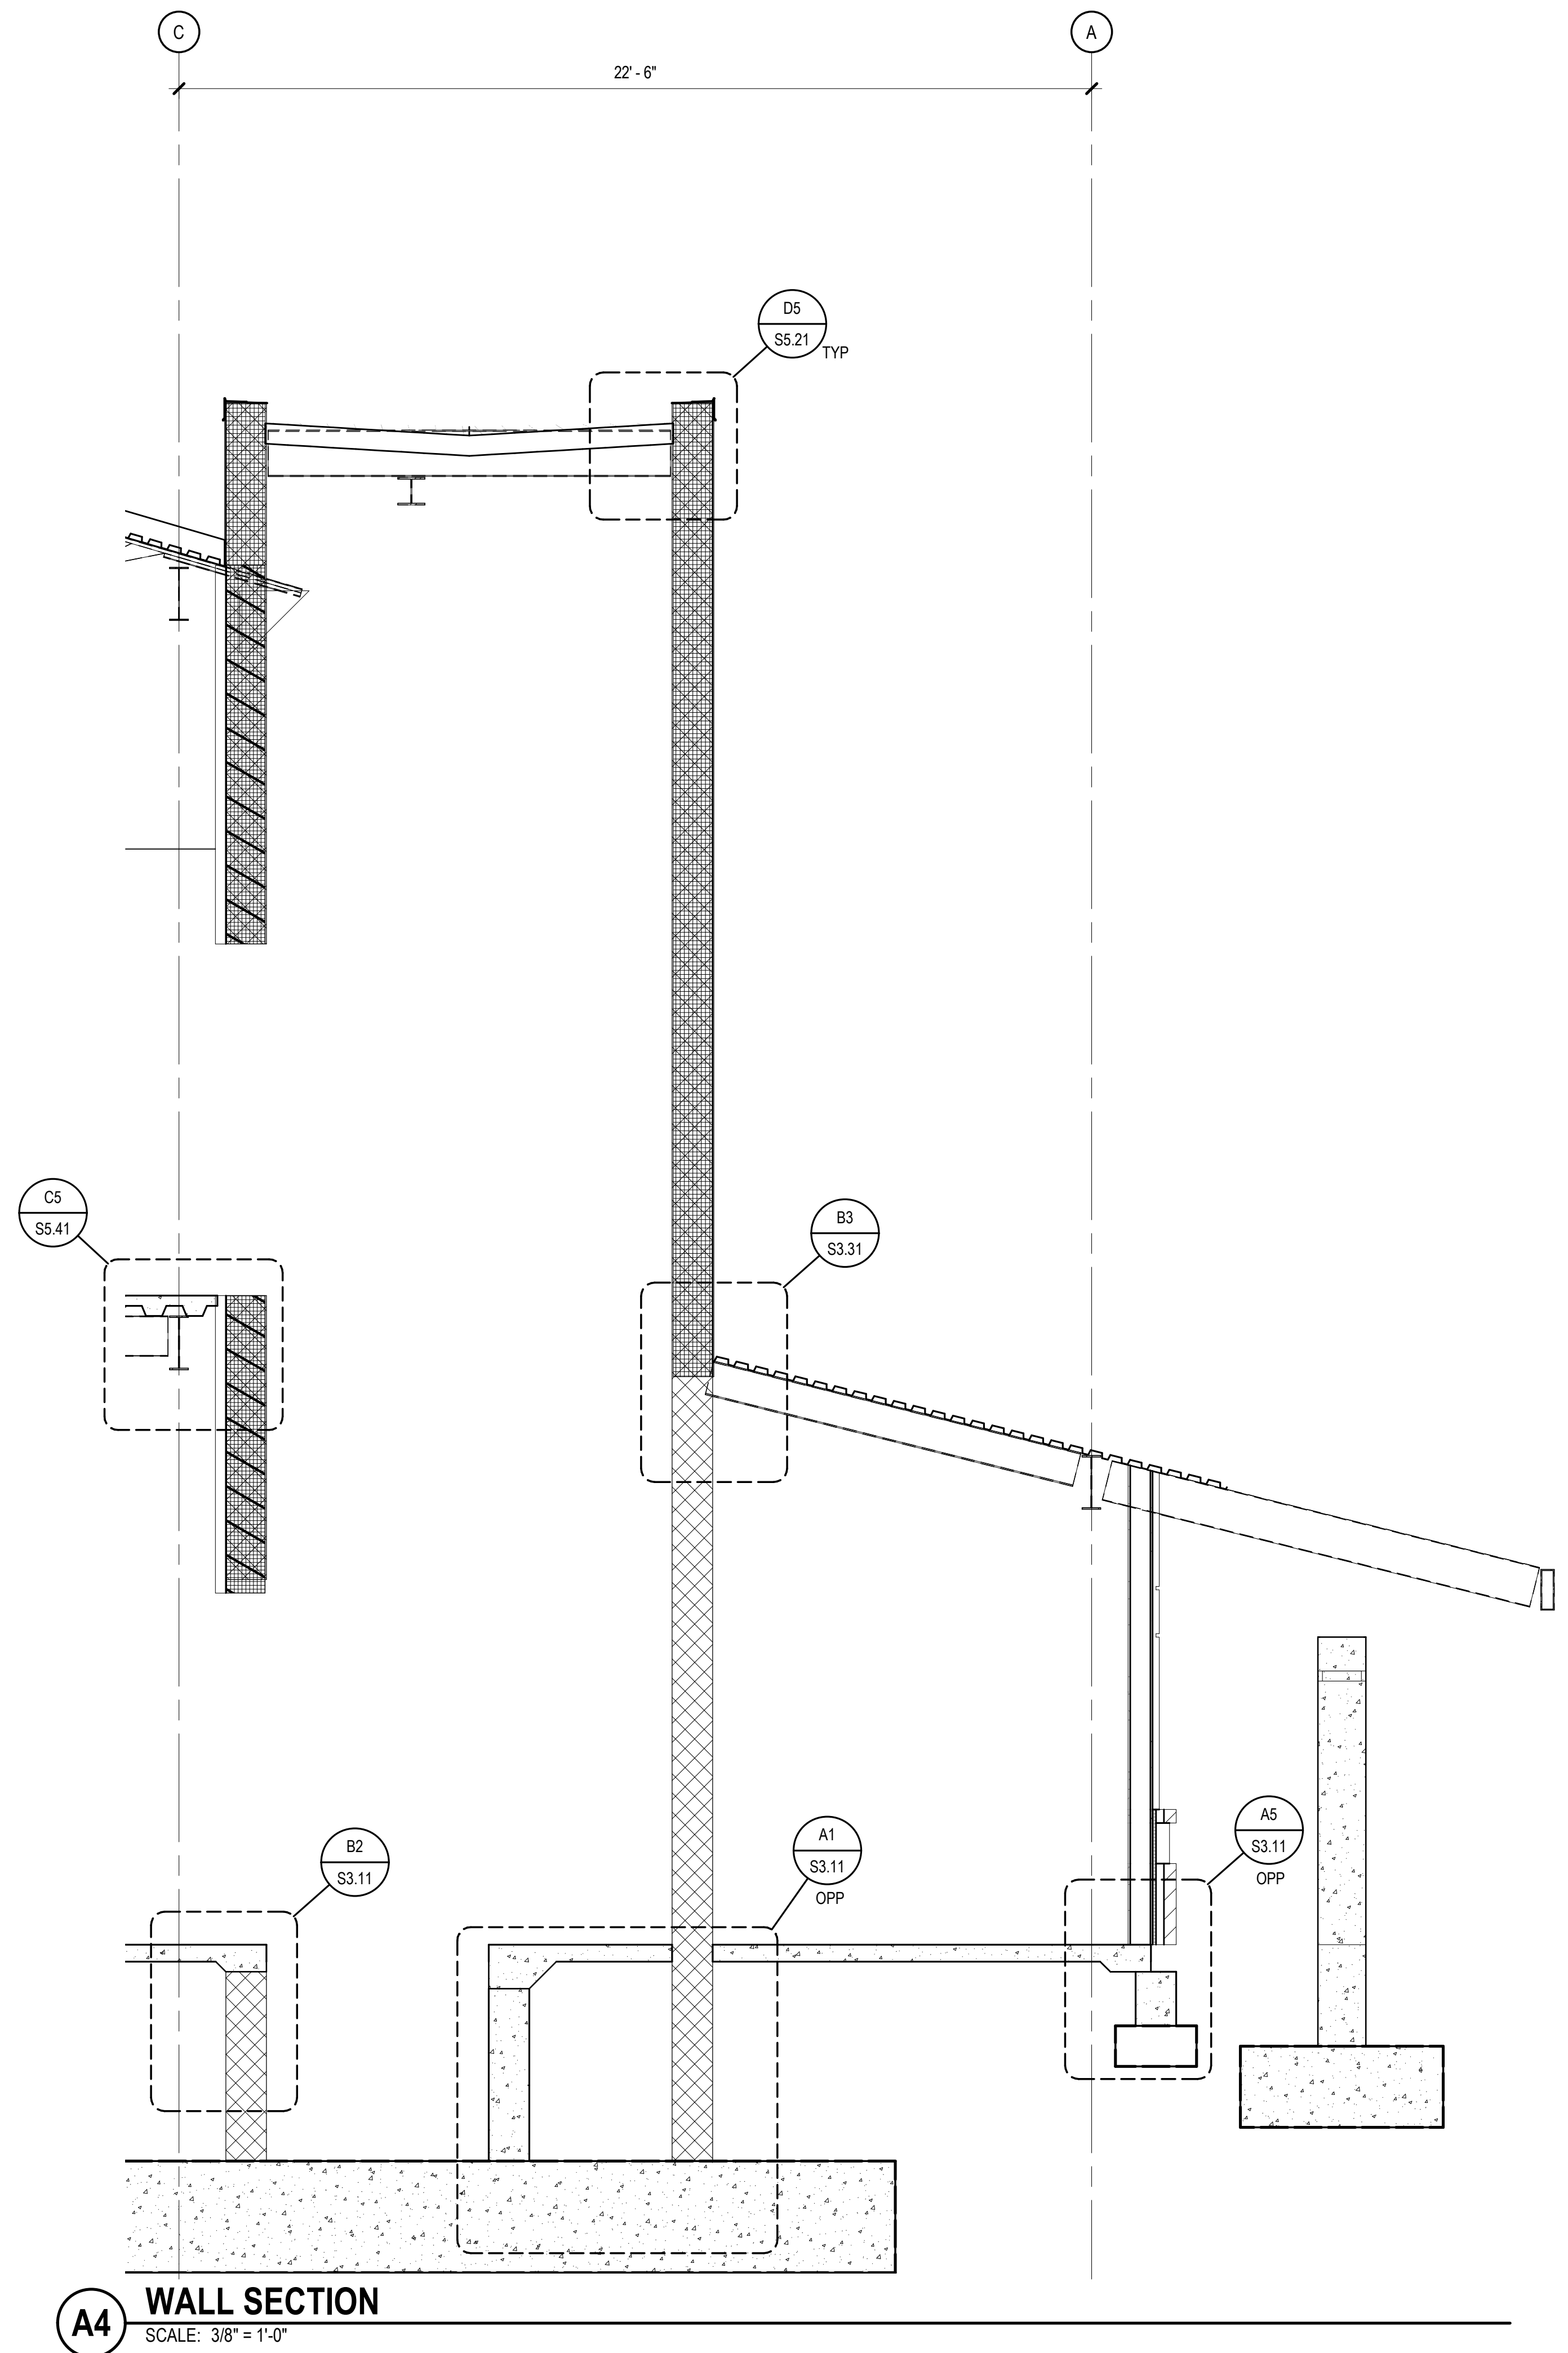


A4 WALL SECTION
SCALE: 3/8" = 1'-0"


#	DATE	REVISIONS	DESCRIPTION

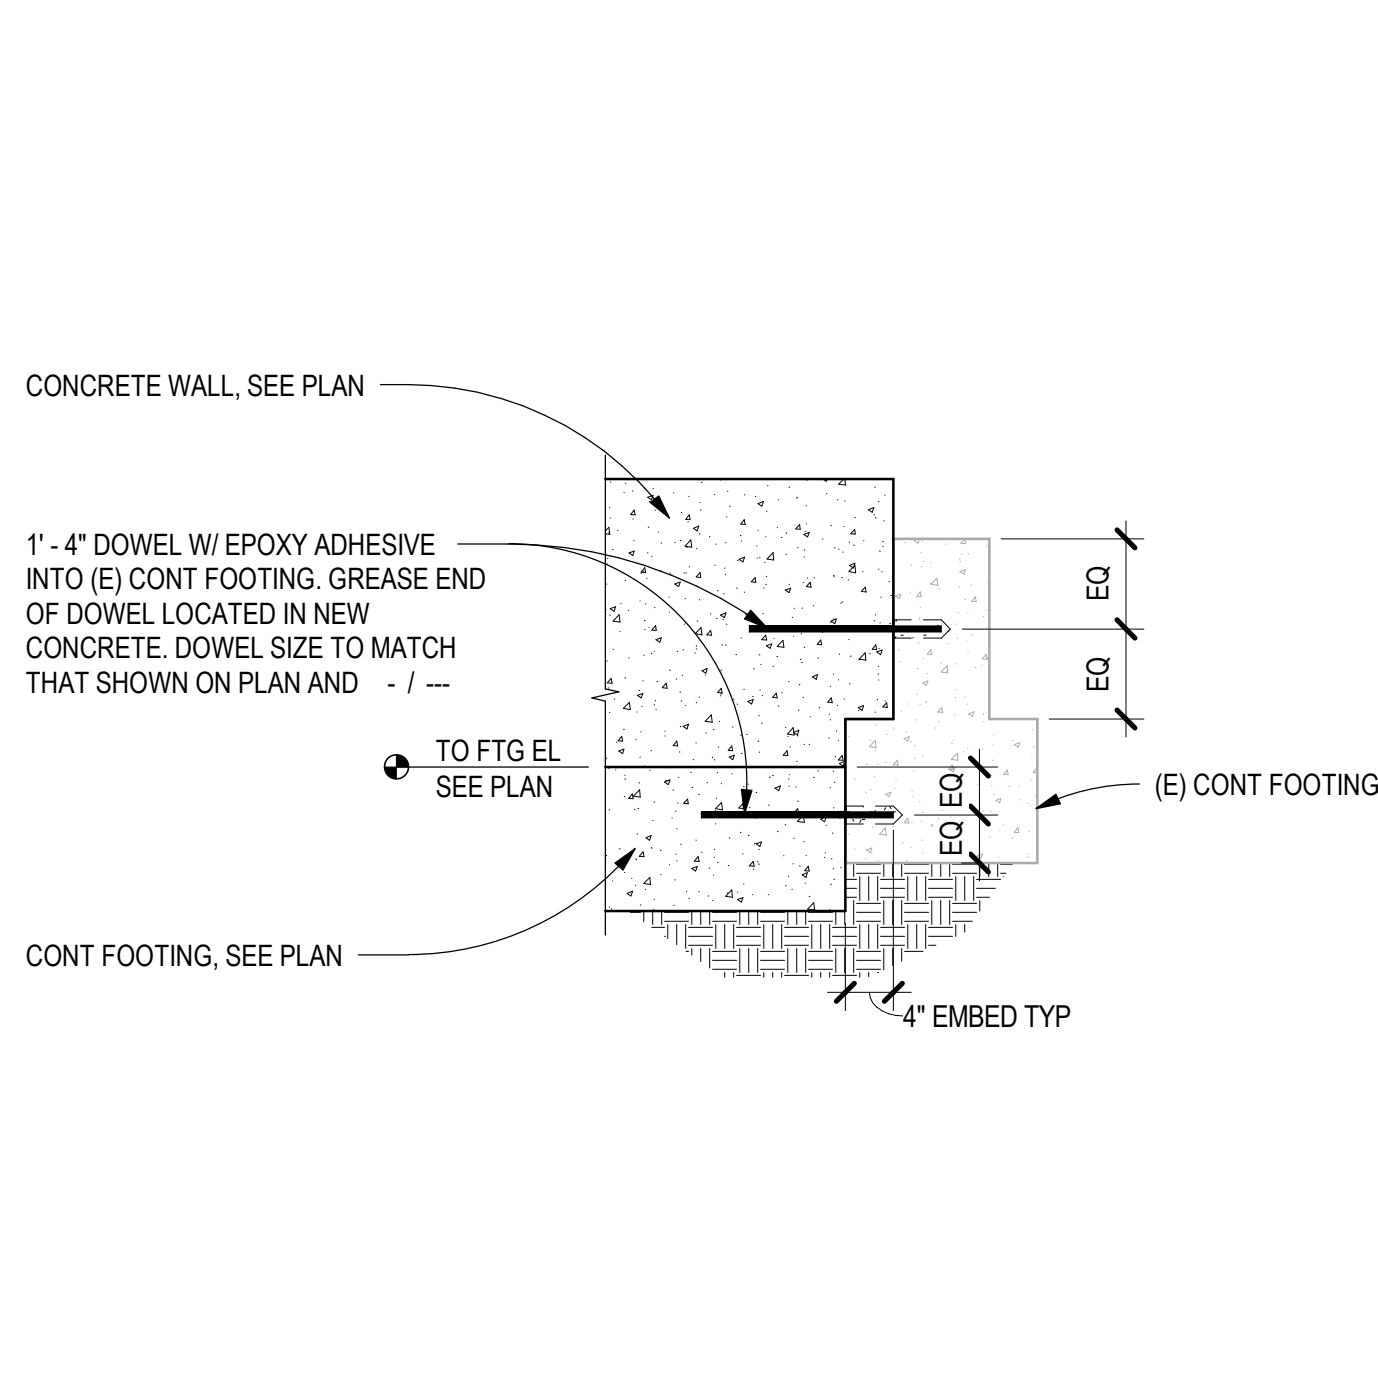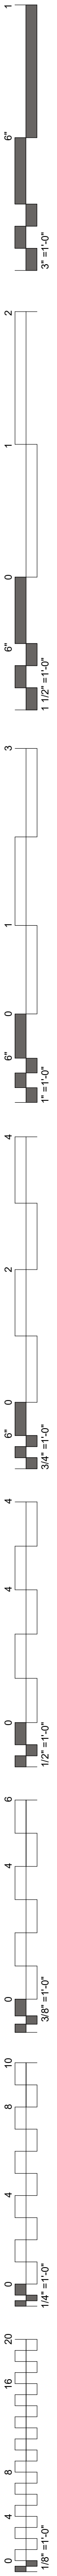


D1 DOWEL INTO (E) CONTINUOUS FOOTING
SCALE: 3/4" = 1'-0"

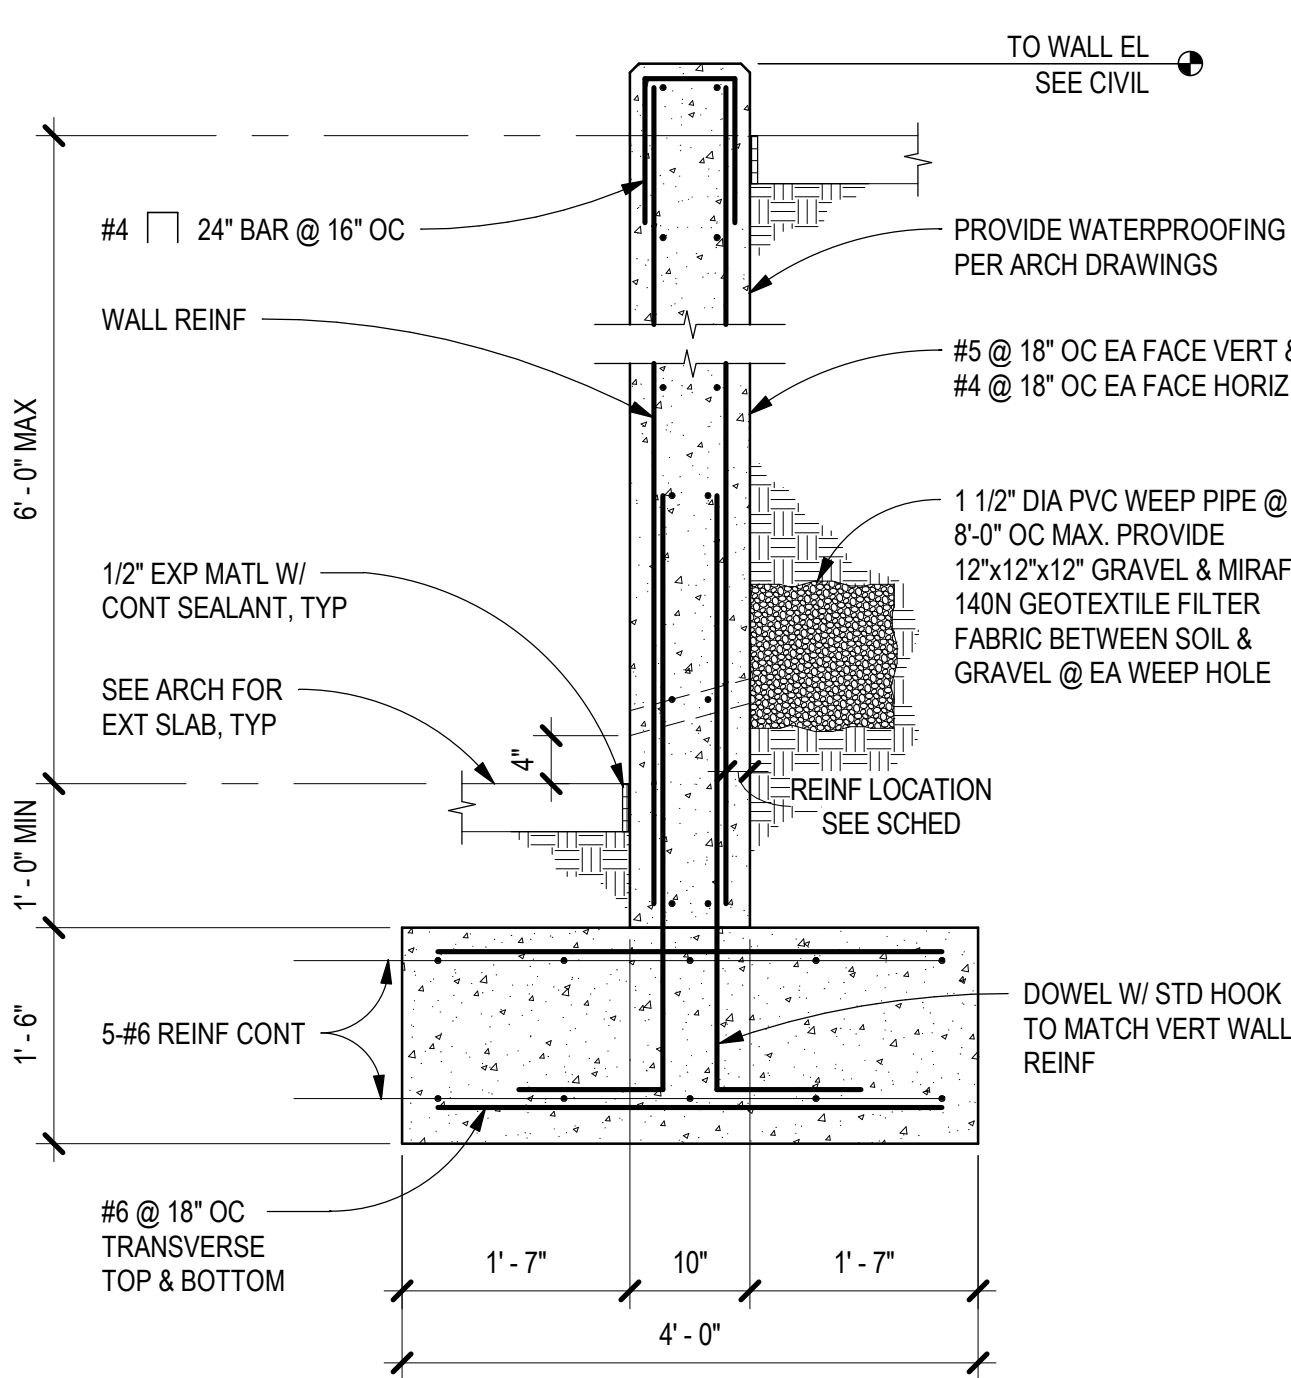


D2 RETAINING WALL SECTION
SCALE: 3/4" = 1'-0"

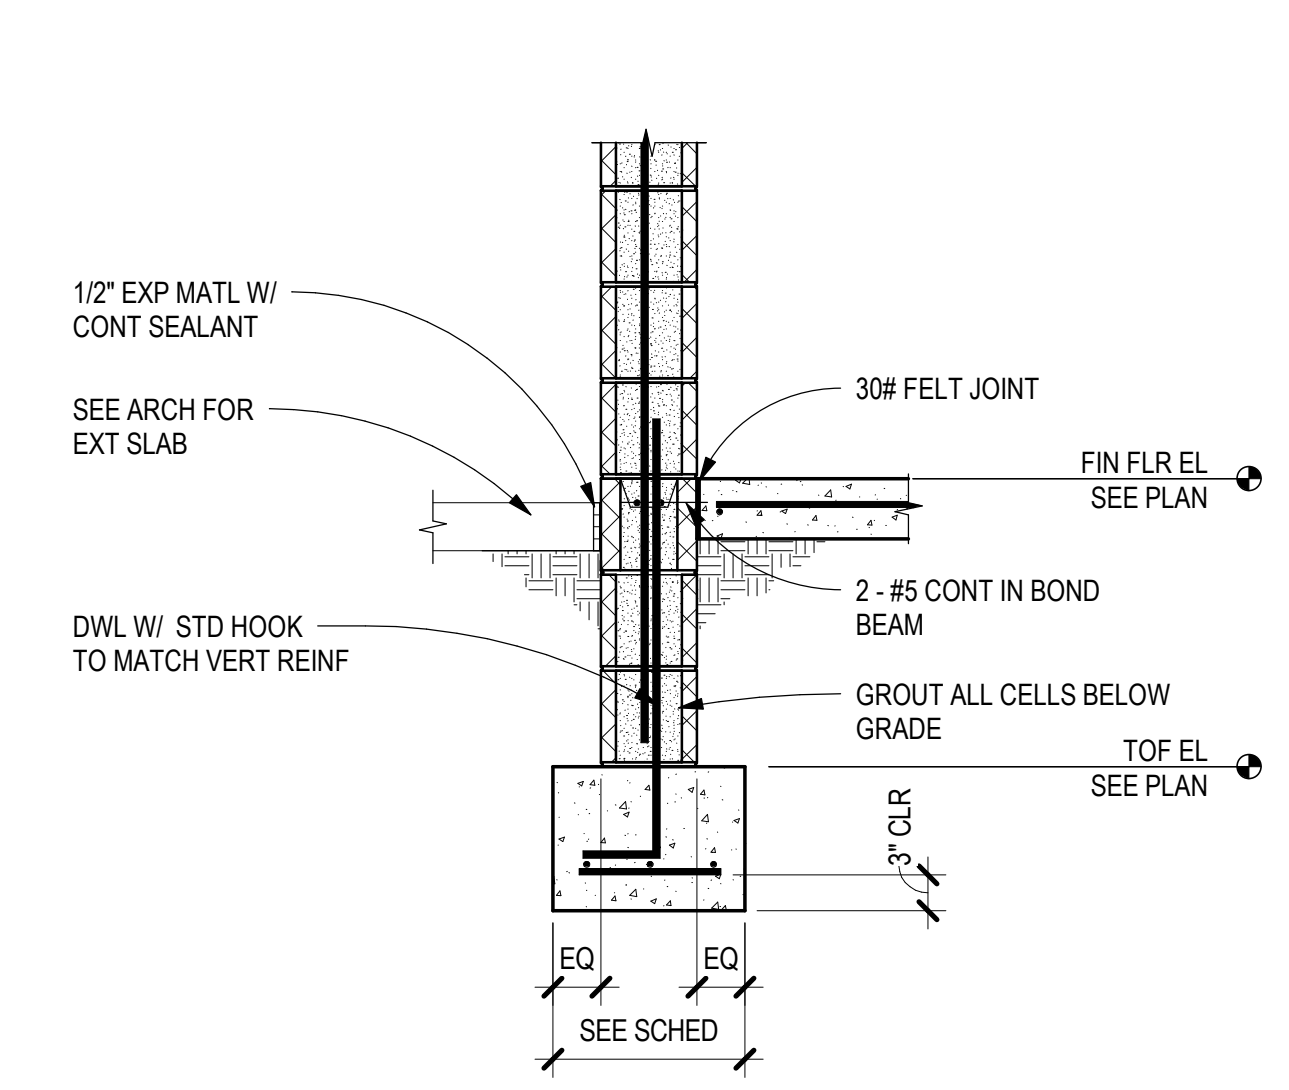


D3 PERIMETER FOUNDATION SECTION
SCALE: 3/4" = 1'-0"

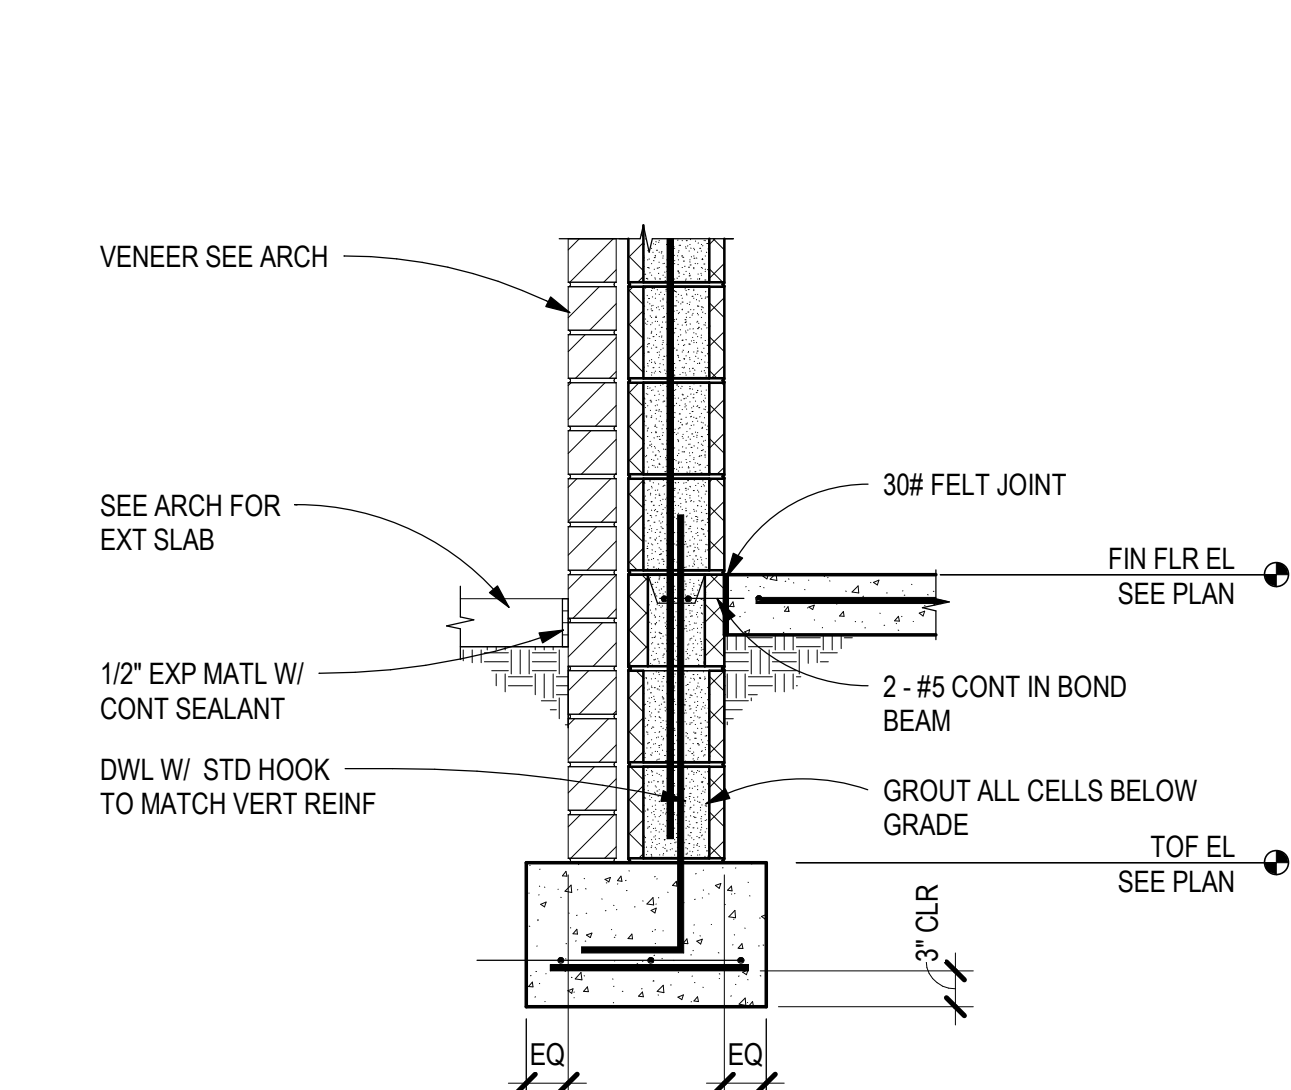


D4 PERIMETER FOUNDATION SECTION
SCALE: 3/4" = 1'-0"

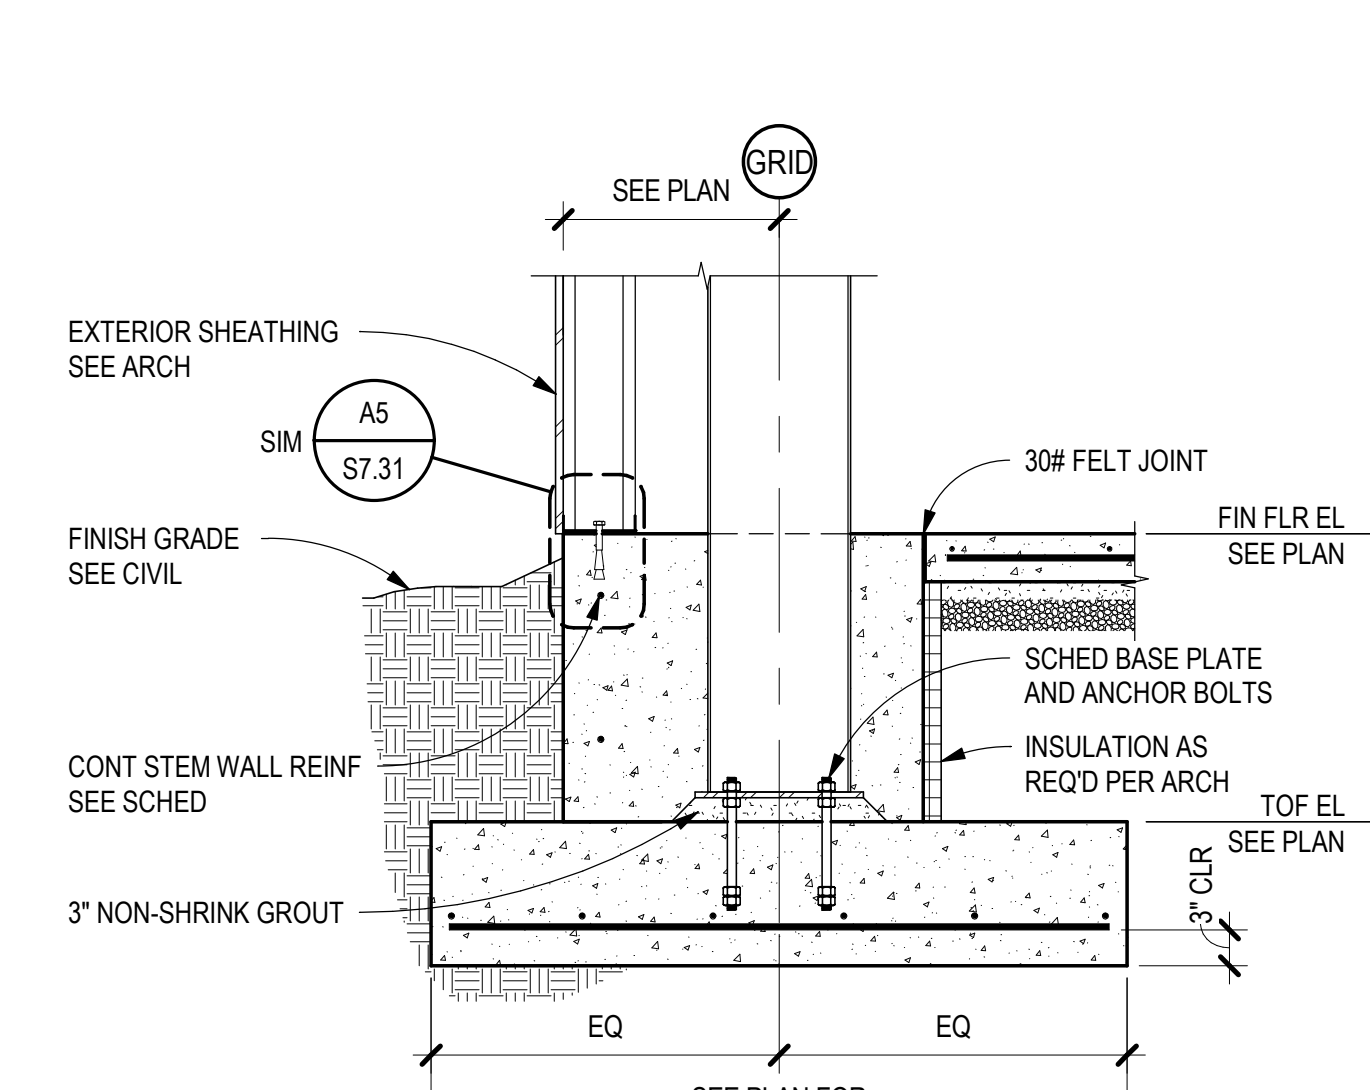


D5 FOUNDATION SECTION
SCALE: 3/4" = 1'-0"

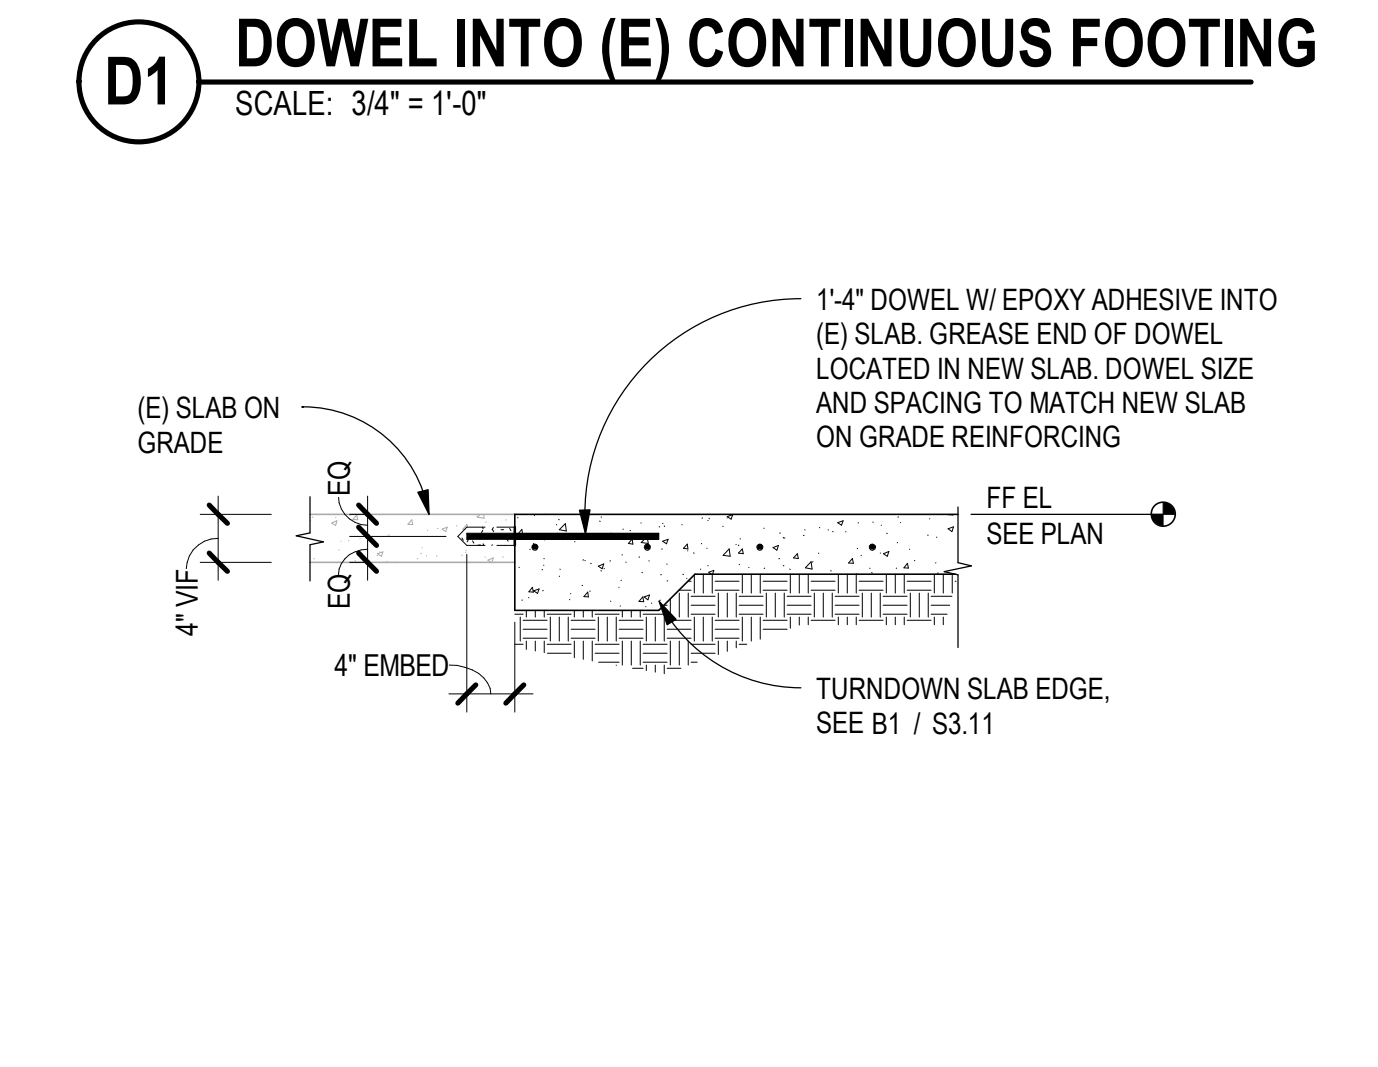


C1 DOWEL INTO (E) SLAB ON GRADE
SCALE: 3/4" = 1'-0"

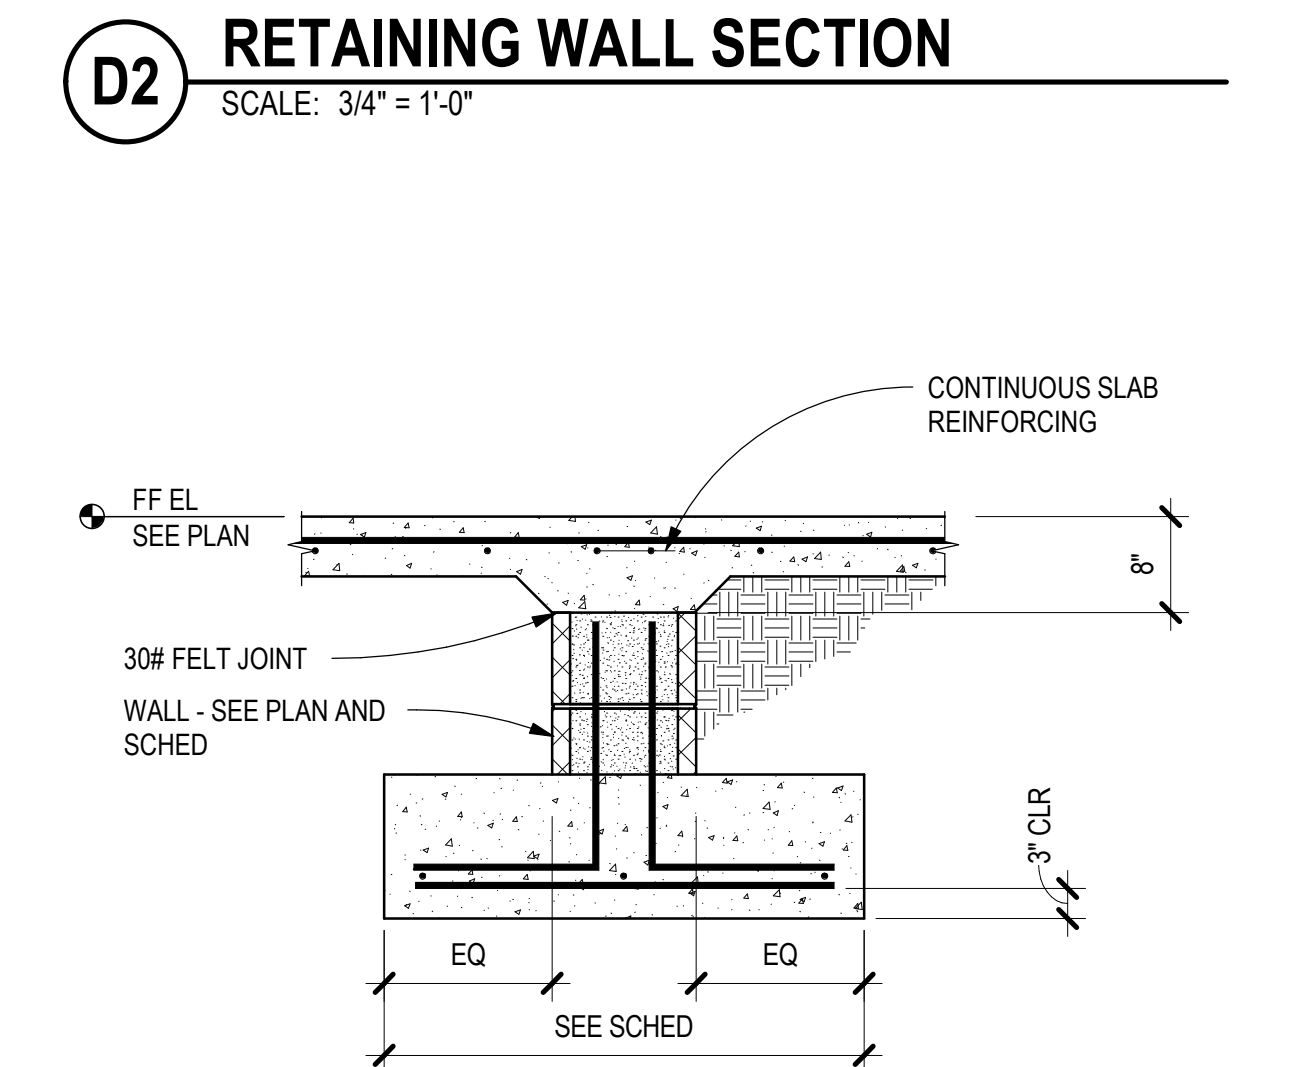


C2 INT SECTION @ DOORWAYS CMU
SCALE: 3/4" = 1'-0"

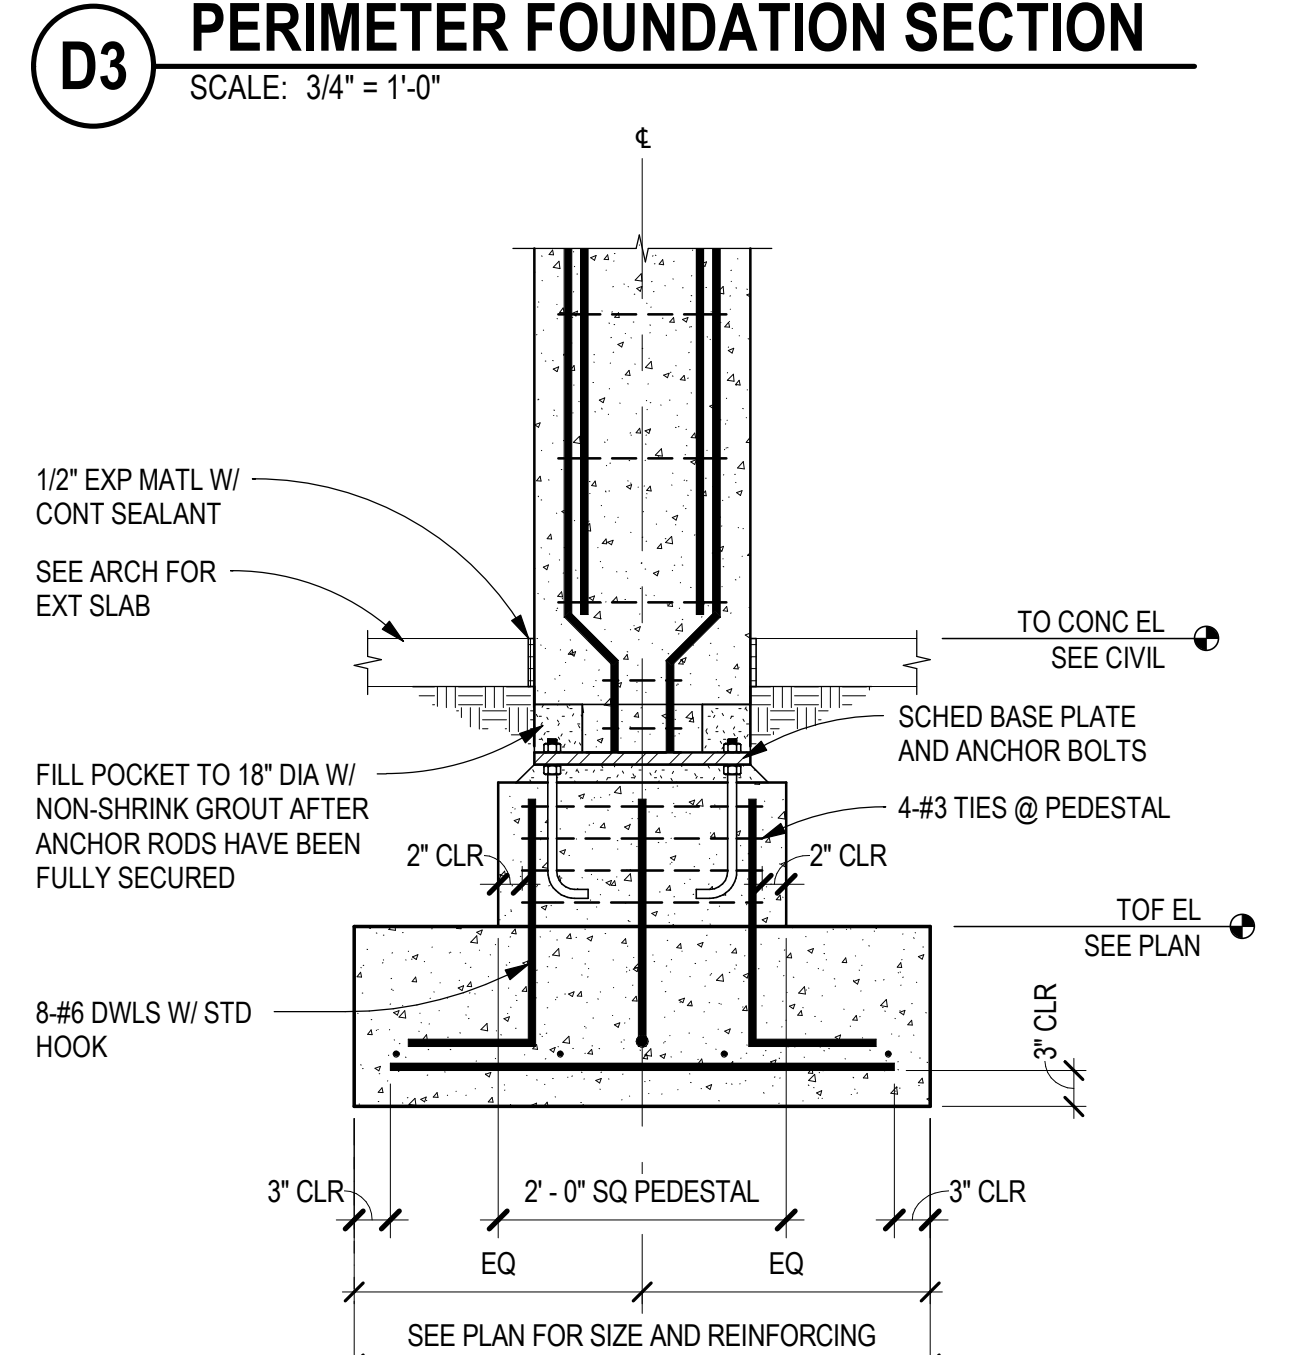


C3 EXT CONC COLUMN SECTION
SCALE: 3/4" = 1'-0"

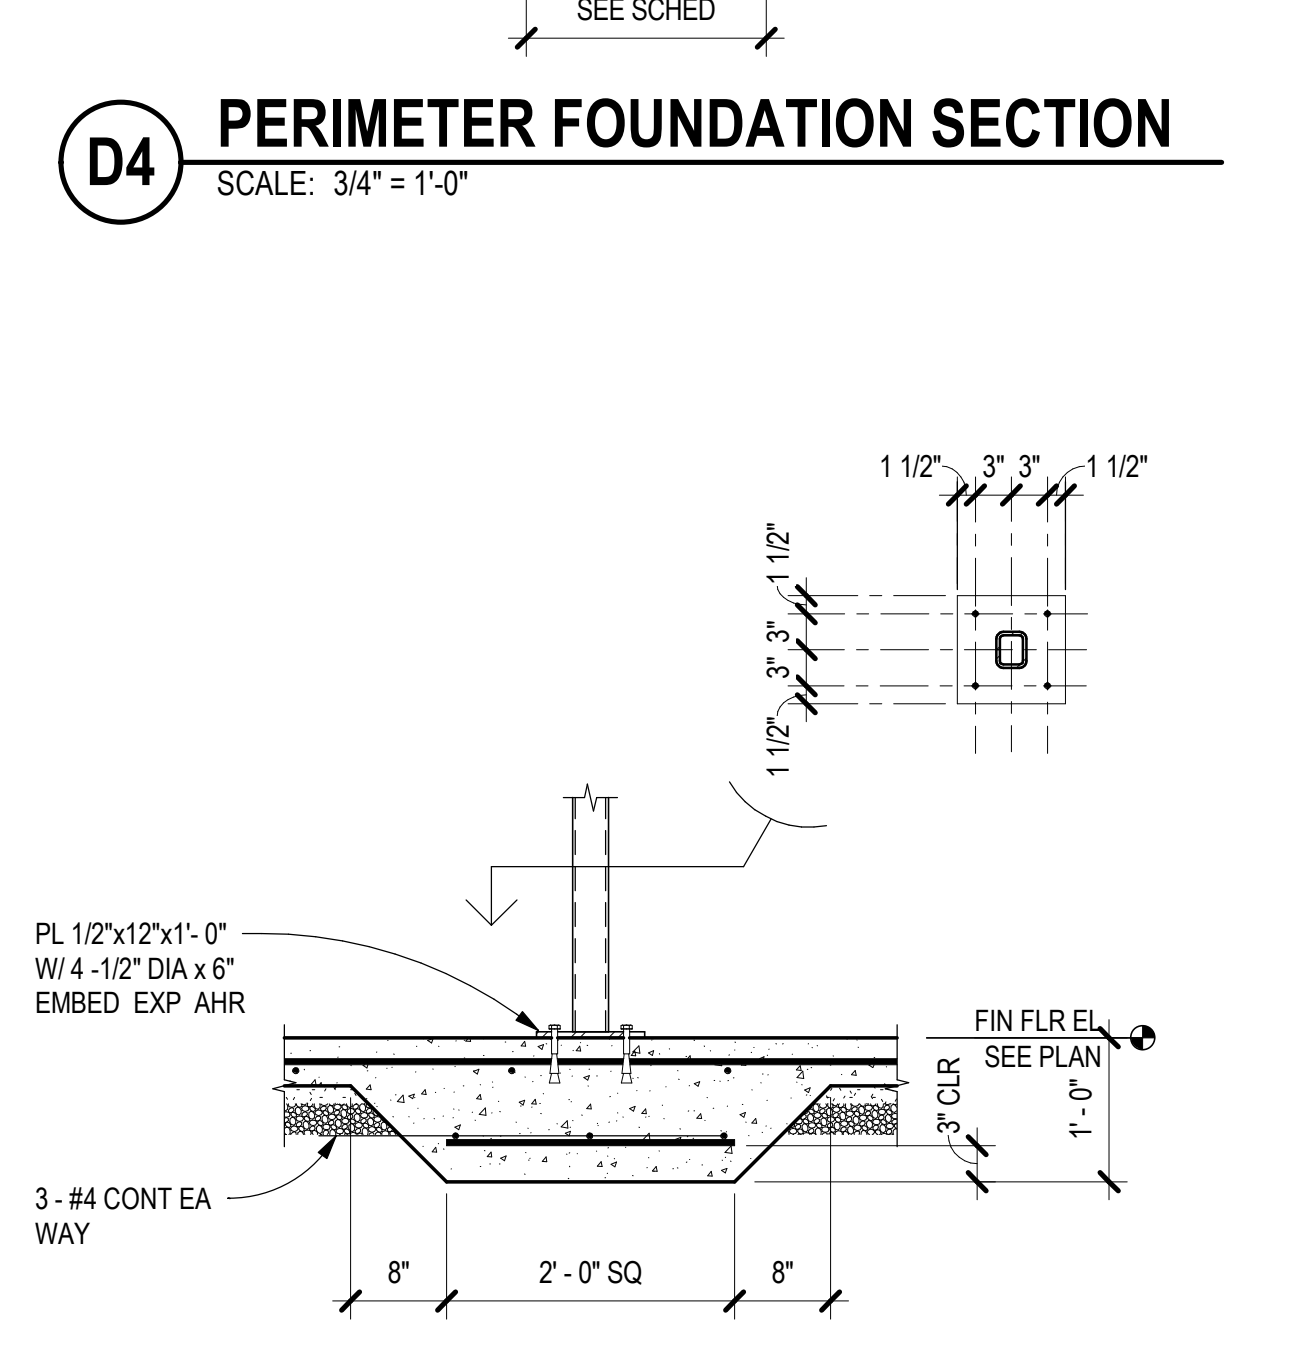


C4 INT COLUMN AT THICKENED SLAB
SCALE: 3/4" = 1'-0"

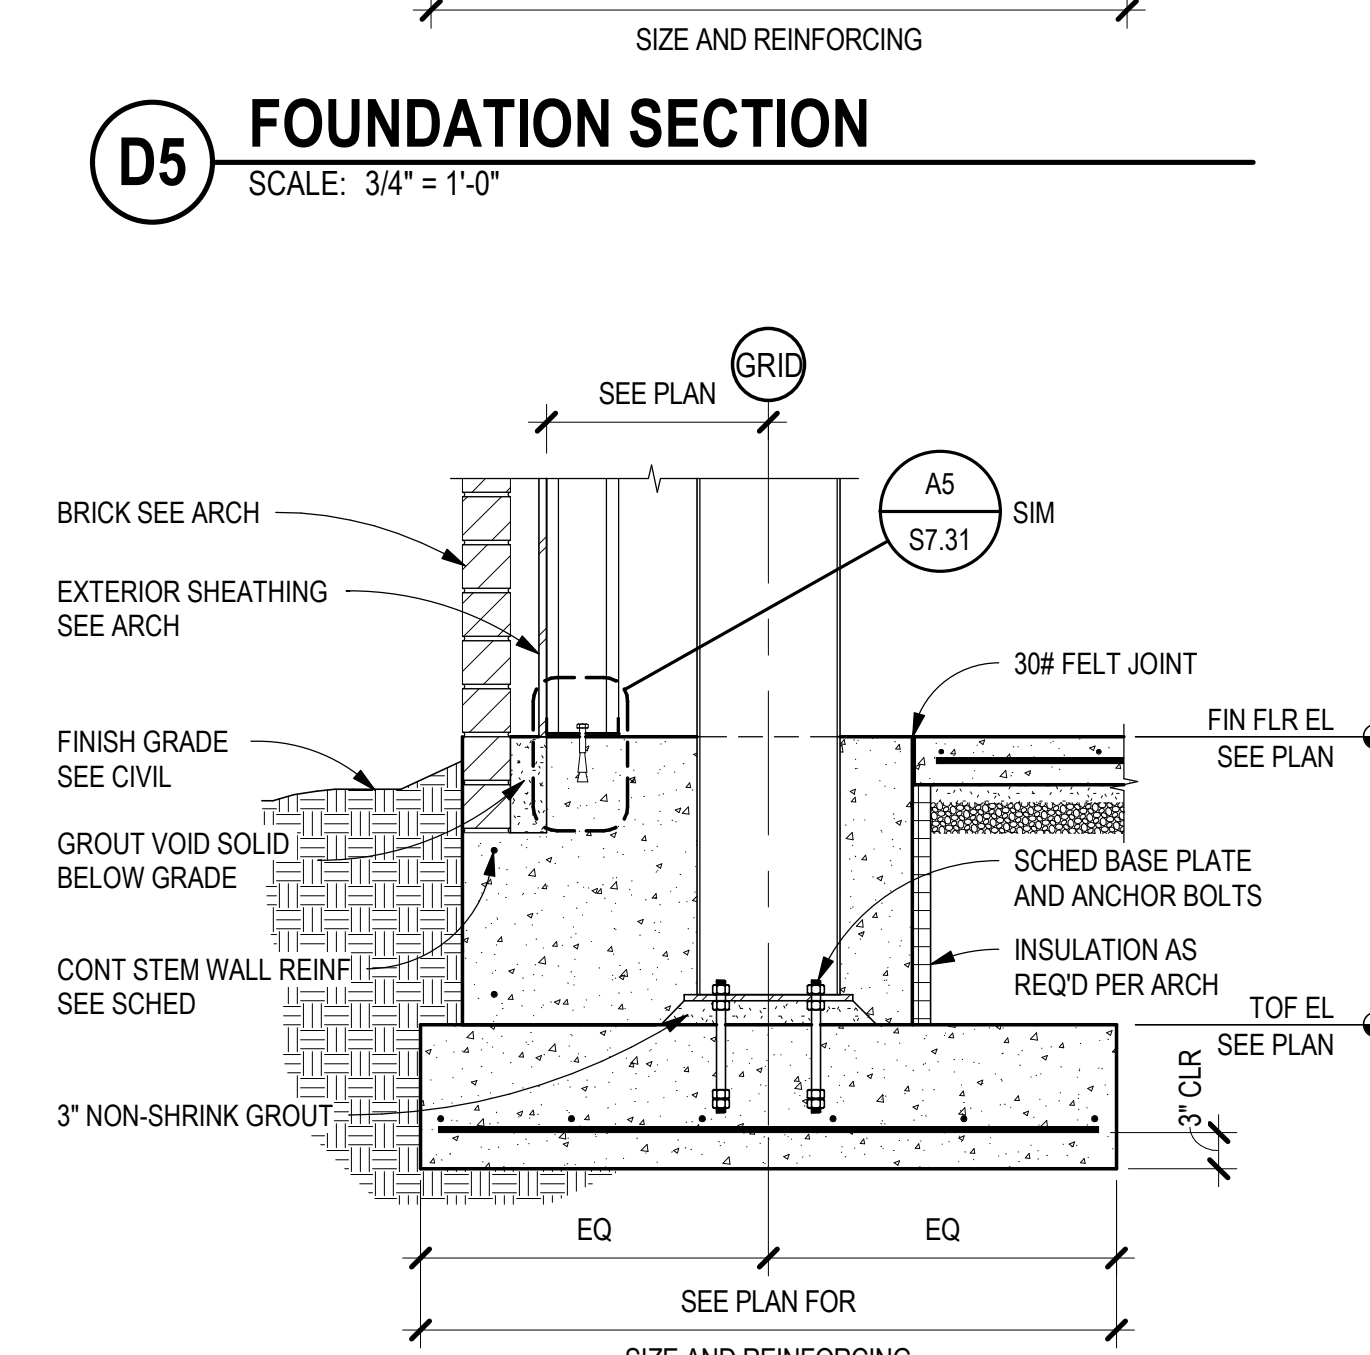


C5 FOUNDATION SECTION
SCALE: 3/4" = 1'-0"

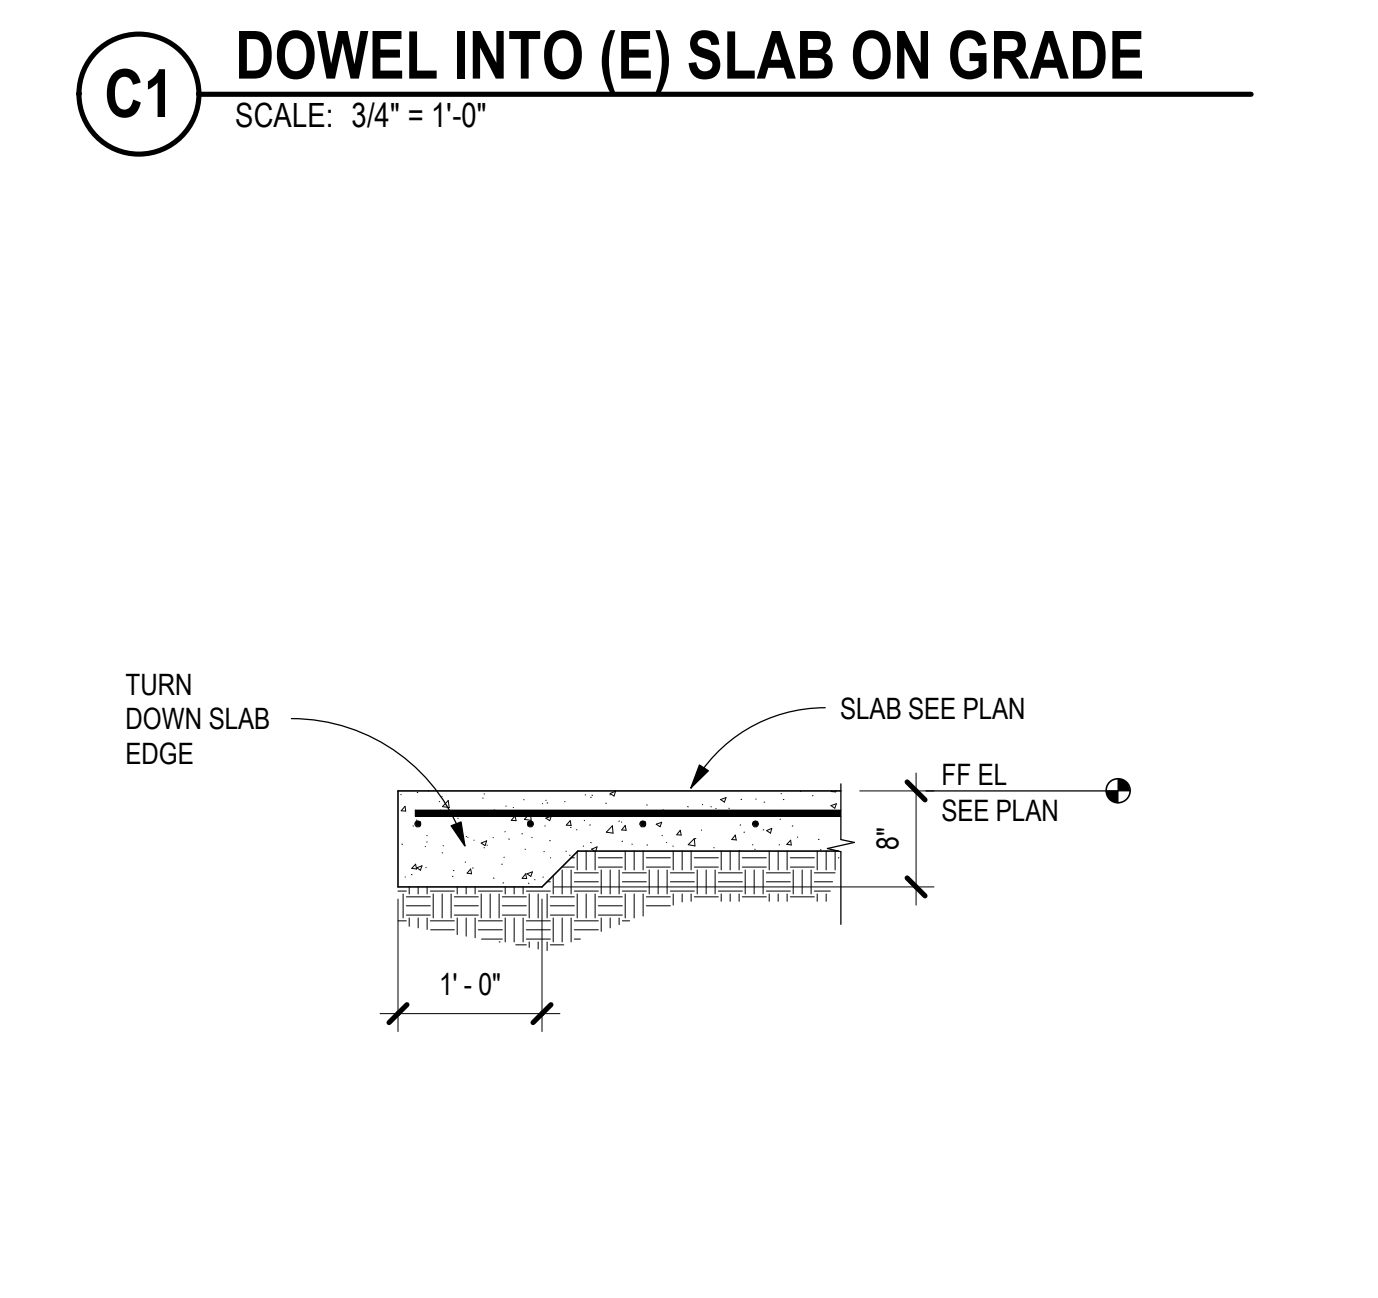


B1 TYP TURN DOWN SLAB EDGE
SCALE: 3/4" = 1'-0"

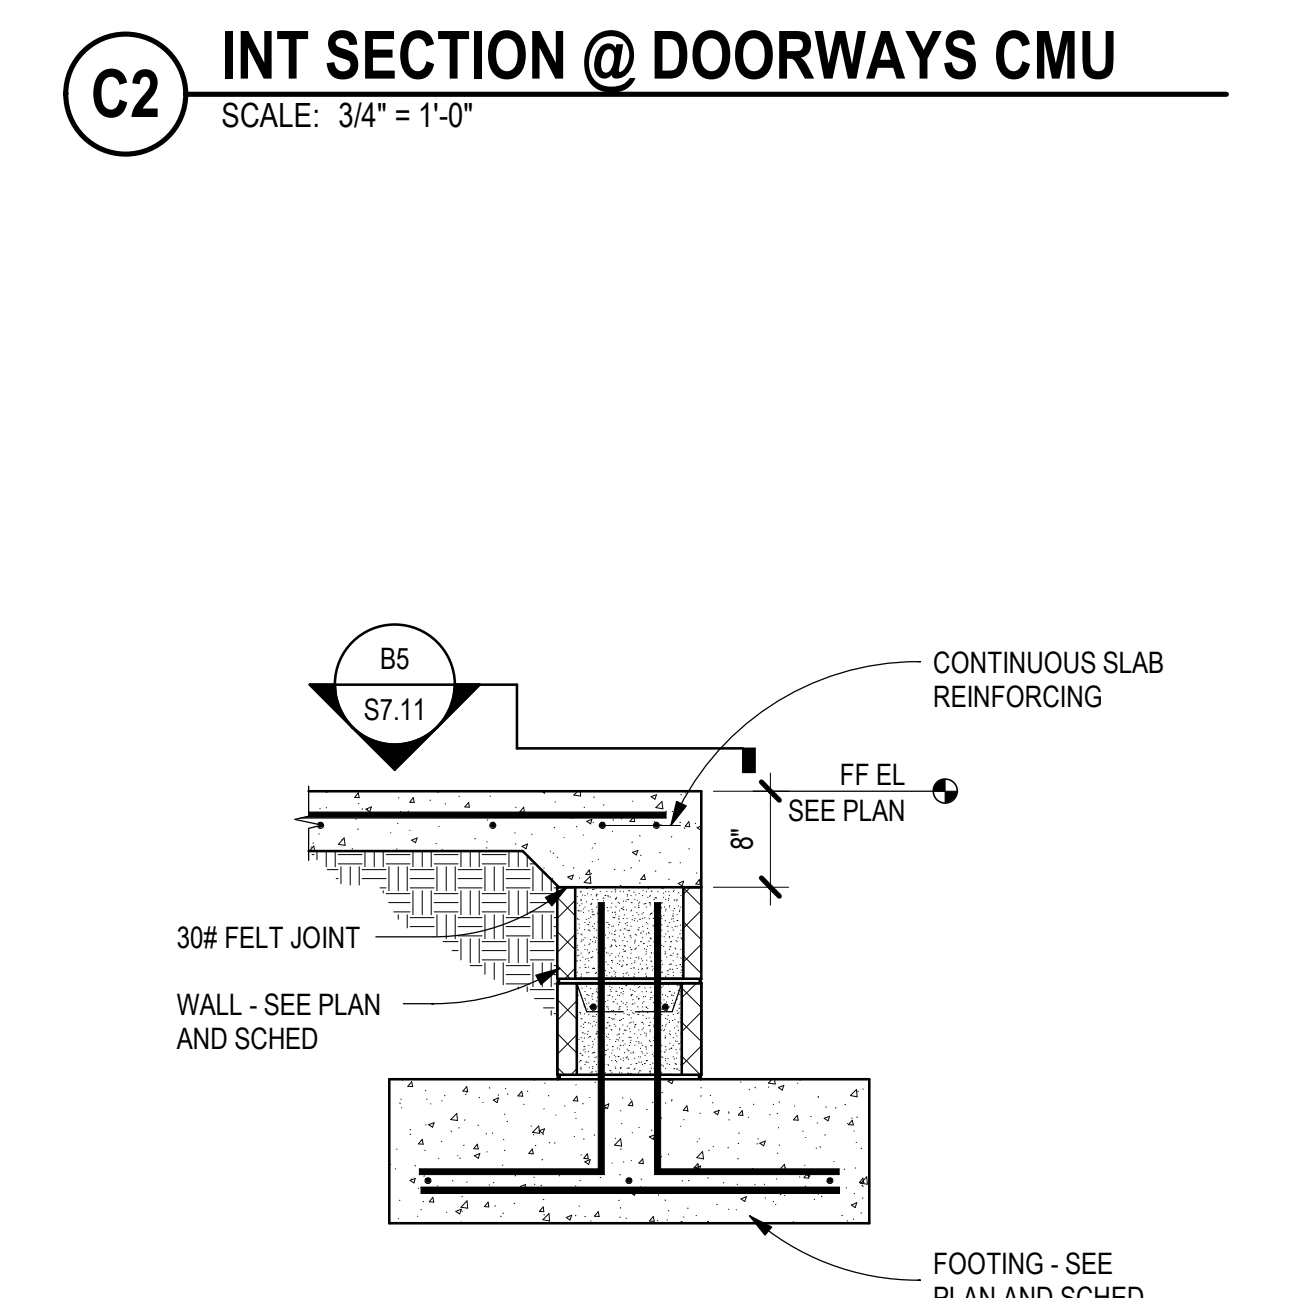


B2 PERIM SECTION AT DOORWAYS CMU
SCALE: 3/4" = 1'-0"

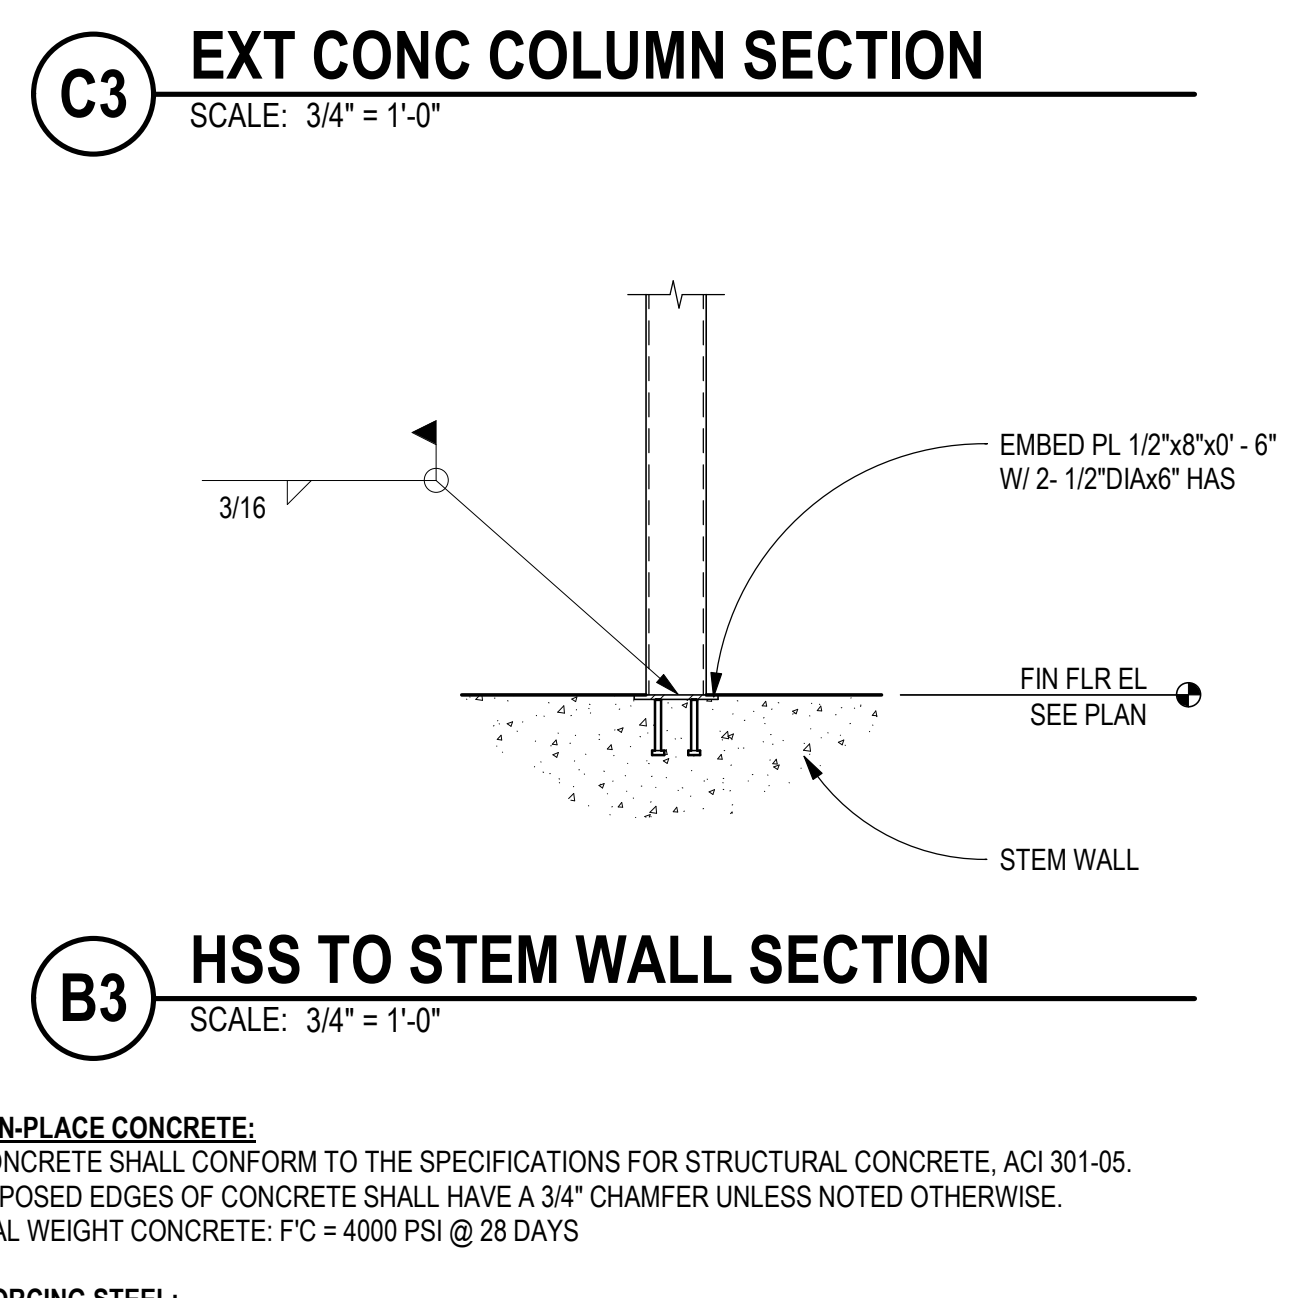


B3 HSS TO STEM WALL SECTION
SCALE: 3/4" = 1'-0"

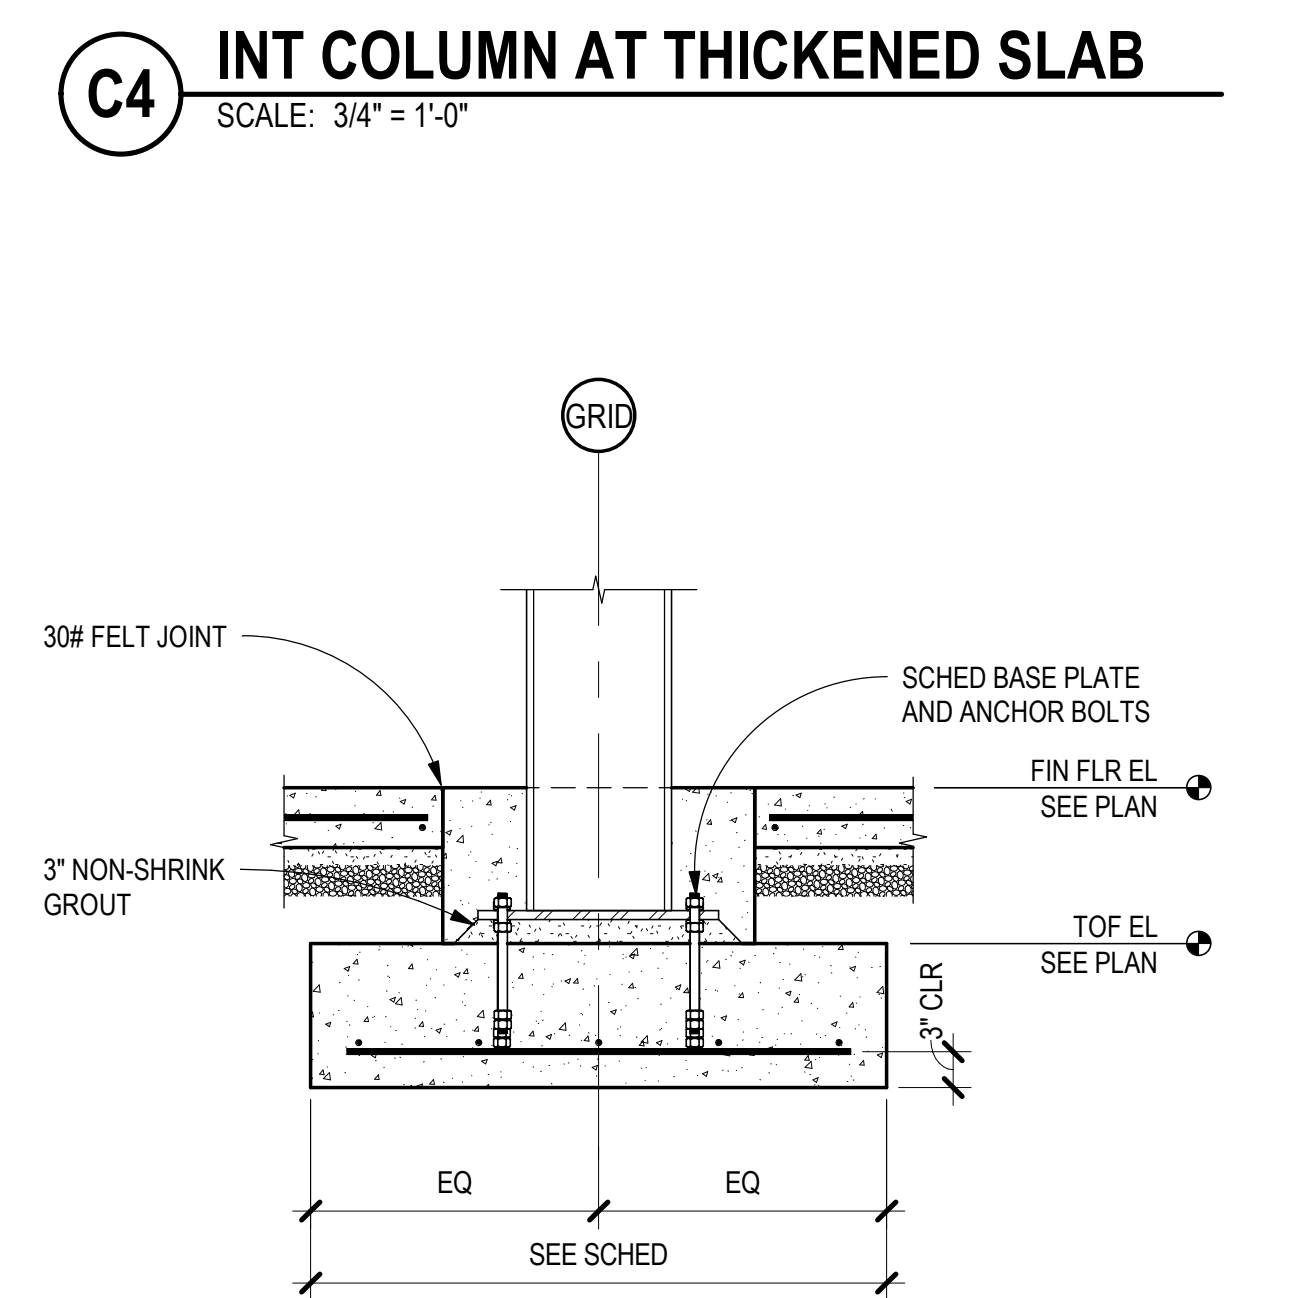


B4 INTERIOR COLUMN SECTION
SCALE: 3/4" = 1'-0"

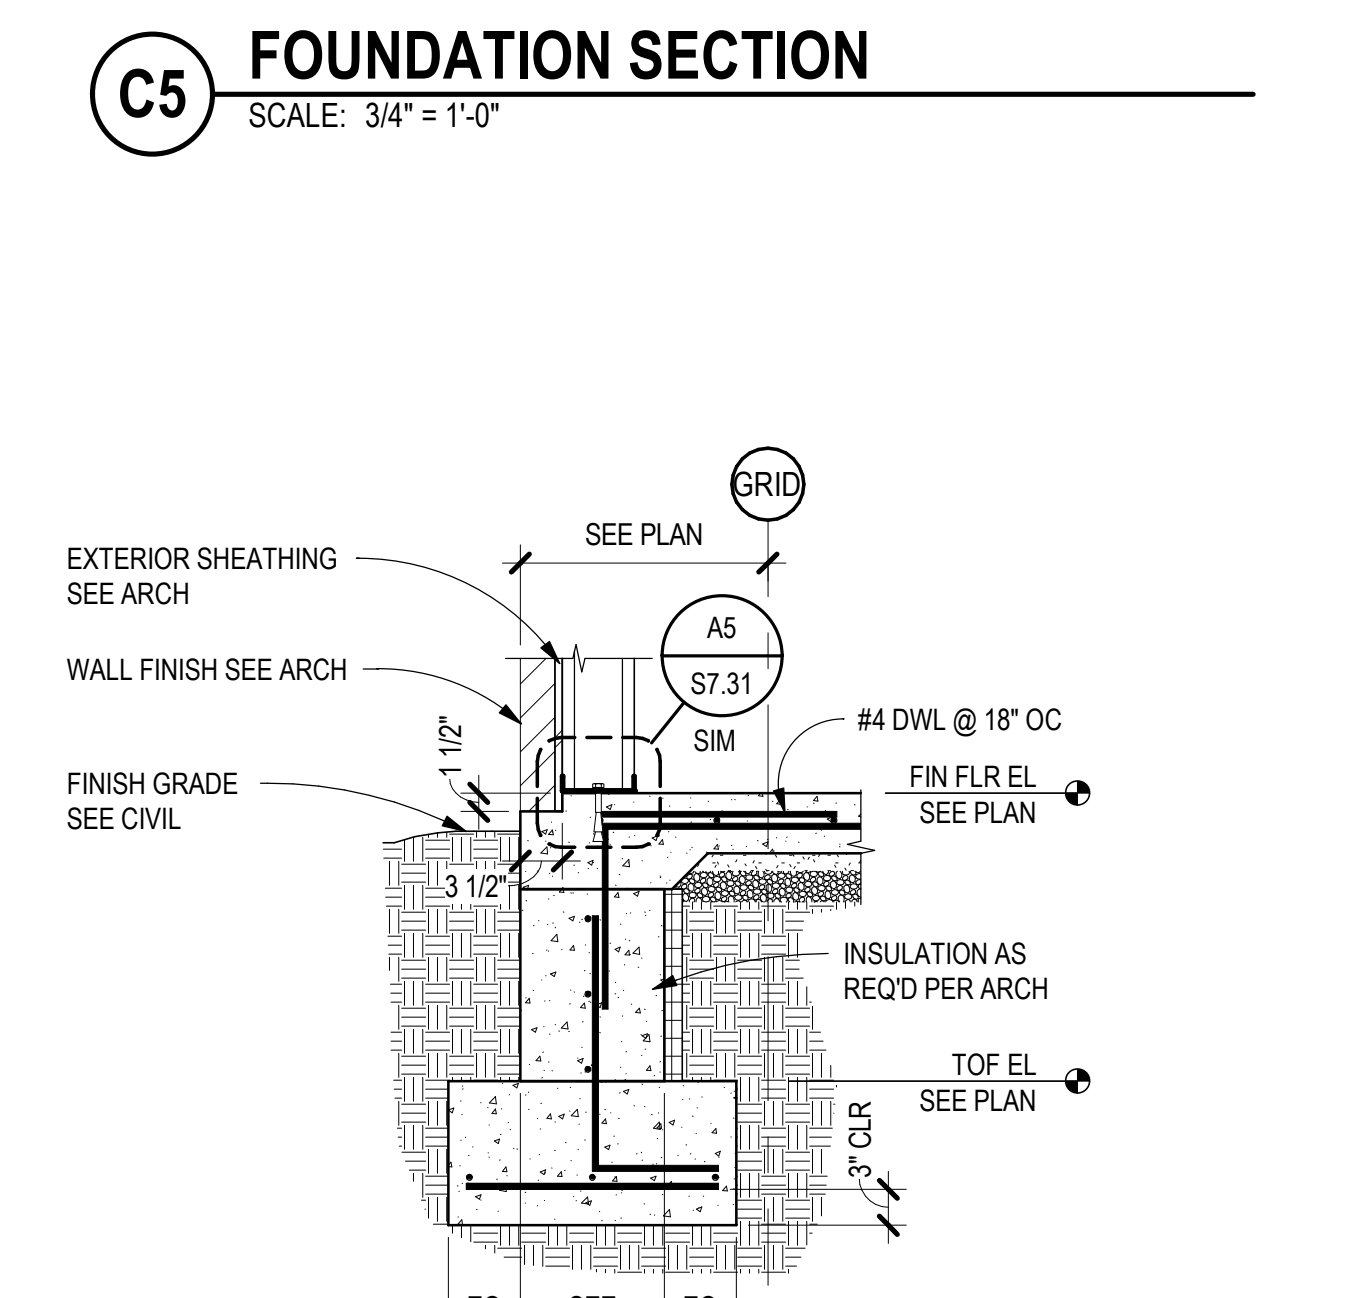


B5 FOUNDATION SECTION NO VENEER
SCALE: 3/4" = 1'-0"

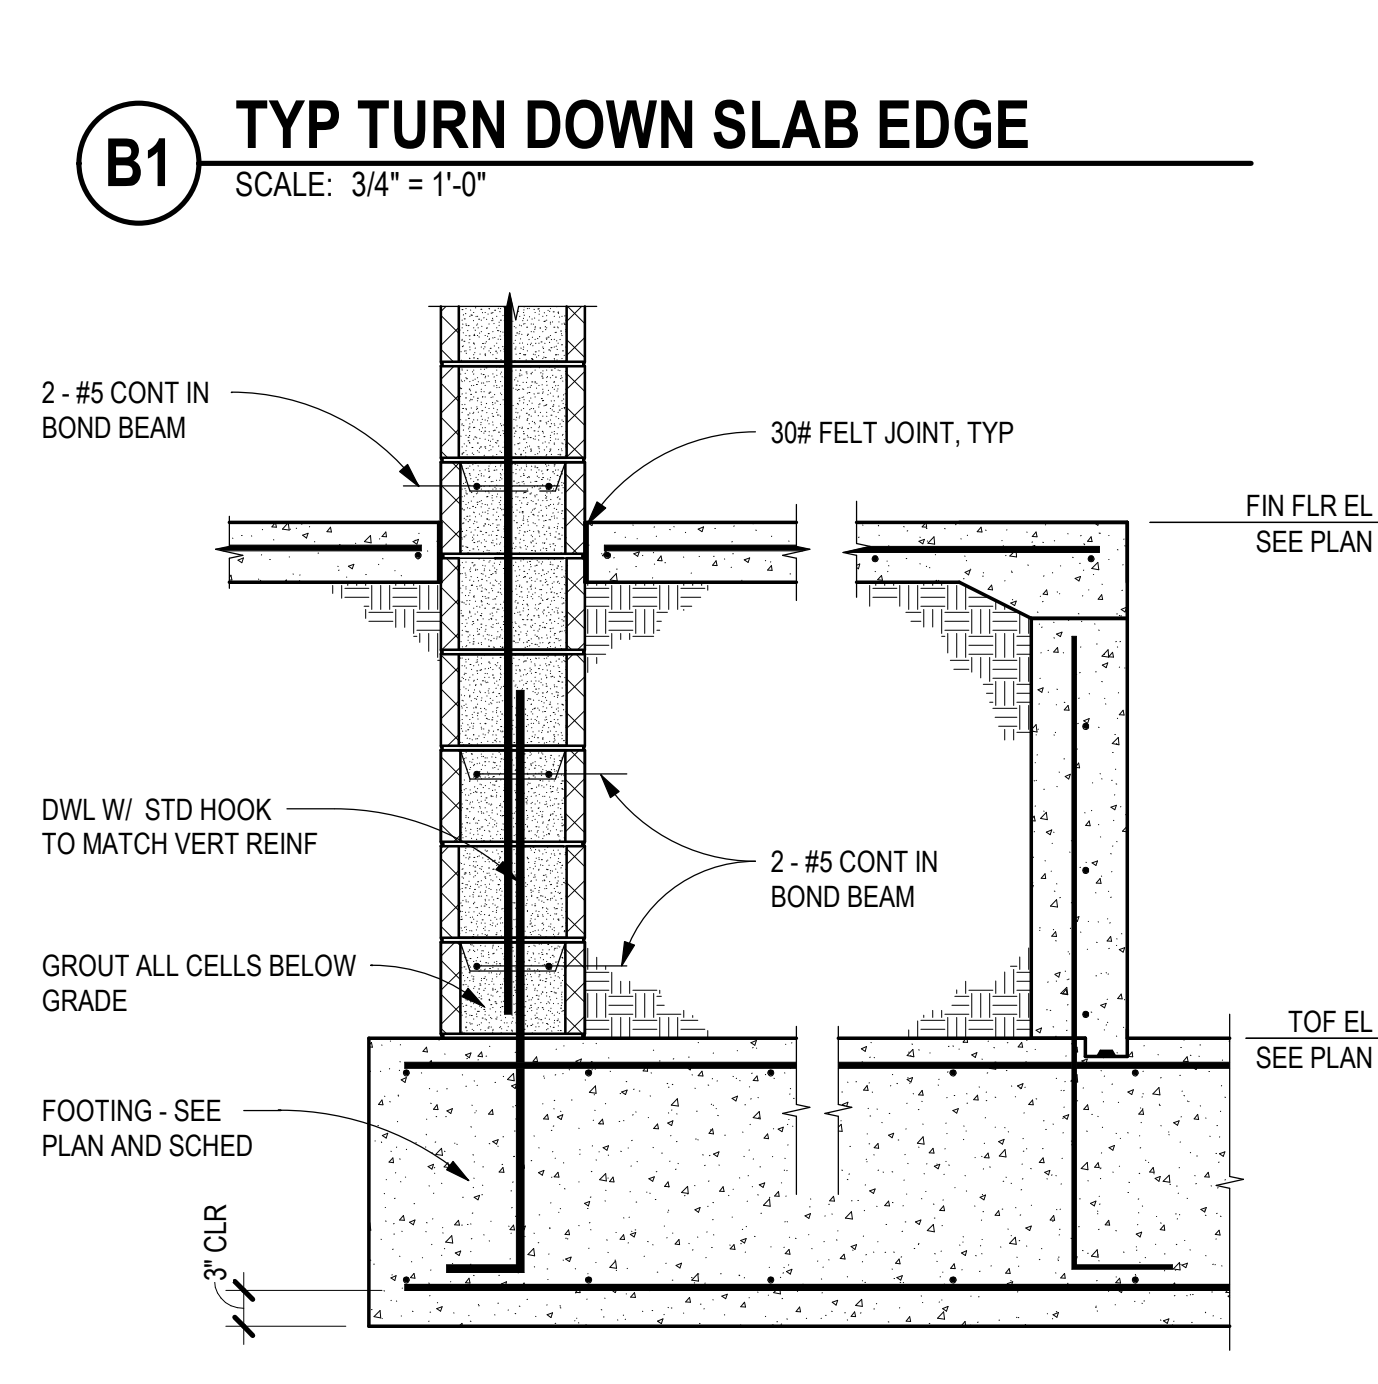


A1 FOUNDATION SECTION @ ELEVATOR
SCALE: 3/4" = 1'-0"

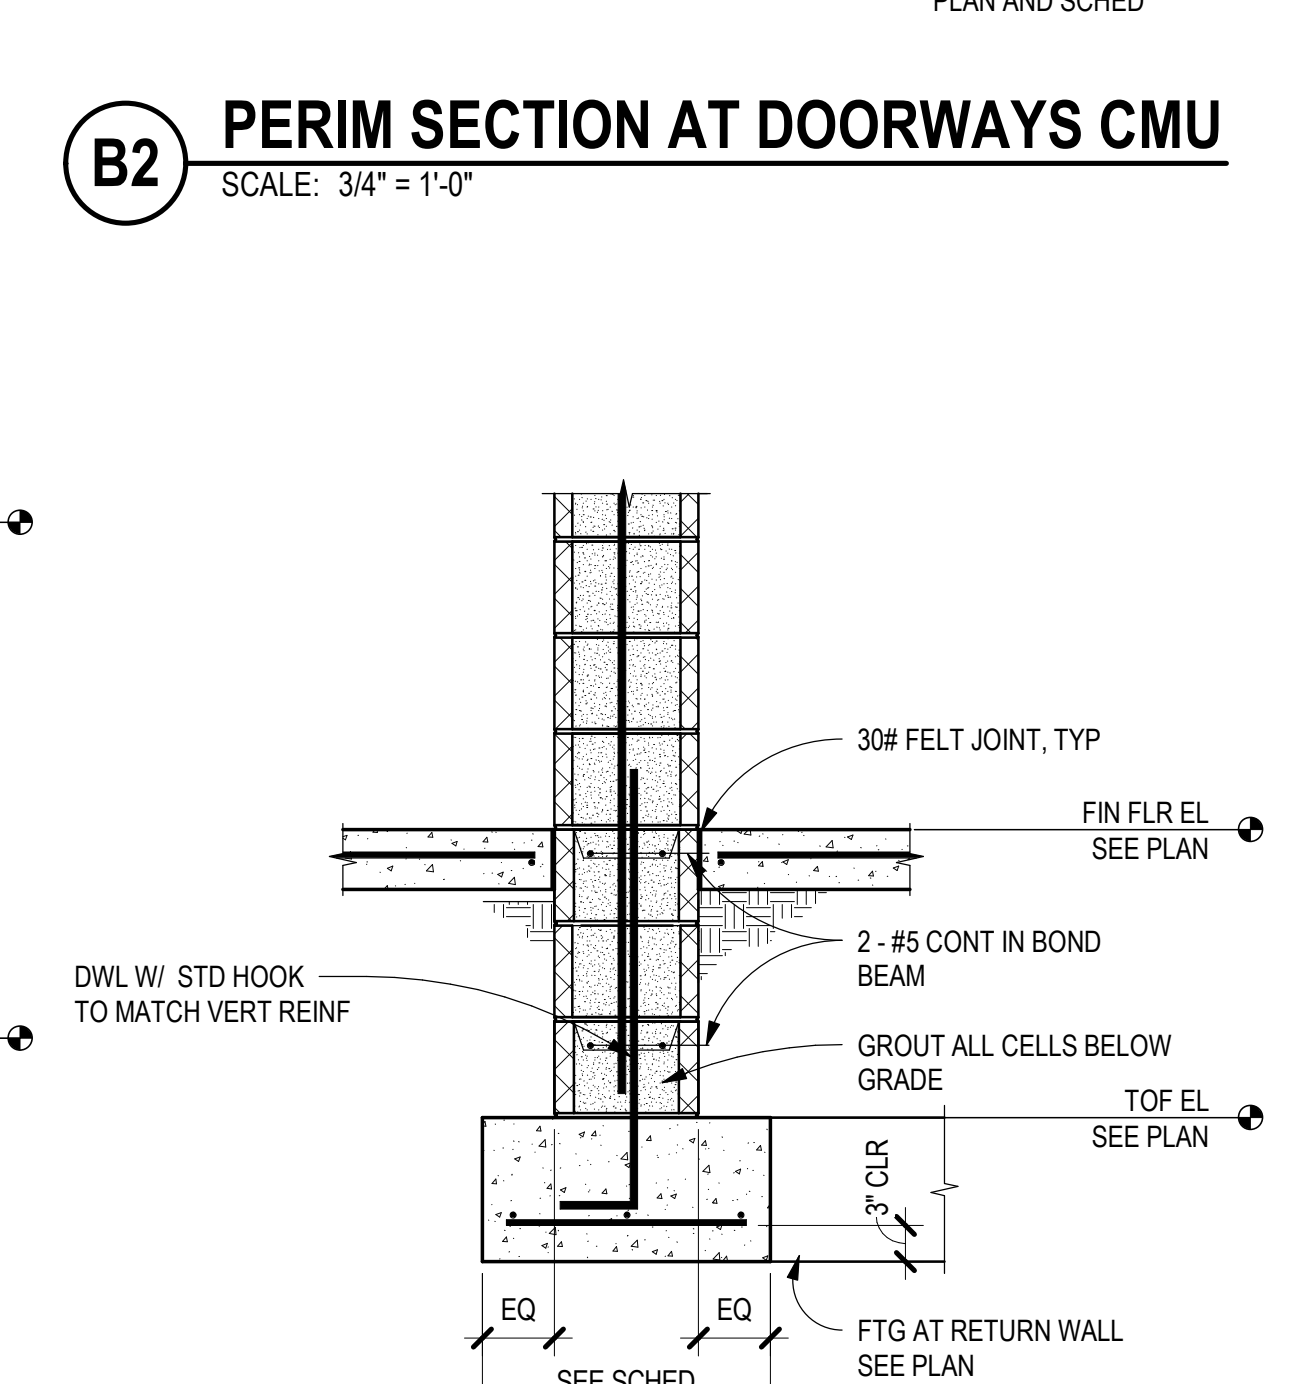


A2 PERIMETER FOUNDATION SECTION
SCALE: 3/4" = 1'-0"

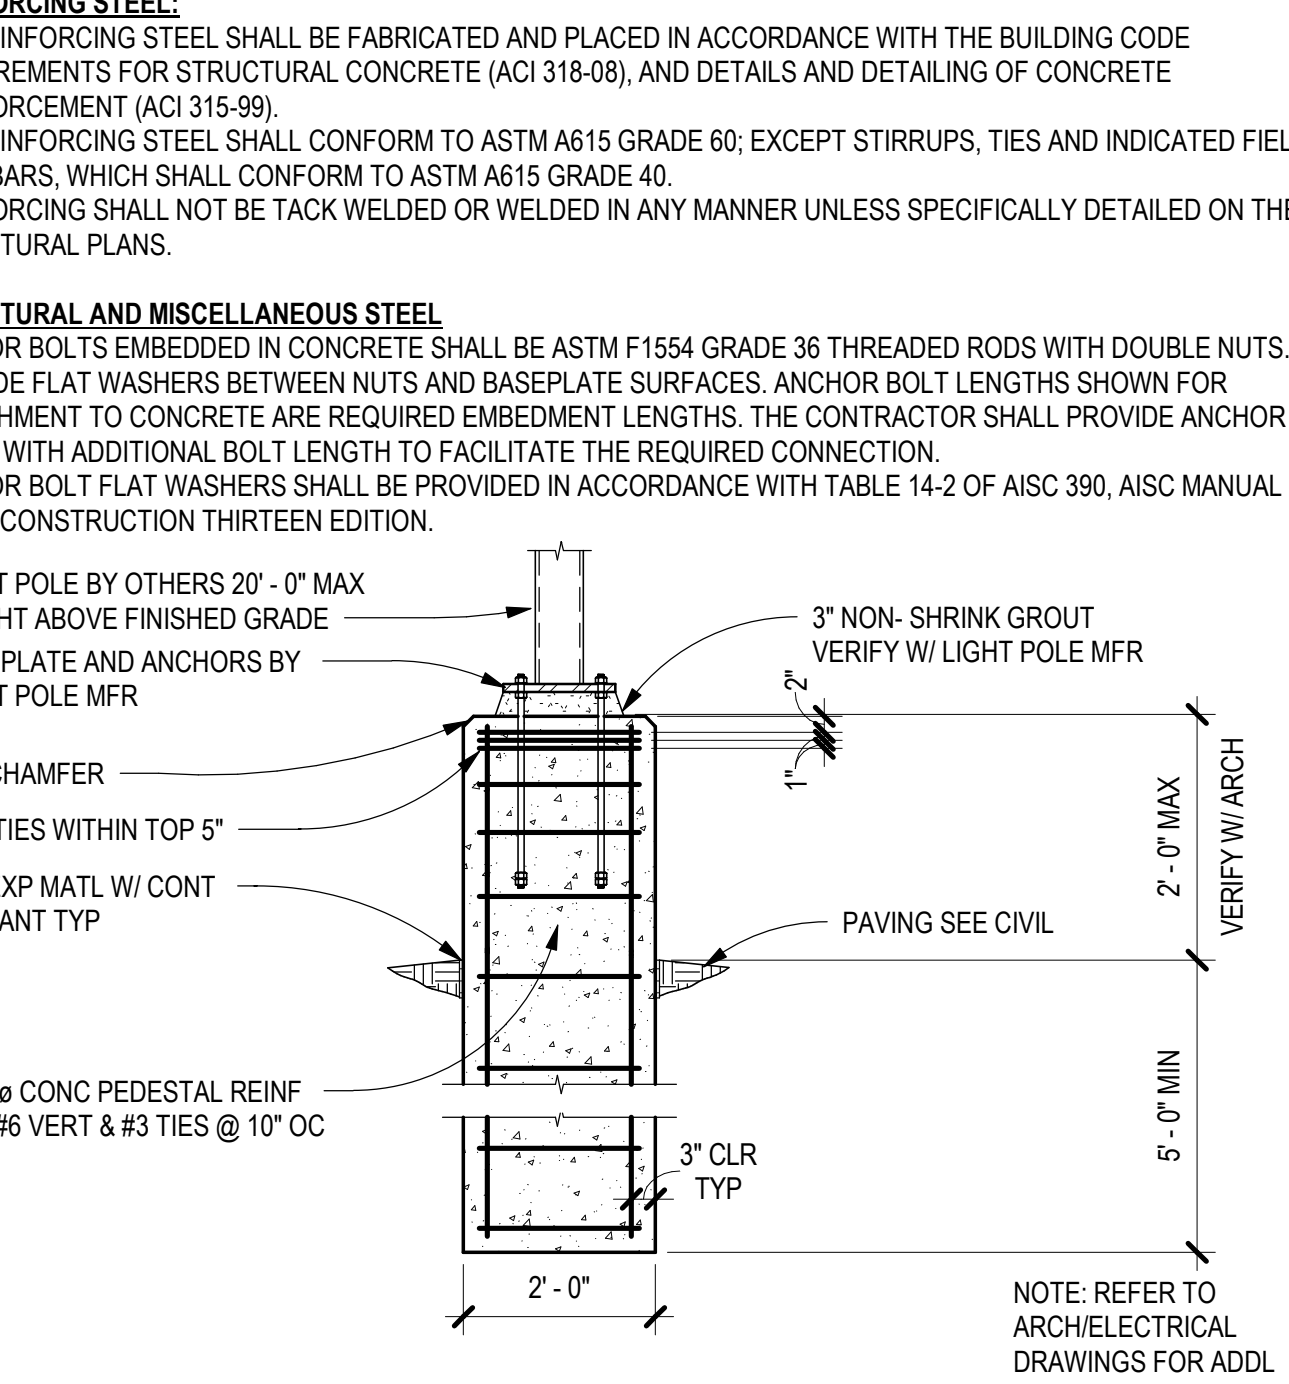


A3 LIGHT POLE BASE
SCALE: 1/2" = 1'-0"

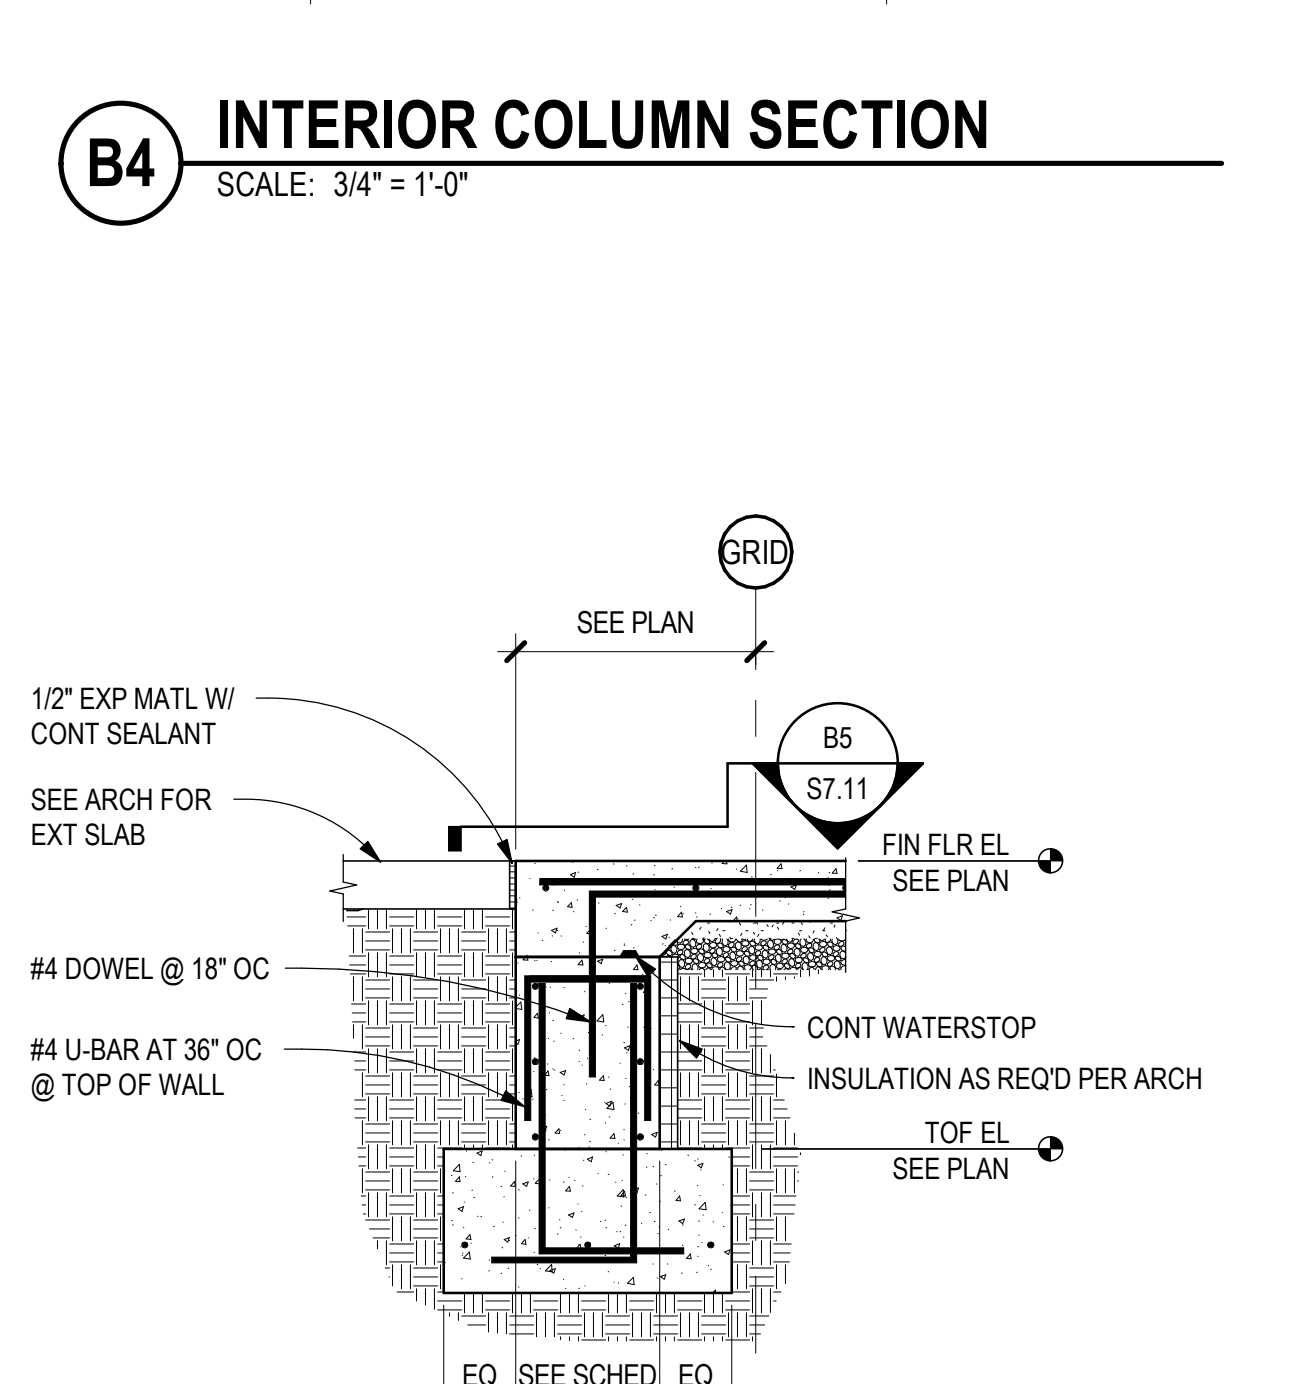

A4 FOUNDATION SECTION AT DOORWAY
SCALE: 3/4" = 1'-0"

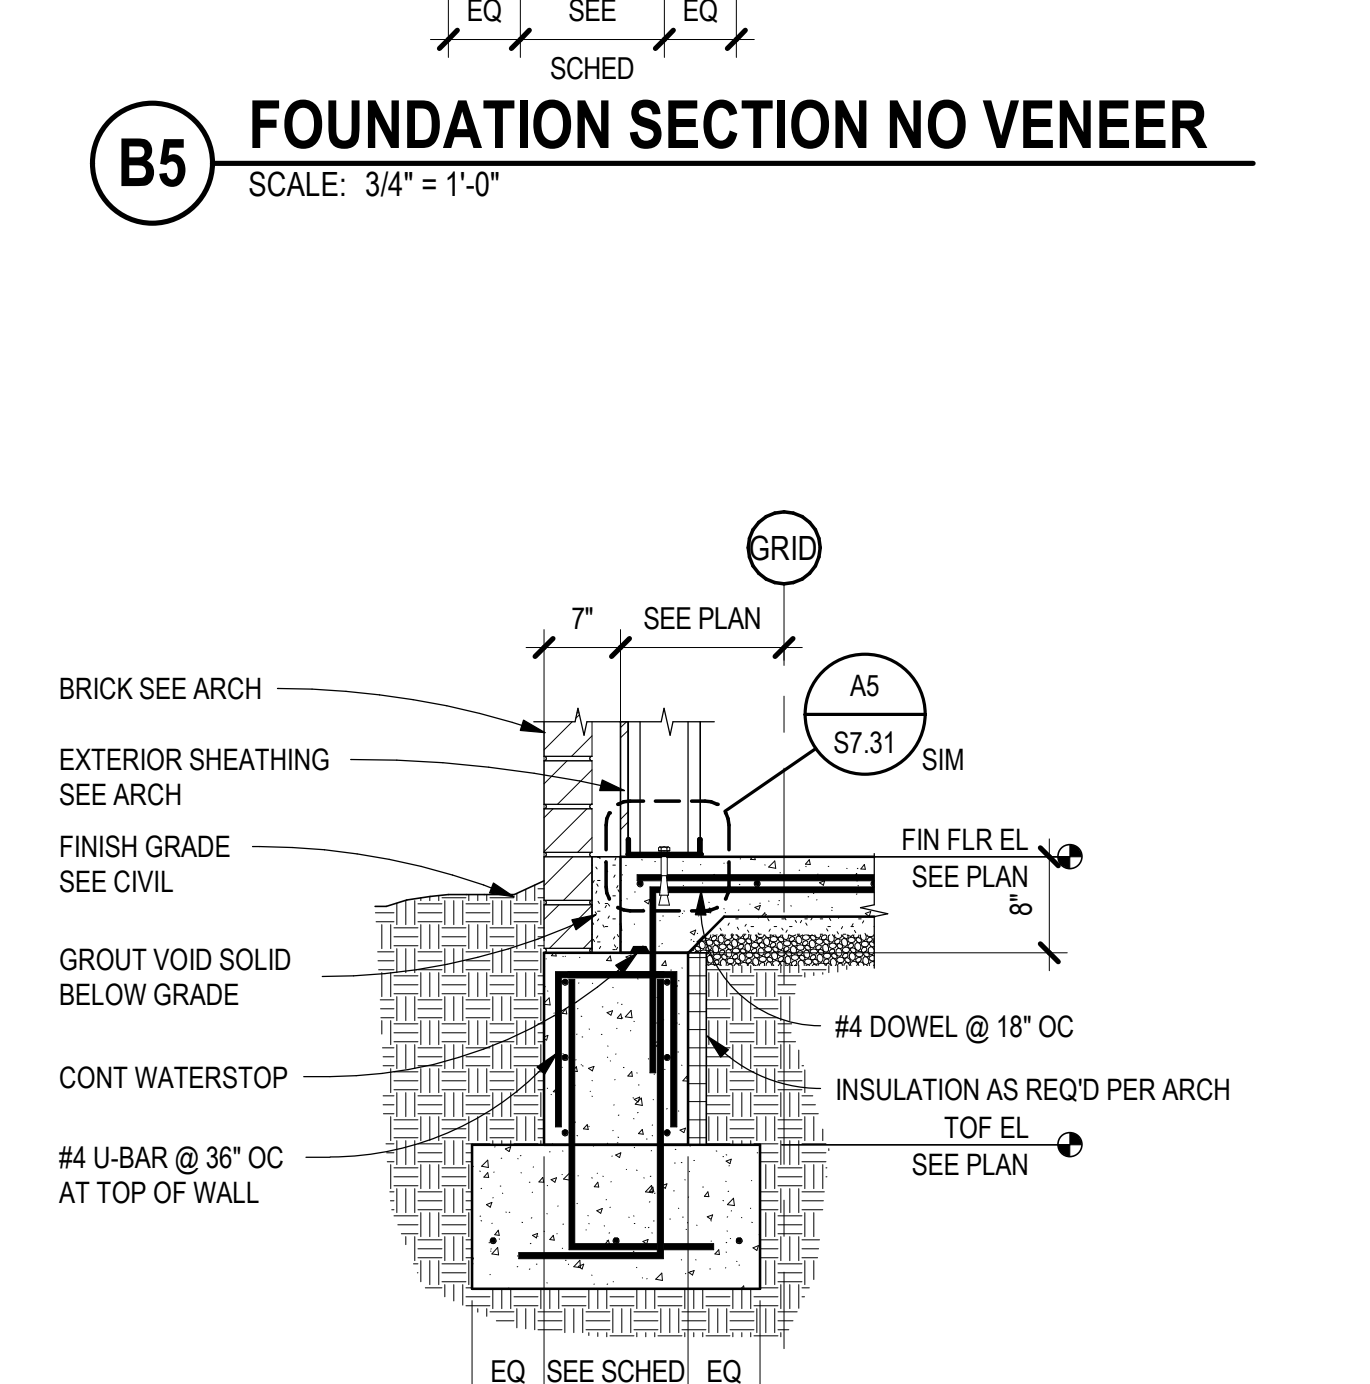

A5 TYPICAL FOUNDATION SECTION
SCALE: 3/4" = 1'-0"



WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

KEY PLAN:



PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER: S3.11


FOUNDATION SECTIONS

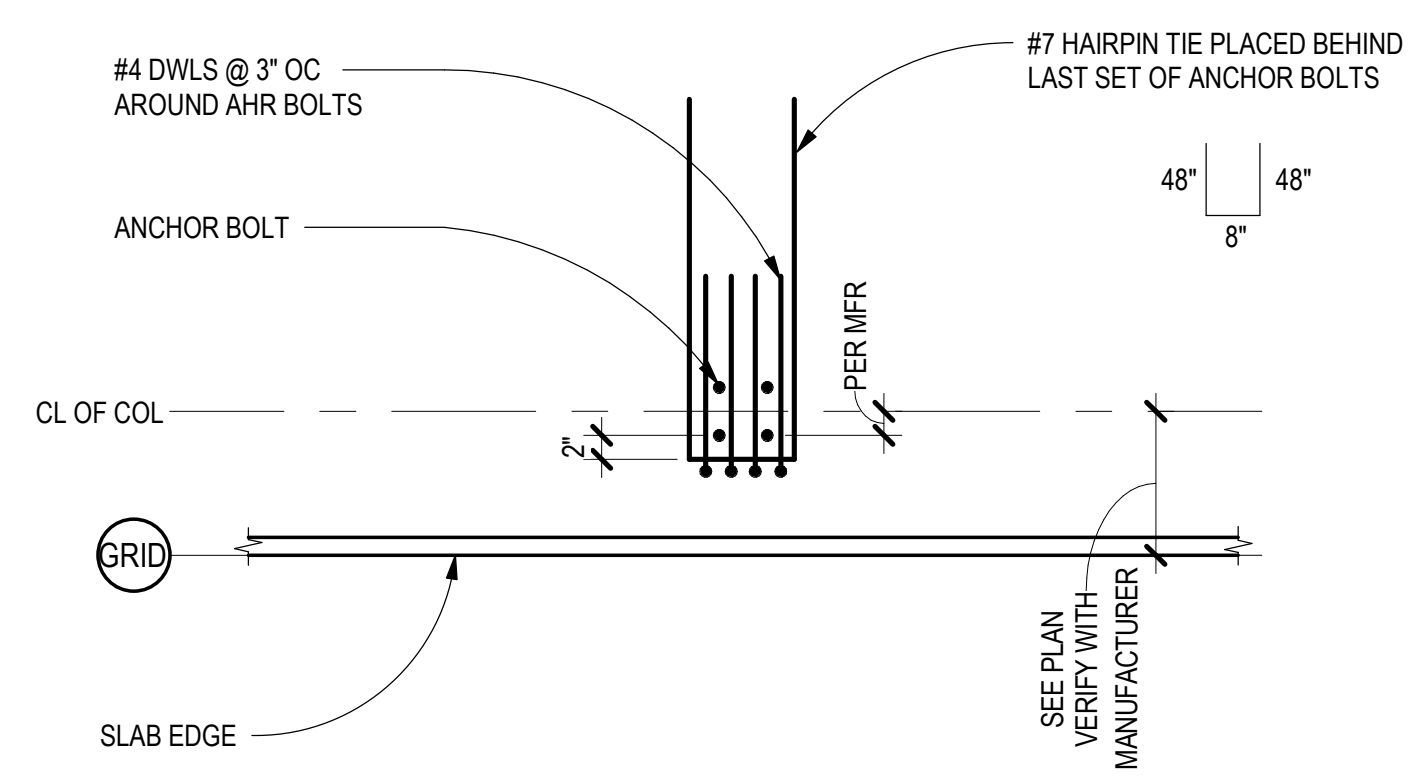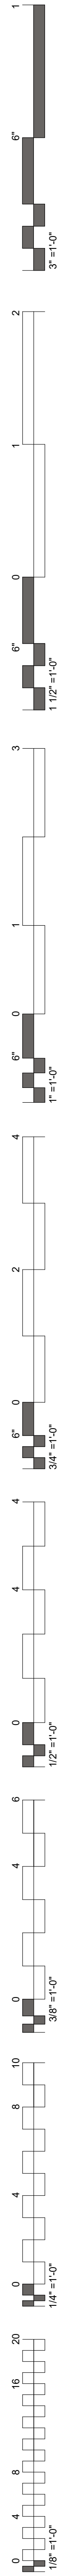


A4 HAIRPIN REINF AT CORNER COLUMN
SCALE: 3/4" = 1'-0"

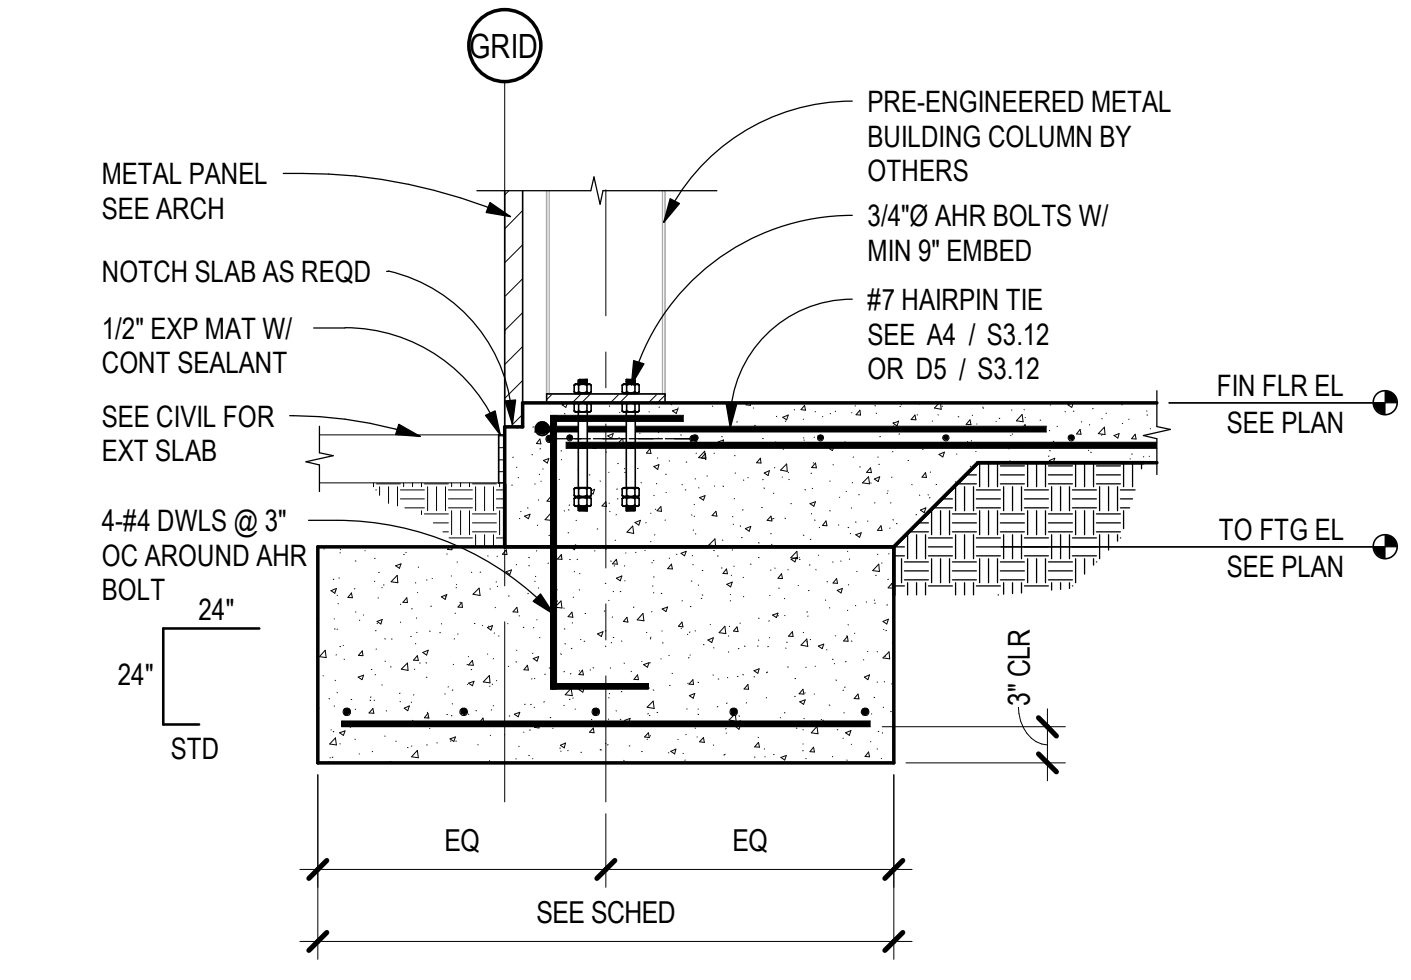


D5 HAIRPIN REINF AT COLUMN
SCALE: 3/4" = 1'-0"

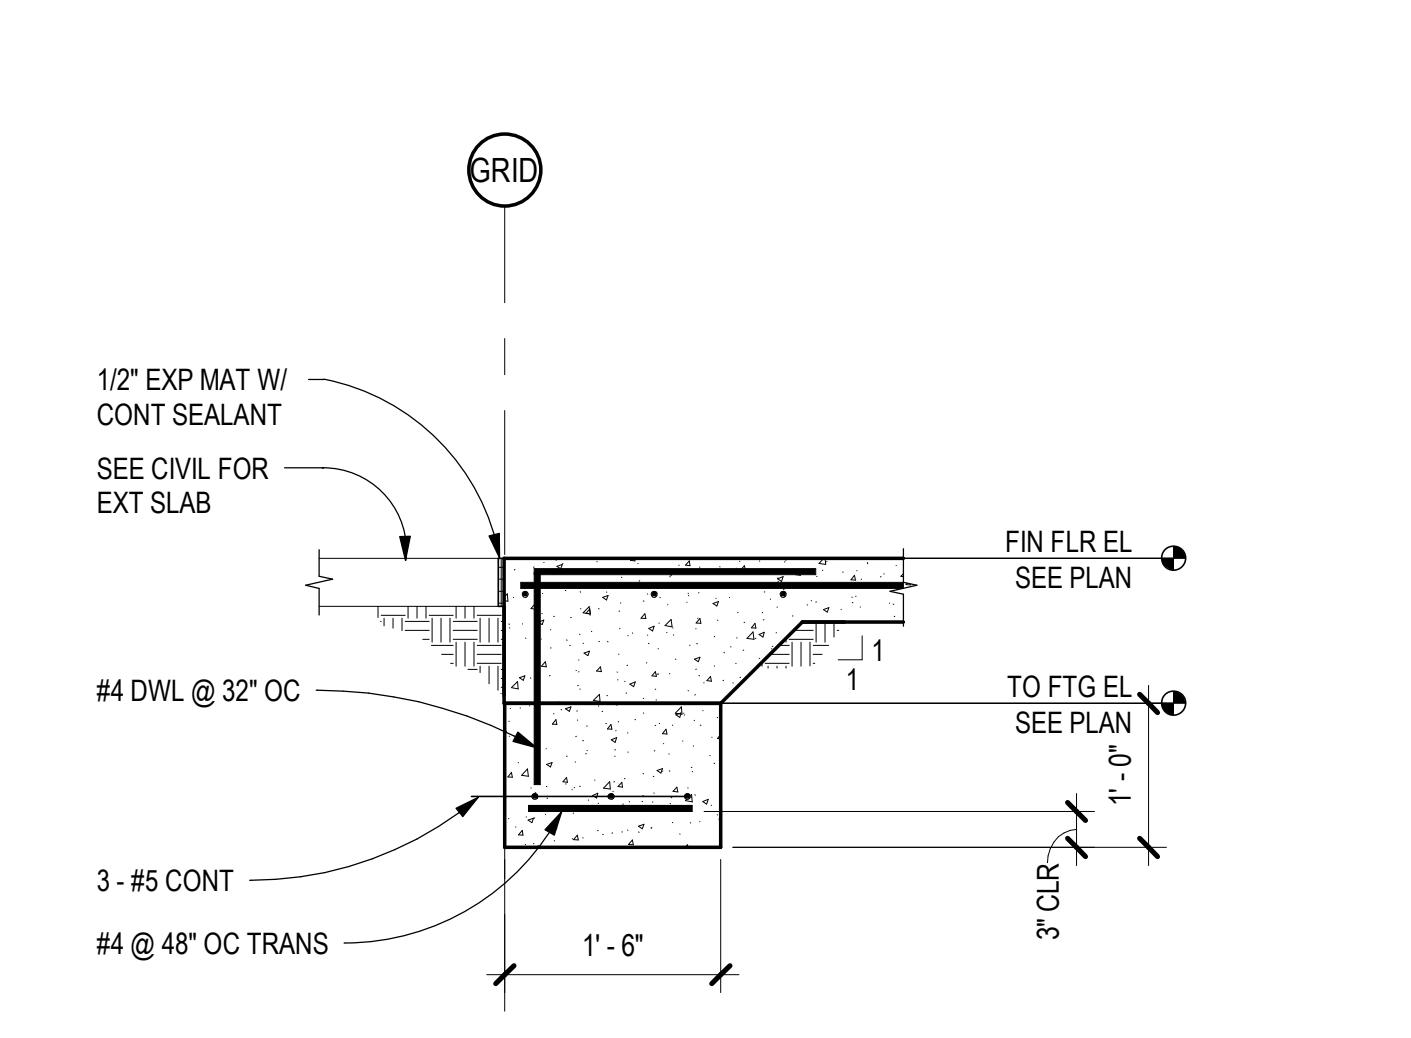


C5 PERIMETER SECTION @ COLUMN
SCALE: 3/4" = 1'-0"

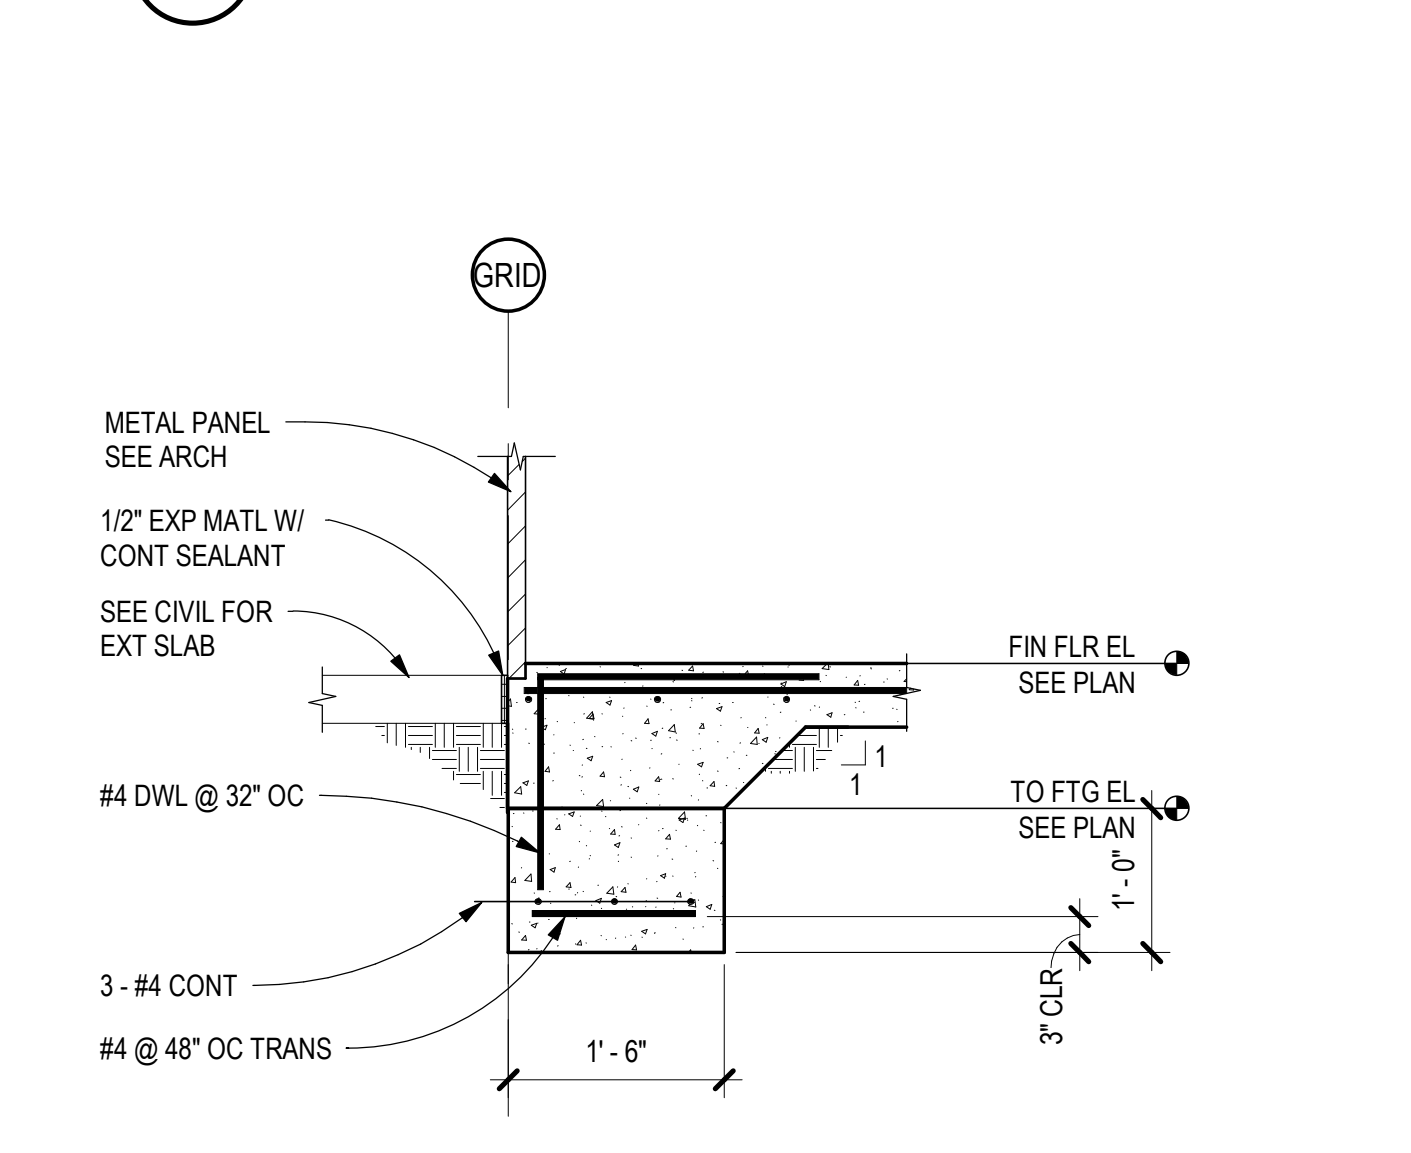

B5 FOUNDATION SECT @ OPENING
SCALE: 3/4" = 1'-0"


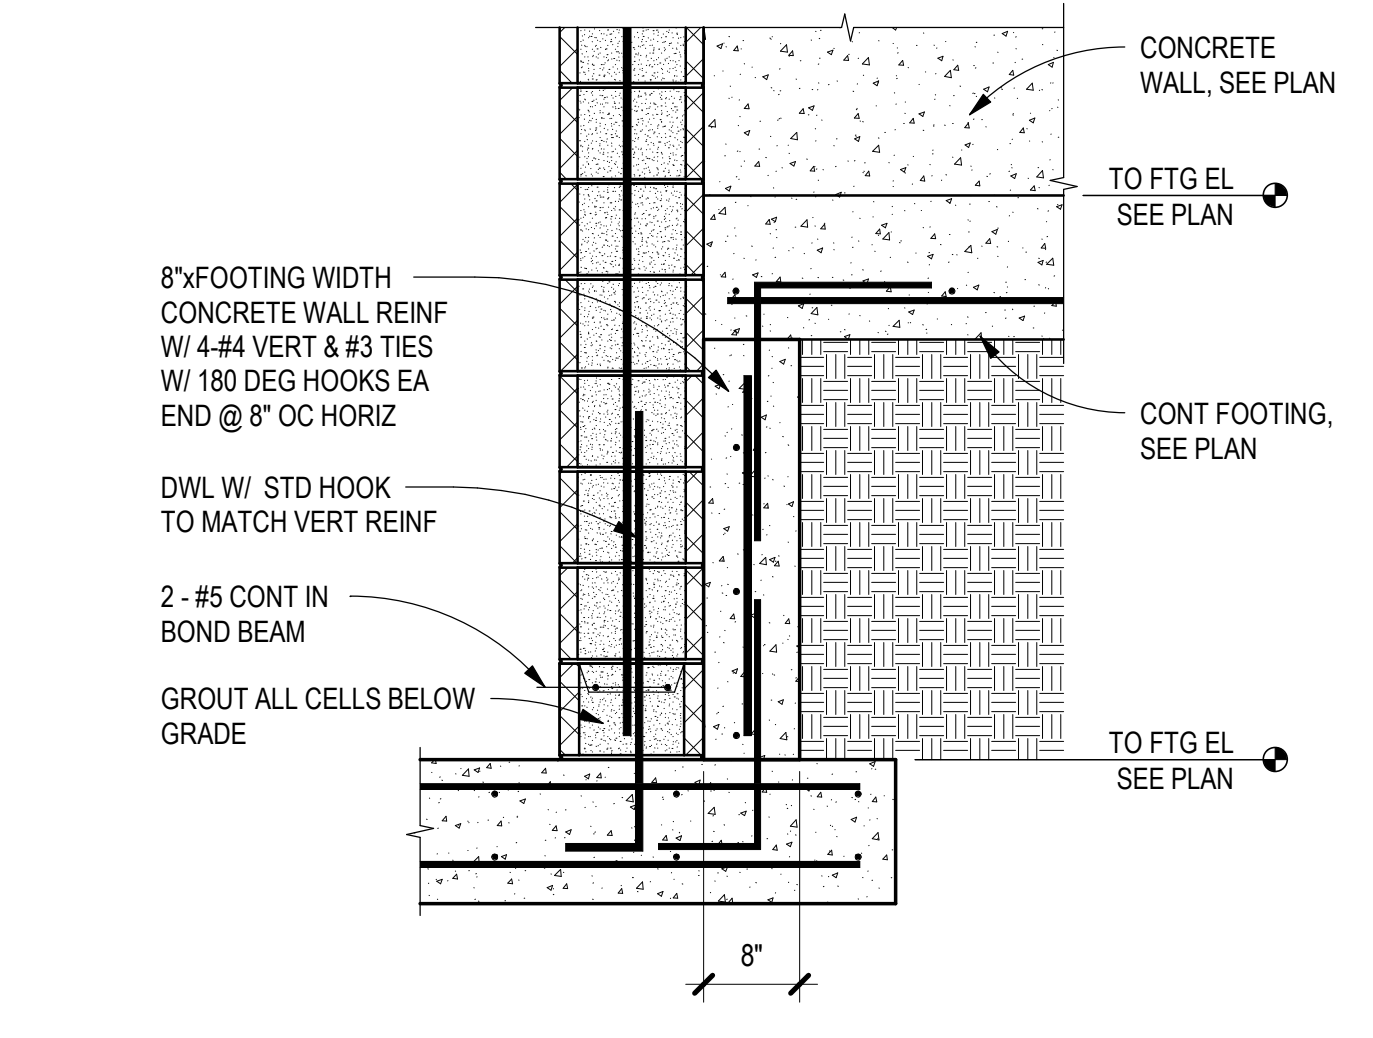


B4 FOUNDATION SECTION @ ELEVATOR
SCALE: 3/4" = 1'-0"

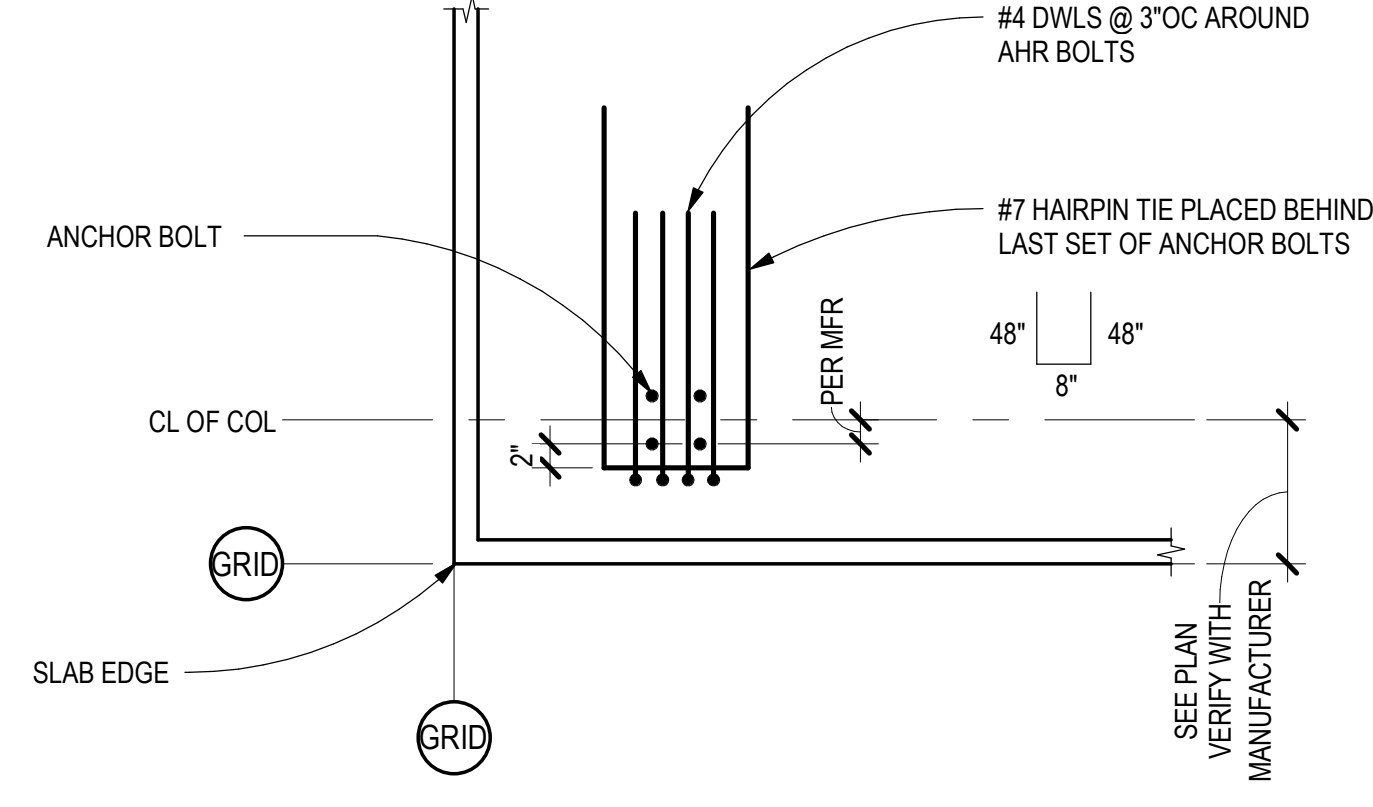


A5 PERIMETER FOUNDATION SECTION
SCALE: 3/4" = 1'-0"


#	DATE	REVISIONS	DESCRIPTION

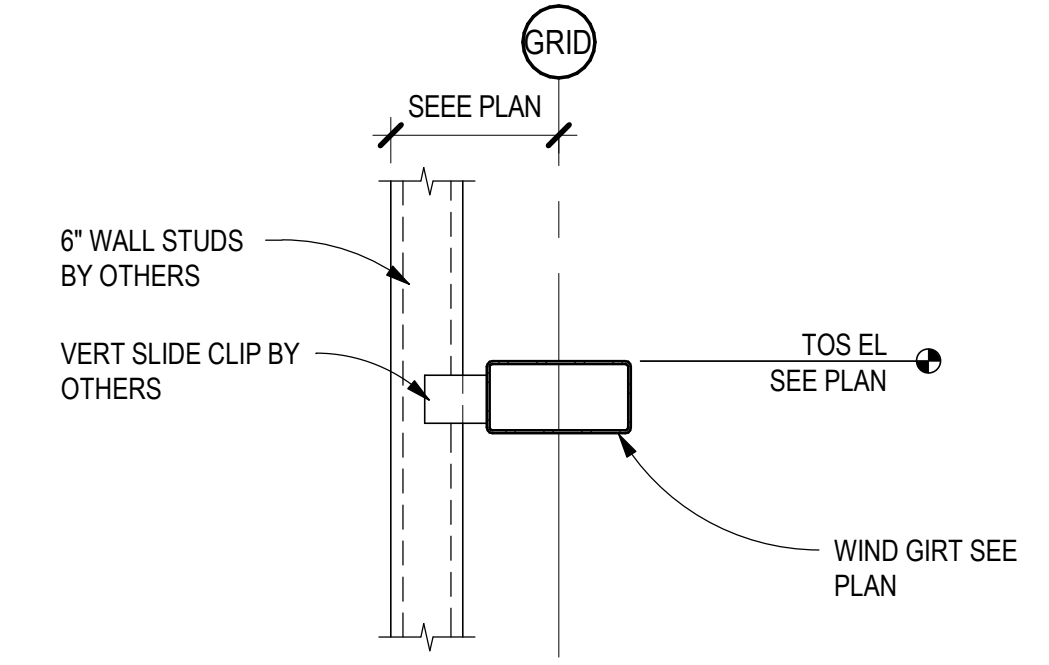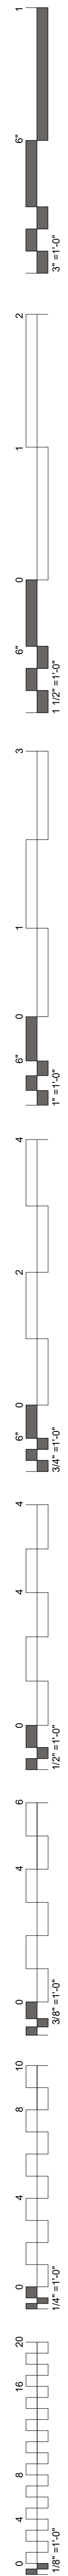


D5 FRAMING SECTION
SCALE: 3/4" = 1'-0"

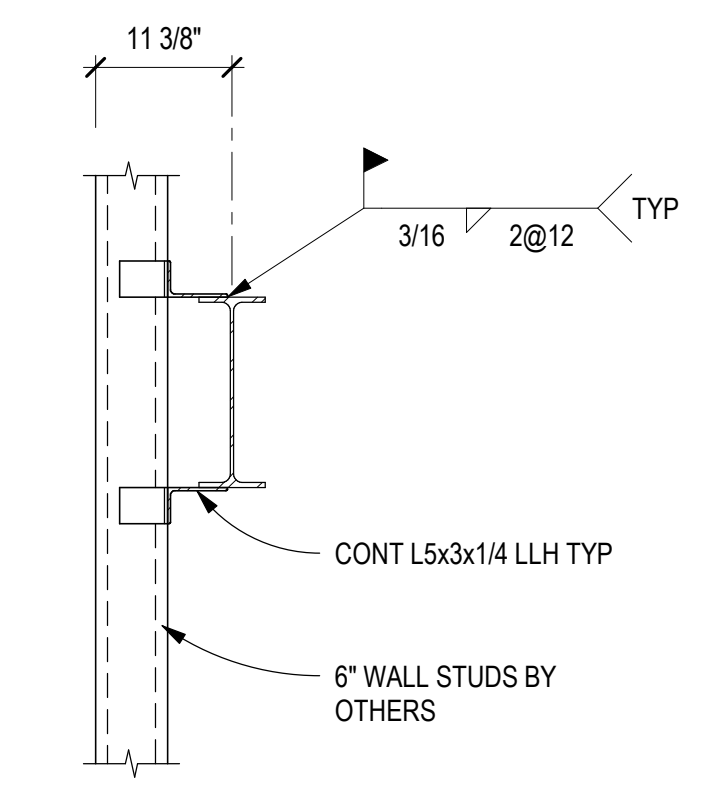


C5 FRAMING SECTION
SCALE: 3/4" = 1'-0"

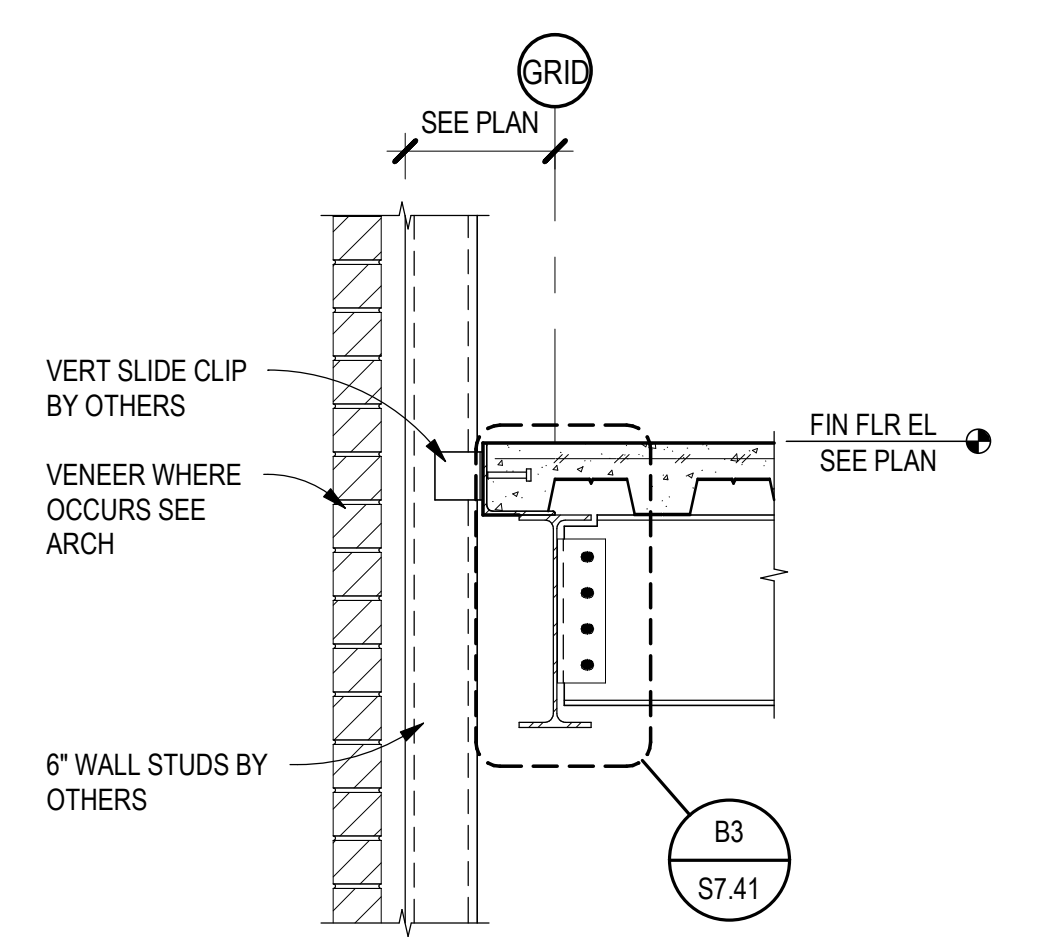



B5 FLOOR FRAMING SECTION
SCALE: 3/4" = 1'-0"

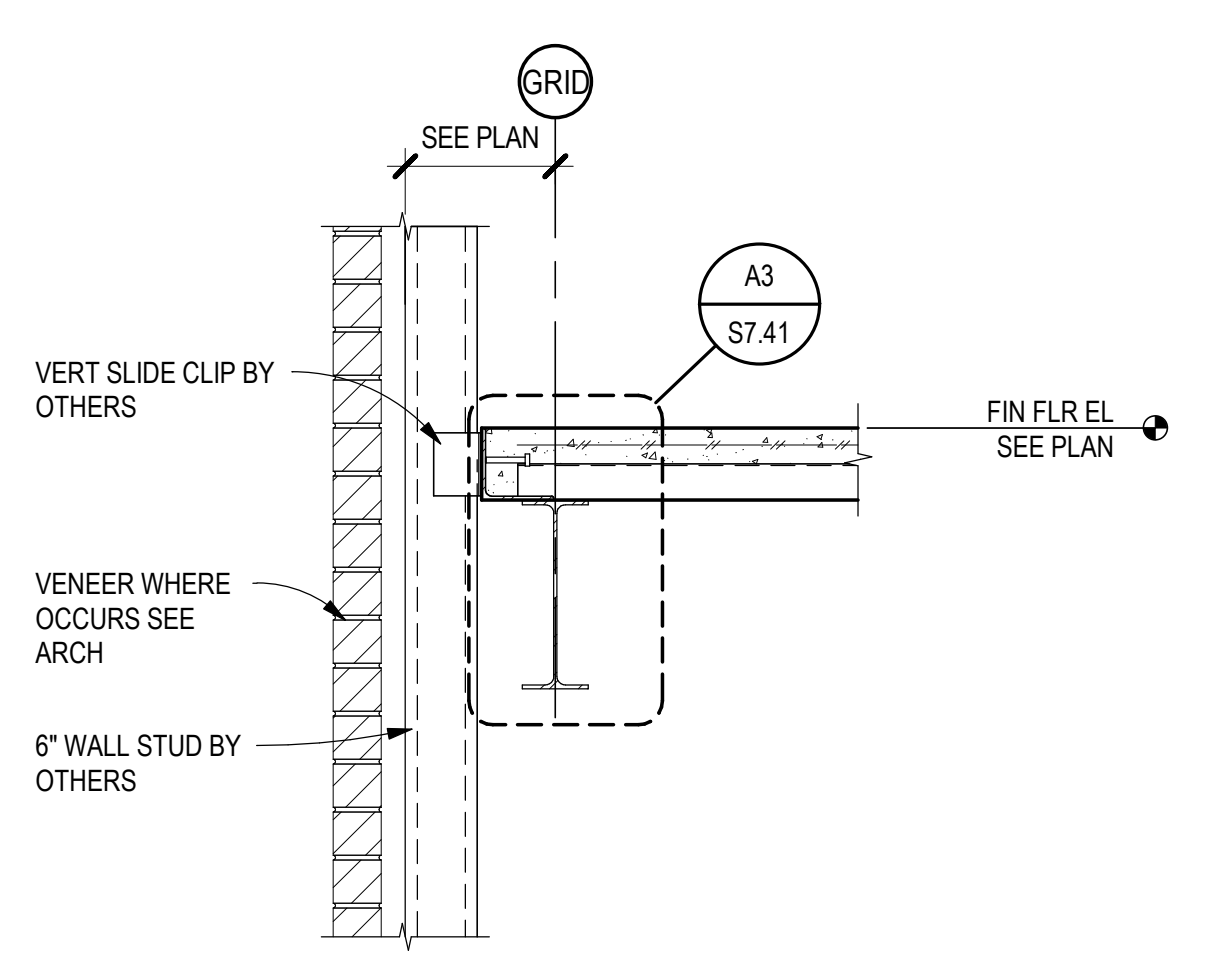

A5 FLOOR FRAMING SECTION
SCALE: 3/4" = 1'-0"

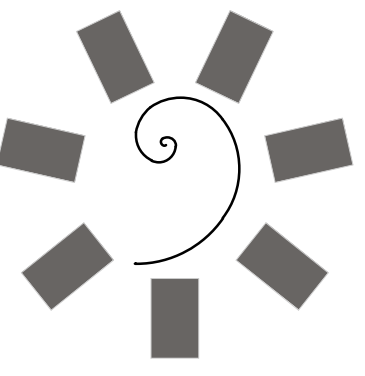

**James R. Childers
Architect, Inc.**
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com

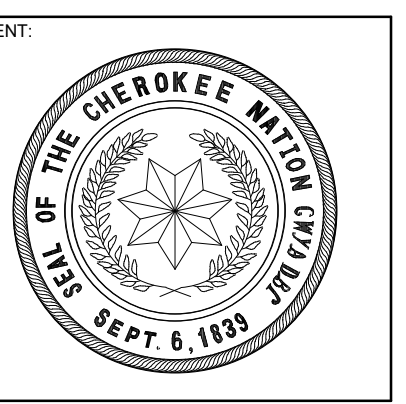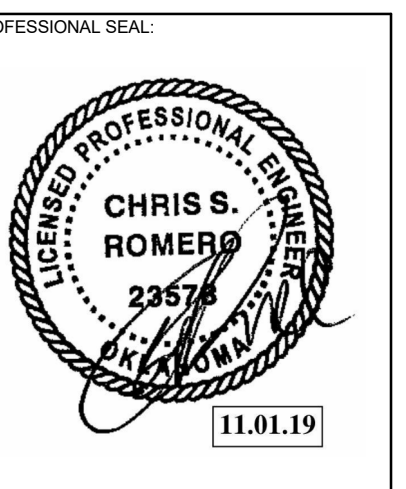

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA



KEY PLAN:

PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:
S3.21
FLOOR FRAMING
SECTIONS

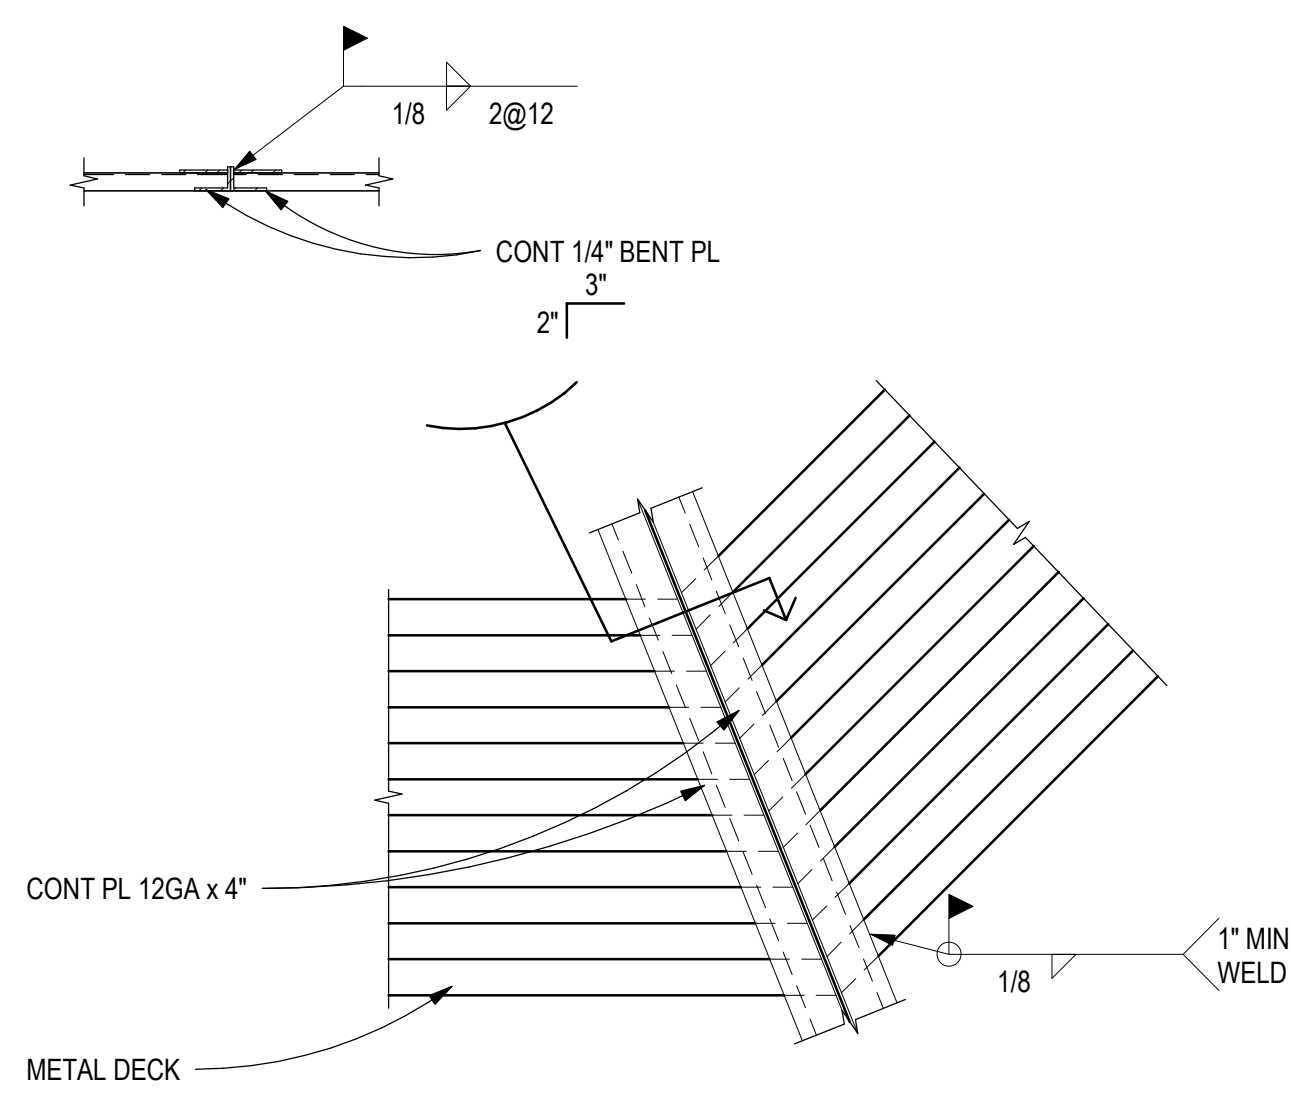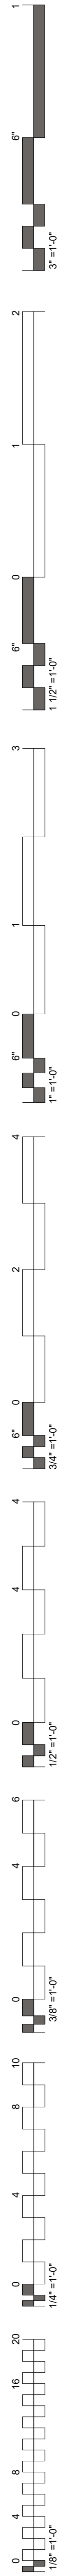


D2 ROOF DECK TRANSITION
SCALE: 3/4" = 1'-0"

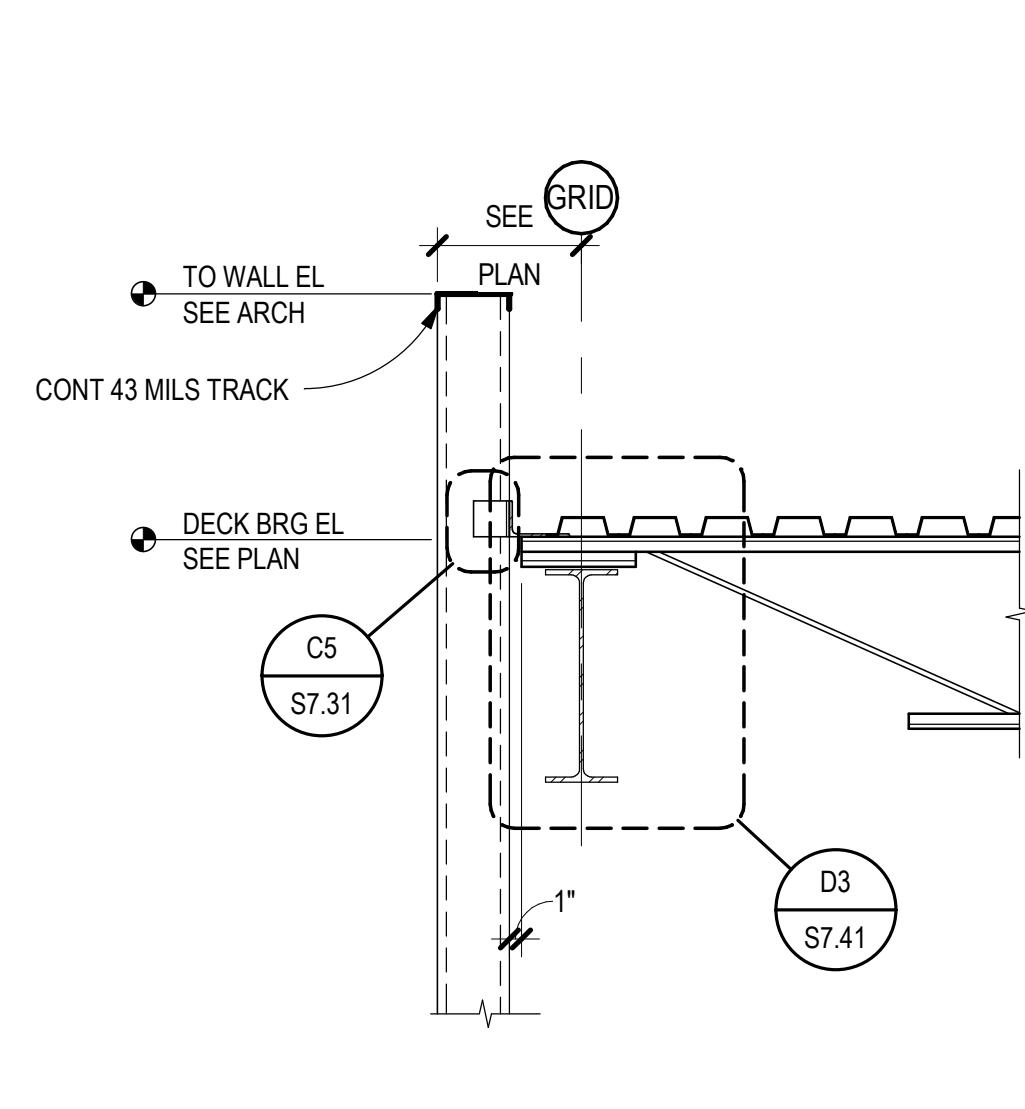


D3 ROOF FRAMING SECTION
SCALE: 3/4" = 1'-0"

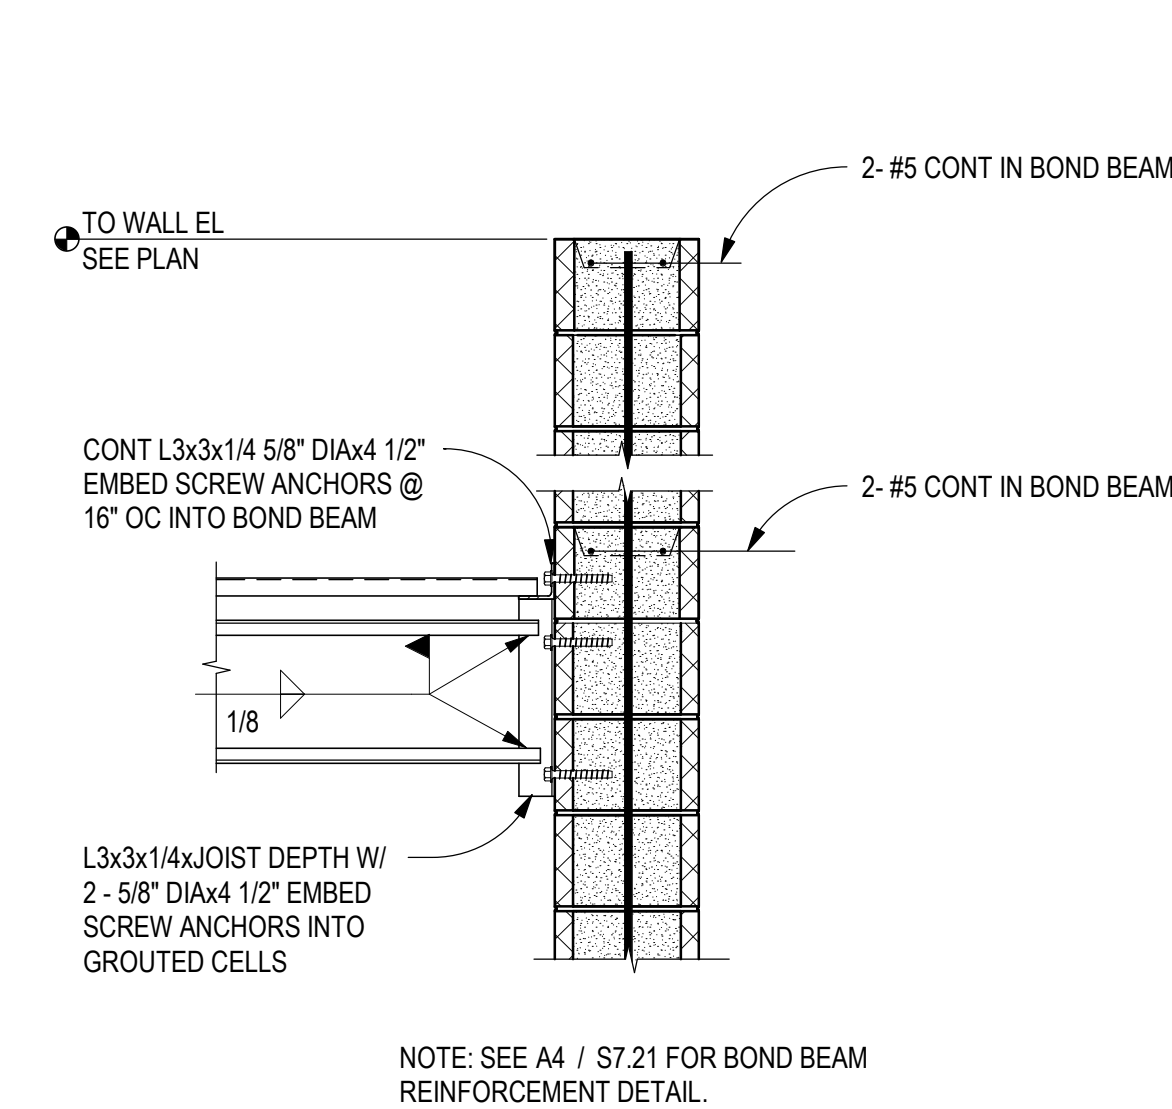


D4 ROOF NON-BEARING AT CMU WALL
SCALE: 3/4" = 1'-0"

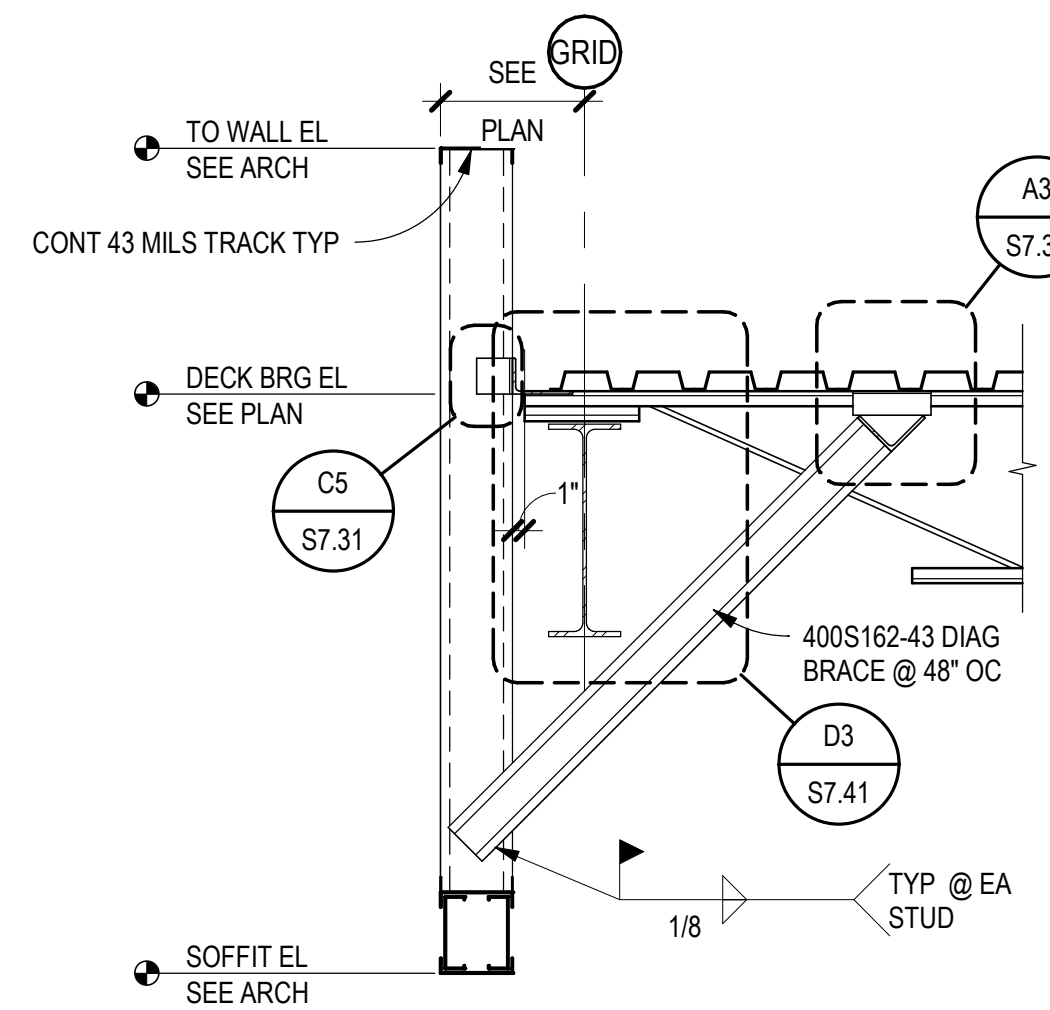


C2 ROOF FRAMING SECTION
SCALE: 3/4" = 1'-0"

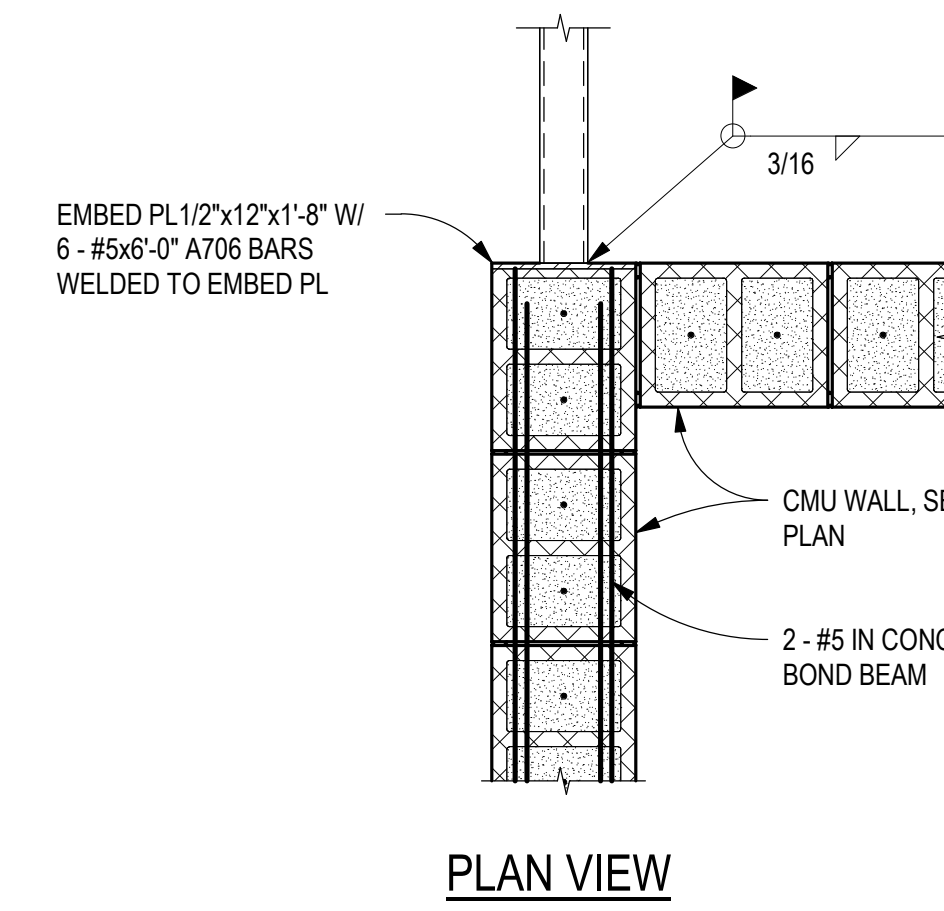


C3 COLLECTOR BLOCKING
SCALE: 3/4" = 1'-0"

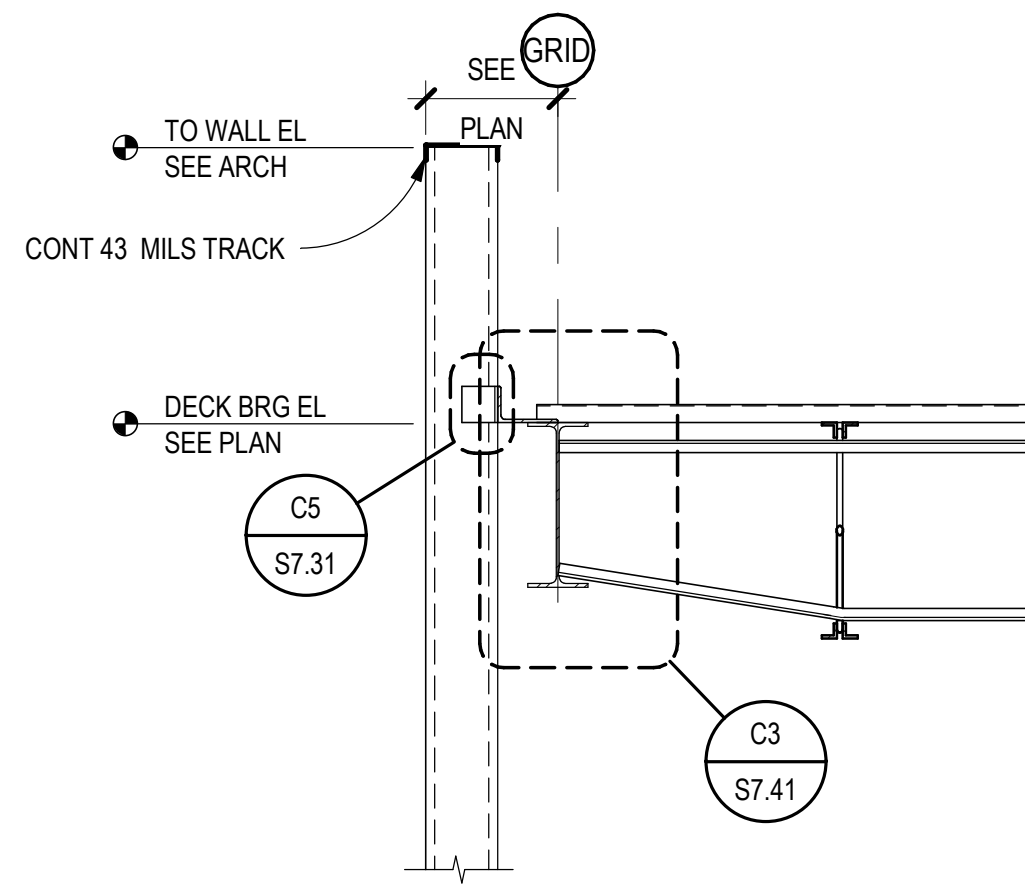


B2 ROOF FRAMING SECTION
SCALE: 3/4" = 1'-0"

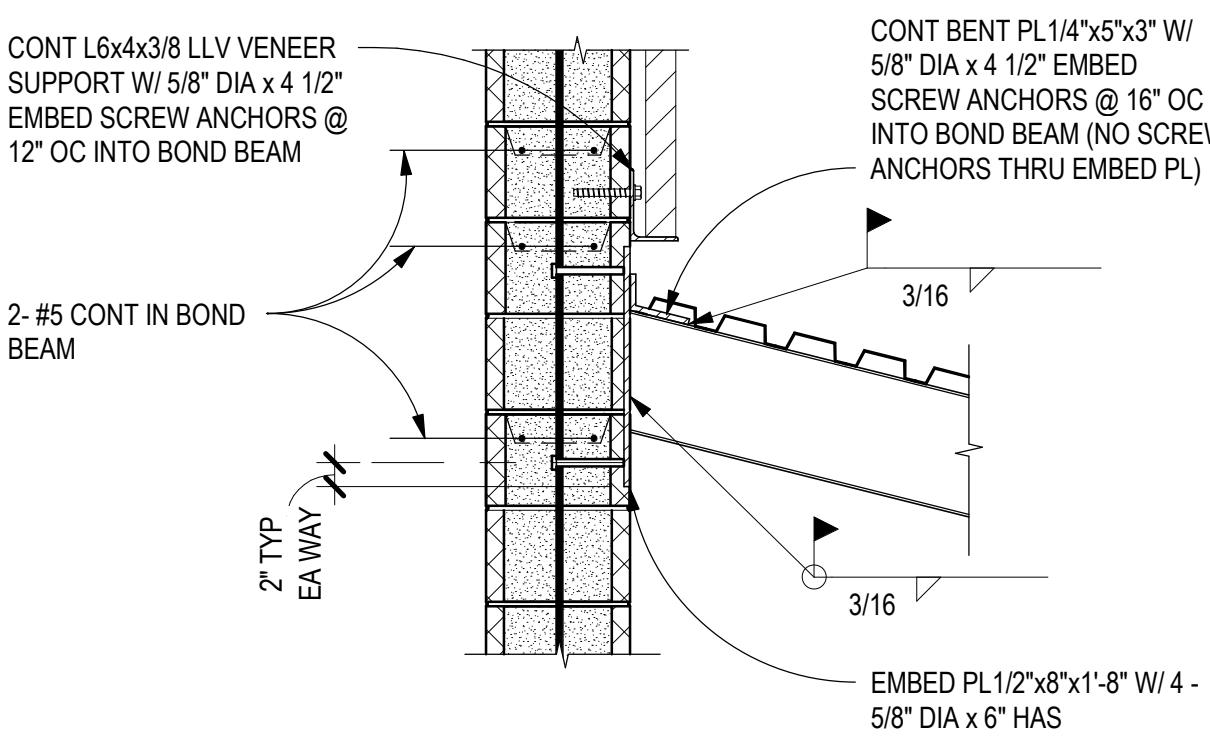


B3 FRAMING SECTION
SCALE: 3/4" = 1'-0"

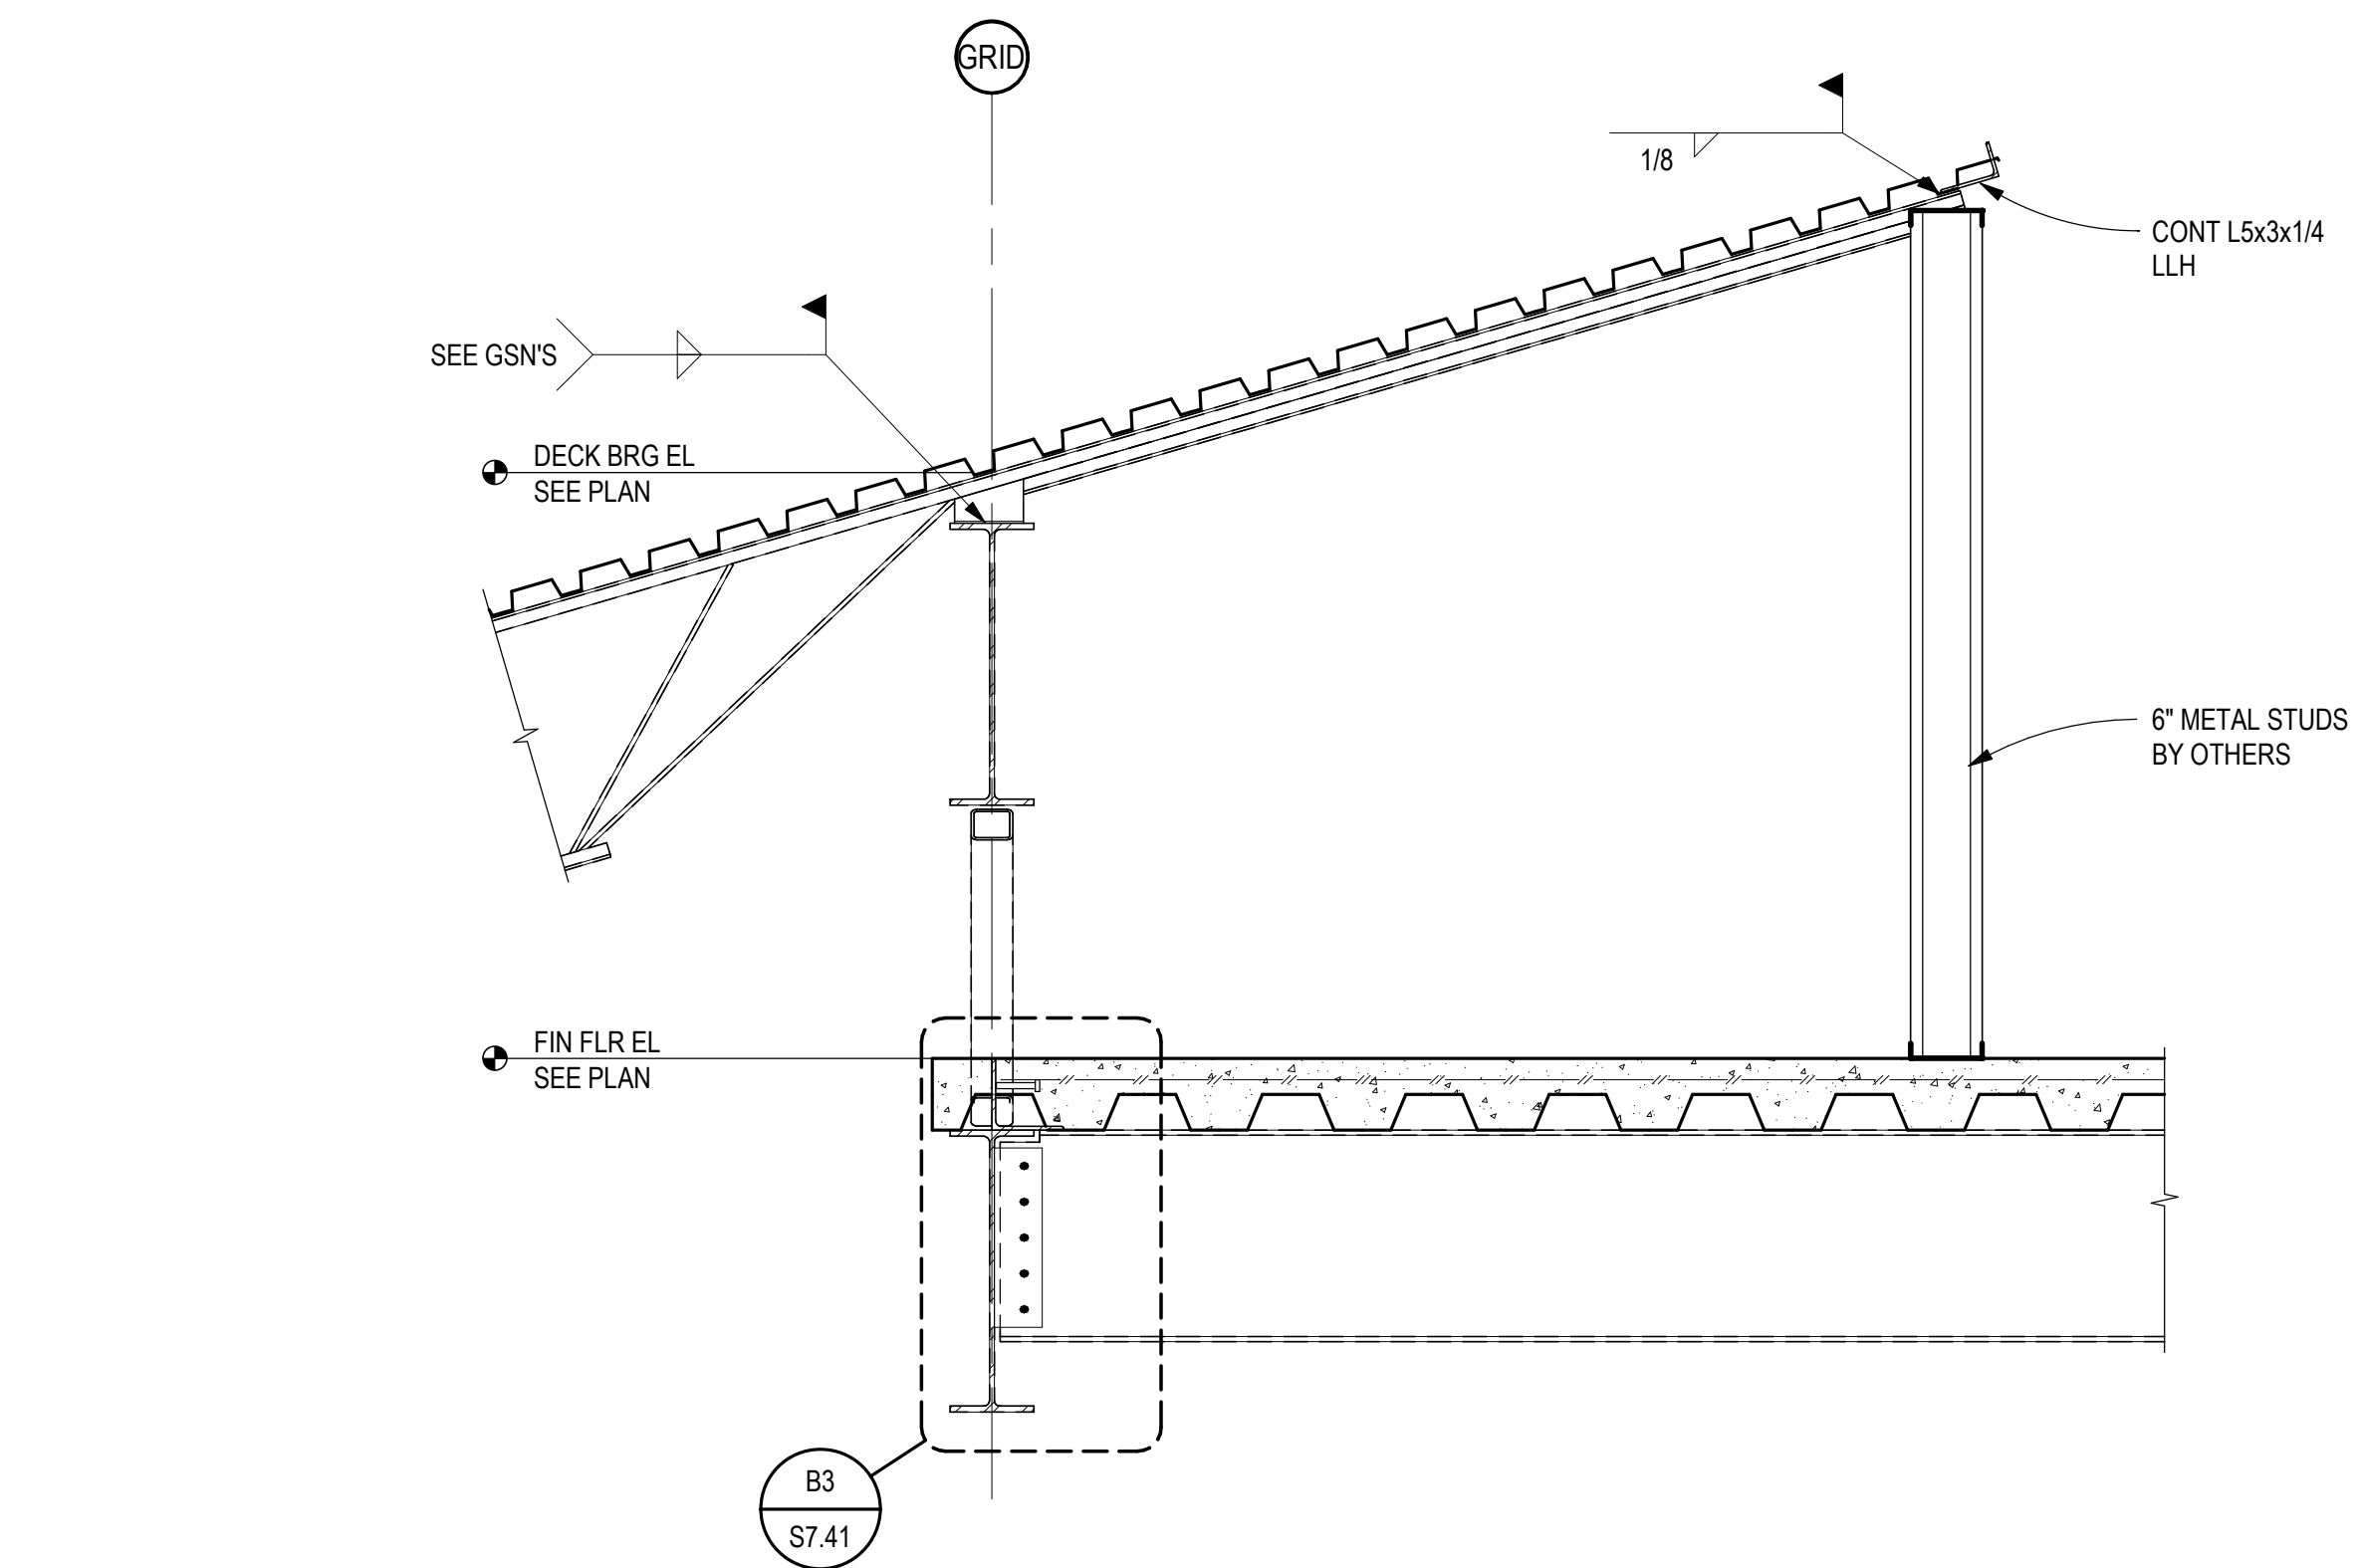


B4 ROOF FRAMING SECTION
SCALE: 3/4" = 1'-0"

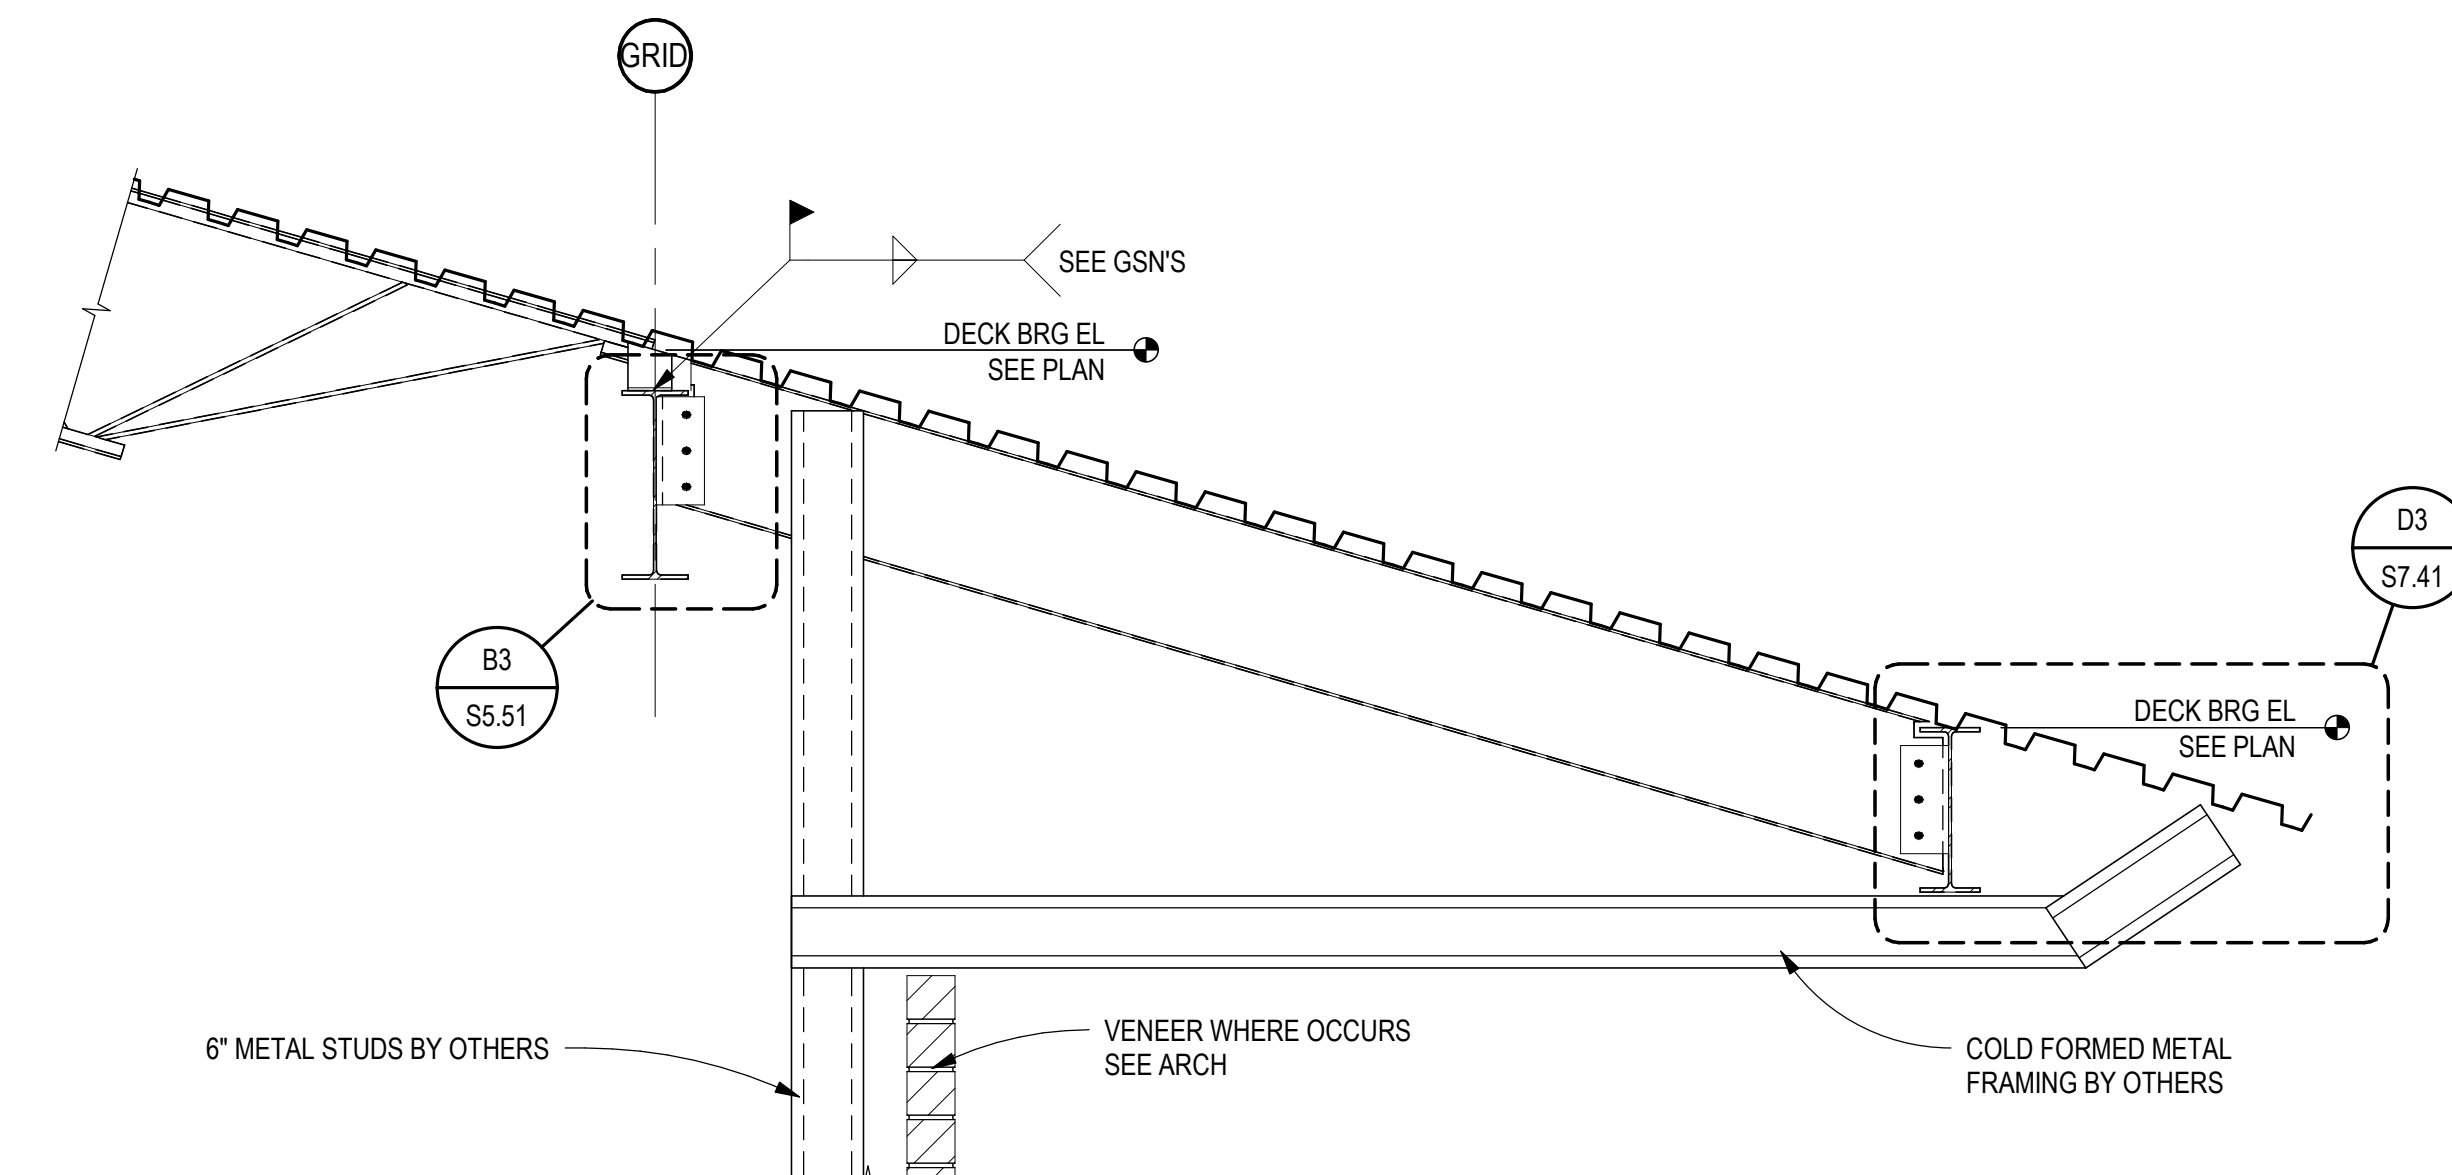


A2 ROOF FRAMING SECTION
SCALE: 3/4" = 1'-0"

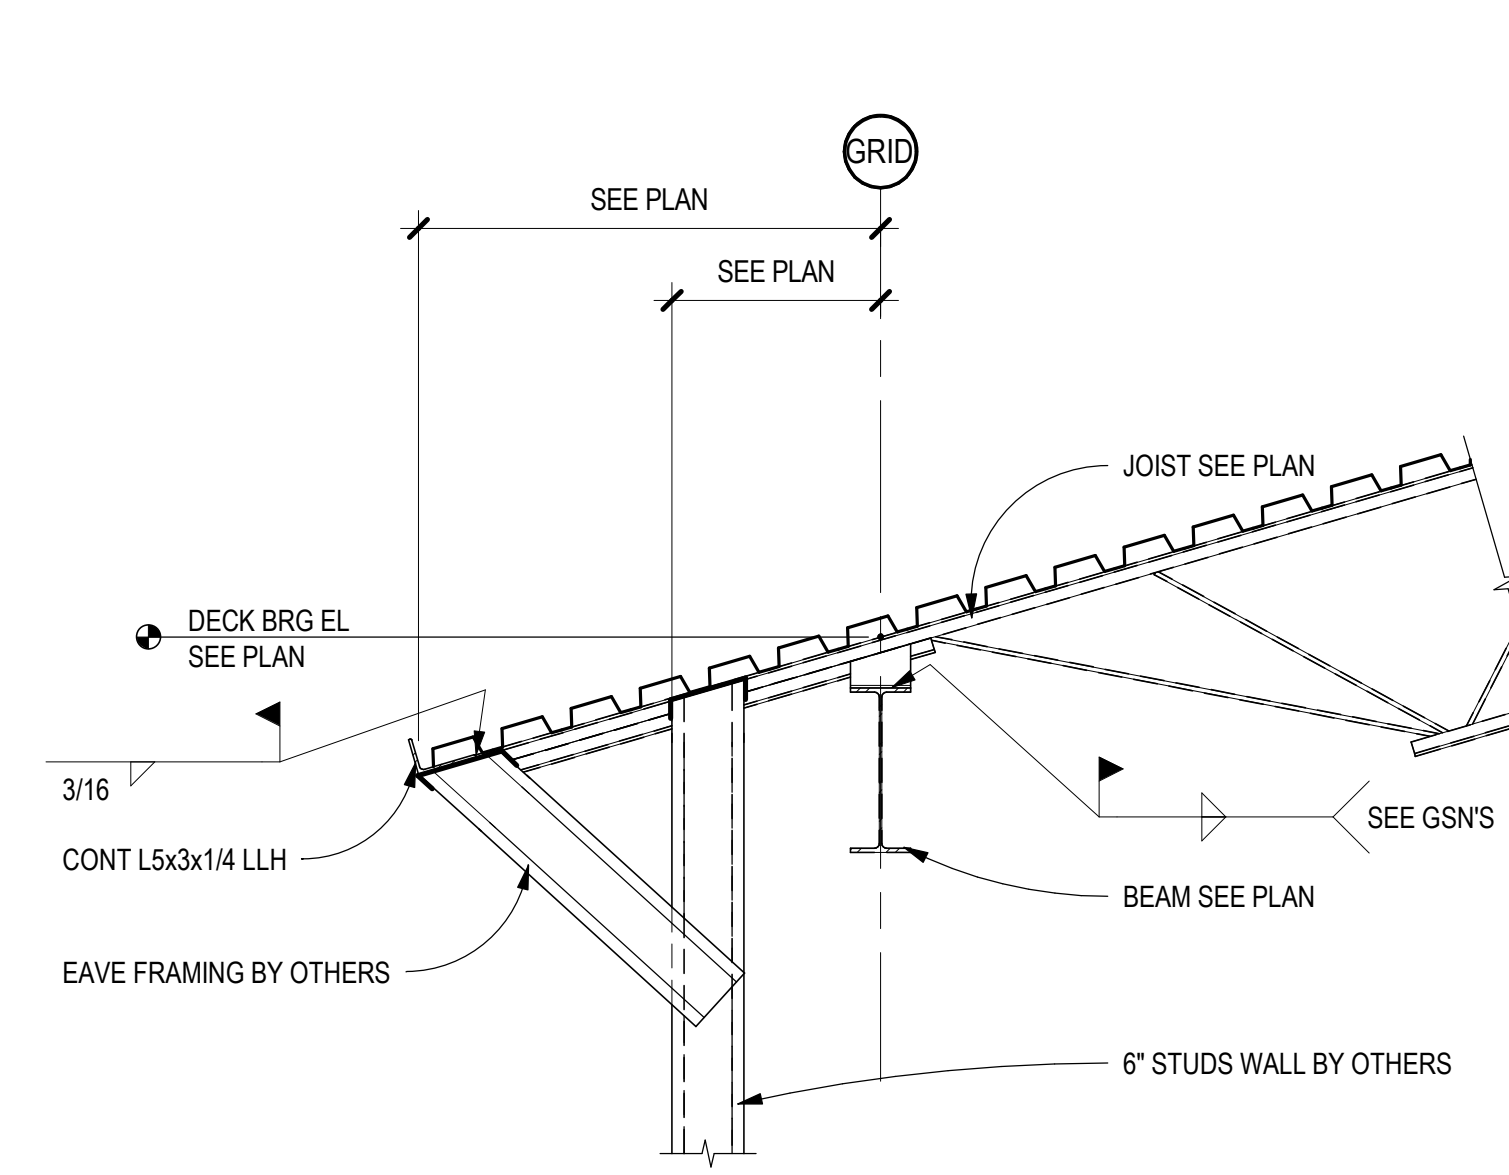

A4 TYPICAL ROOF FRAMING SECTION
SCALE: 3/4" = 1'-0"

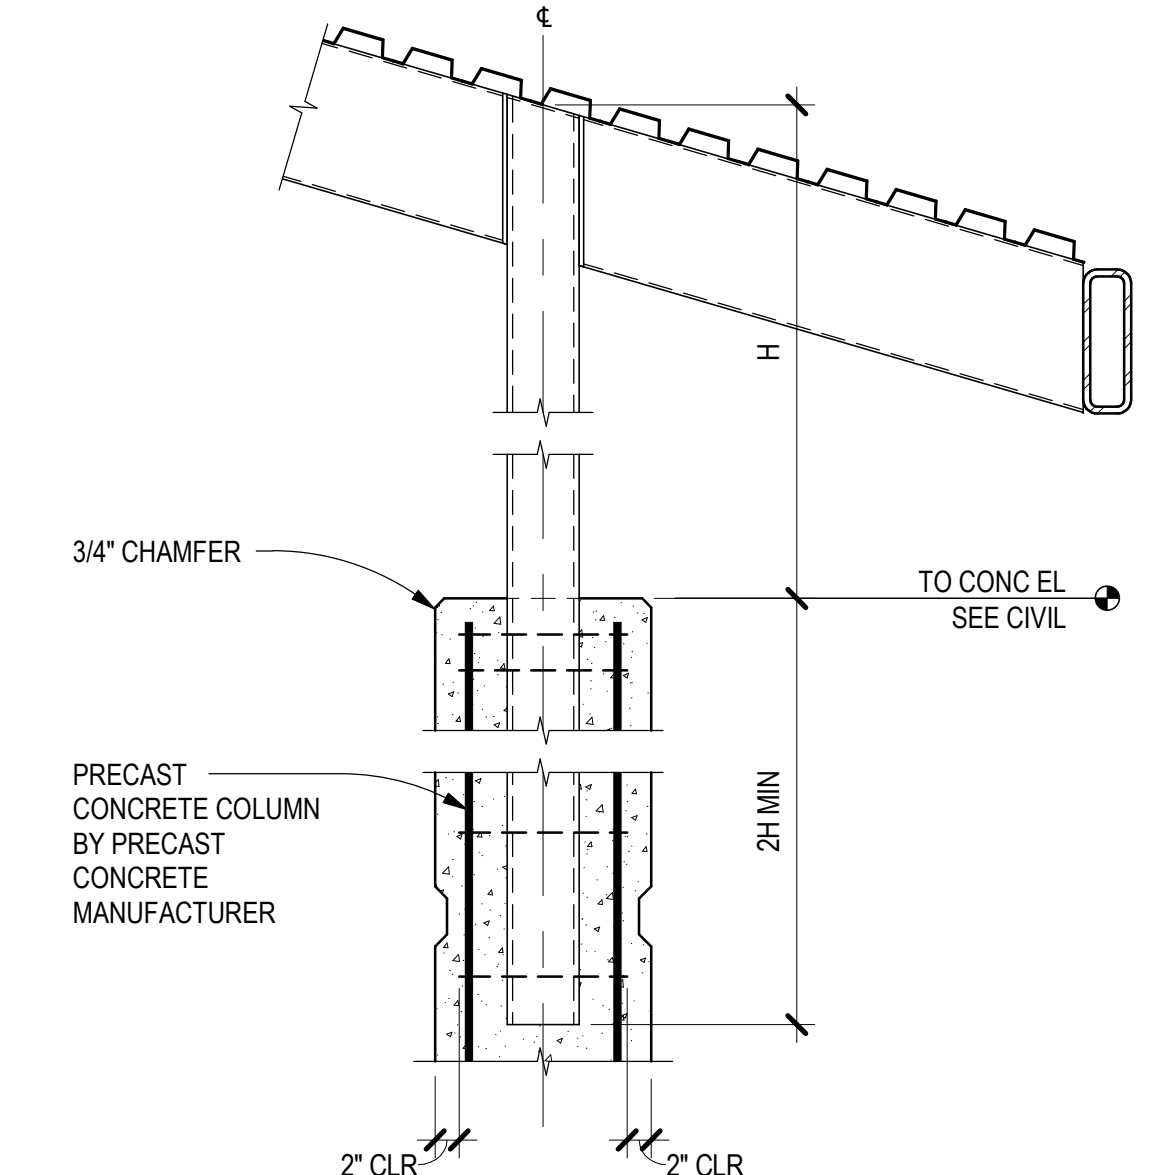


A5 EXT CONC COLUMN SECTION
SCALE: 3/4" = 1'-0"

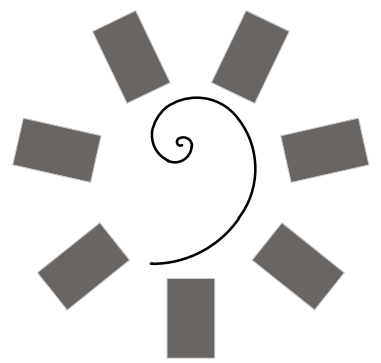

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com



CONSULTANT LOGO

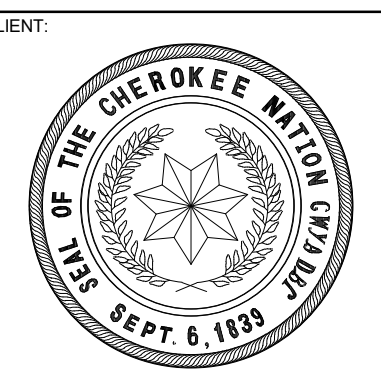

WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE:
BID PACKAGE 01



#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19
JOB NUMBER: 18-01.01


SHEET NUMBER:

S3.31


ROOF FRAMING SECTIONS

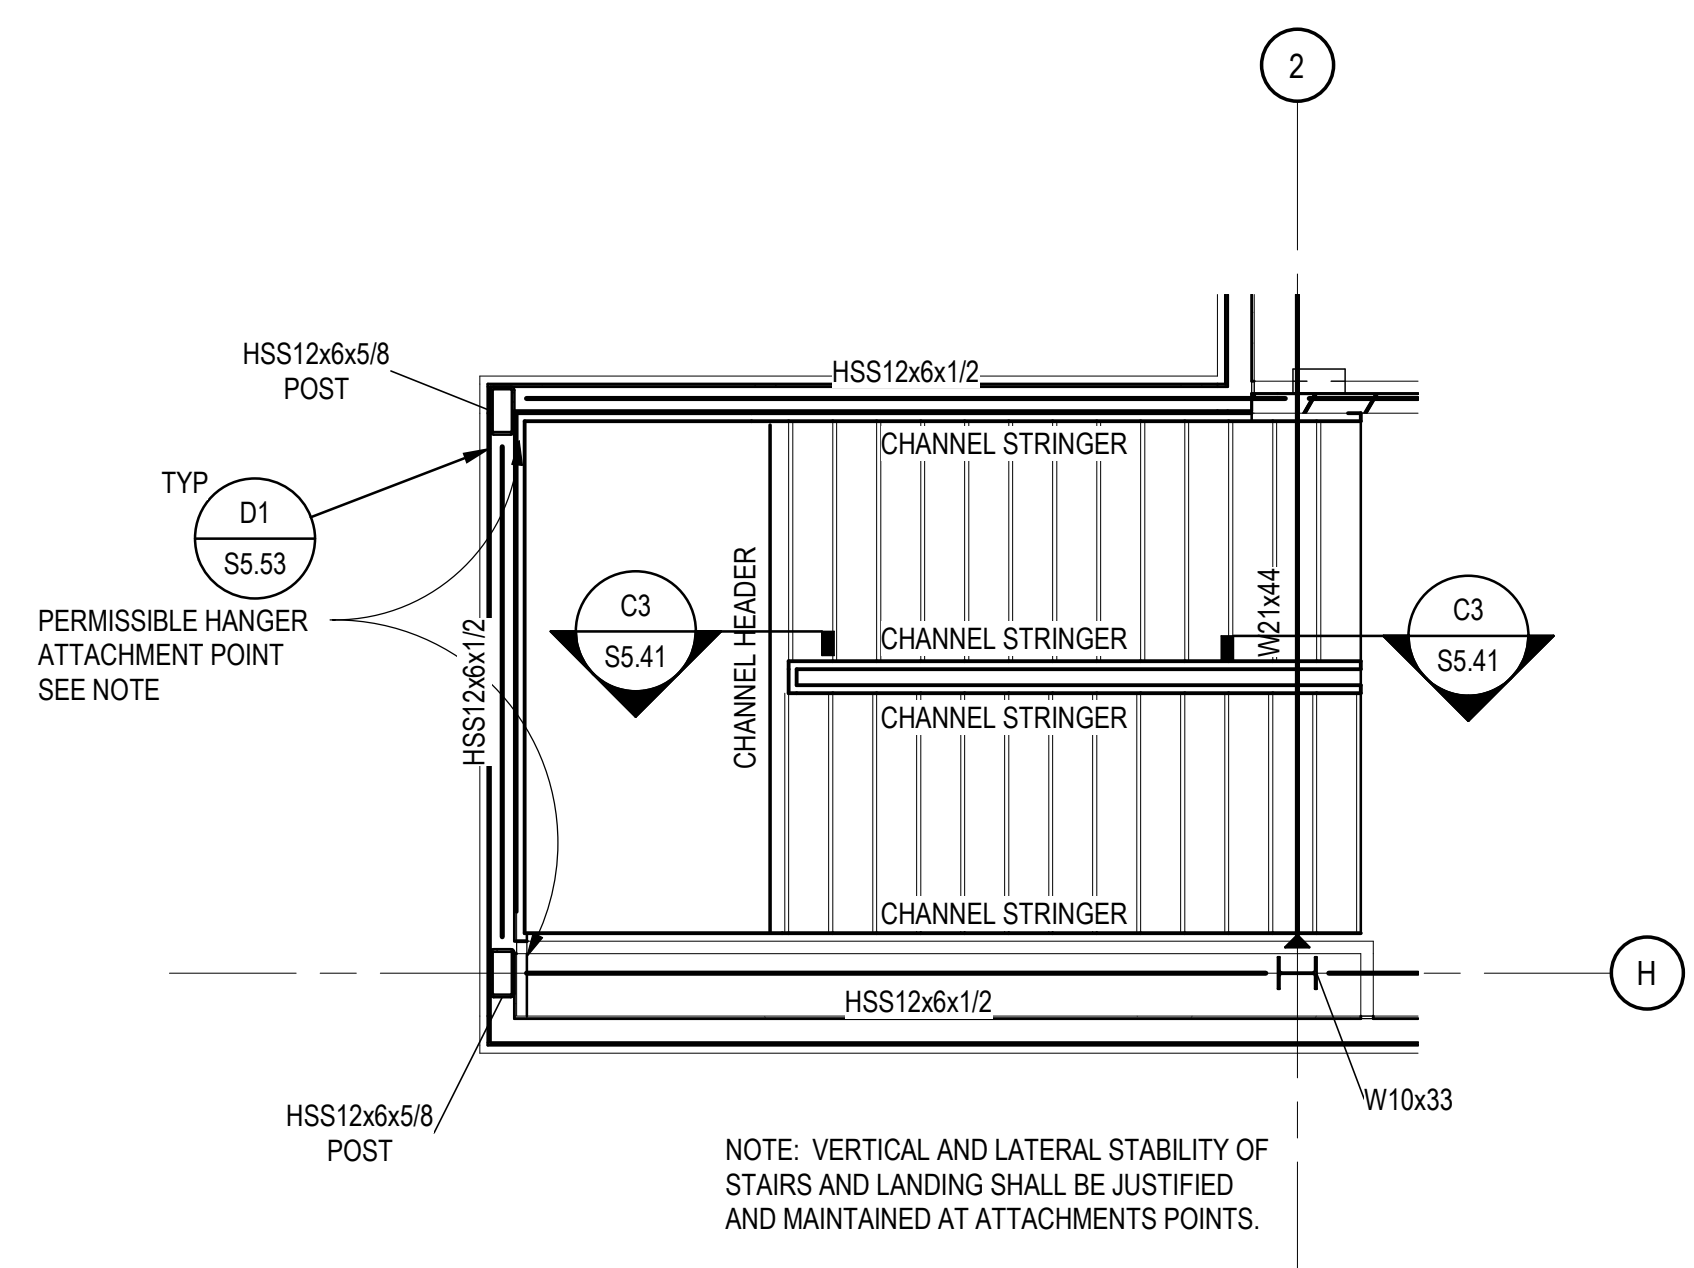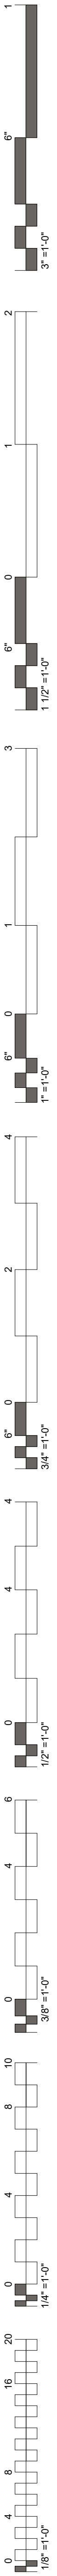


D1 ENLARGED SOUTHWEST STAIR FRAMING PLAN
SCALE: 1/4" = 1'-0"

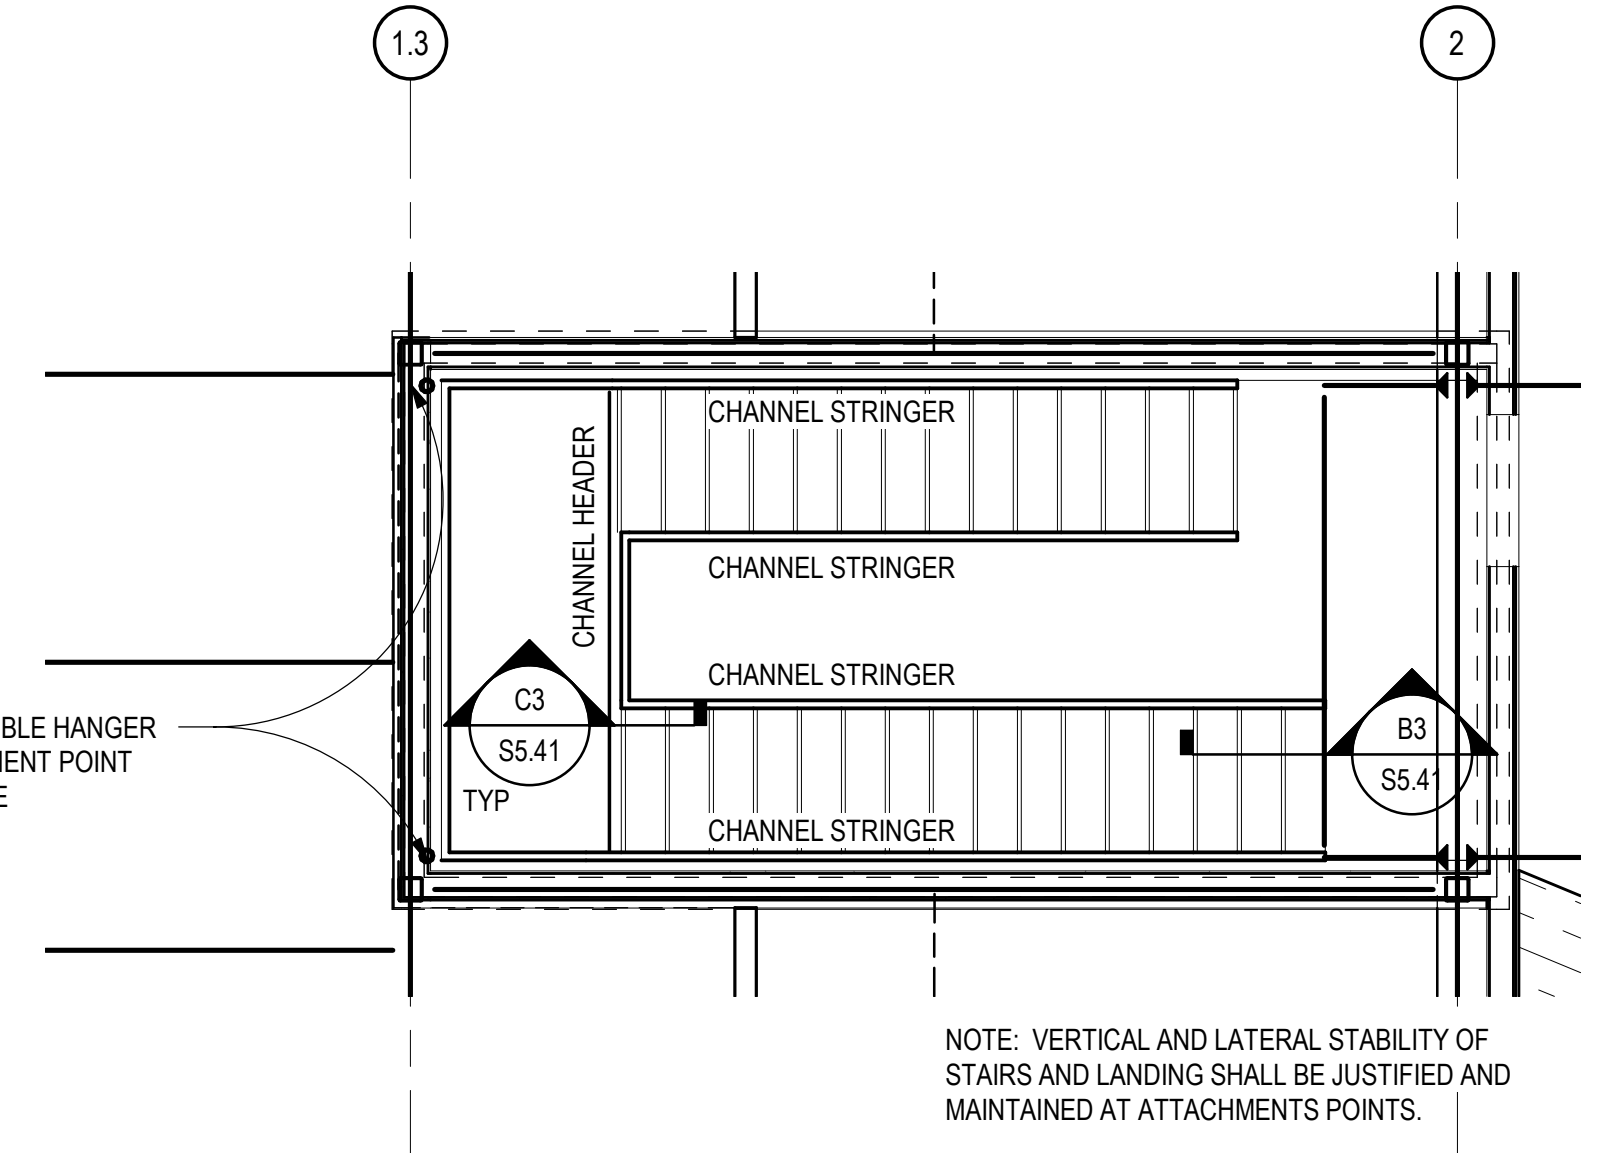


C1 ENLARGED WEST STAIR FRAMING PLAN TO MEZZANINE
SCALE: 1/4" = 1'-0"

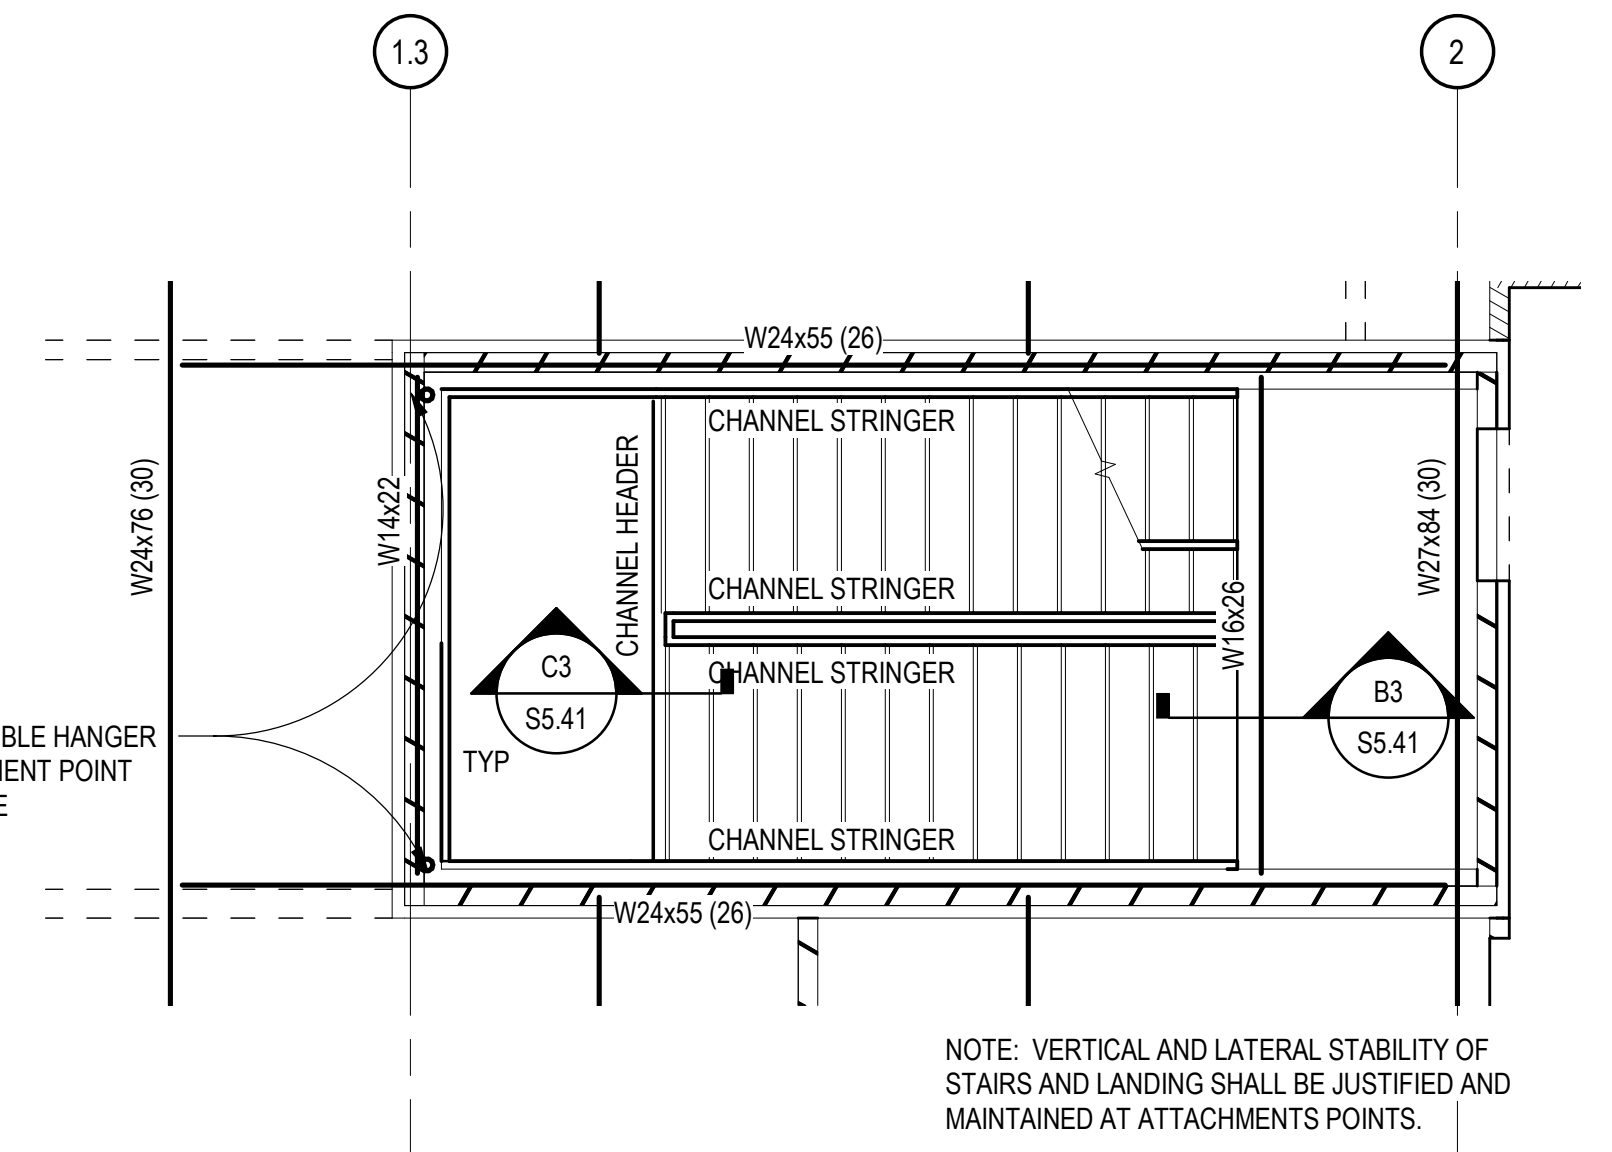


B1 ENLARGED WEST STAIR FRAMING PLAN
SCALE: 1/4" = 1'-0"

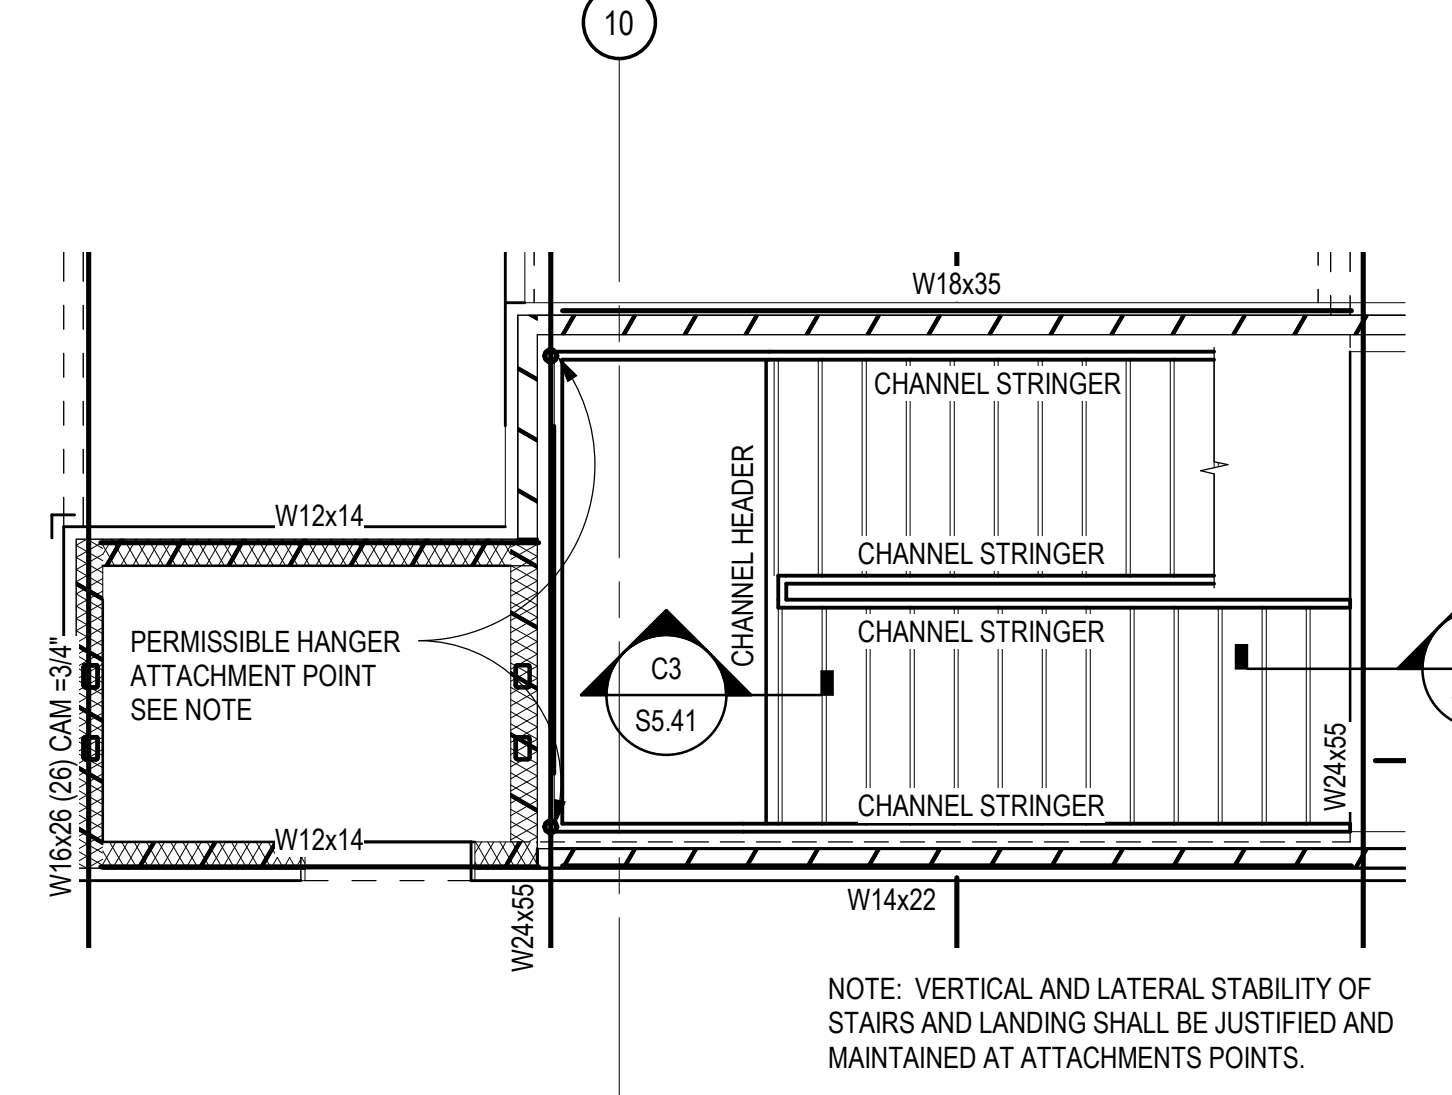


A1 ENLARGED EAST STAIR FRAMING PLAN
SCALE: 1/4" = 1'-0"

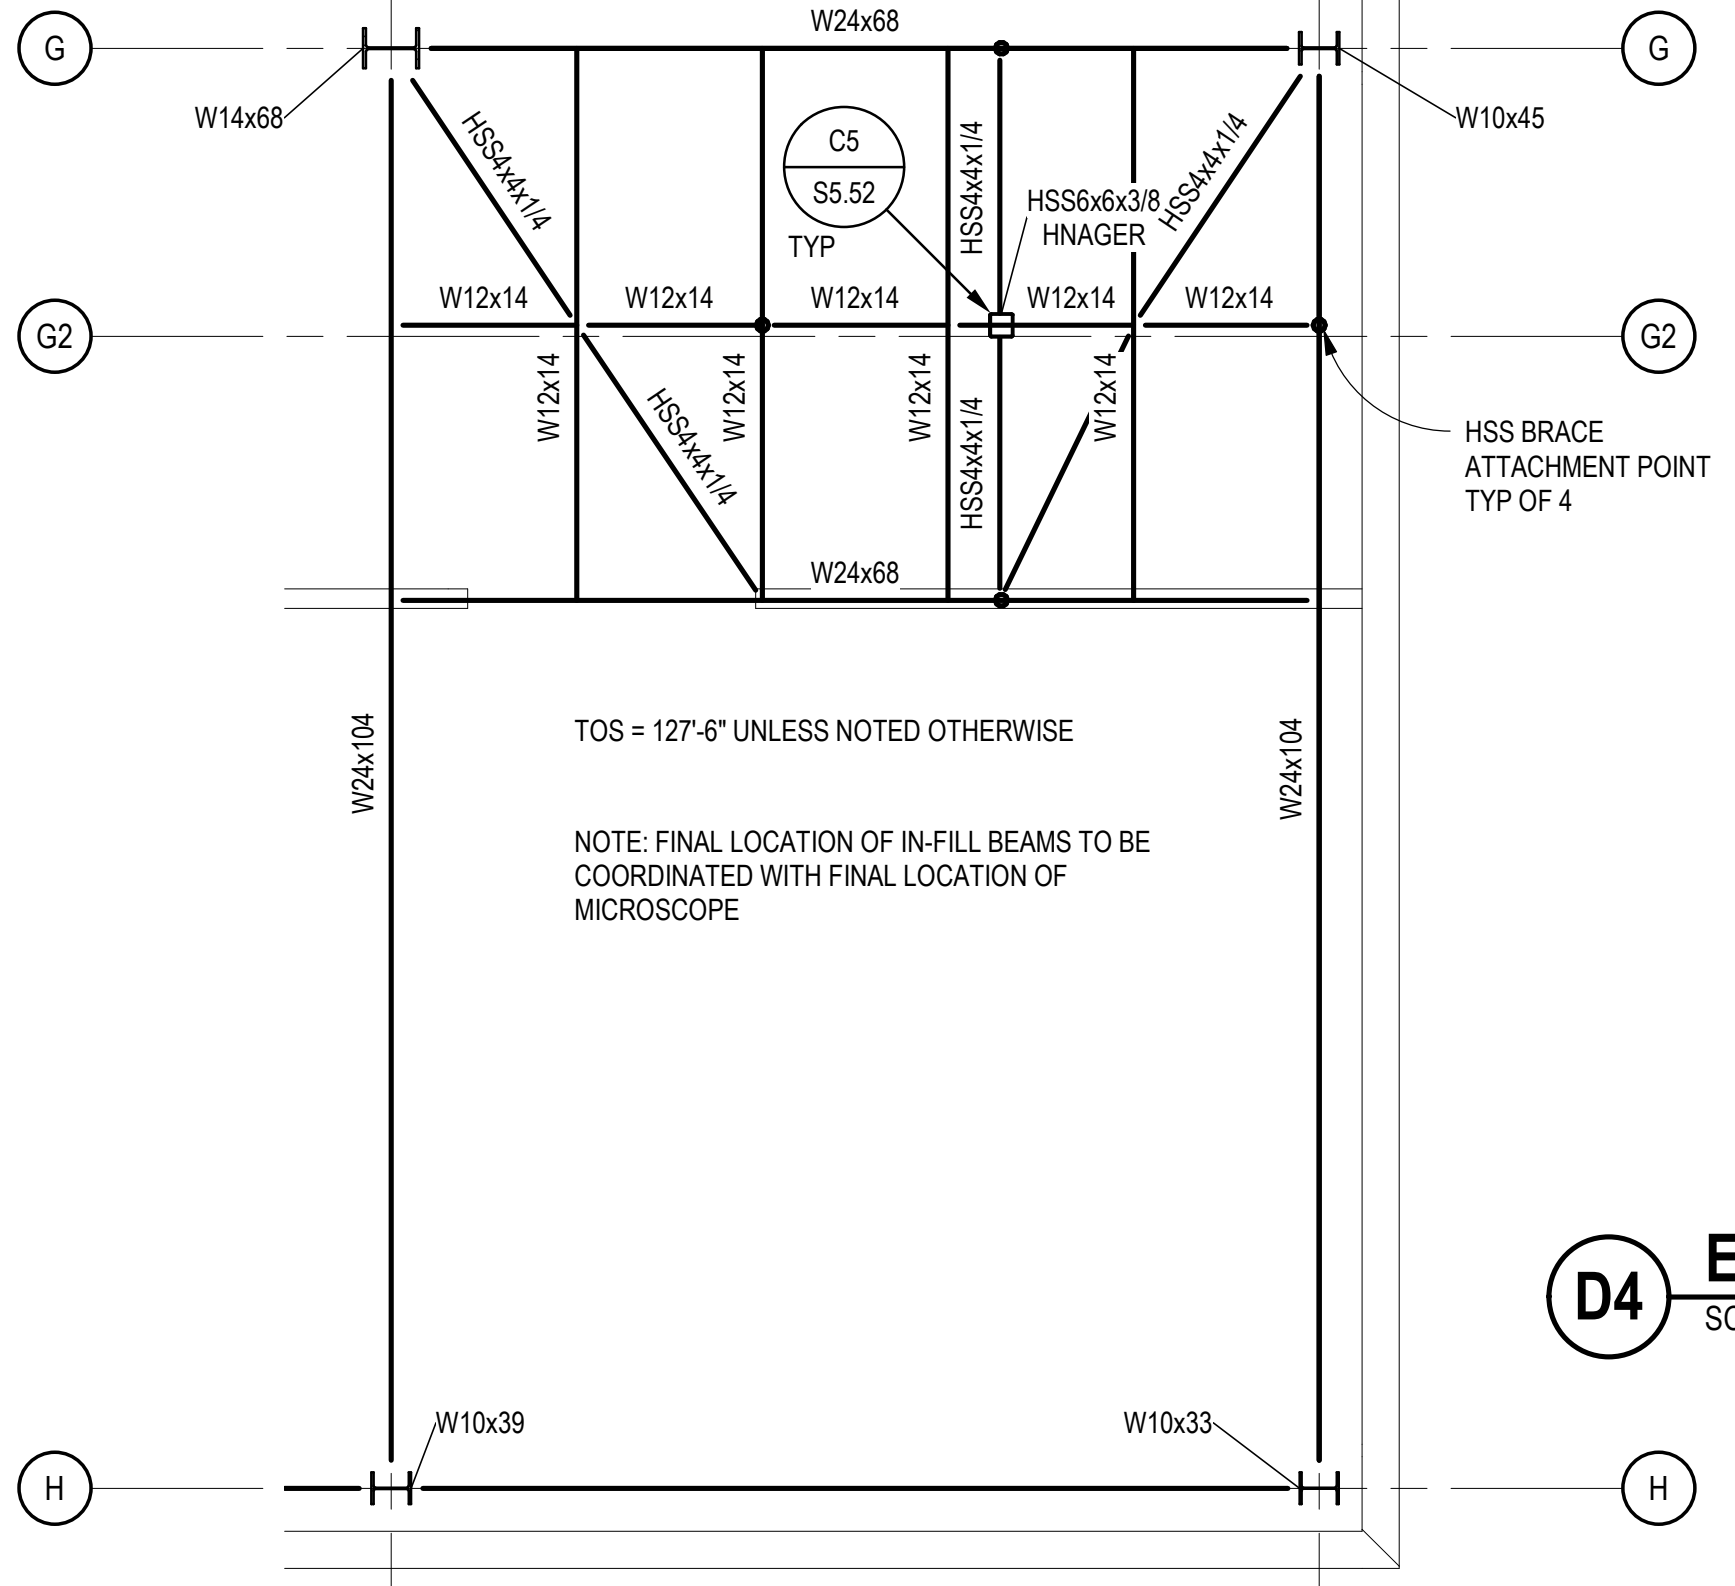

D2 MICROSCOPE SUPPORT FRAMING PLAN
SCALE: 1/4" = 1'-0"

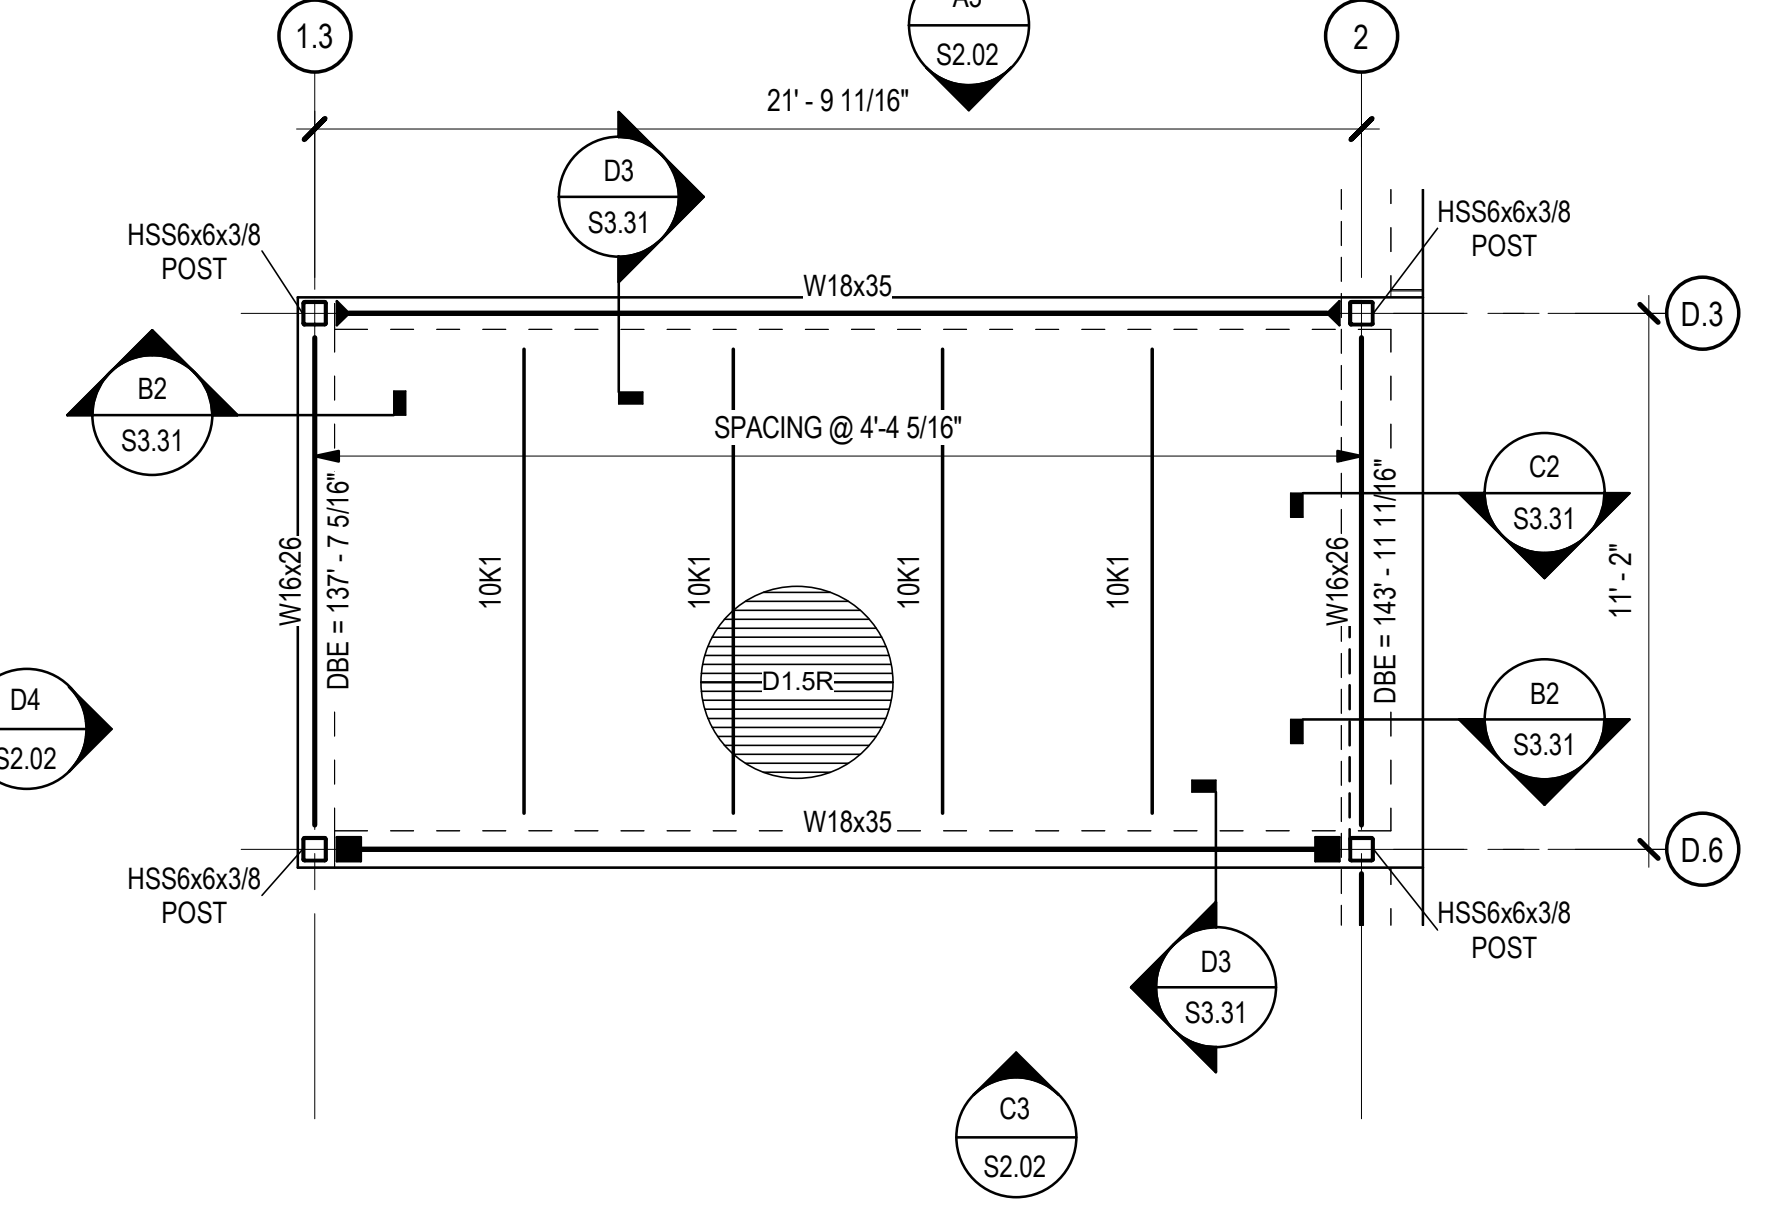

D4 ENLARGED PLAN - WEST ROOF POP-UP
SCALE: 1/4" = 1'-0"

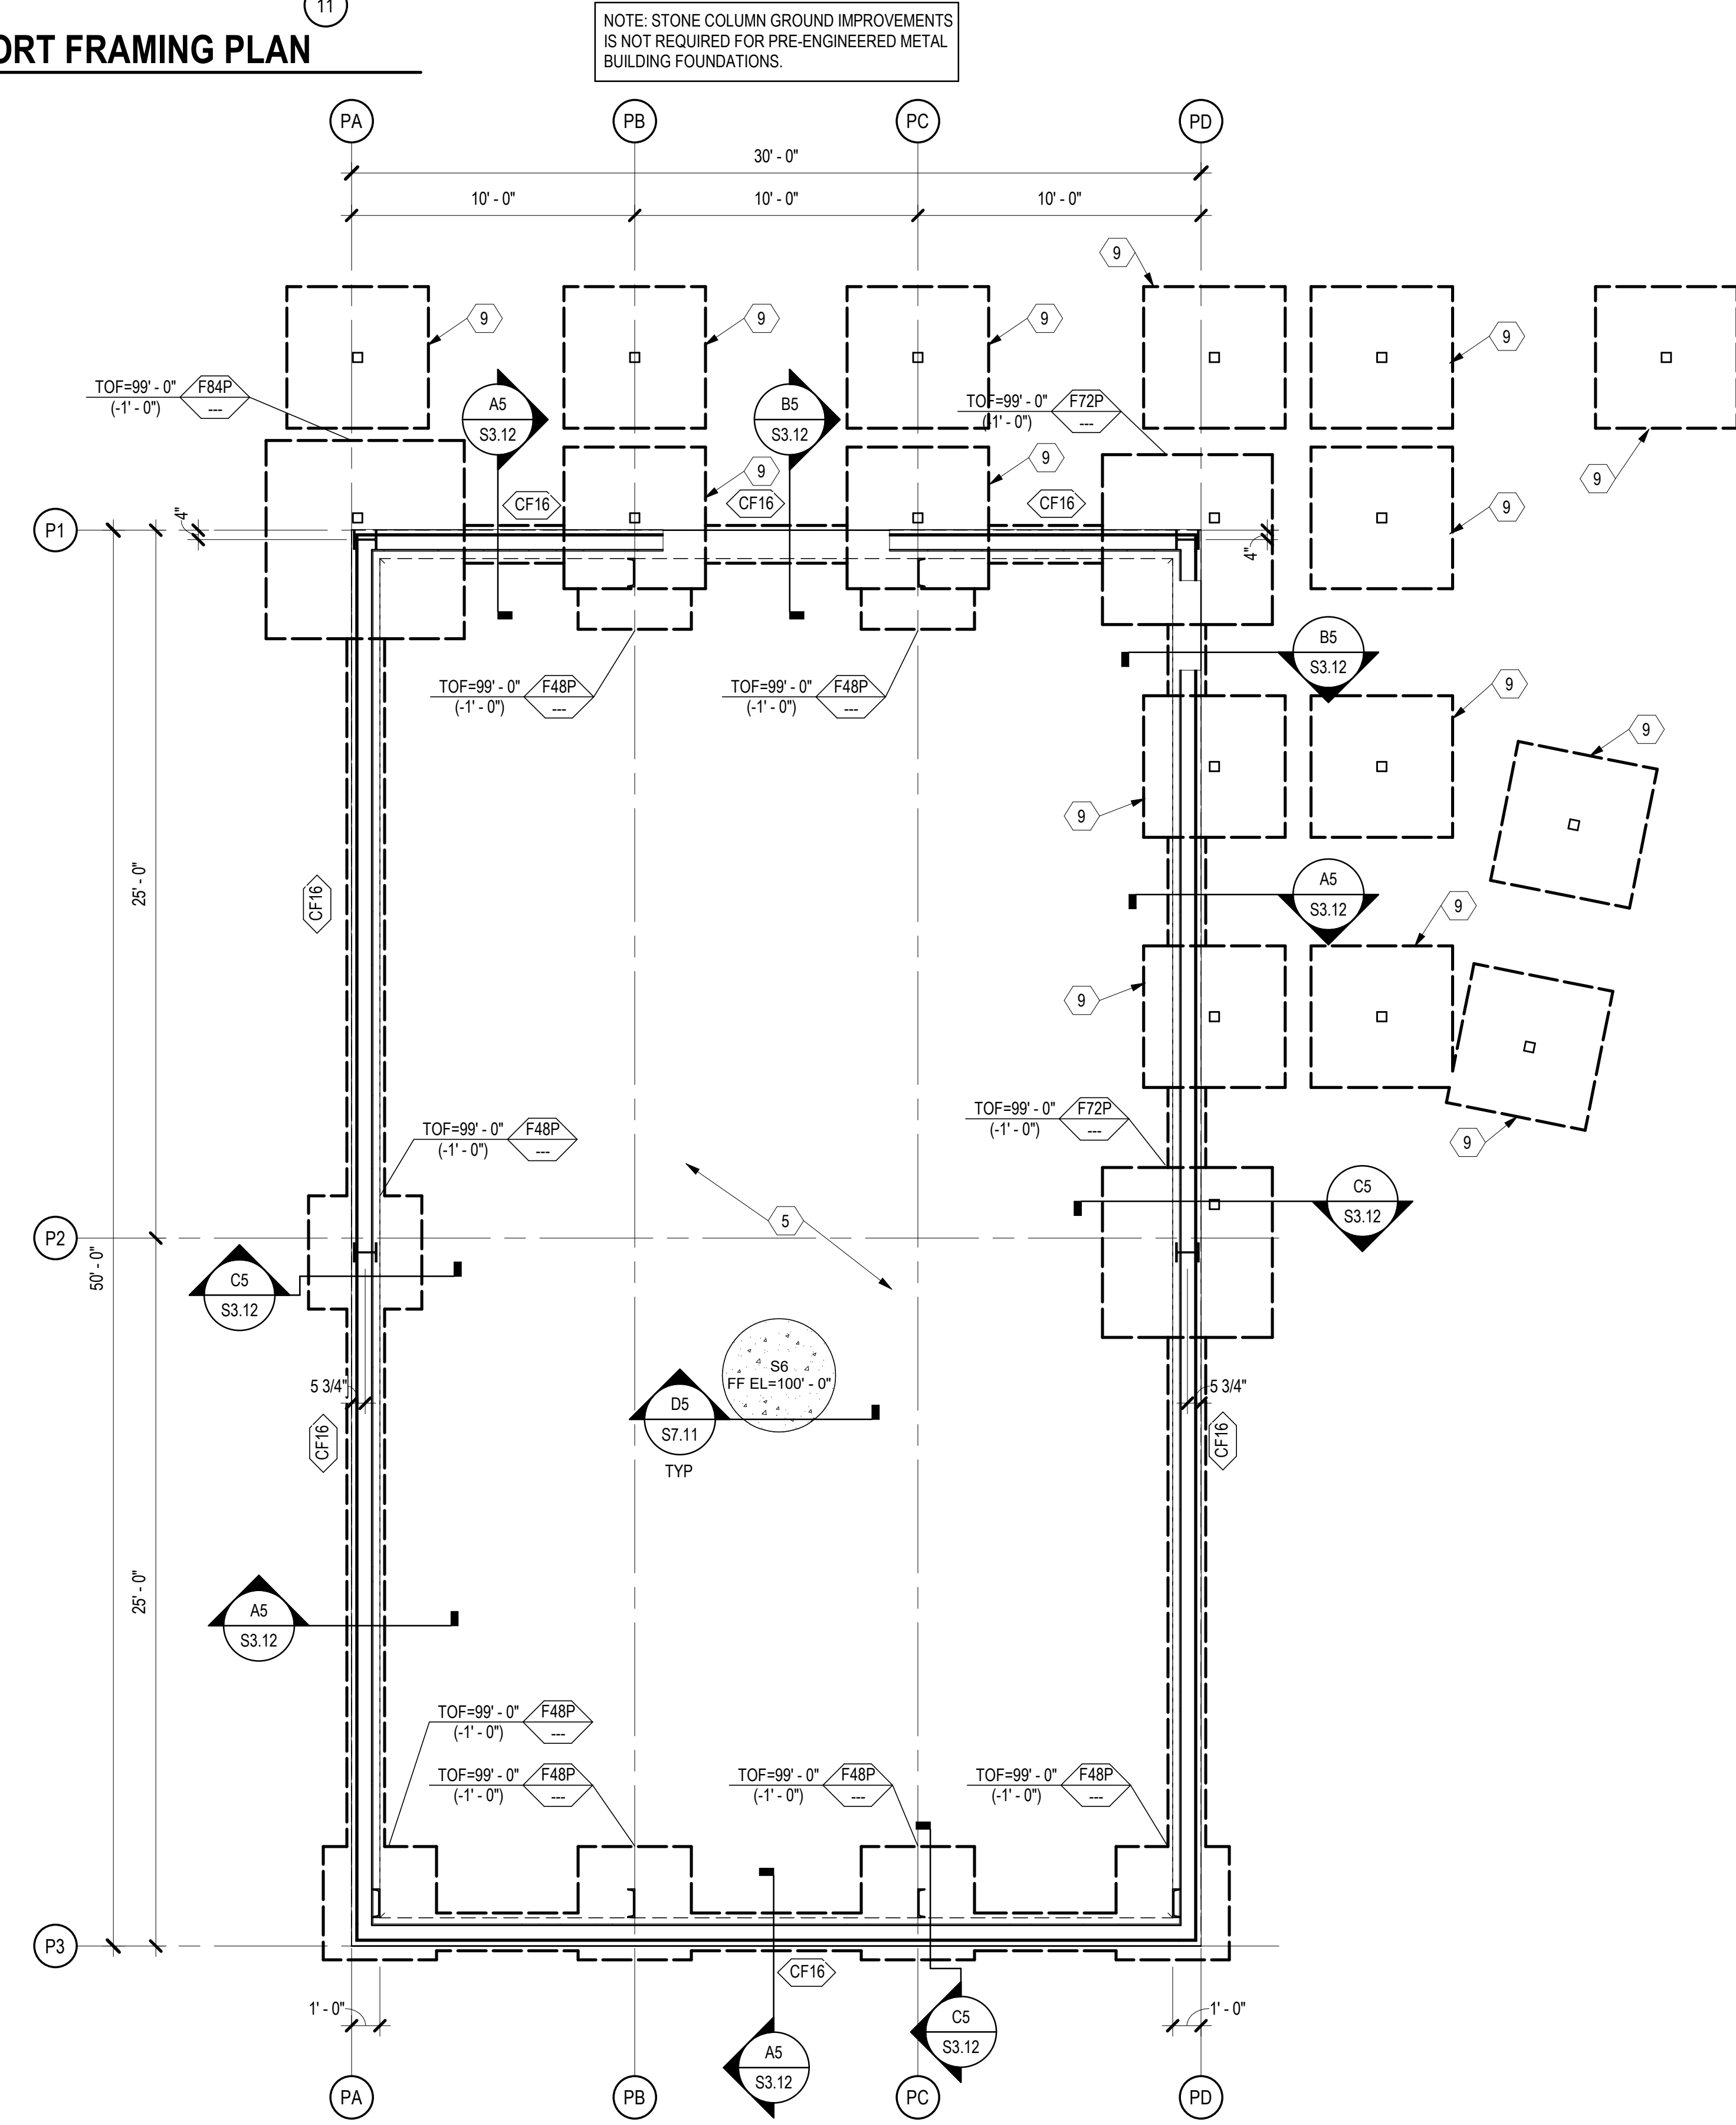



A3 ENLARGED PLAN - PEMB FOUNDATION
SCALE: 1/4" = 1'-0"

GENERAL SHEET NOTES


- SOME SHEET KEYNOTES MAY NOT APPLY TO THIS SHEET.
- REFERENCE FINISH FLOOR ELEVATION 100'-0" = MEAN SEA FINISH FLOOR ELEVATION. SEE CIVIL DRAWINGS.
- TOP OF FOOTING ELEVATION = 98'-0" (-2'-0"), UNLESS NOTED OTHERWISE ON PLAN.
- NOTE TO CONTRACTOR: ENLARGED SLAB BLOCKOUTS MAY BE REQUIRED AT FRAME COLUMNS FOR MOMENT FRAME BASE PLATE CLEARANCE.
- NOTE TO ERECTOR: LATERAL STABILITY OF THE STEEL FRAME IS DEPENDENT UPON THE MOMENT FRAMES. THE ERECTOR SHALL PROVIDE TEMPORARY BRACINGS OF THE STEEL FRAME IN ACCORDANCE WITH SECTION 7.10 OF THE AISC CODE OF STANDARD PRACTICES.
- DIMENSIONS ARE TO THE FACE OF STUD UNLESS NOTED OTHERWISE.
- SEE ARCHITECTURAL DRAWINGS FOR MASONRY DIMENSIONS NOT SHOWN.
- EXISTING CONSTRUCTION IS PER AVAILABLE EXISTING DRAWINGS. ALL EXISTING CONSTRUCTION AND DIMENSIONS SHALL BE VERIFIED PRIOR TO CONSTRUCTION. SHOULD CONDITIONS VARY FROM THOSE SHOWN, CONTACT ENGINEER BEFORE PROCEEDING.
- PROVIDE SLAB JOINTS AT 10'-0" ON CENTER MAXIMUM. THE AREA OF THE CONTROL JOINT SHALL NOT EXCEED A 2:1 RATIO. CONTROL JOINTS SHALL BE LOCATED AT COLUMN LINES WHERE THE LAYOUT PERMITS. AT RE-ENTRANT CORNERS THAT DO NOT HAVE CONTROL JOINTS, PROVIDE 2#4 x 3'-0" DIAGONAL TO THE RE-ENTRANT CORNER.
- STRUCTURAL COLD FORMED METAL STUDS SHALL BE 6" WIDE UNLESS NOTED OTHERWISE. STUD THICKNESS AND SPACING BY OTHERS.
- SEE SHEET S7.00 SERIES SHEETS FOR TYPICAL FOUNDATION SECTIONS AND DETAILS.
- SEE SHEET S6.01 FOR SCHEDULES.

SHEET KEYNOTE

- FLOOR DRAIN, SLOPE SLAB TO DRAIN 1/8" PER FOOT. COORDINATE EXACT SIZE AND LOCATION WITH ARCHITECTURAL AND MECHANICAL DRAWINGS.
- POST AND FOUNDATION AS REQUIRED FOR STAIR SUPPORT. STAIR ENGINEER TO PROVIDE REQUIRED LOADS AND LOCATIONS.
- ELEVATOR SUMP PIT. COORDINATE EXACT SIZE AND LOCATION WITH ELEVATOR MANUFACTURER. SEE A4 / S5.41
- HSS6x4x1/2 ELEVATOR RAIL SUPPORT POST. COORDINATE LOCATION AND SPACING WITH ELEVATOR MANUFACTURER. SEE B4 / S5.41
- PRE-ENGINEERED METAL BUILDING STEEL AND ANCHORAGE BY OTHERS. CONTRACTOR TO CONFIRM LOCATIONS OF FOUNDATIONS WITH FINAL PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS.
- NOTCH MASONRY AS REQUIRED TO FACILITATE BASEPLATE INSTALLATION. STEP BOND BEAM AT THIS LOCATION.
- CUT AND REMOVE EXISTING SLAB AS REQUIRED TO PLACE NEW FOOTING. NEW SLAB TO POUR UP TO REMAINING SLAB.
- CENTER FOOTING ON GRID C.
- F60A PRE-MANUFACTURED SUNSHADE CONCRETE FOOTING. TOP OF FOOTING = 99'-0" (-1'-0"). SEE SHEET S6.01 FOR FOOTING SCHEDULE. COORDINATE FINAL LOCATION WITH SUNSHADE MANUFACTURER.
- EXISTING CANOPY. SEE ARCHITECTURAL DEMOLITION PLANS FOR EXTENT OF DEMOLITION.
- HSS8x6x1/2 ELEVATOR SUPPORT POST. COORDINATE EXACT LOCATION AND SPACING WITH ELEVATOR MANUFACTURER. SEE B4 / S5.41, D3 / S5.41, A2 / S5.41, B2 / S5.41, AND C2 / S5.41
- 1 1/2" RECESSED SLAB AT ADA SHOWER. COORDINATE EXACT SIZE, LOCATION, AND SLOPE REQUIREMENTS WITH ARCHITECTURAL DRAWINGS. SEE C4 / S7.11
- 18" DIAMETER PRECAST CONCRETE COLUMN BY OTHERS.
- 18" DIAMETER PRECAST CONCRETE CANOPY COLUMN BY OTHERS.

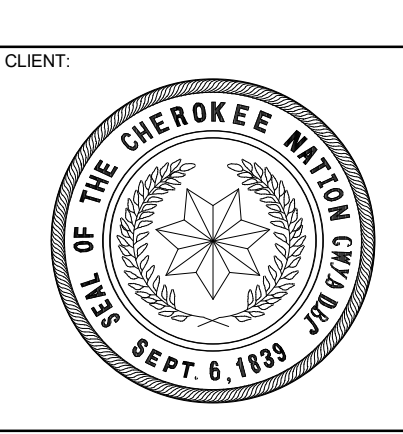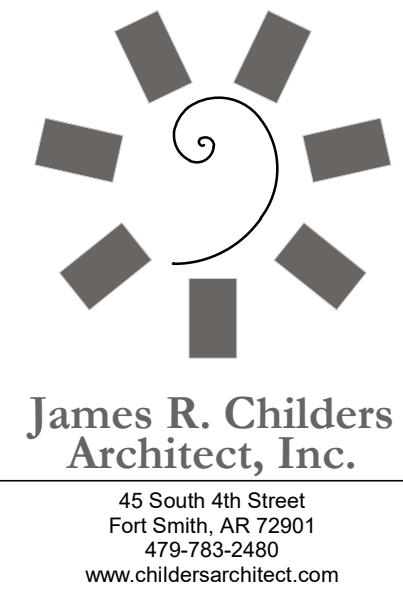

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA


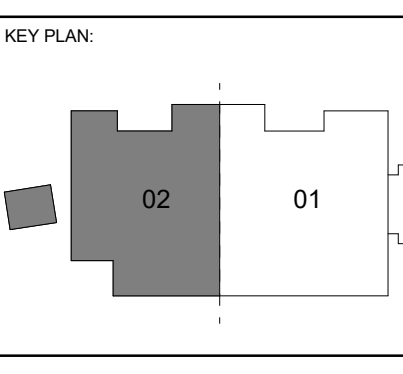


PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:
S4.01
ENLARGED PLANS

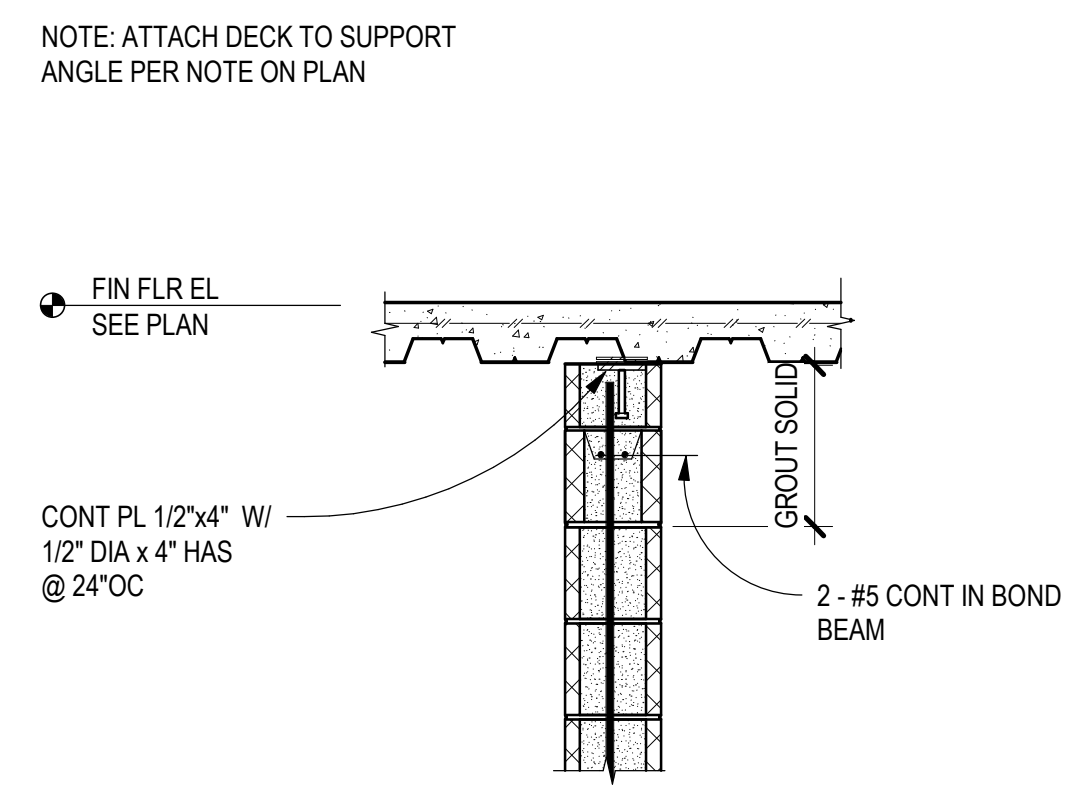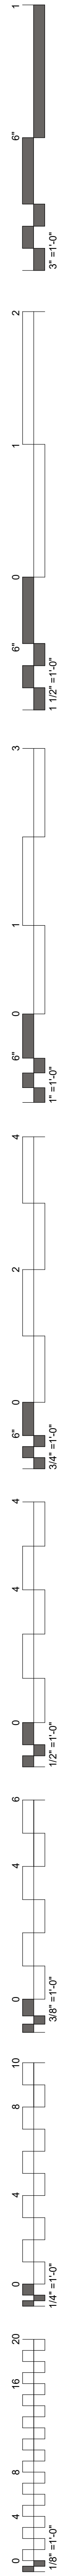


D3 CMU BEARING WALL TO DECK
SCALE: 3/4" = 1'-0"

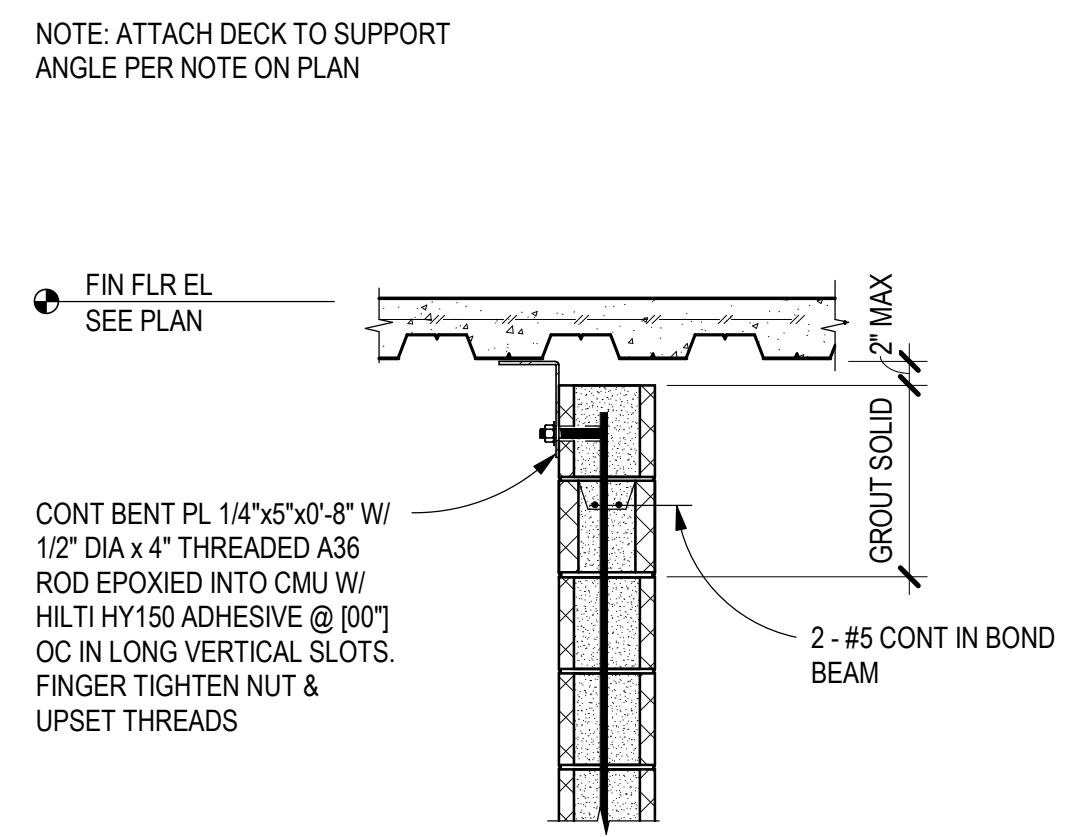


D4 CMU NON-BRG WALL TO DECK
SCALE: 3/4" = 1'-0"

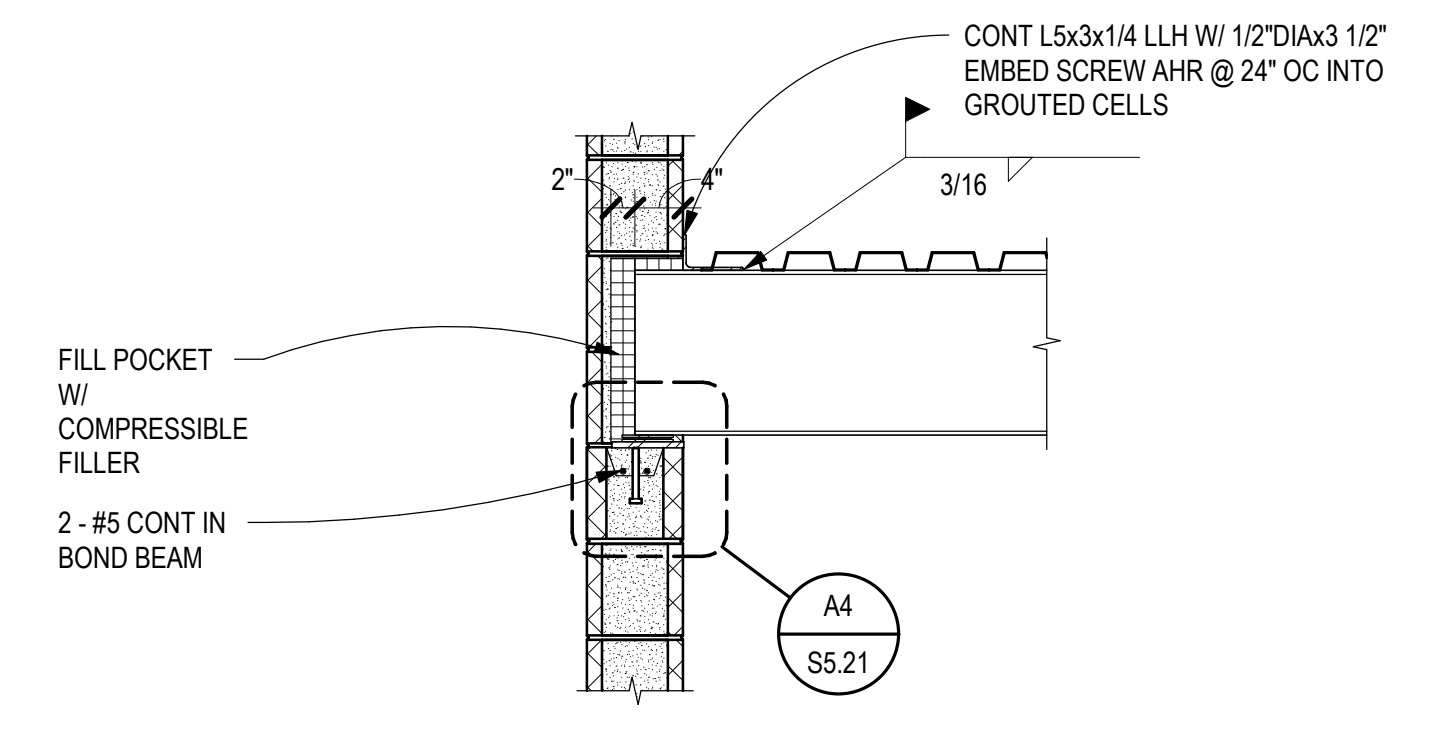


D5 TYPICAL BEAM TO WALL SLIDE BRG
SCALE: 3/4" = 1'-0"

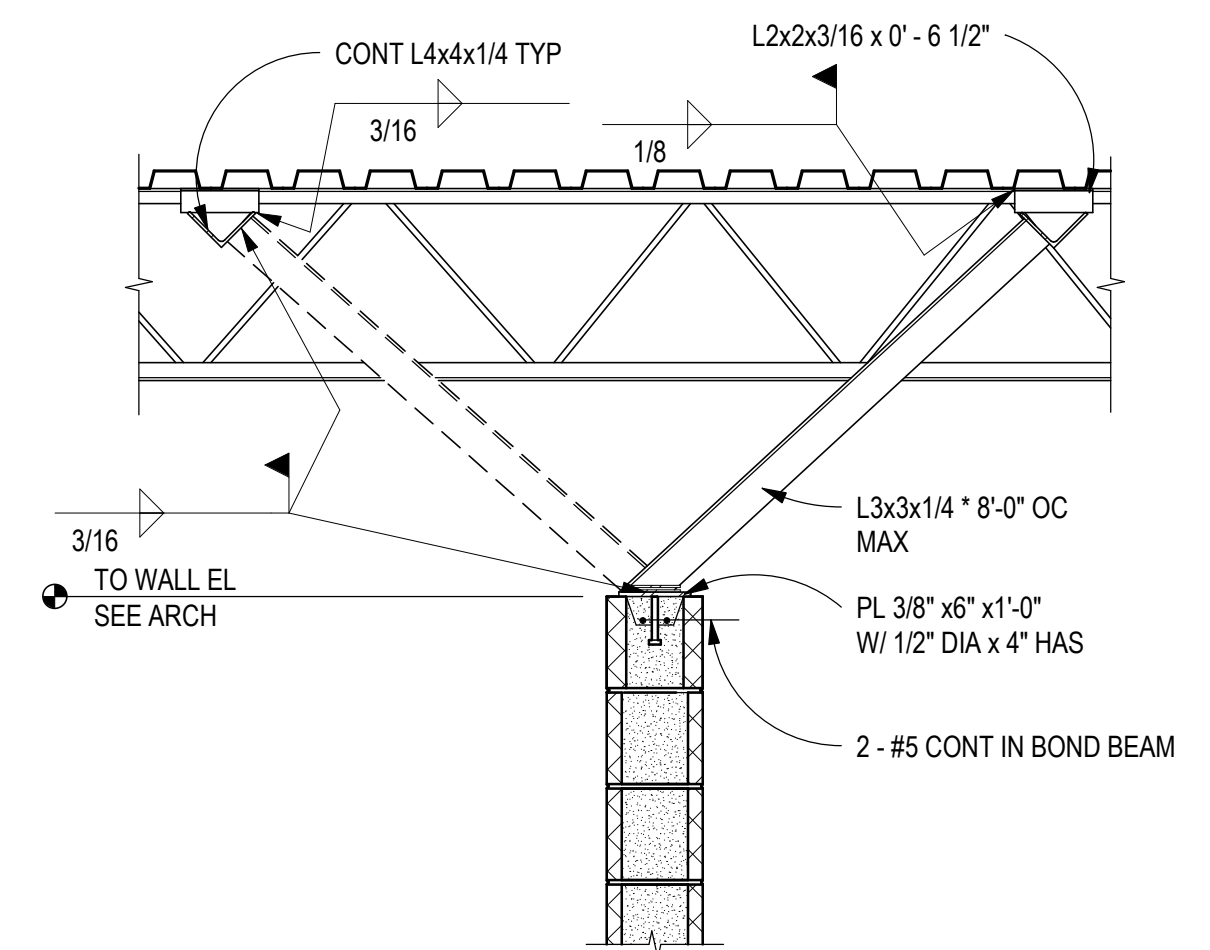


C3 CMU WALL BRACING SECTION
SCALE: 3/4" = 1'-0"

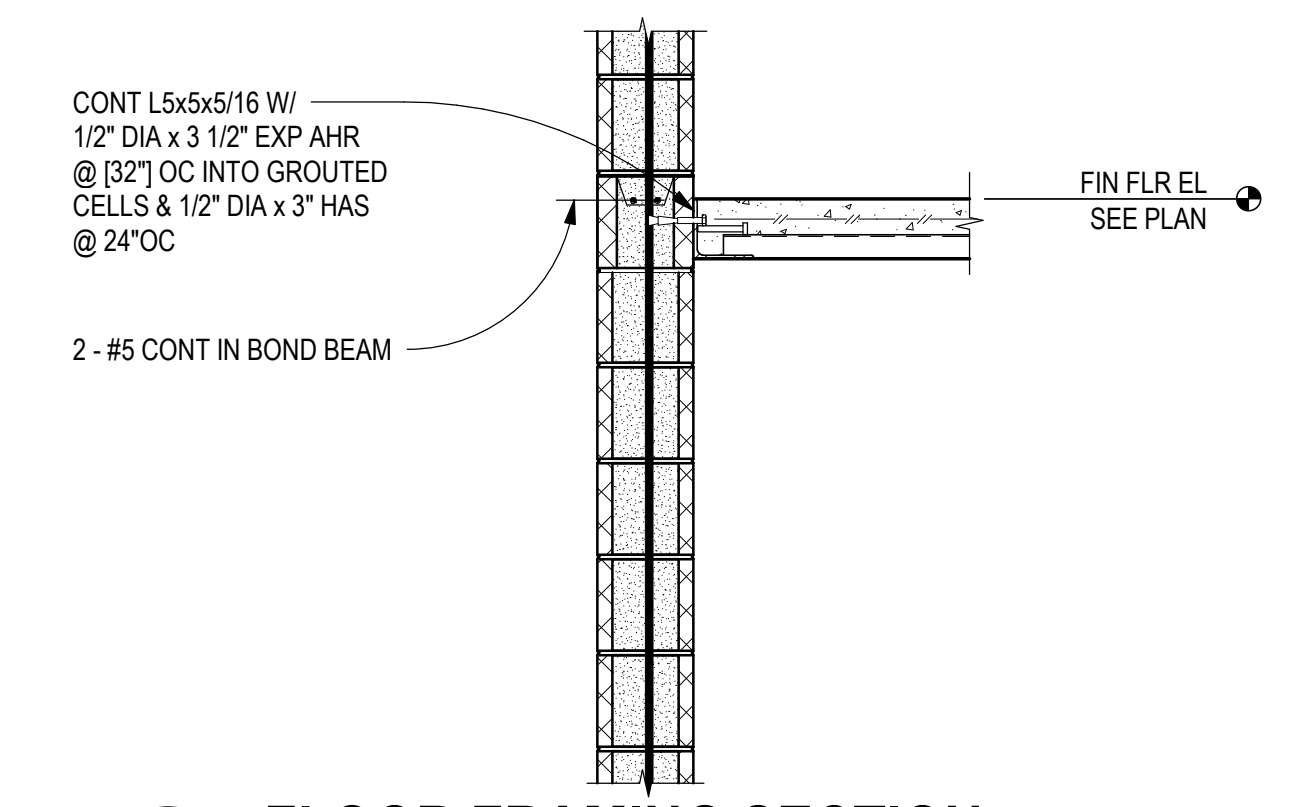


C4 FLOOR FRAMING SECTION
SCALE: 3/4" = 1'-0"

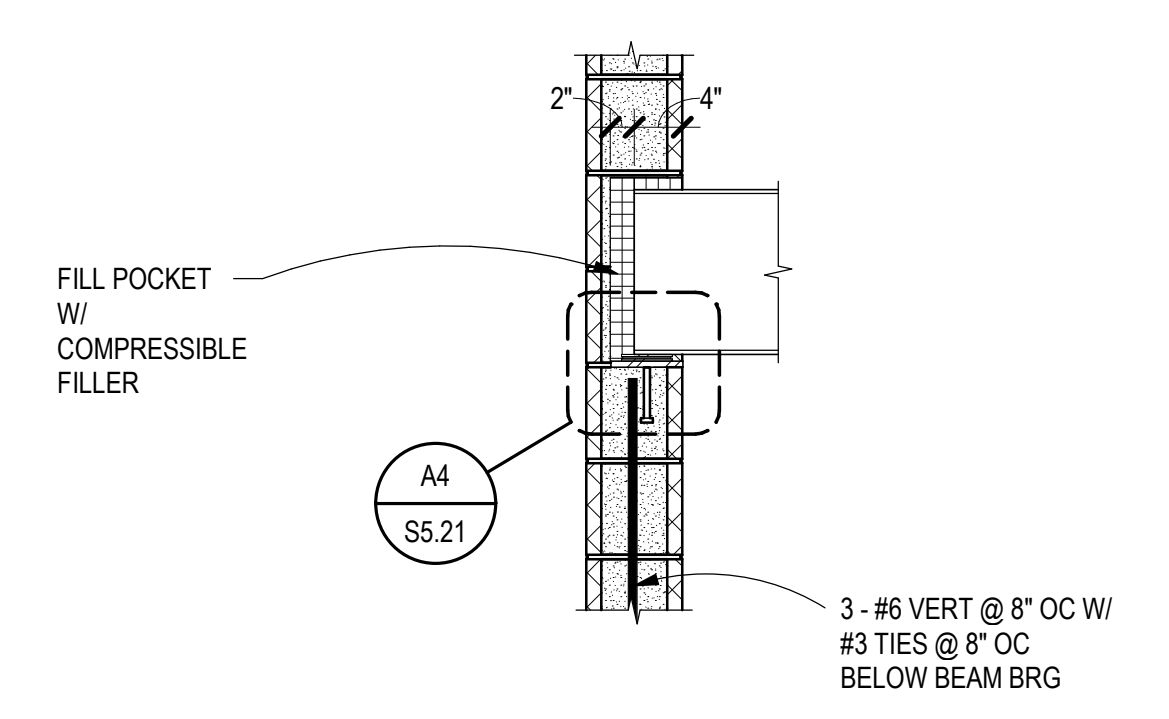


C5 TYPICAL GIRDER TO WALL SLIDE BRG
SCALE: 3/4" = 1'-0"

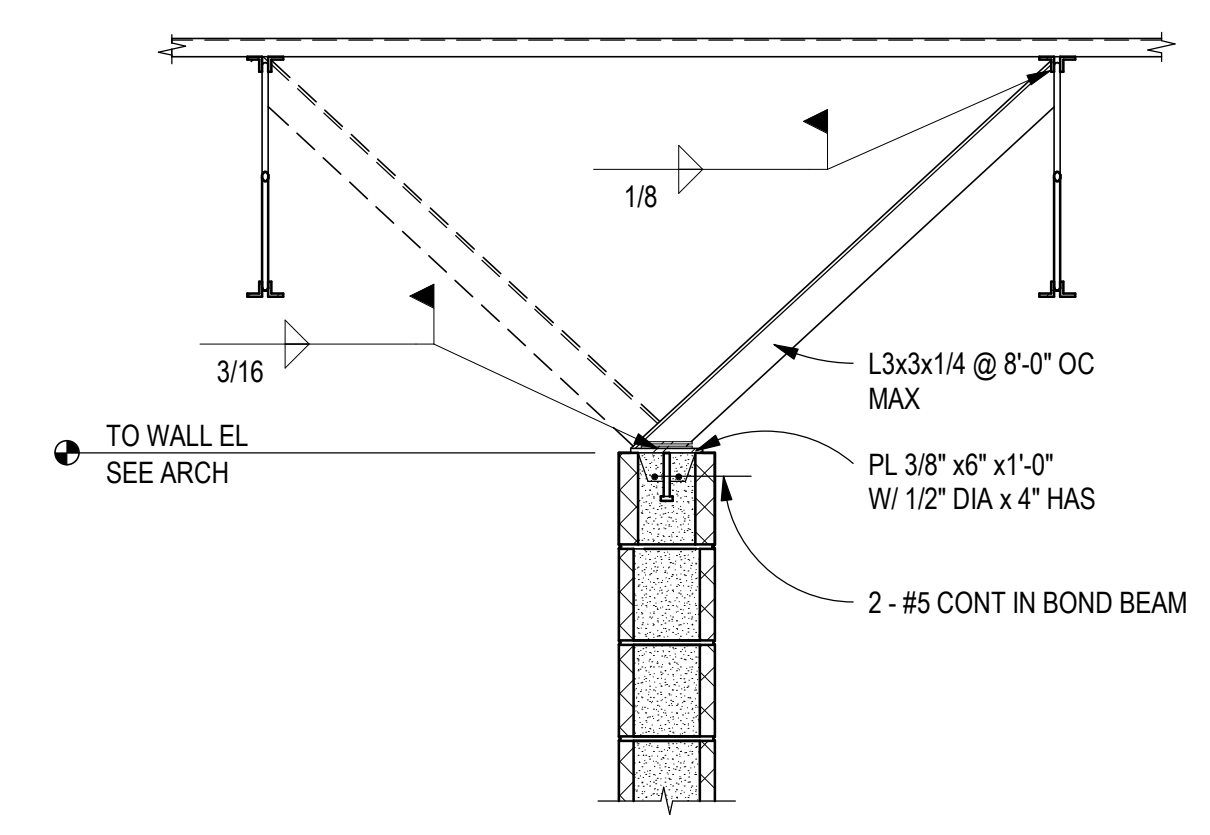


B3 CMU WALL BRACING SECTION
SCALE: 3/4" = 1'-0"

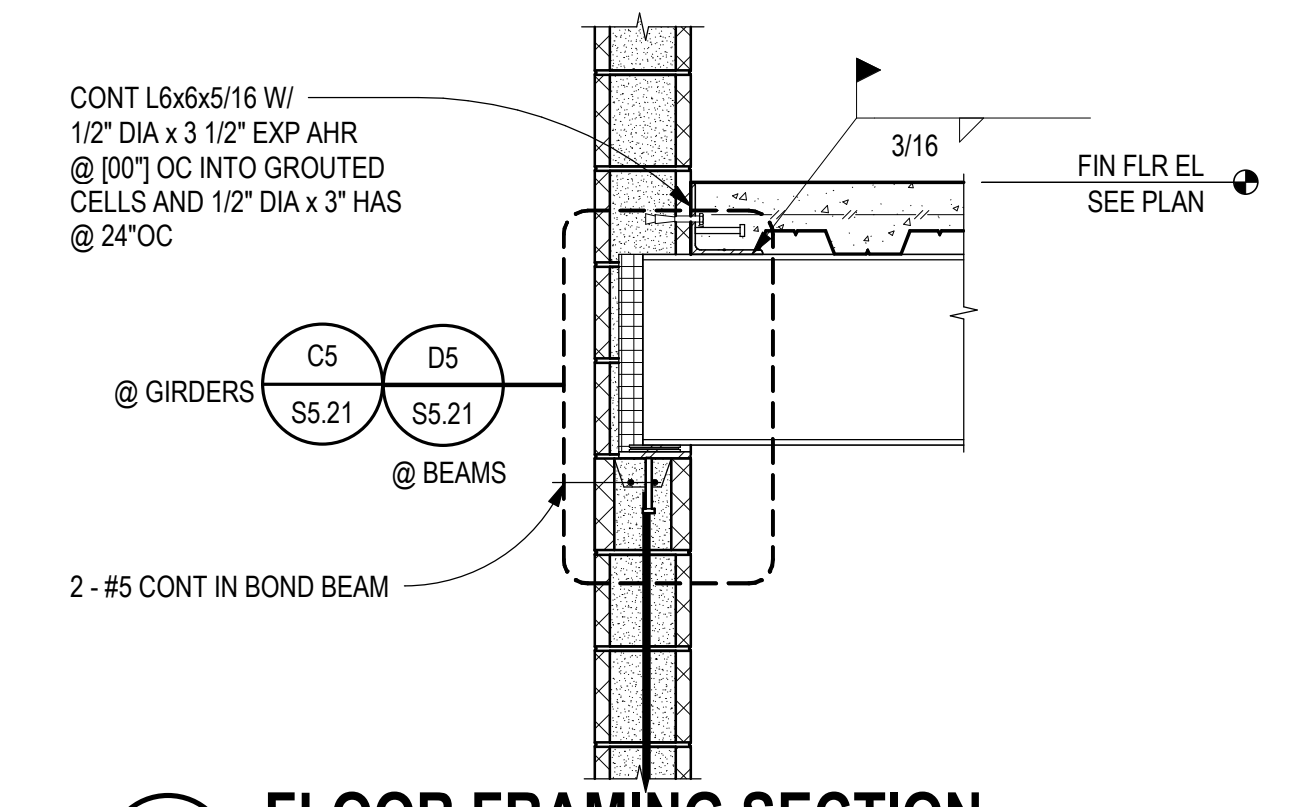


B4 FLOOR FRAMING SECTION
SCALE: 3/4" = 1'-0"

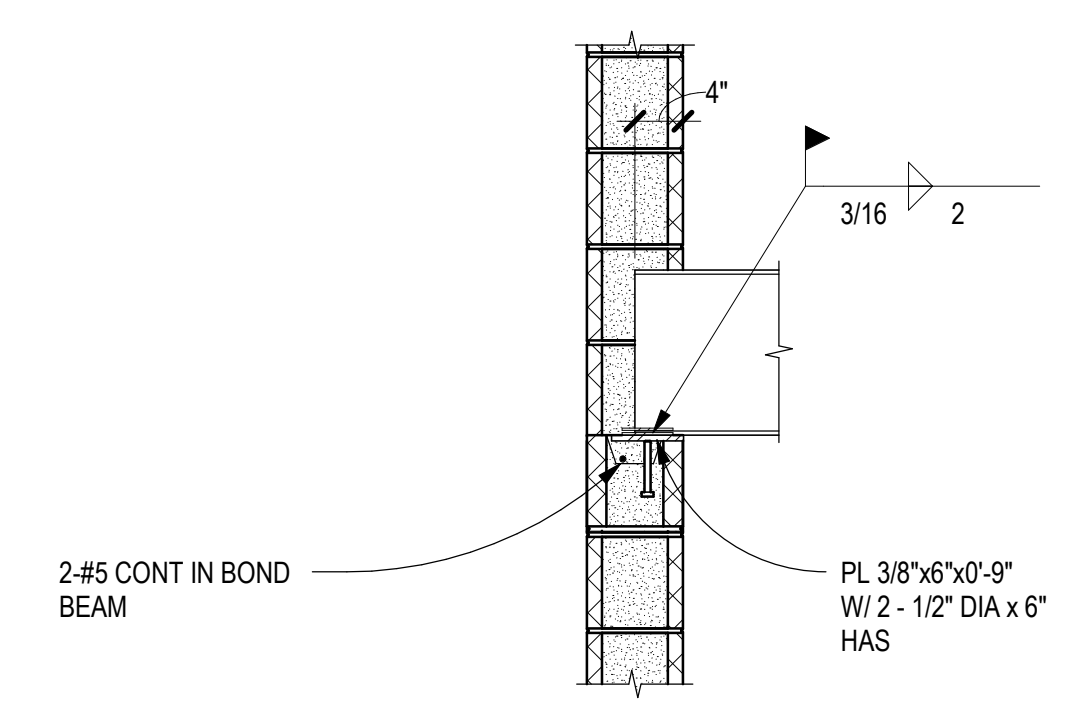


B5 TYPICAL BEAM TO CMU WALL
SCALE: 3/4" = 1'-0"

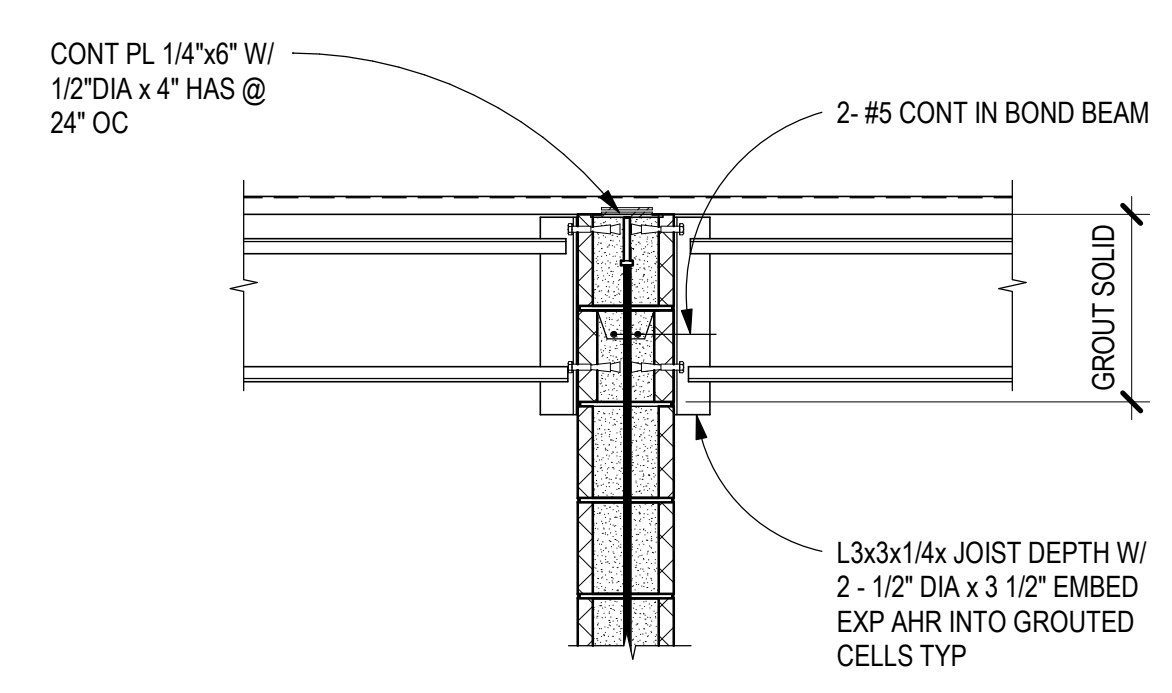


A2 INT CMU BEARING WALL TO DECK
SCALE: 3/4" = 1'-0"

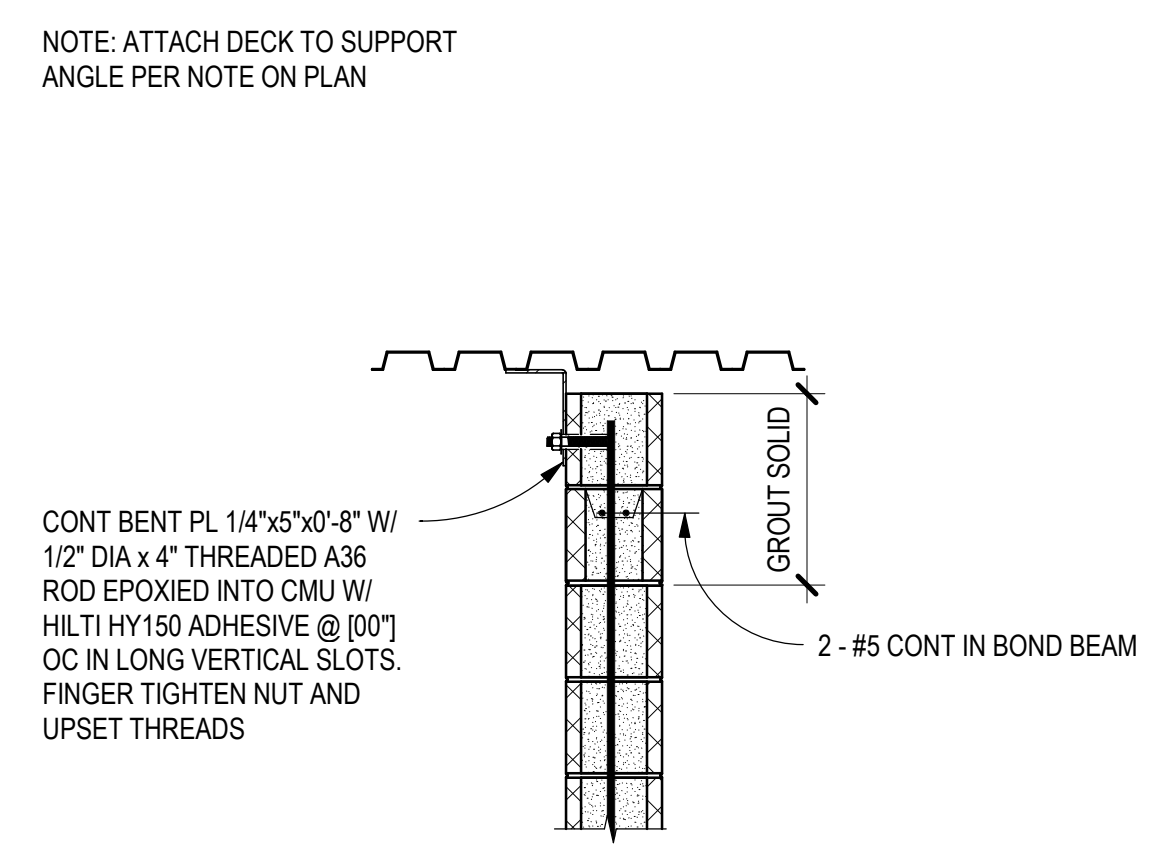


A3 CMU NON-BRG WALL TO DECK
SCALE: 3/4" = 1'-0"

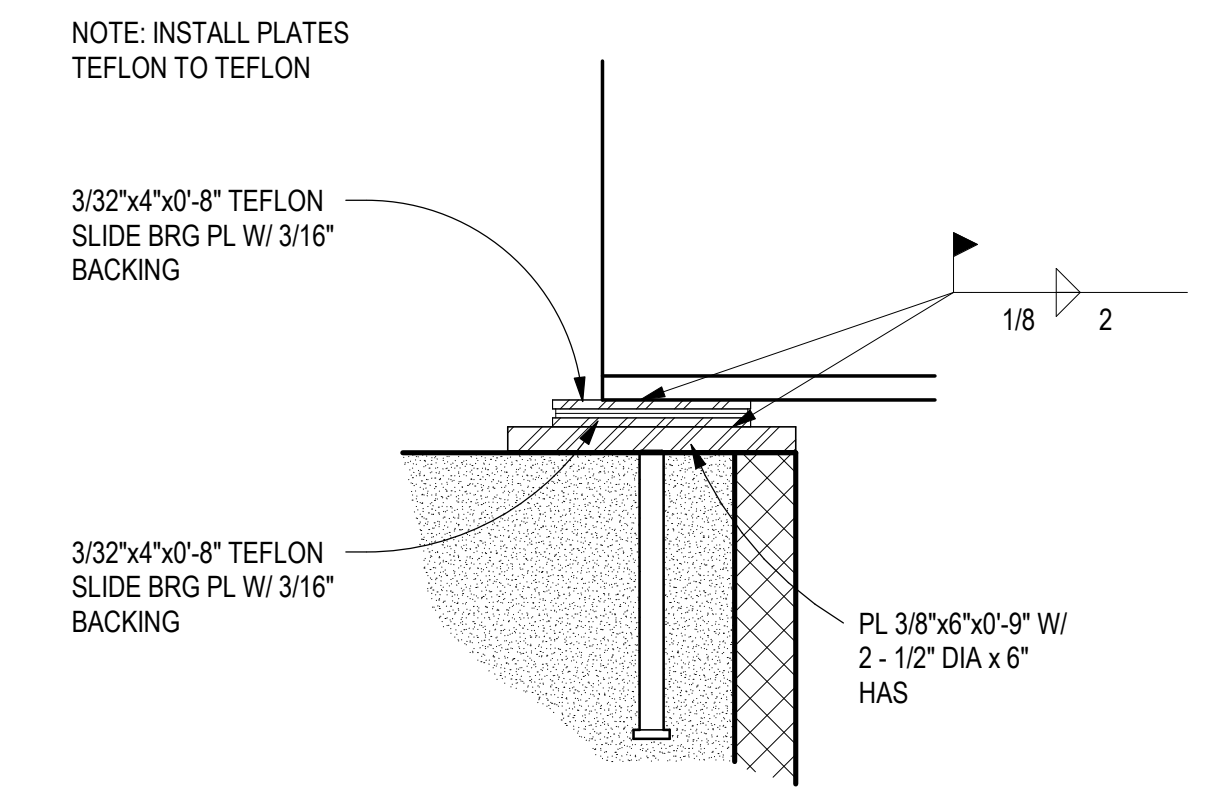


A4 TYPICAL SLIDE BRG CONN
SCALE: 1 1/2" = 1'-0"

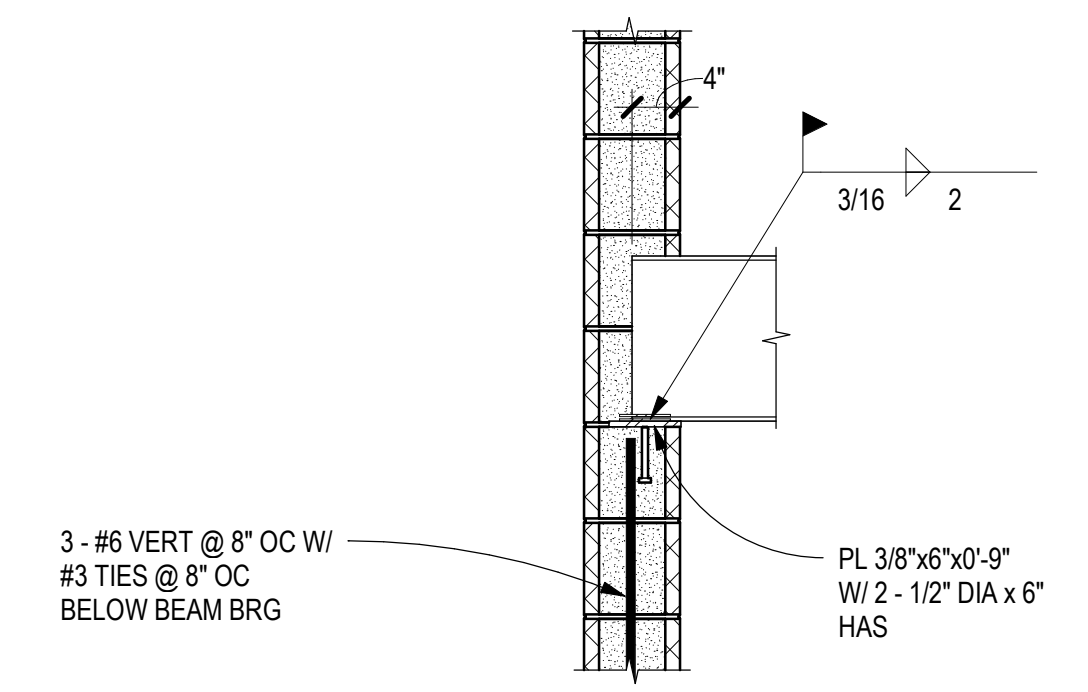

A5 TYPICAL GIRDER TO CMU WALL
SCALE: 3/4" = 1'-0"

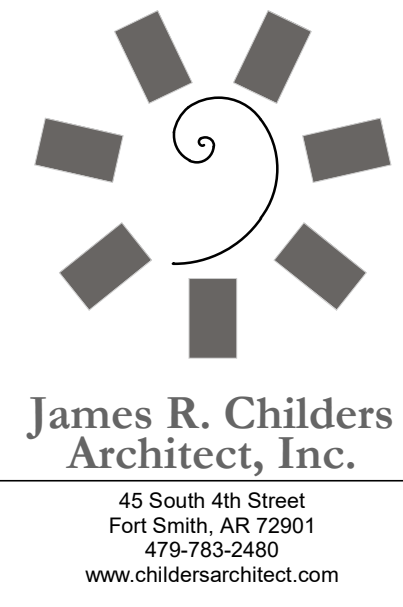

James R. Childers Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:



PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
S5.21


MASONRY FRAMING SECTIONS AND DETAILS

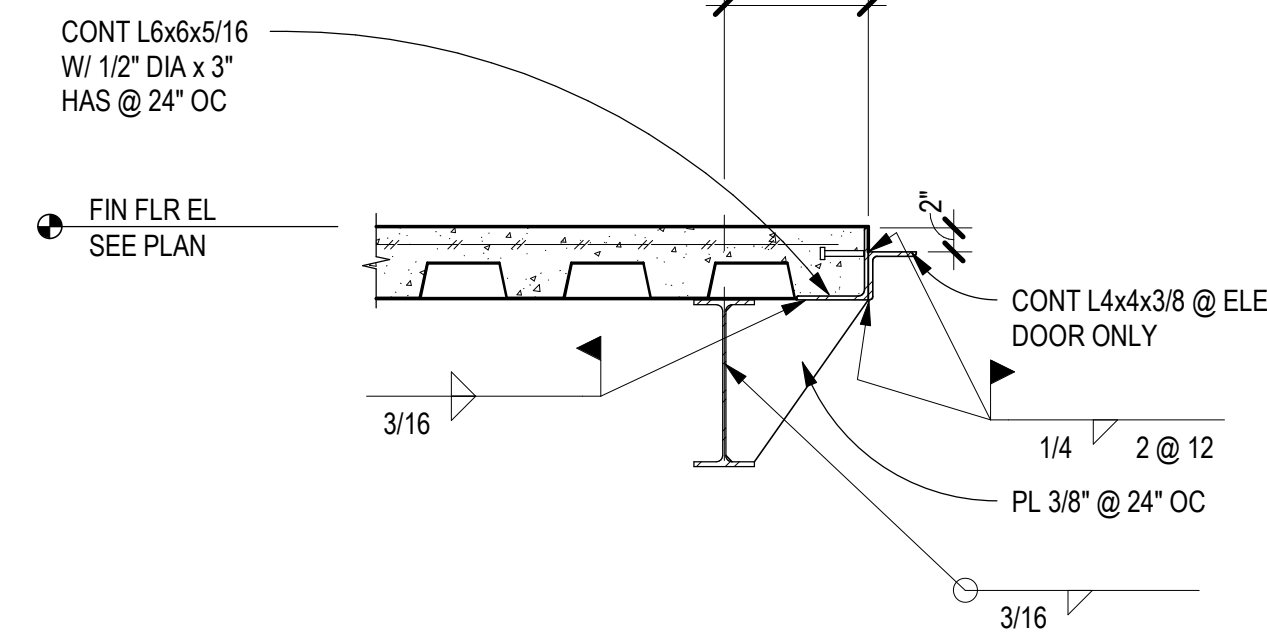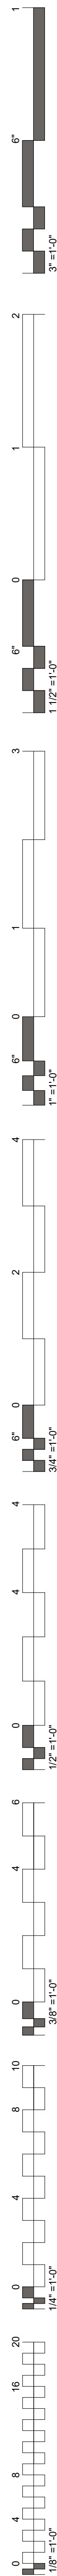


D2 ELEVATOR OPENING SECTION
SCALE: 3/4" = 1'-0"

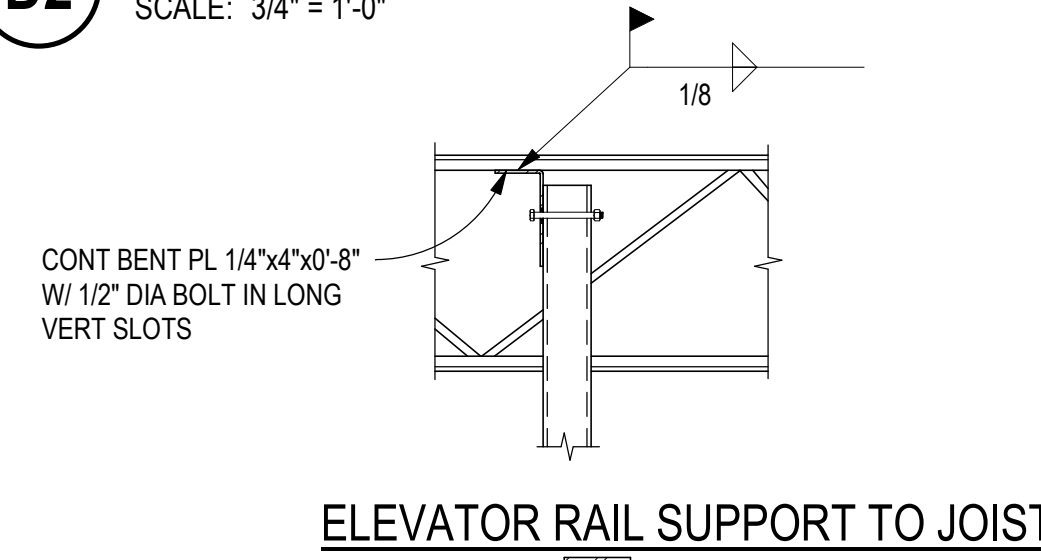


ELEVATOR RAIL SUPPORT TO JOIST

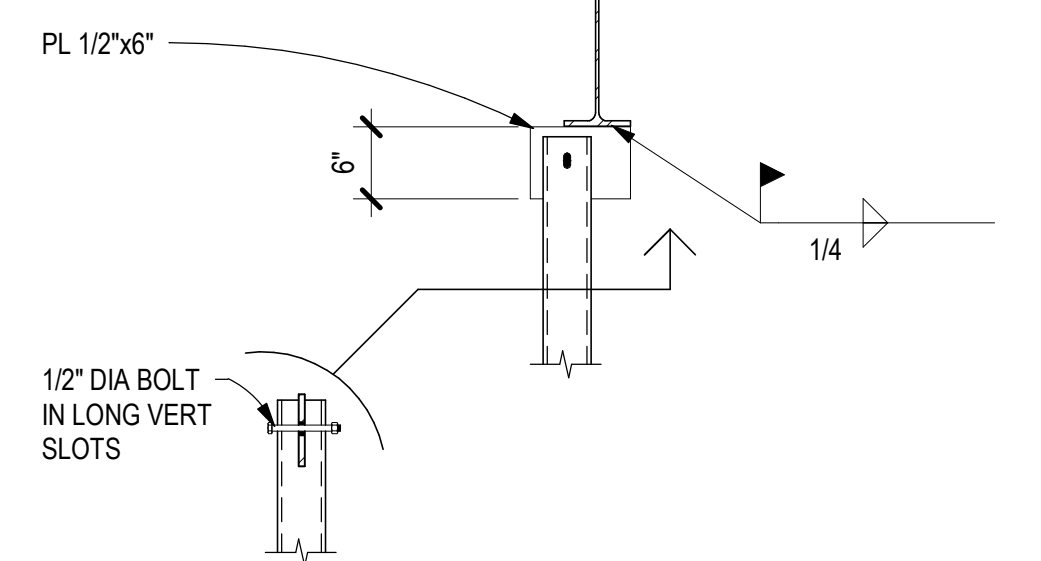


C2 ELEV RAIL SUPPORT TO ROOF
SCALE: 3/4" = 1'-0"

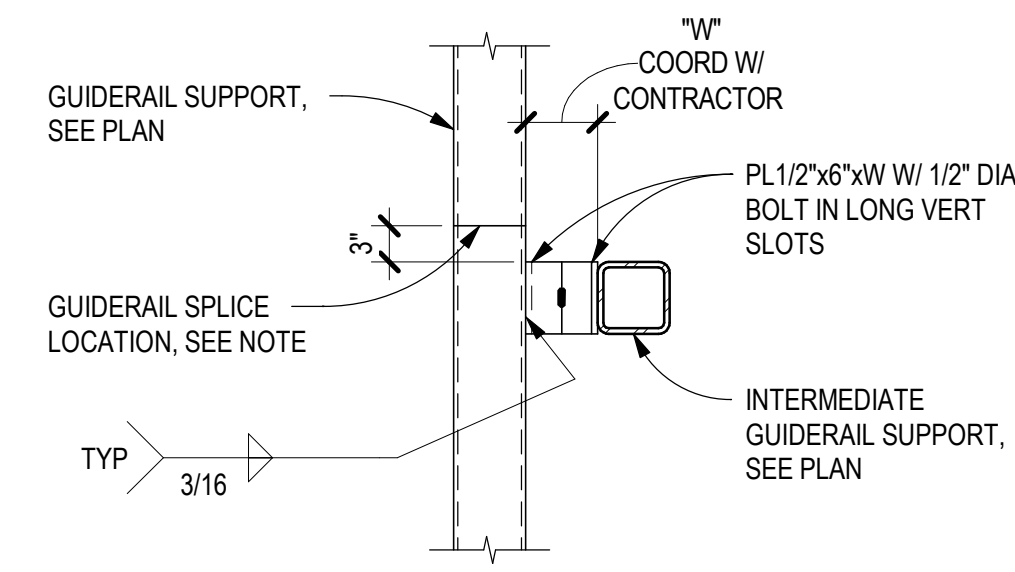


B1 GUIDERAIL @ INTERMEDIATE SUPPORT
SCALE: 3/4" = 1'-0"

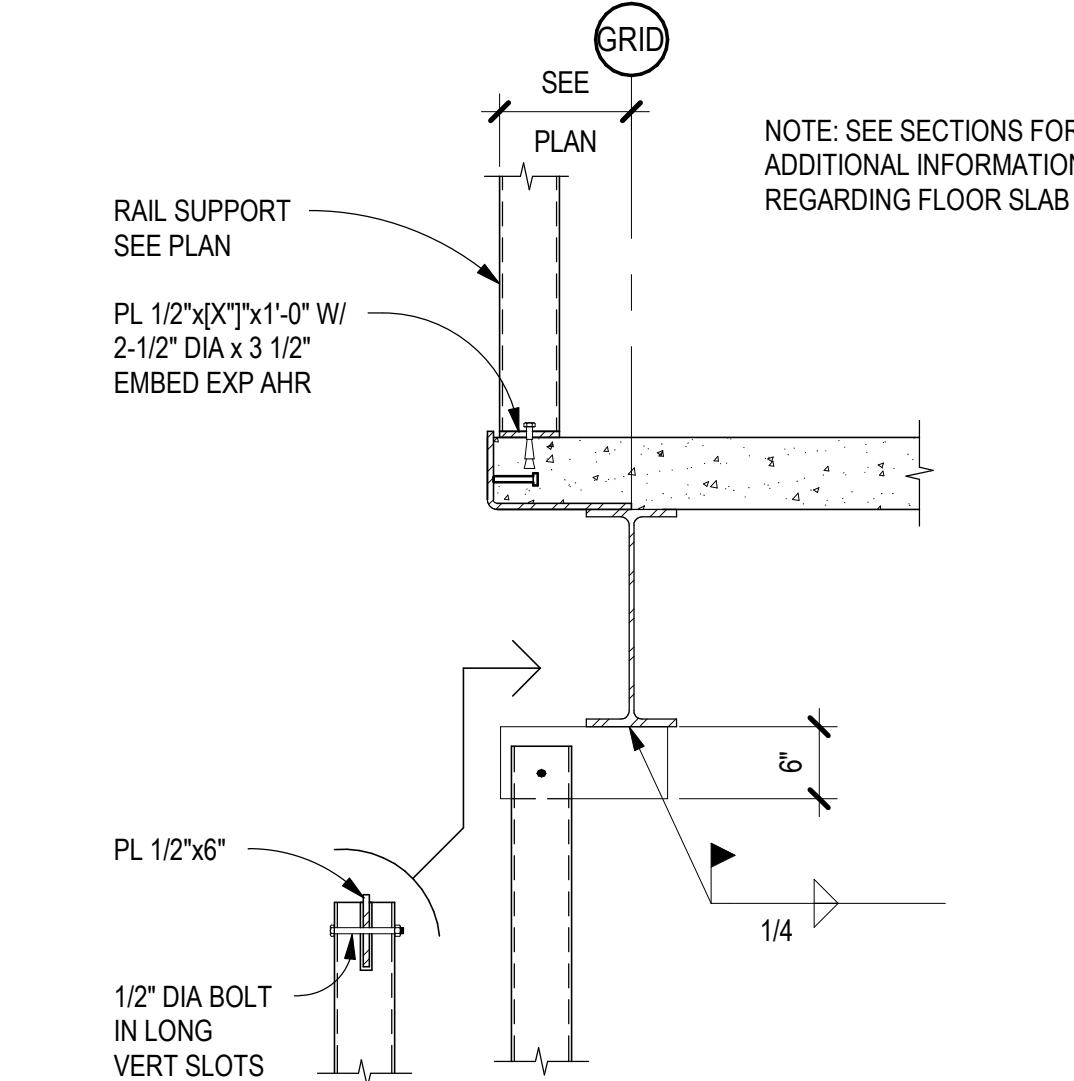


B2 ELEVATOR DETAIL
SCALE: 3/4" = 1'-0"

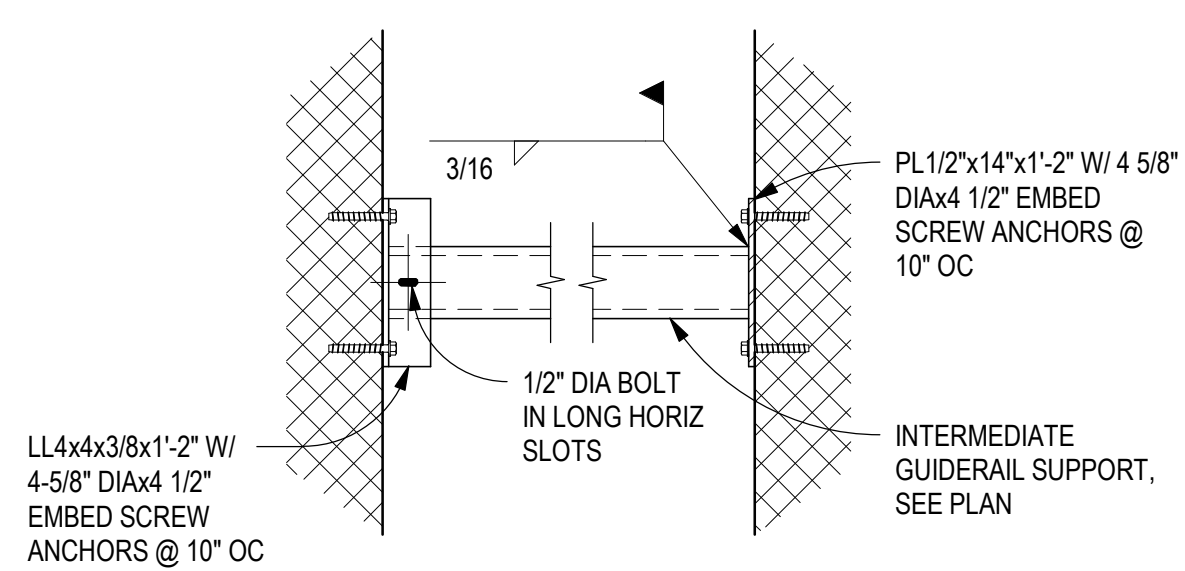


A1 INTERMEDIATE SUPPORT @ CMU
SCALE: 3/4" = 1'-0"

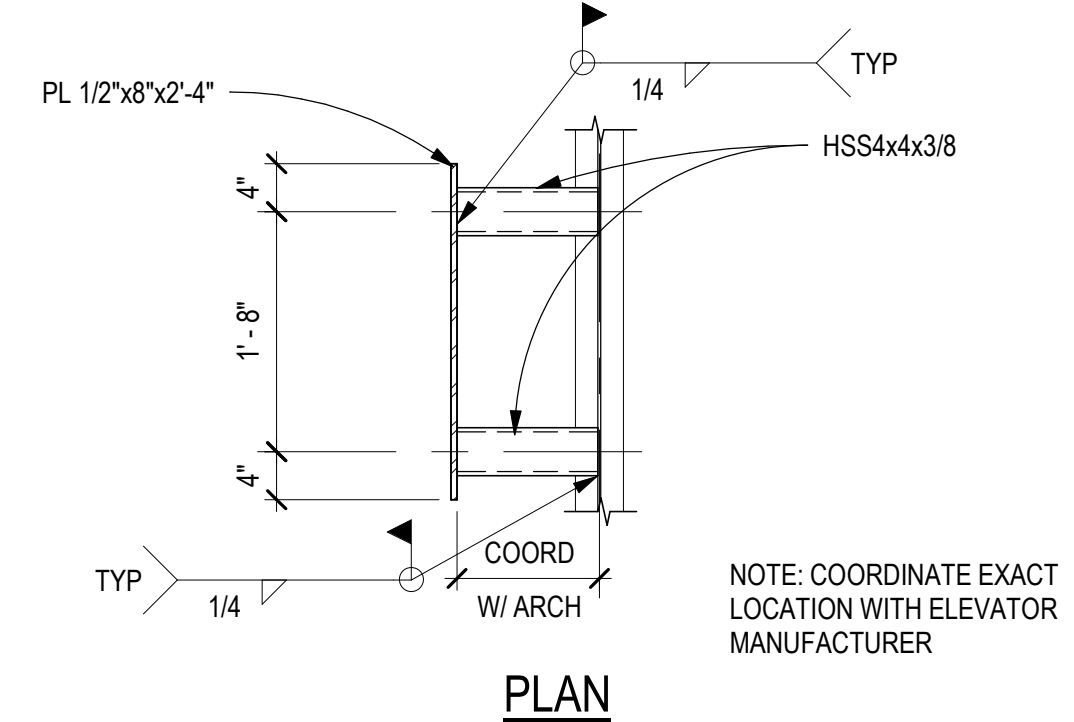


A2 ELEV RAIL BRACKET SUPPORT
SCALE: 3/4" = 1'-0"

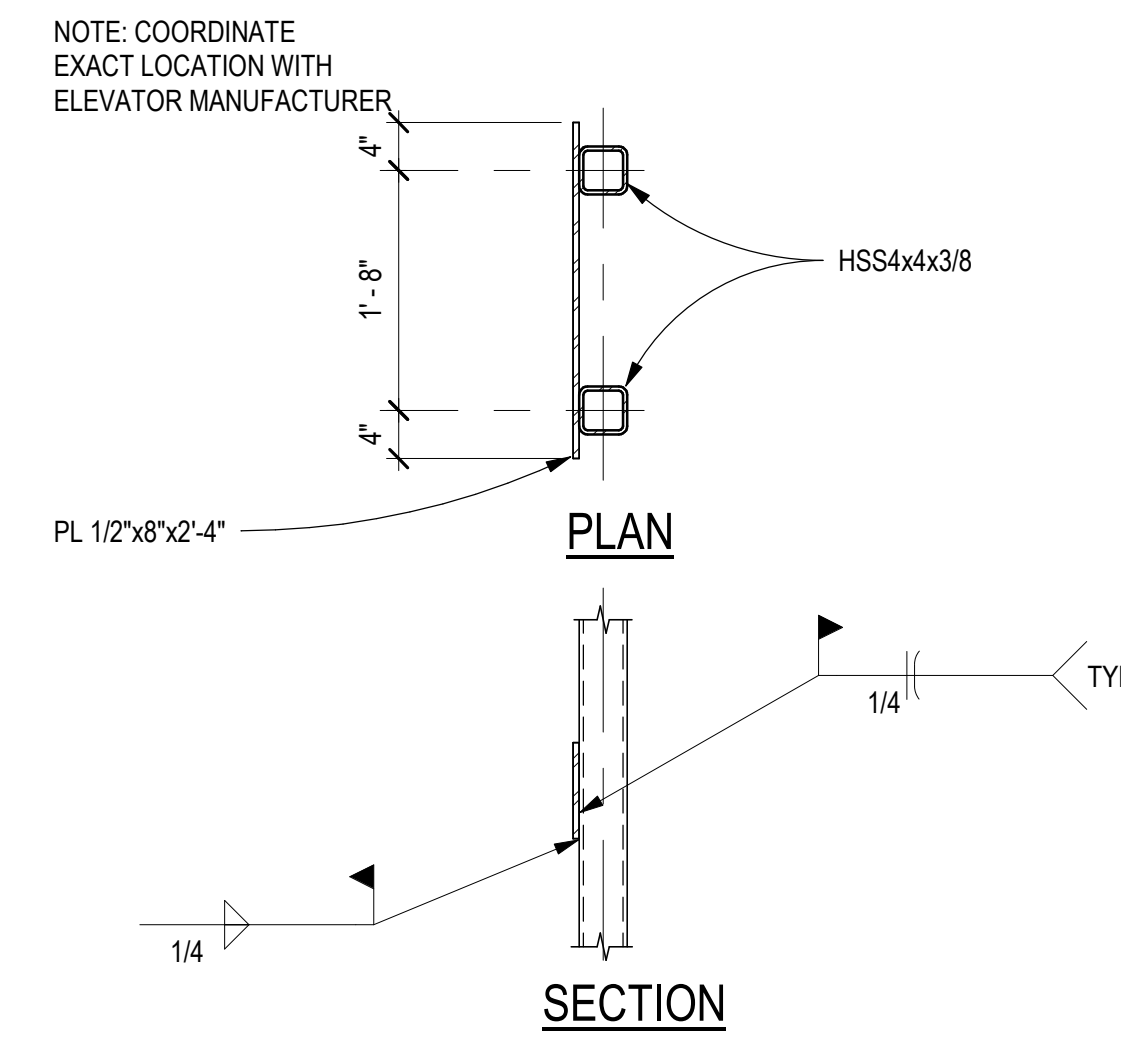


D3 ELEV RAIL BRACKET SUPPORT
SCALE: 3/4" = 1'-0"

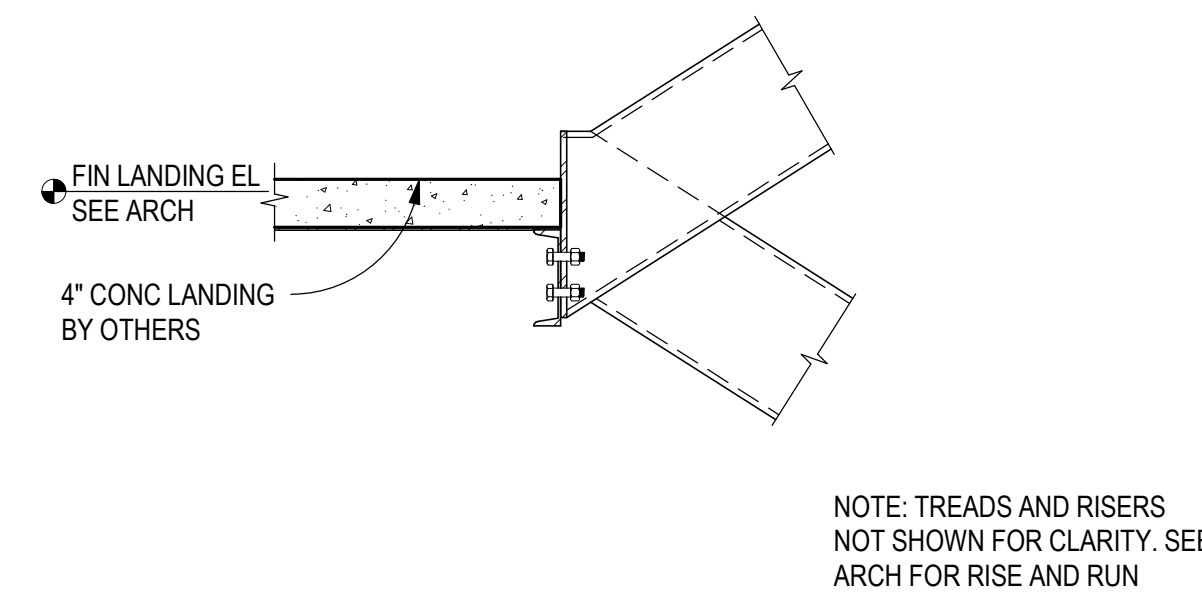


C3 INTERMEDIATE LANDING SECTION
SCALE: 3/4" = 1'-0"

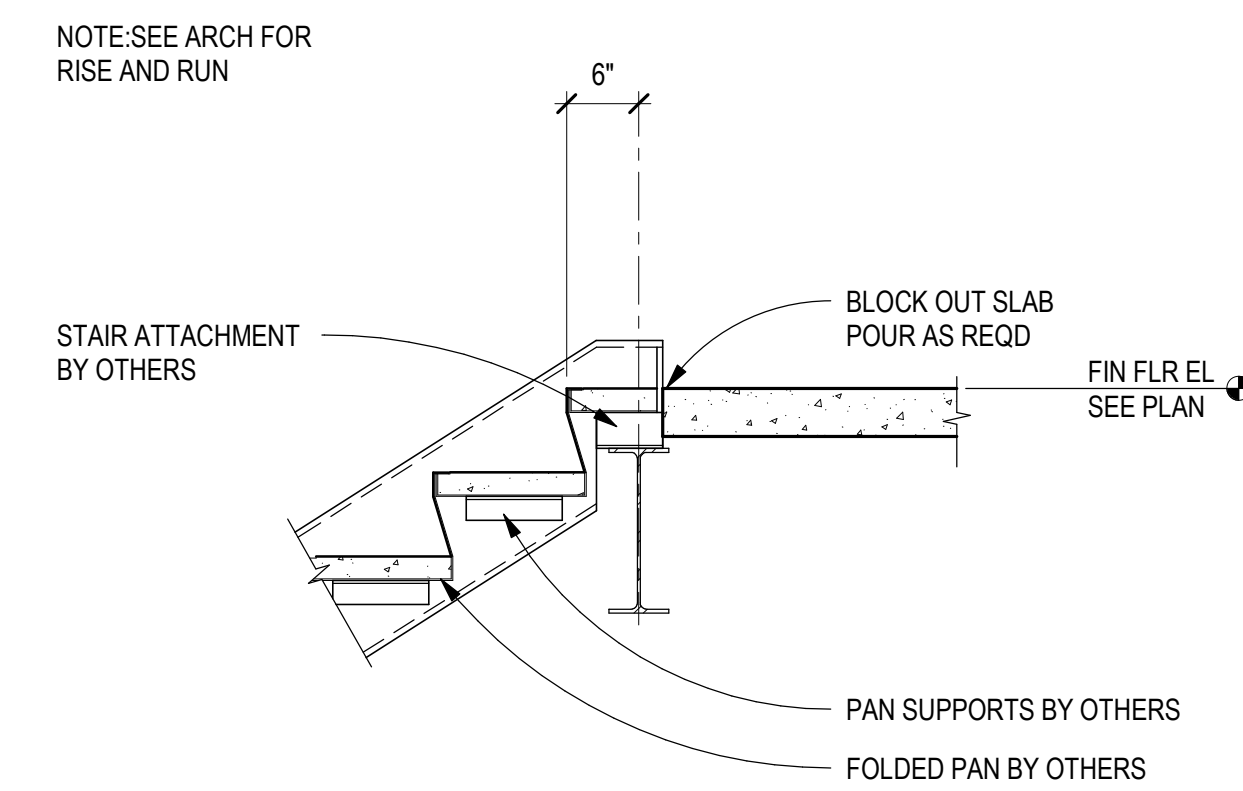


B3 STAIR STRINGER AT LANDING
SCALE: 3/4" = 1'-0"

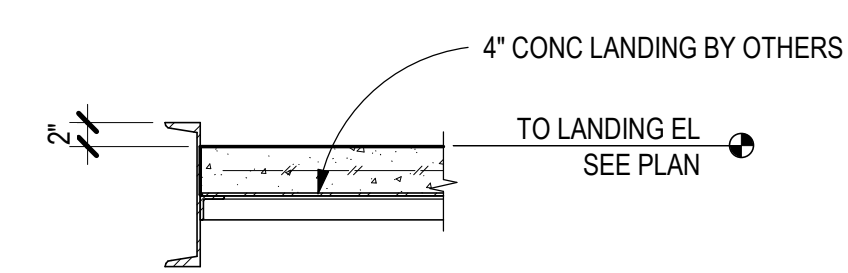


A3 STAIR LANDING SECTION
SCALE: 3/4" = 1'-0"

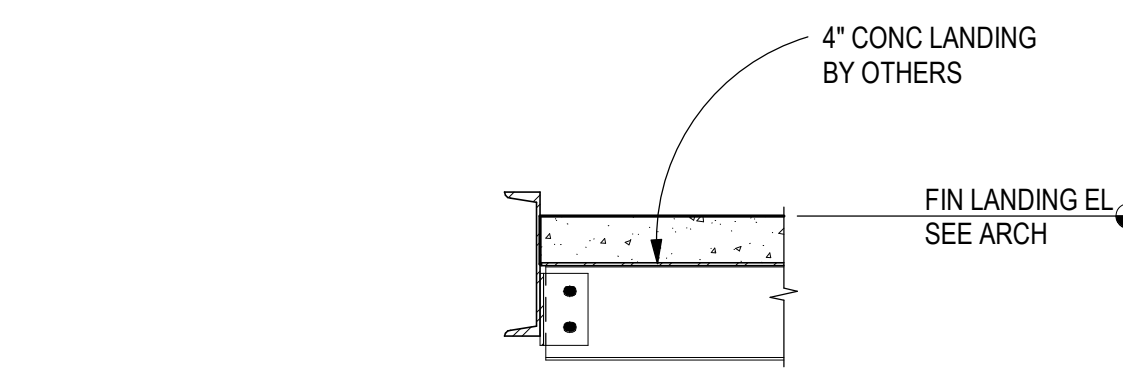


D4 STAIR LANDING SECTION
SCALE: 3/4" = 1'-0"

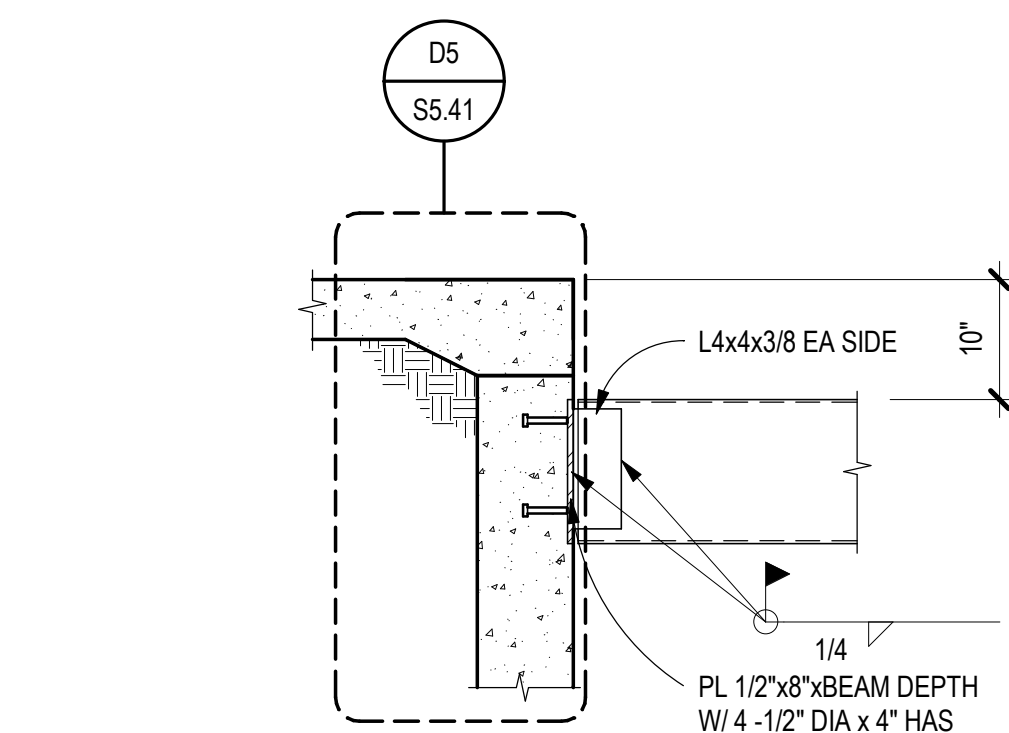


C4 ELEVATOR SEPARATOR BEAM
SCALE: 3/4" = 1'-0"

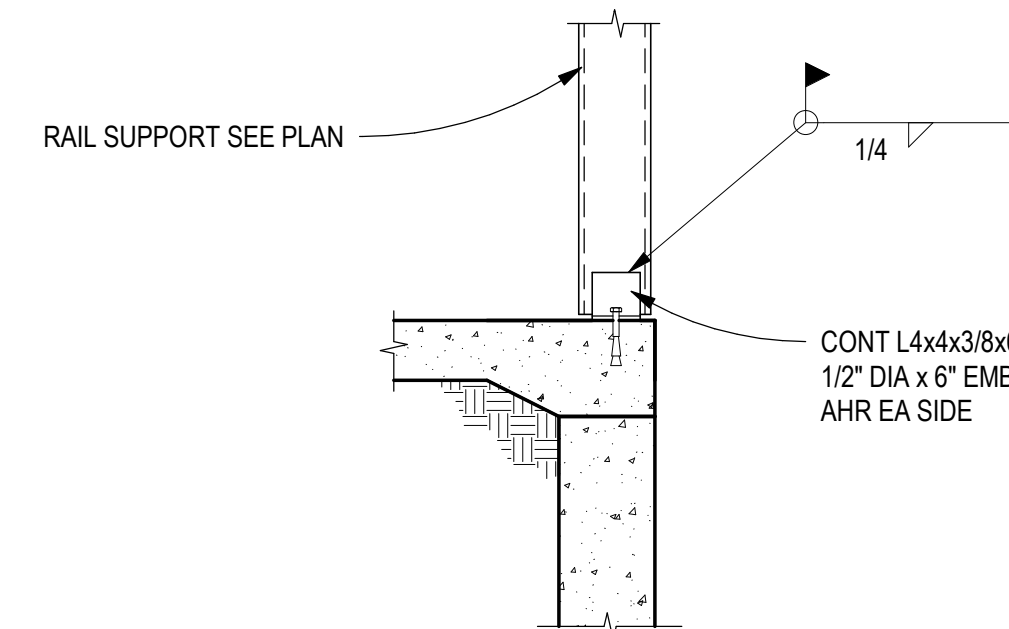


B4 ELEVATOR PIT SECTION
SCALE: 3/4" = 1'-0"

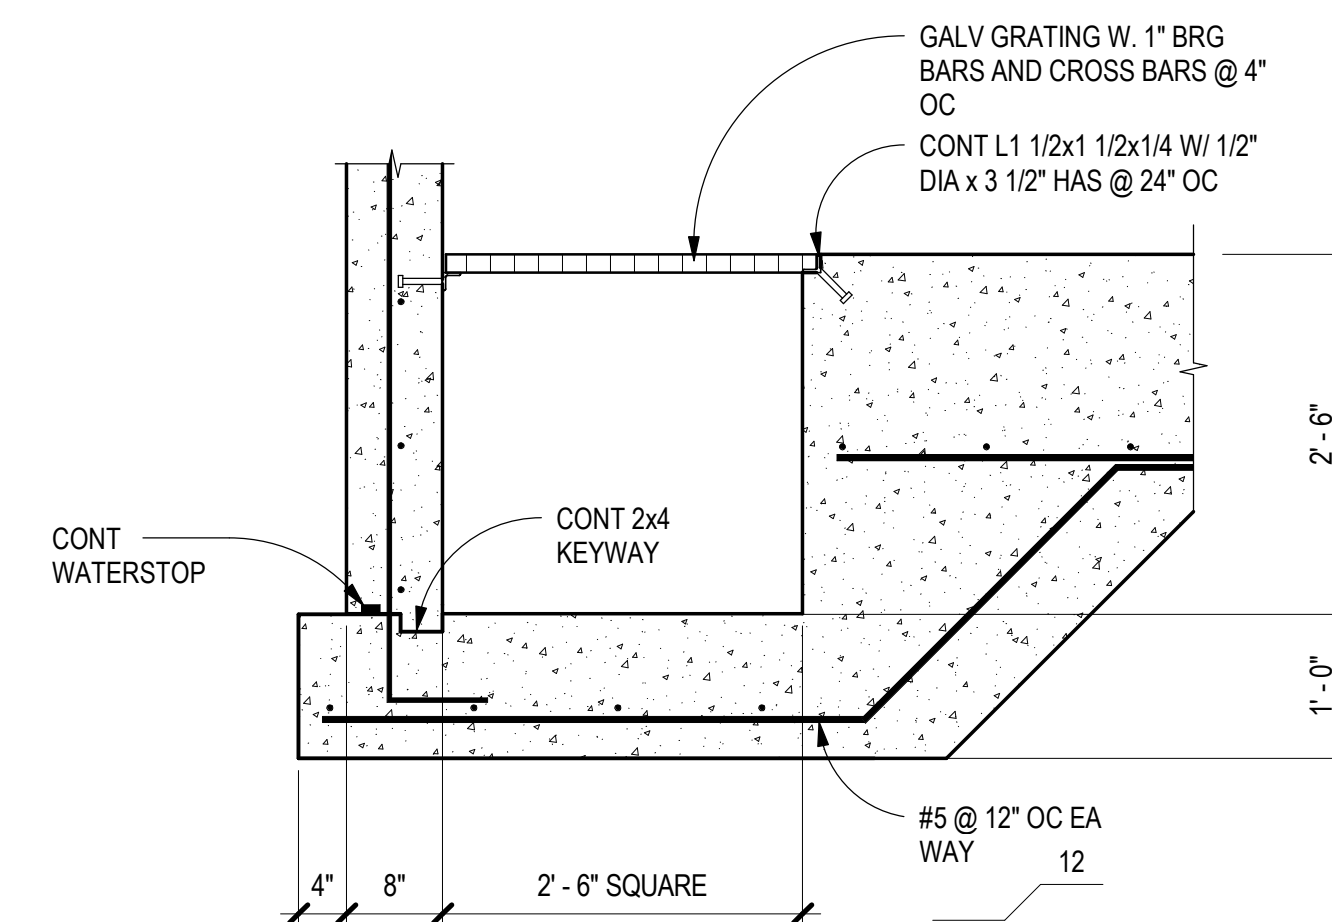


A4 ELEVATOR SUMP PIT SECTION
SCALE: 3/4" = 1'-0"

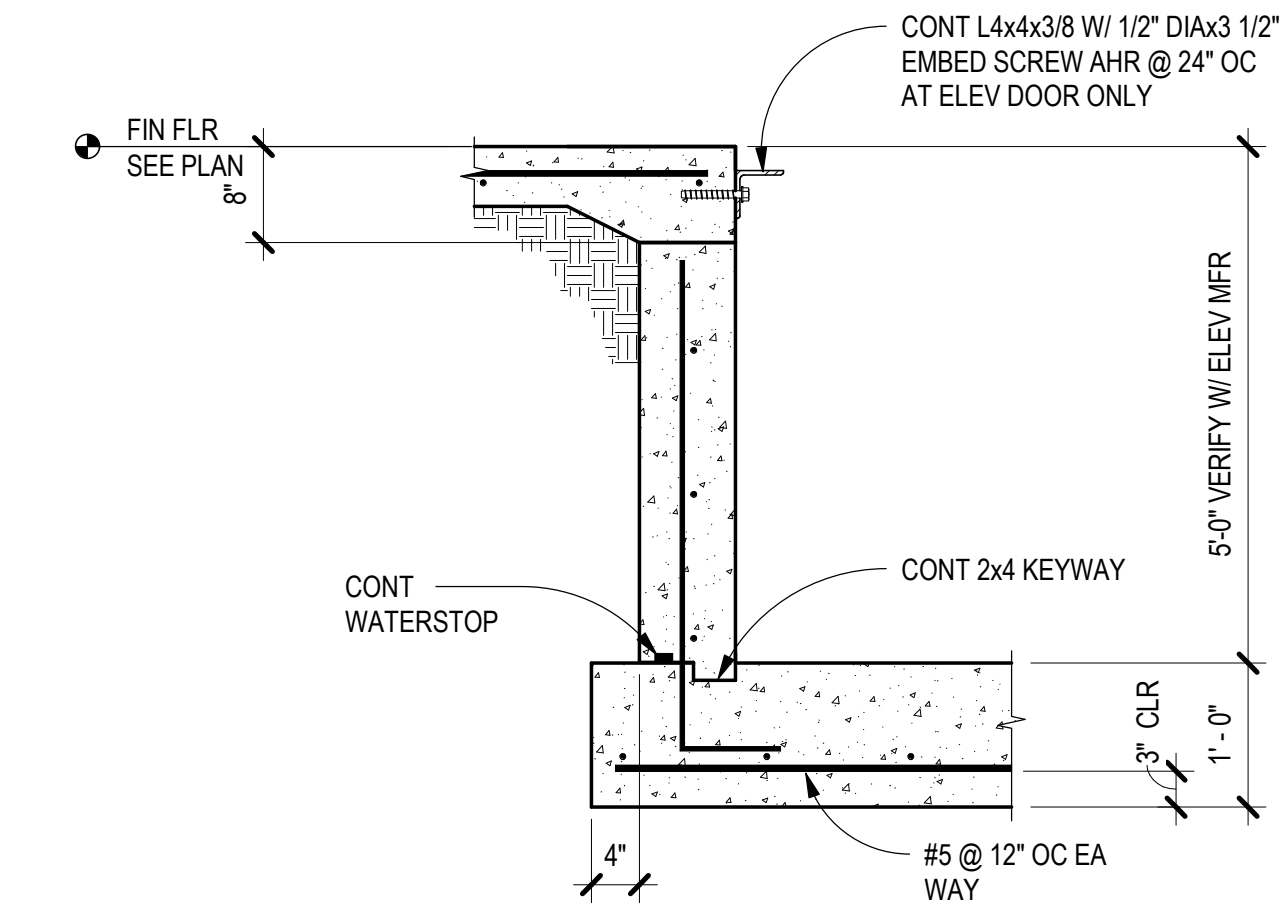


D5 ELEVATOR PIT SECTION
SCALE: 3/4" = 1'-0"

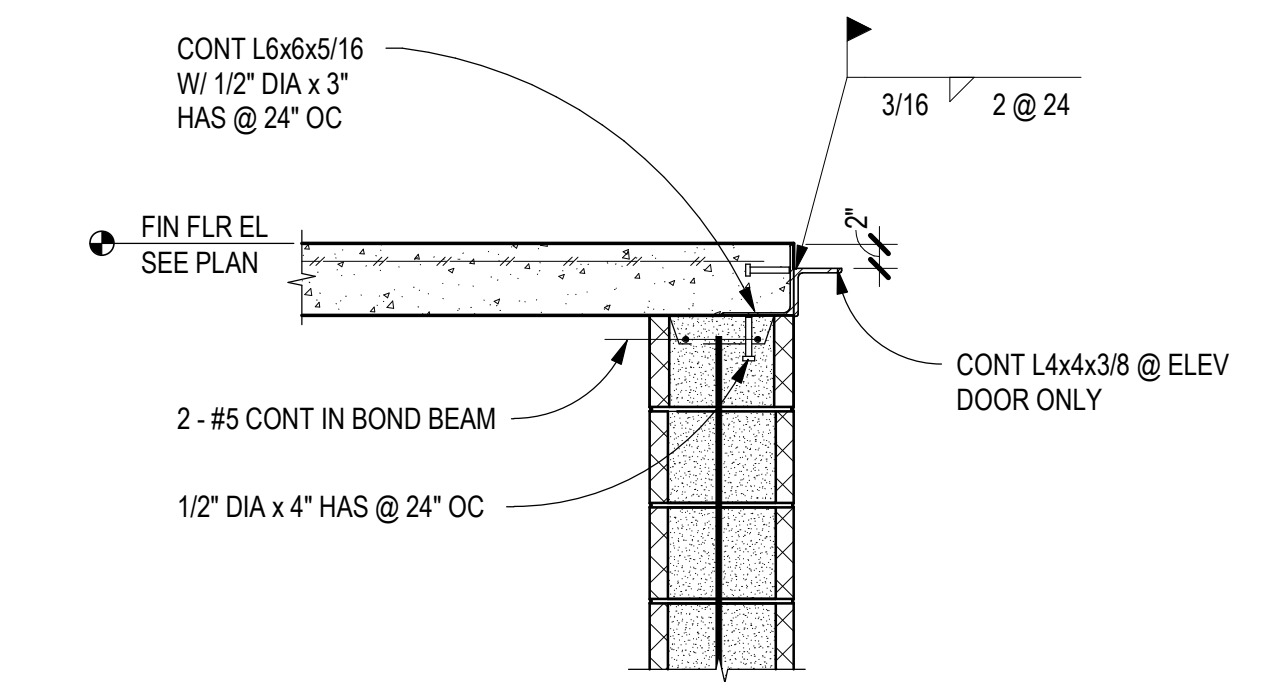


C5 ELEVATOR OPENING SECTION
SCALE: 3/4" = 1'-0"

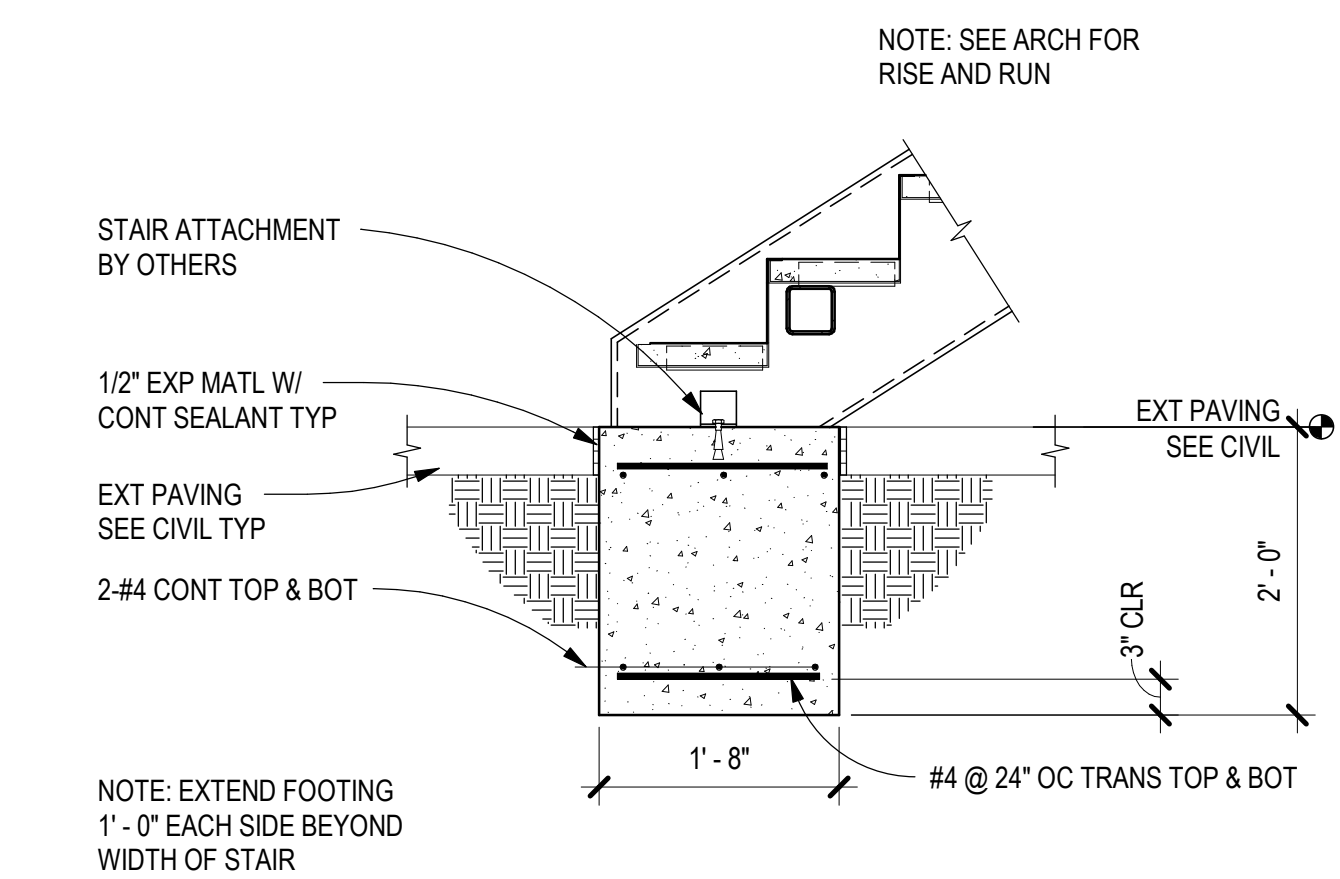

B5 STAIR BASE DETAIL
SCALE: 3/4" = 1'-0"

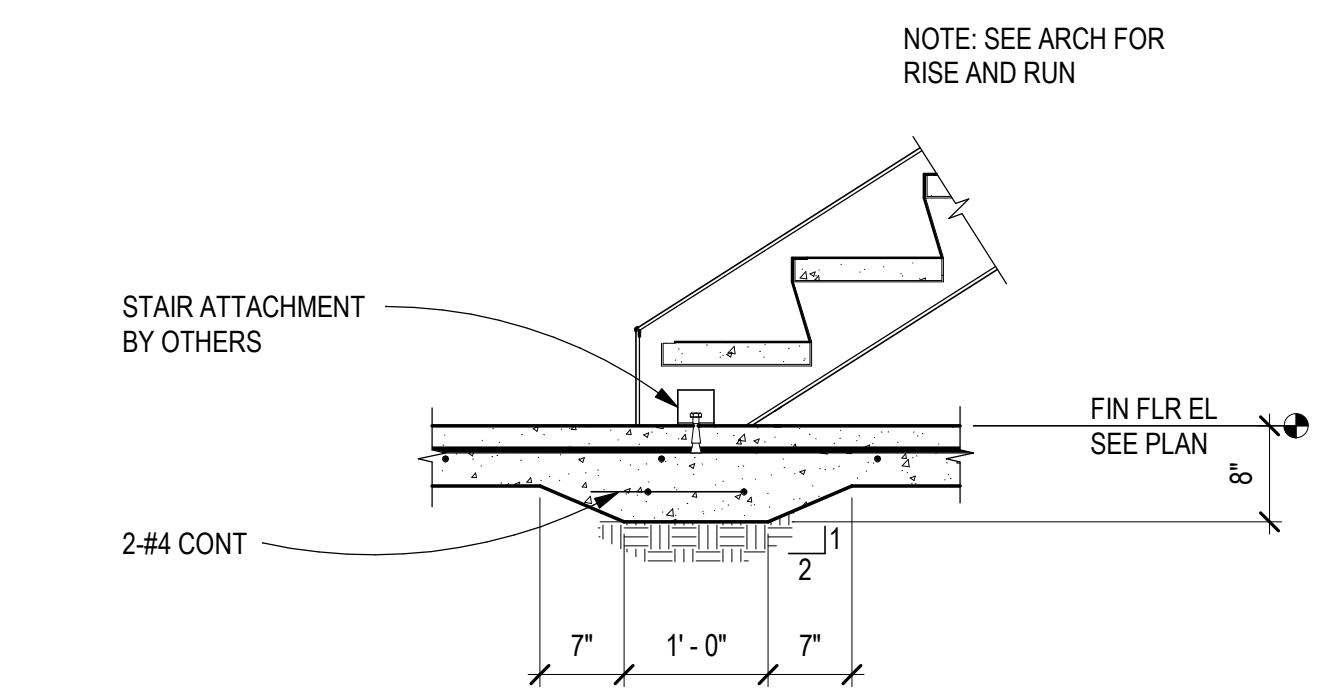


A5 TYPICAL STAIR BASE DETAIL
SCALE: 3/4" = 1'-0"

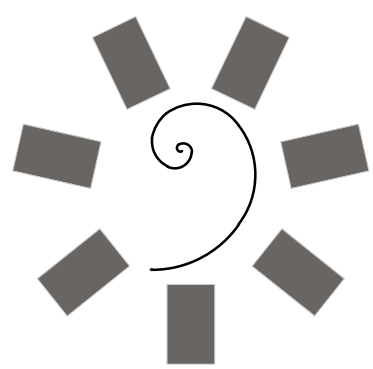

James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com



CONSULTANT LOGO

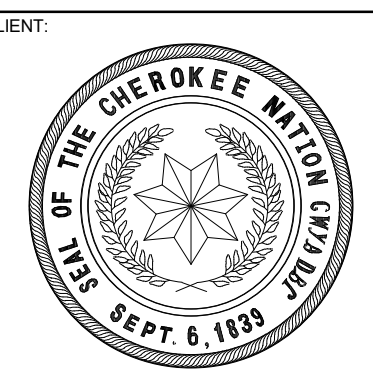

WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE:
BID PACKAGE 01



#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:

S5.41


VERTICAL CIRCULATION DETAILS

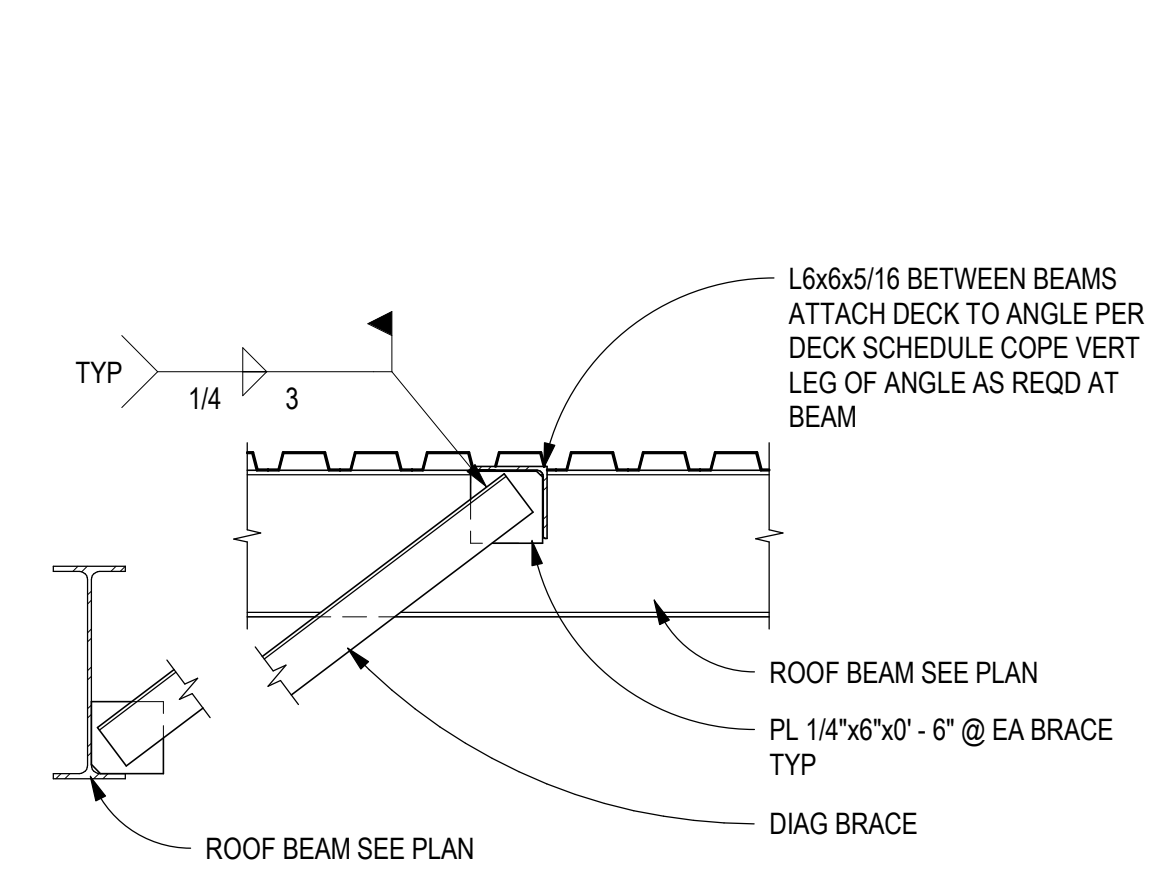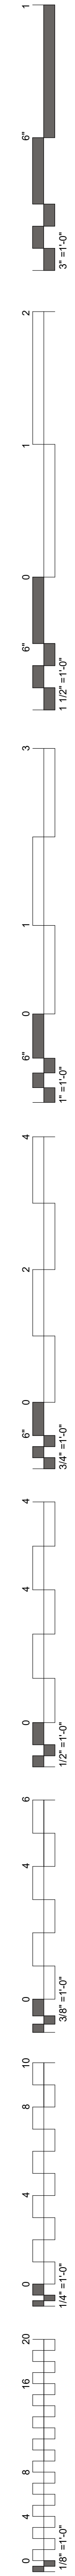


D1 **DIAG BRACE TO ROOF STRUCTURE**
SCALE: 3/4" = 1'-0"

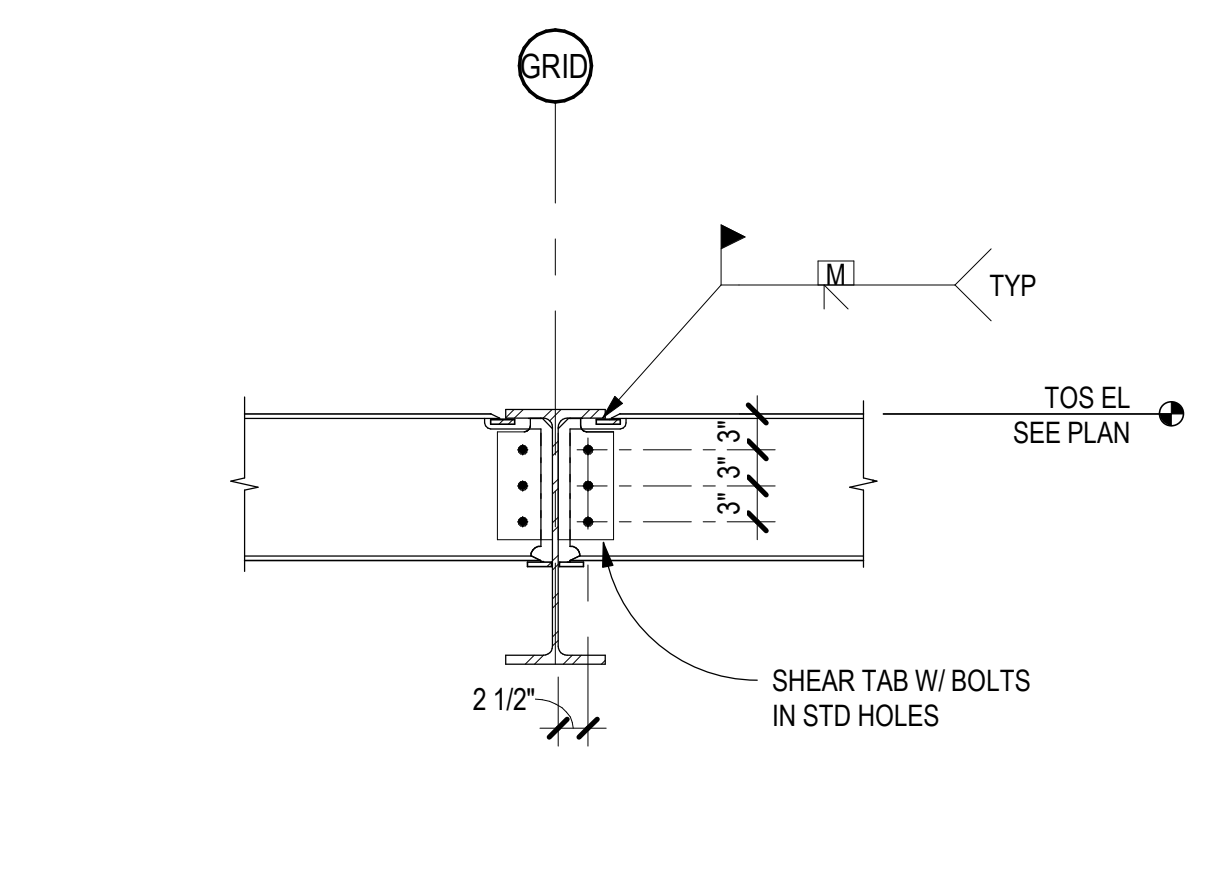


D2 **BEAM TO BEAM MOMENT CONN**
SCALE: 3/4" = 1'-0"

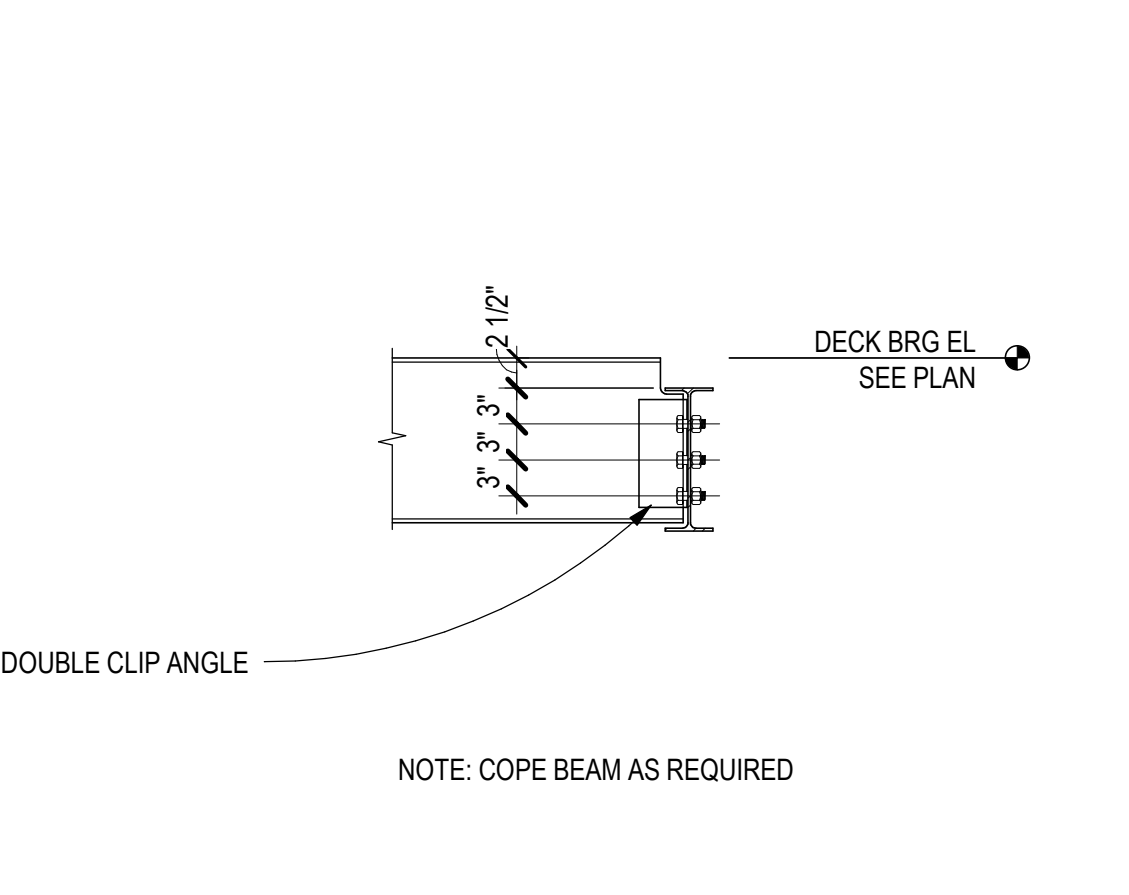


D3 **BEAM TO BEAM CONN**
SCALE: 3/4" = 1'-0"

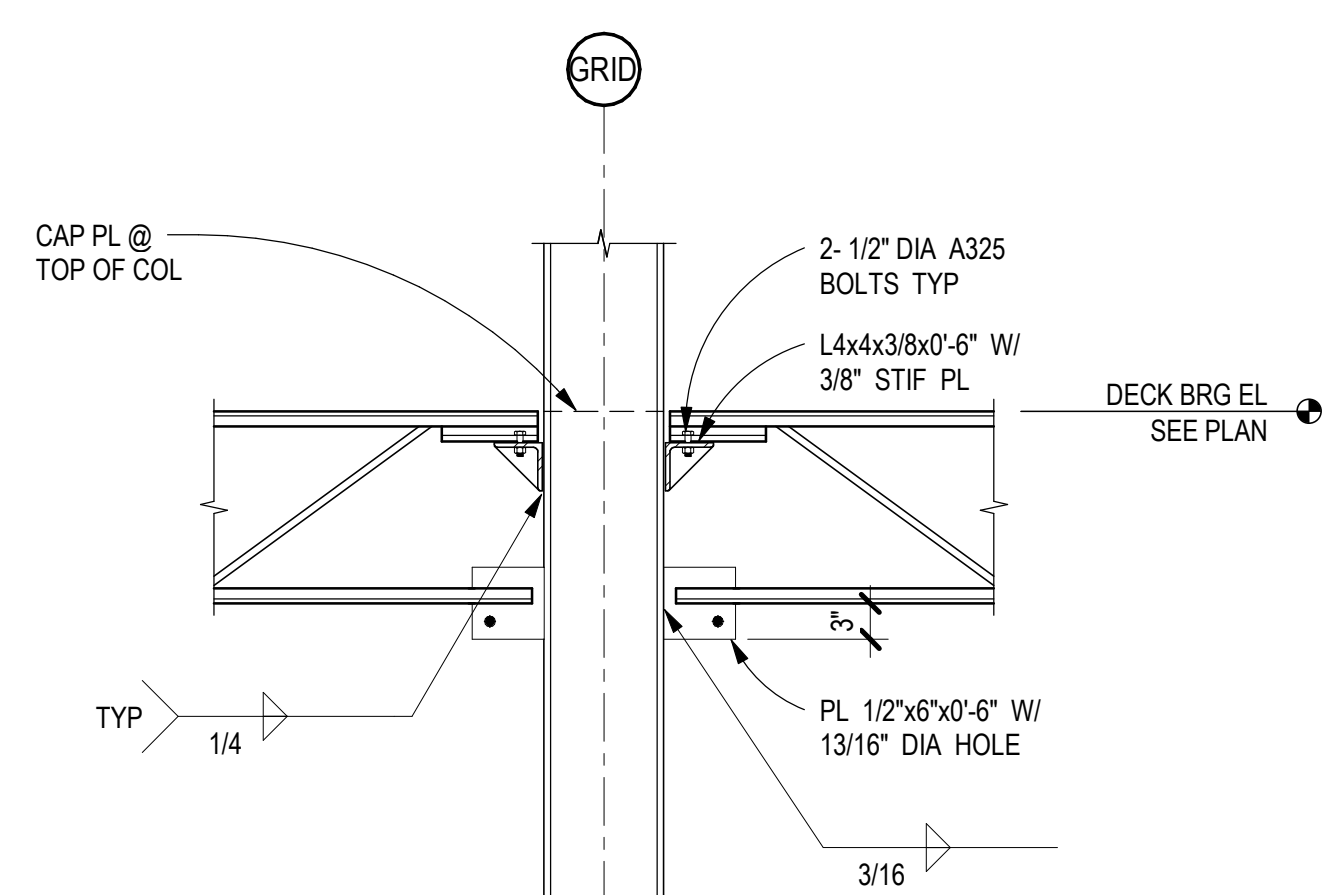


D4 **JOIST TO COLUMN FLANGE CONN**
SCALE: 3/4" = 1'-0"

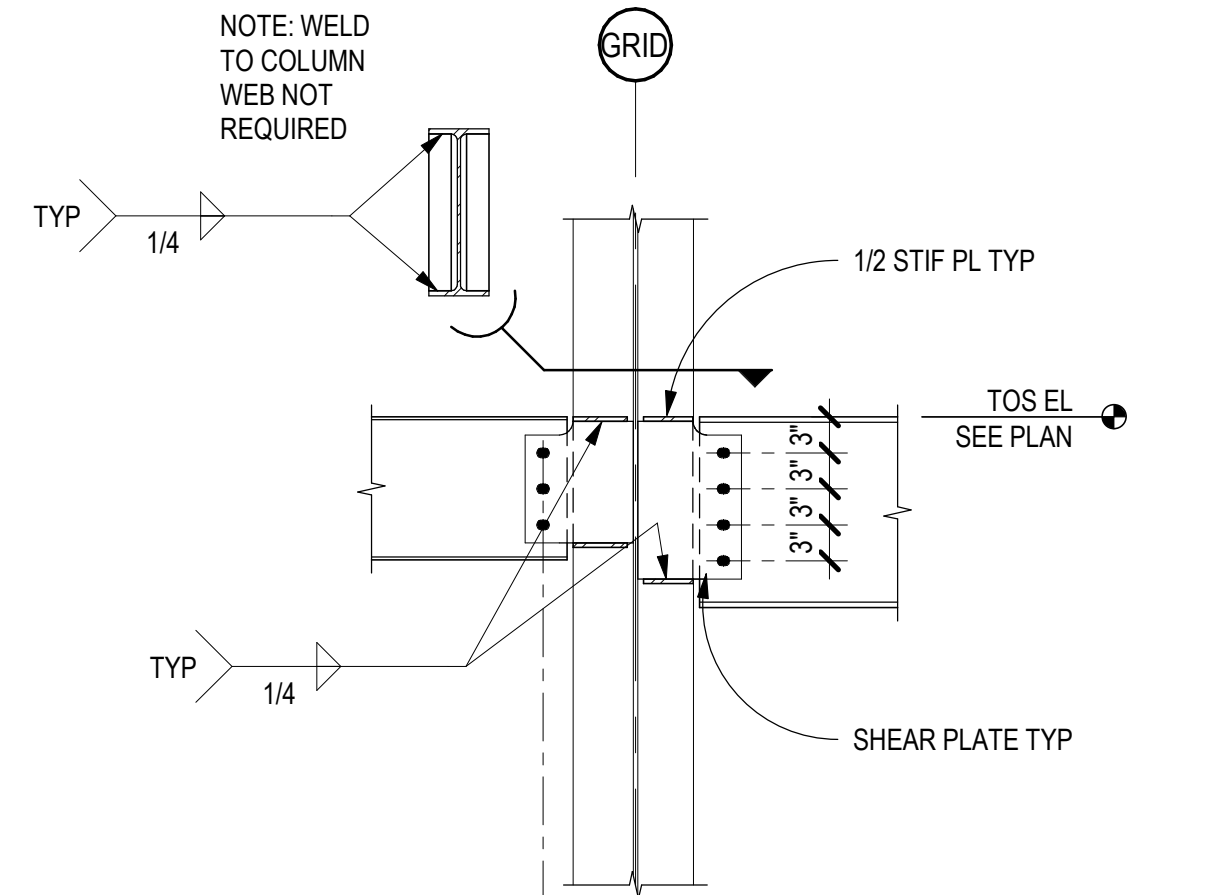


D5 **BEAM TO COLUMN WEB CONN**
SCALE: 3/4" = 1'-0"

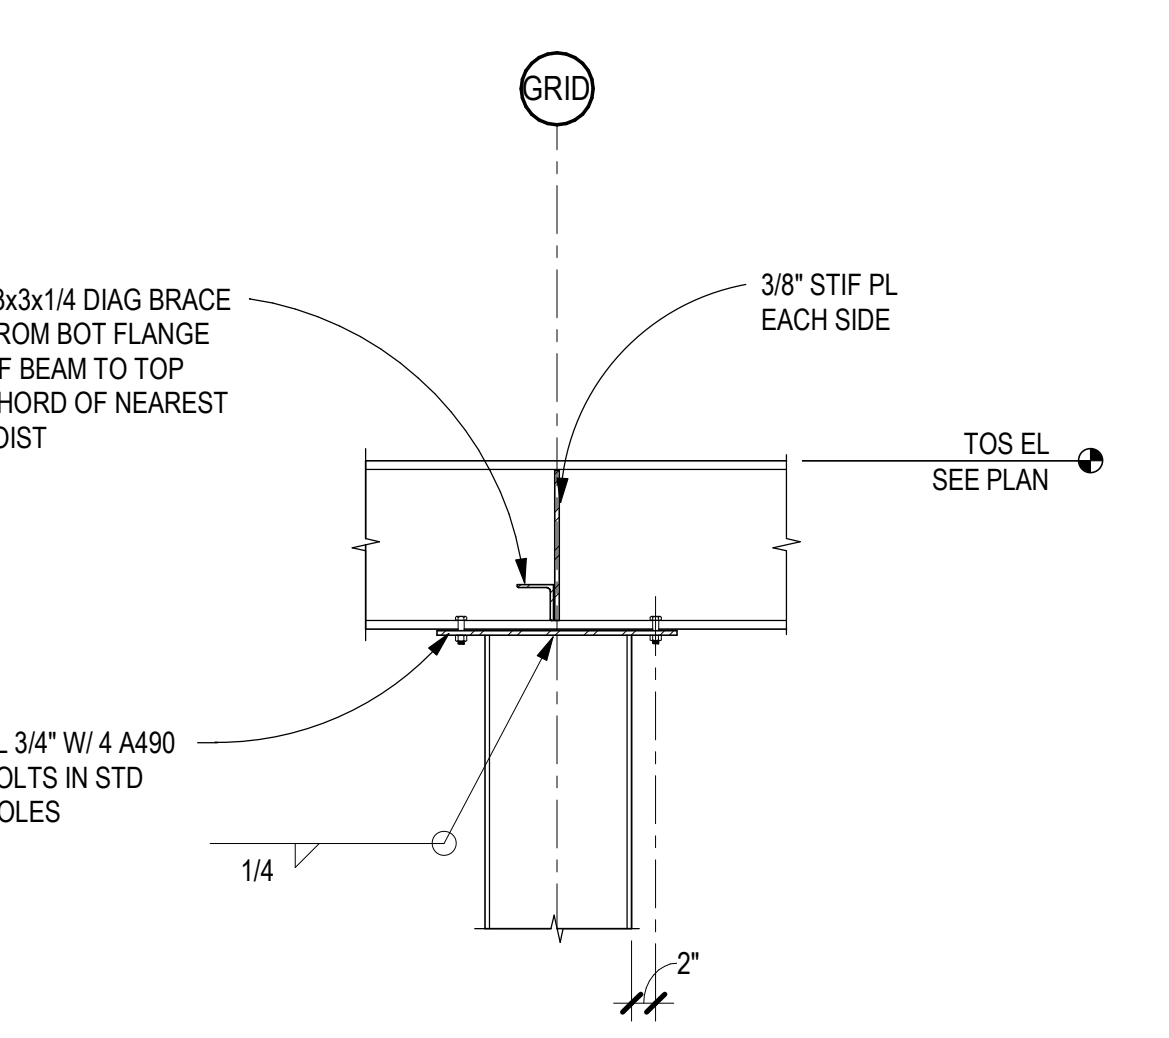


C1 **BEAM OVER COLUMN CONN**
SCALE: 3/4" = 1'-0"

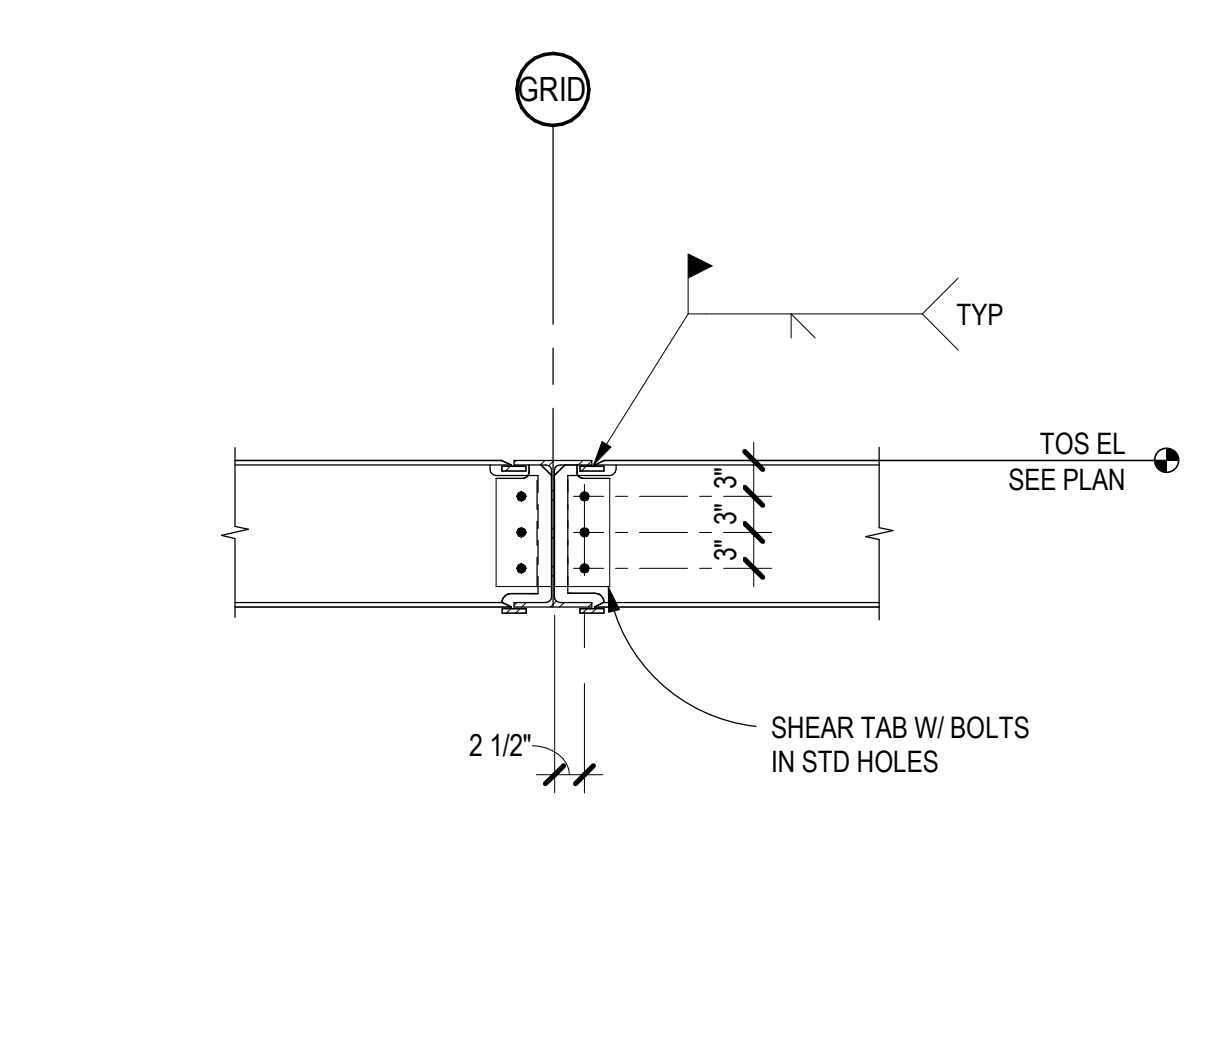


C2 **BEAM TO BEAM MOMENT CONN**
SCALE: 3/4" = 1'-0"

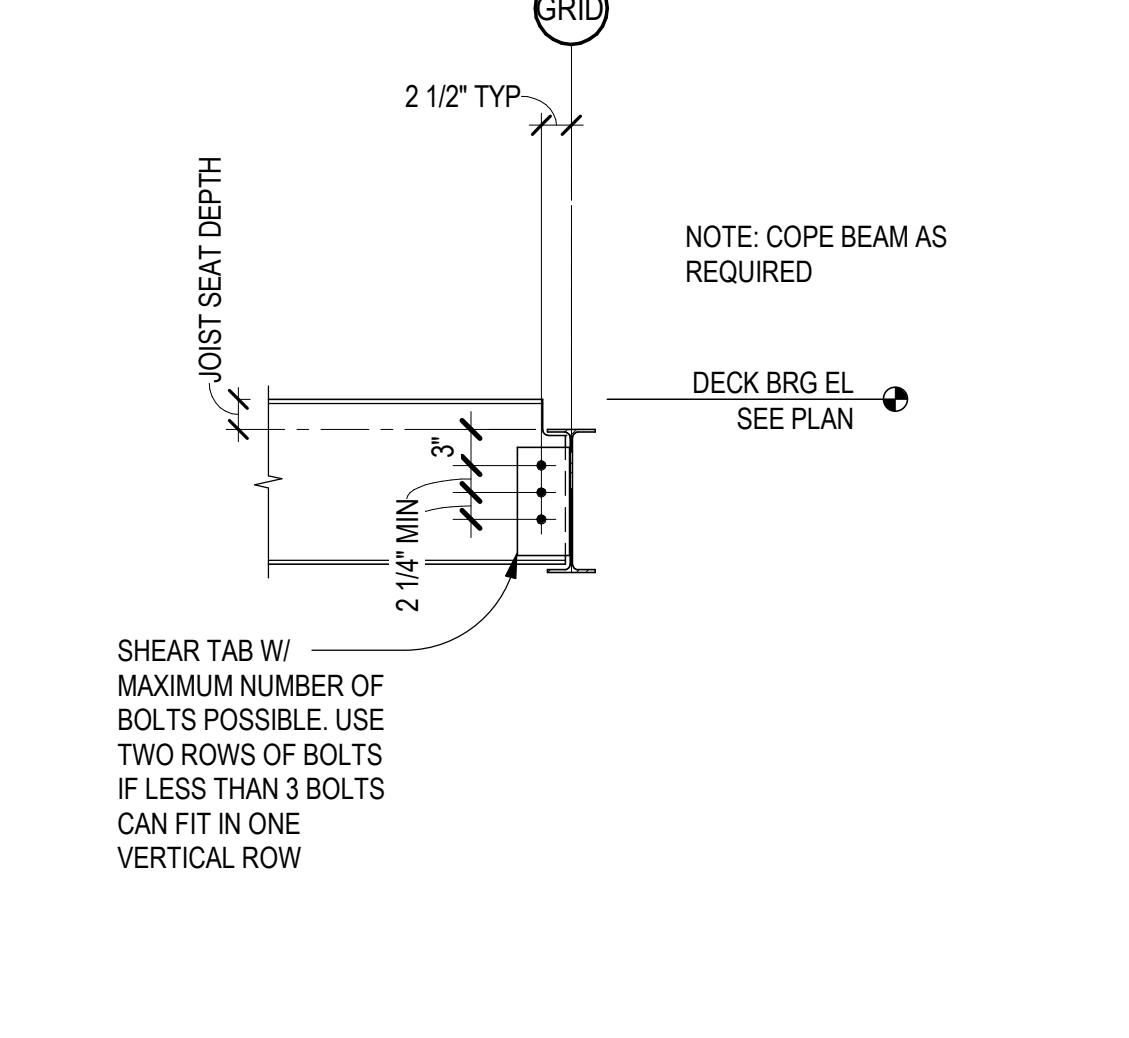


C3 **BEAM TO BEAM CONNECTION**
SCALE: 3/4" = 1'-0"

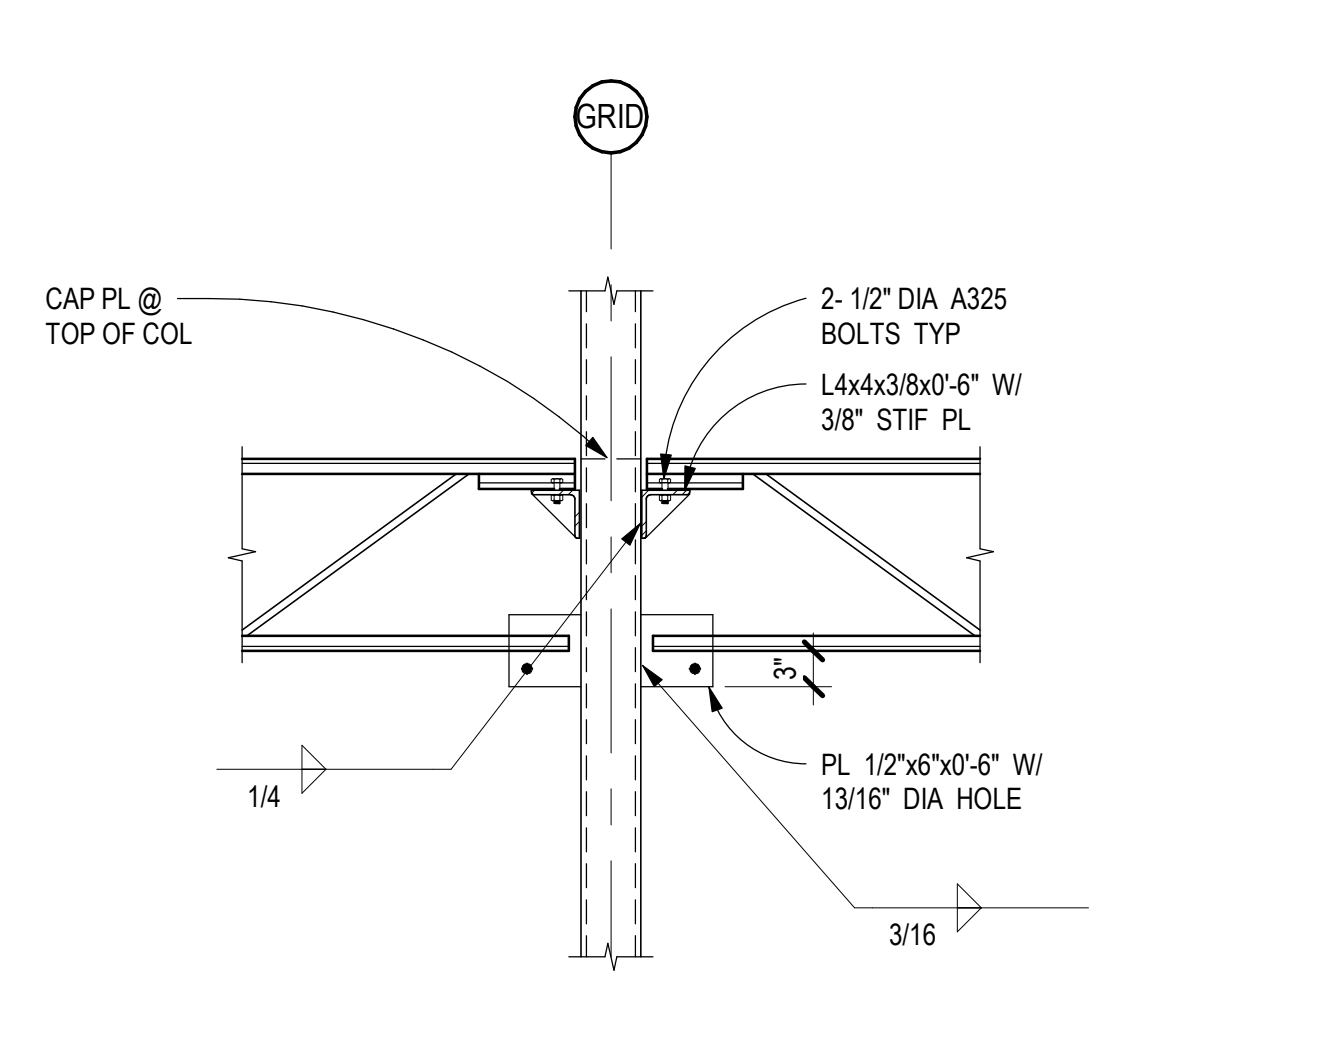


C4 **JOISTS TO COLUMN CONN**
SCALE: 3/4" = 1'-0"

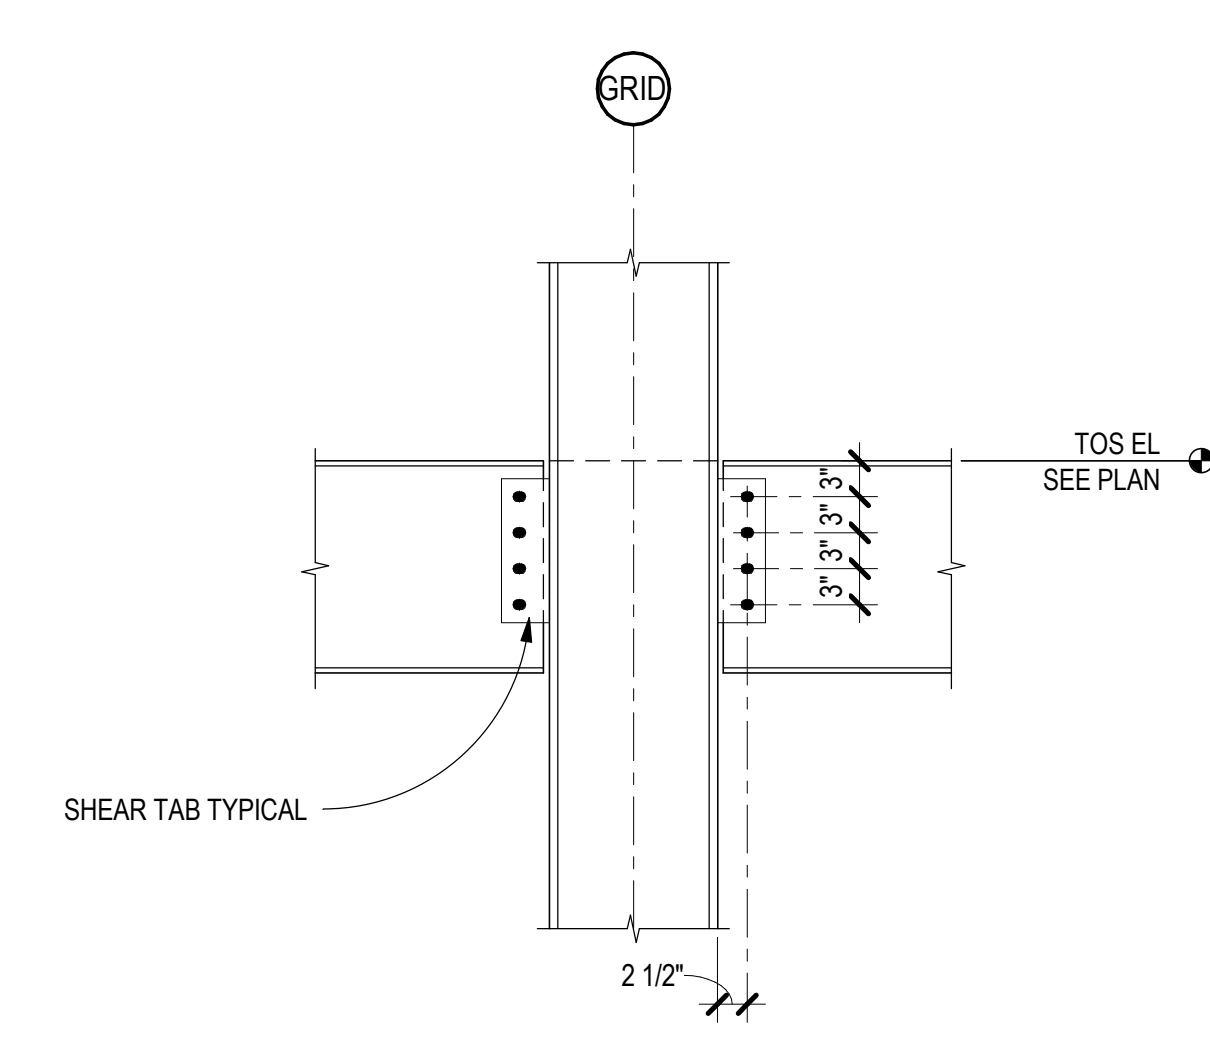


C5 **BEAM TO COLUMN FLANGE CONN**
SCALE: 3/4" = 1'-0"

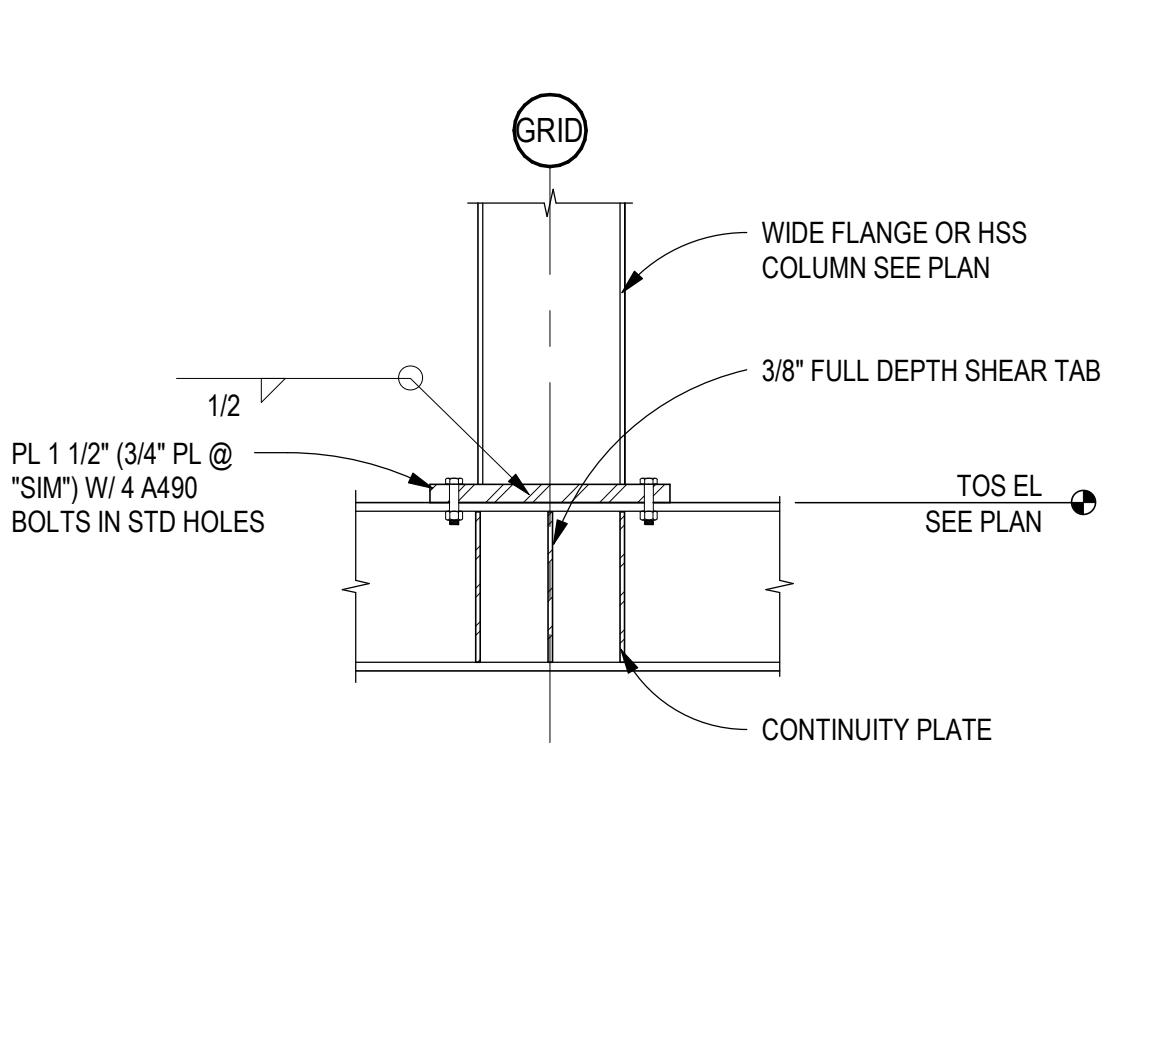


B1 **COL TO TRANSFER GIRDER**
SCALE: 3/4" = 1'-0"

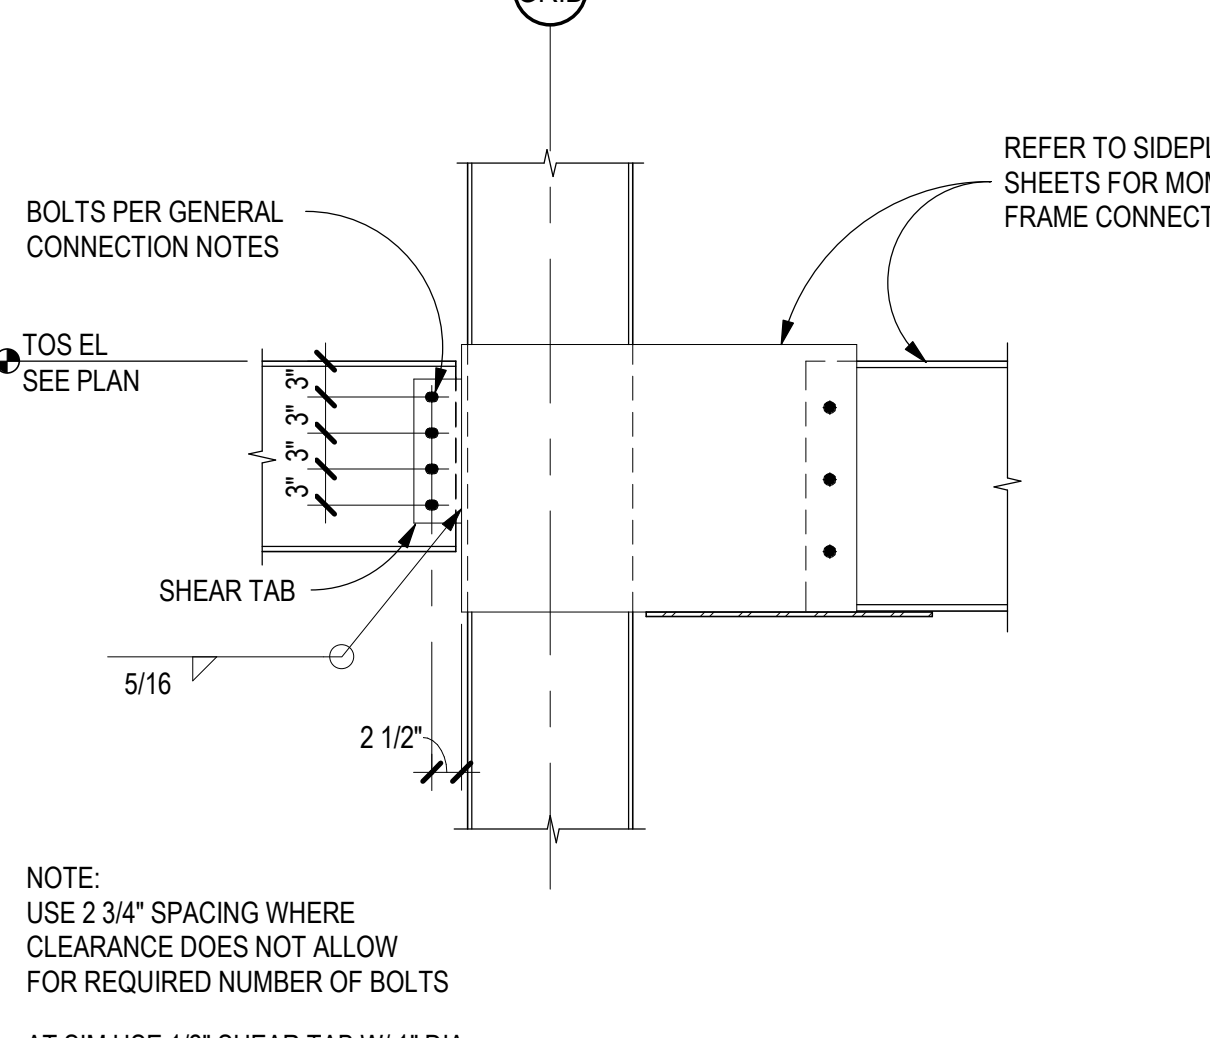


B2 **BM TO COL FLANGE AT SIDEPLATE**
SCALE: 3/4" = 1'-0"

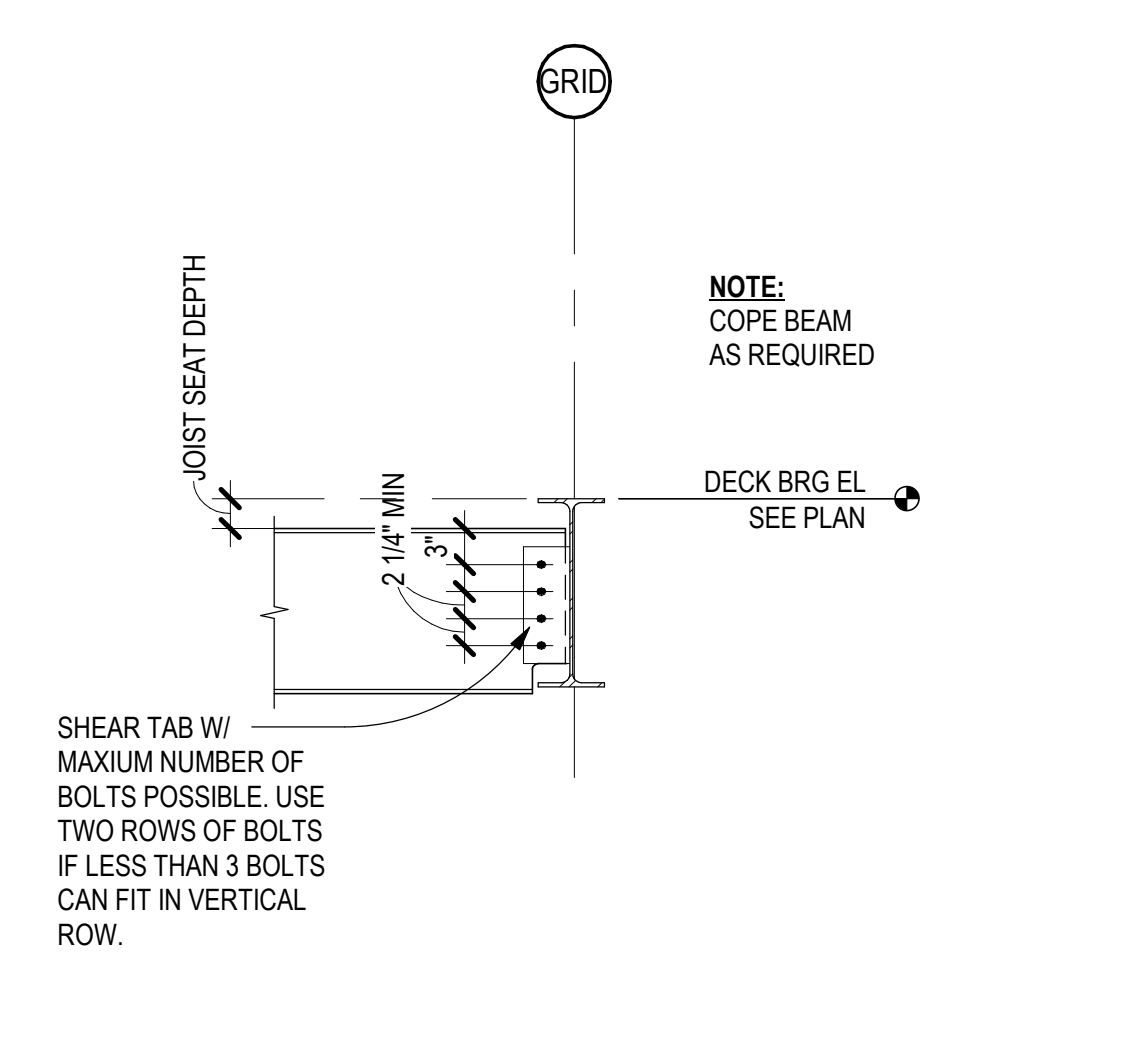


B3 **TYPICAL BEAM TO BEAM CONN**
SCALE: 3/4" = 1'-0"

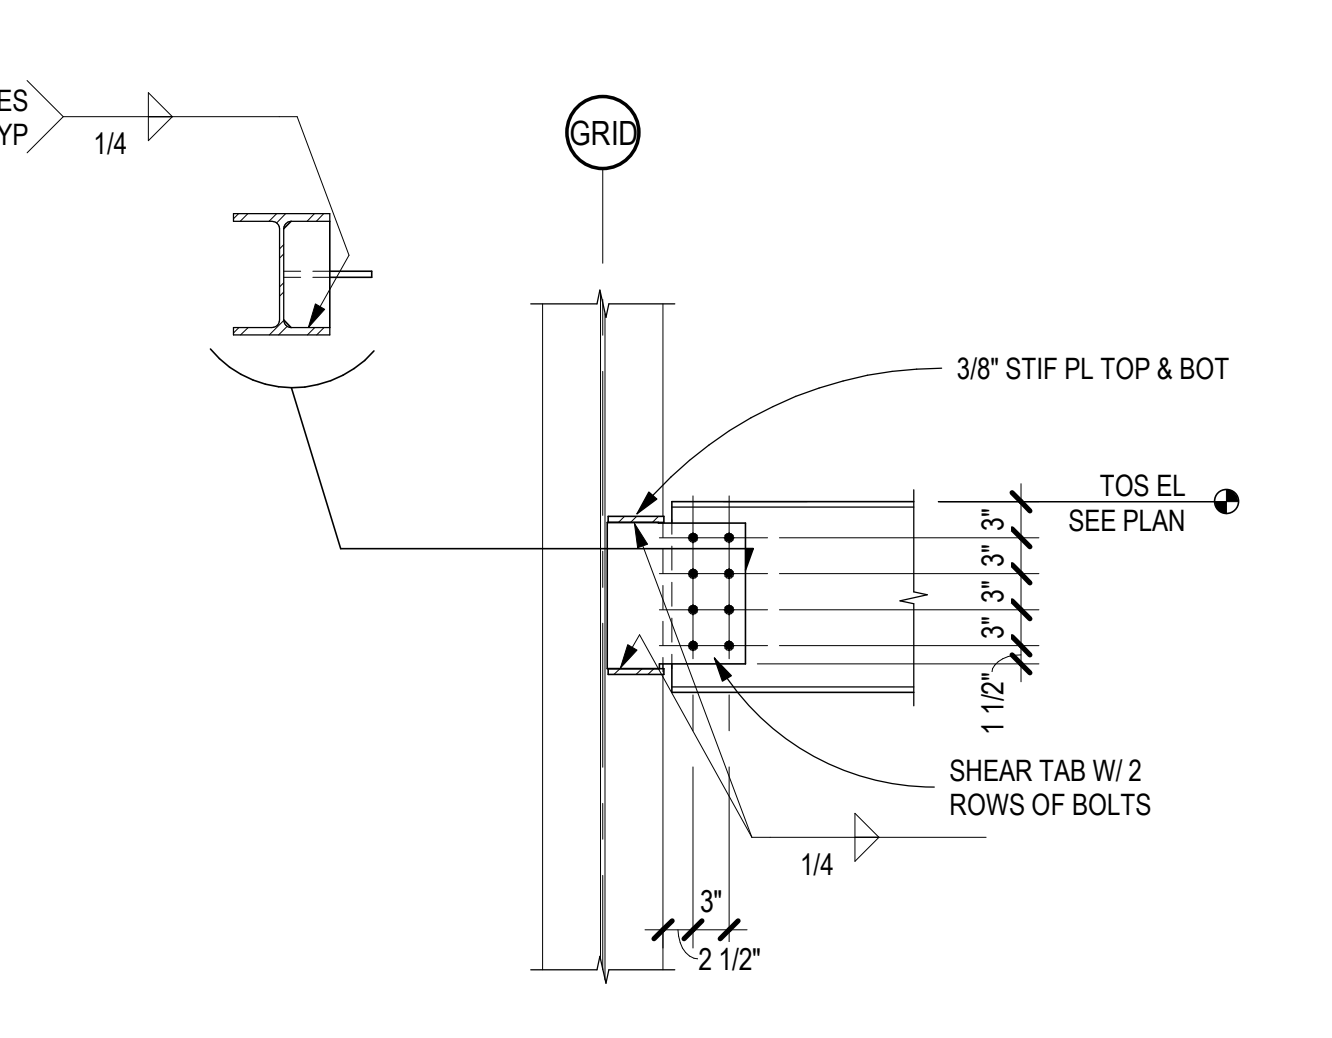


B4 **BEAM TO COL - 2 ROWS OF BOLTS**
SCALE: 3/4" = 1'-0"

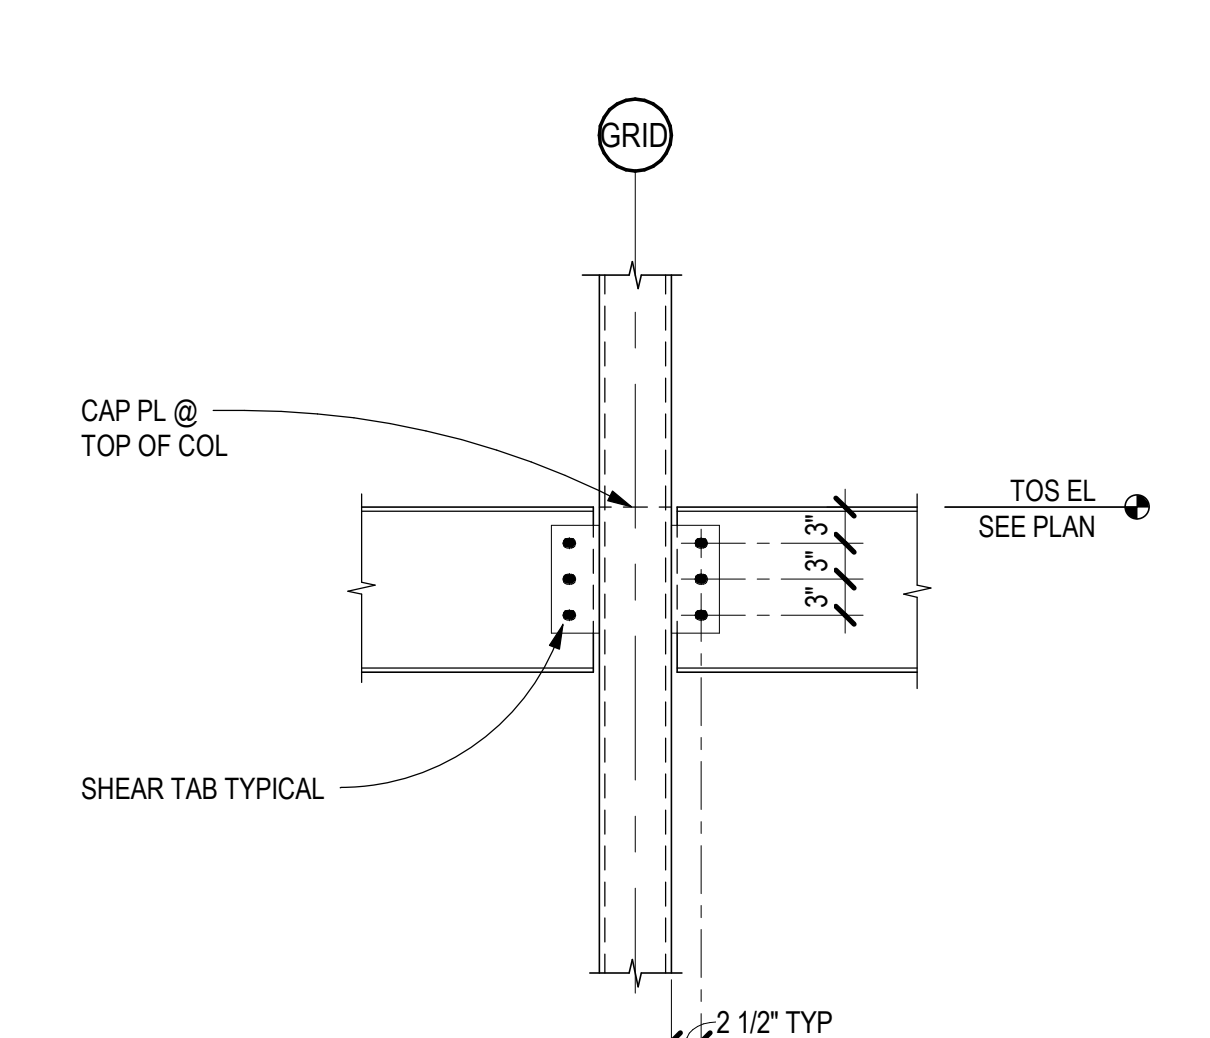


B5 **BEAM TO COLUMN CONN**
SCALE: 3/4" = 1'-0"

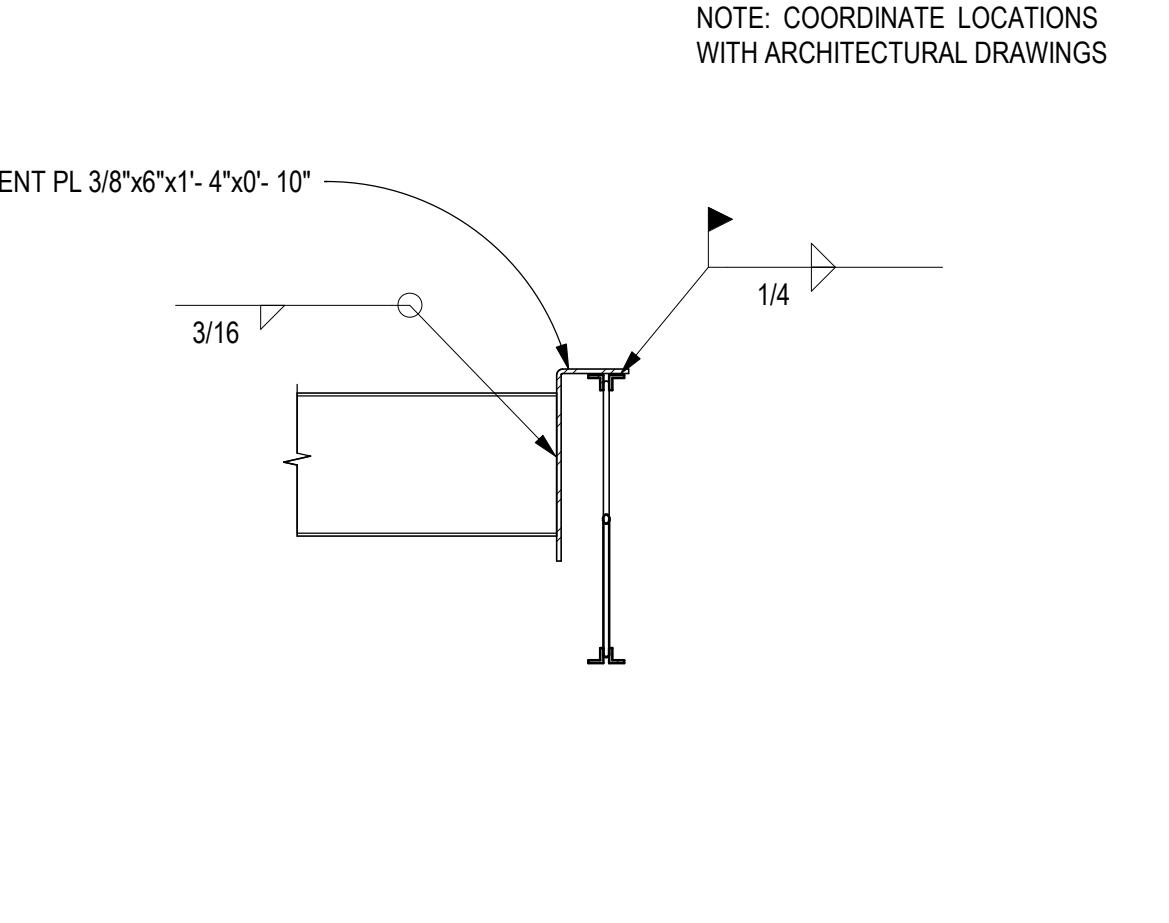


A1 **BEAM TO JOIST CONNECTION**
SCALE: 3/4" = 1'-0"

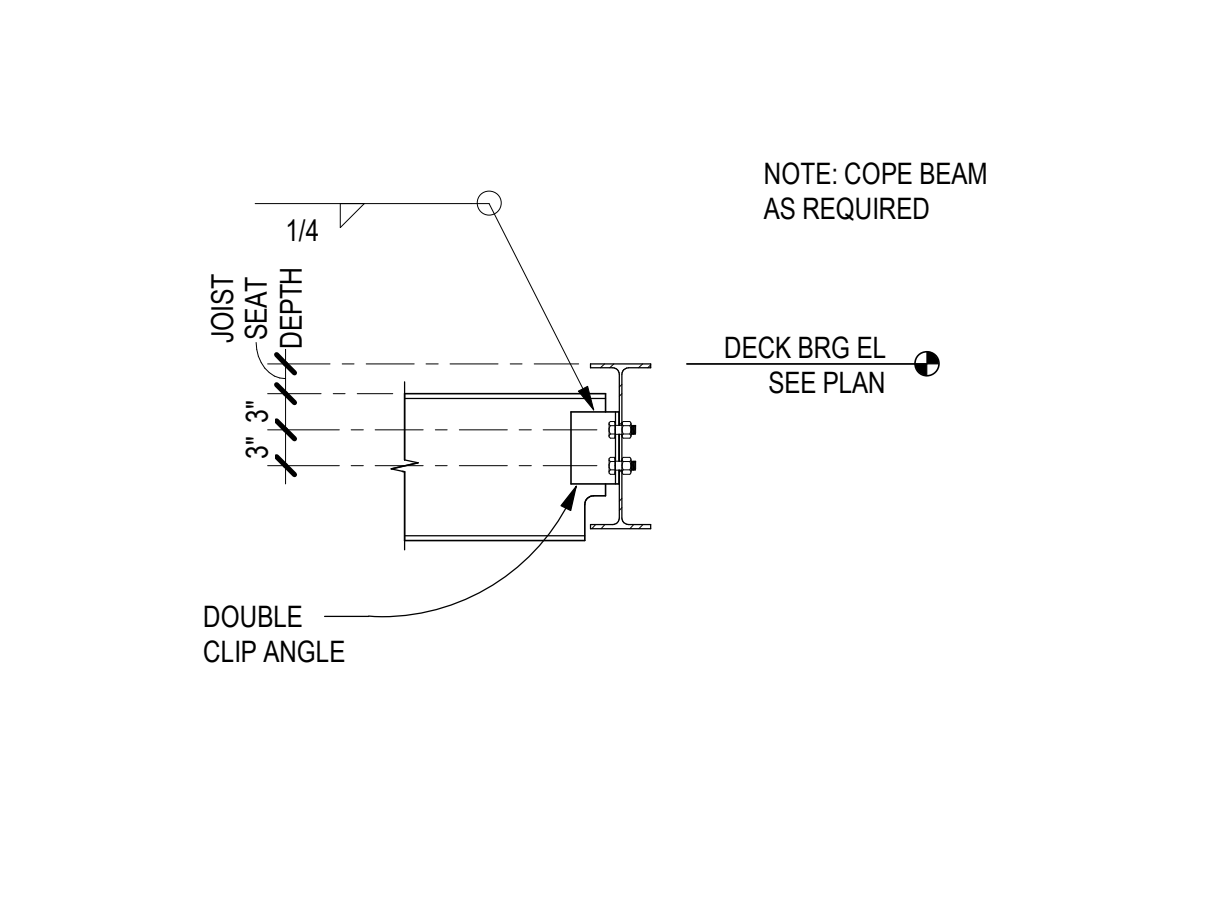

A2 **BEAM TO BEAM CONN**
SCALE: 3/4" = 1'-0"

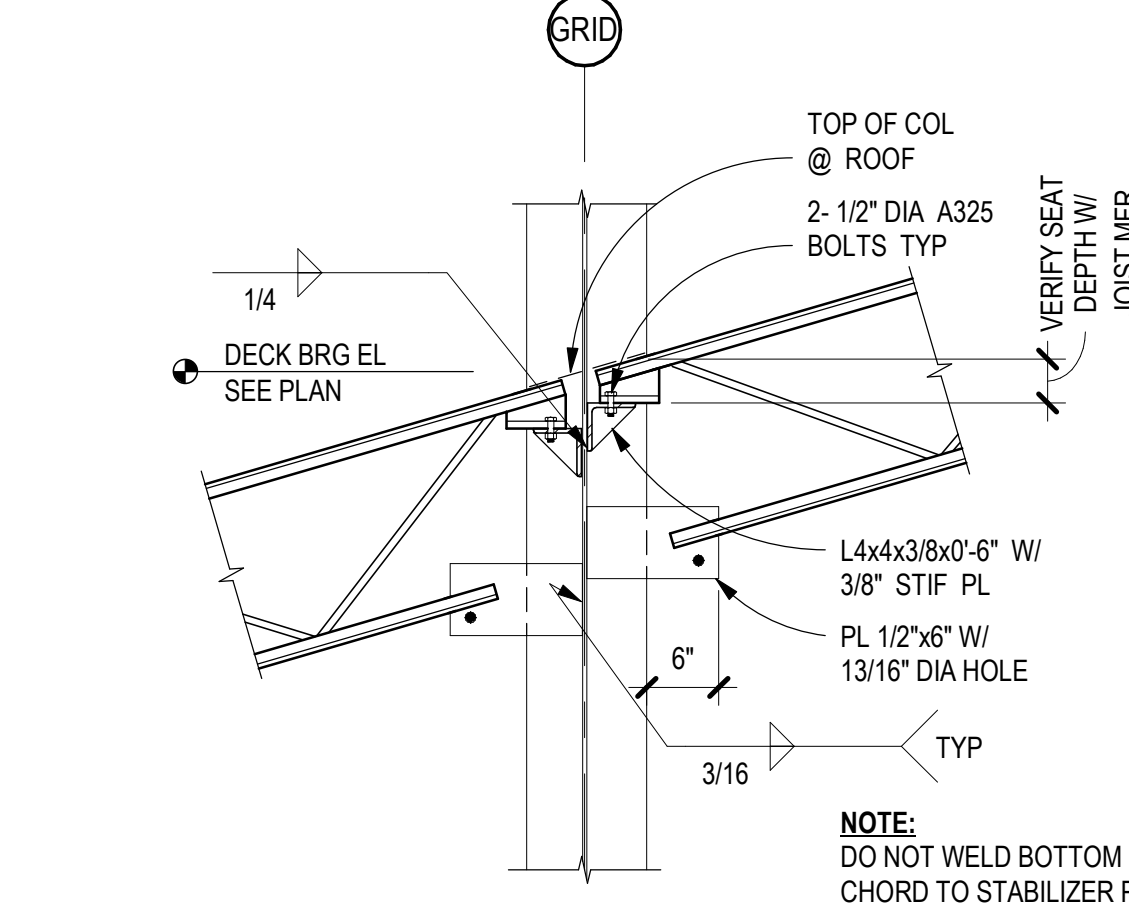

A3 **JOIST TO COLUMN CONN**
SCALE: 3/4" = 1'-0"

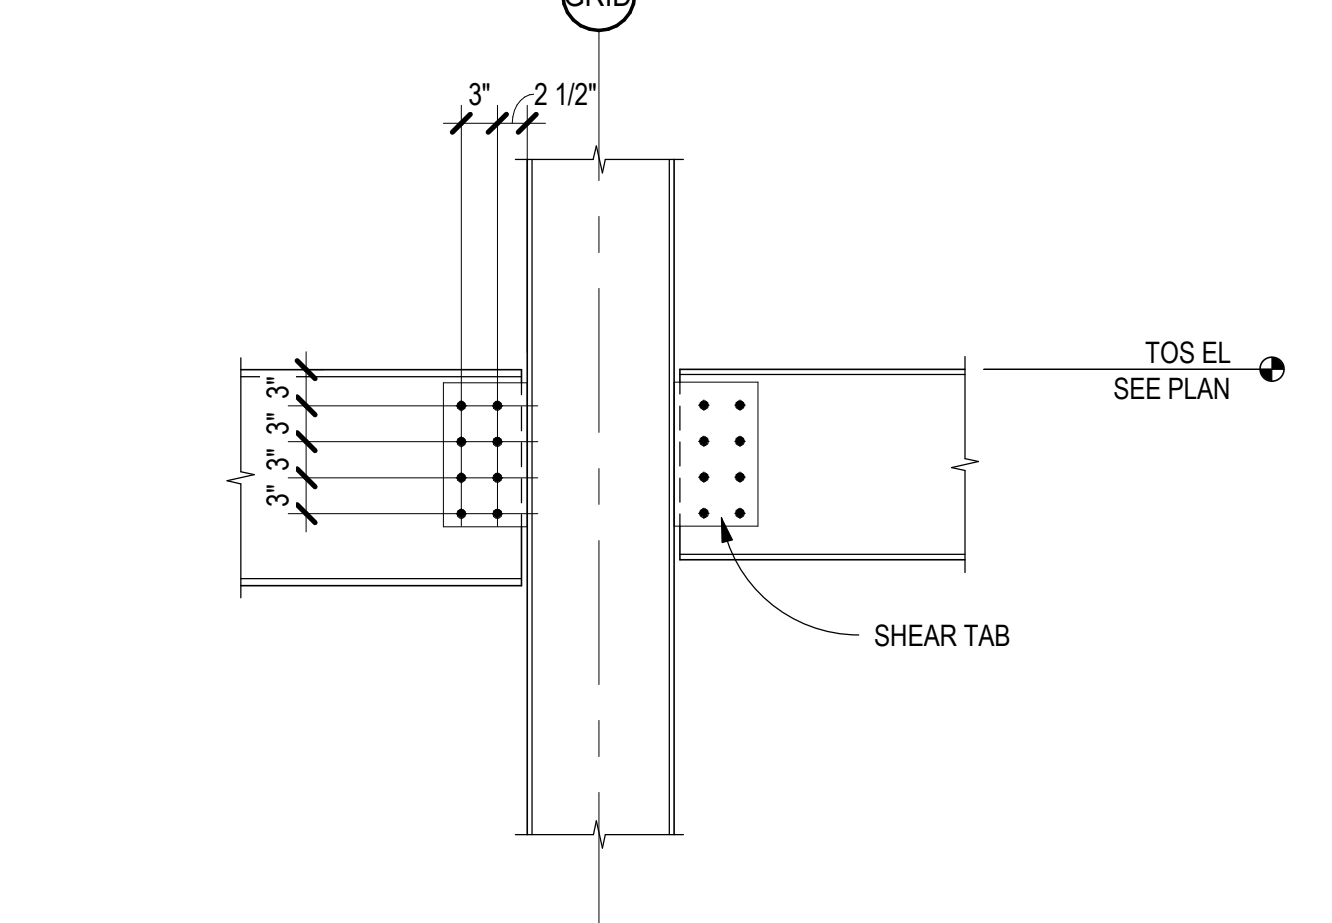

A4 **BEAM TO COL - 2 ROWS OF BOLTS**
SCALE: 3/4" = 1'-0"



1. PROVIDE 1/4" CAP PLATE AT THE TOP OF ALL HOLLOW STRUCTURAL STEEL (HSS) COLUMNS UNLESS NOTED OTHERWISE.
2. PROVIDE 1/4" CAP PLATE AT THE TOP OF ALL PIPE COLUMNS UNLESS NOTED OTHERWISE.
3. PROVIDE 1/2" CAP PLATE AT THE TOP OF ALL WIDE FLANGE COLUMNS UNLESS NOTED OTHERWISE.
4. PROVIDE 1/4" END PLATE AT ALL EXPOSED HSS MEMBERS UNLESS NOTED OTHERWISE.
5. ALL CONNECTION CLIP ANGLES SHALL BE L4x4x3/8 UNLESS NOTED OTHERWISE. BOLT ANGLE TO SUPPORTING MEMBER UNLESS NOTED OTHERWISE.
6. ALL CONNECTION SHEAR TABS SHALL BE PL 3/8" UNLESS NOTED OTHERWISE. PROVIDE 5/16" FILLET WELD EACH SIDE OF SHEAR TAB TO SUPPORTING MEMBER.
7. ALL BOLTS SHALL BE 3/4" DIAMETER A325N IN SHORT SLOTS AS FOLLOWS UNLESS NOTED OTHERWISE:
2 @ W8, W10
3 @ W12
4 @ W14, W16
5 @ W18, S21
6 @ W24
7 @ W27
8 @ W30
9 @ W33
10 @ W36
11 @ W40
12 @ W44

A5 **TYPICAL STEEL CONN NOTES**
SCALE: 3/4" = 1'-0"


KEY PLAN

PROJECT PHASE
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

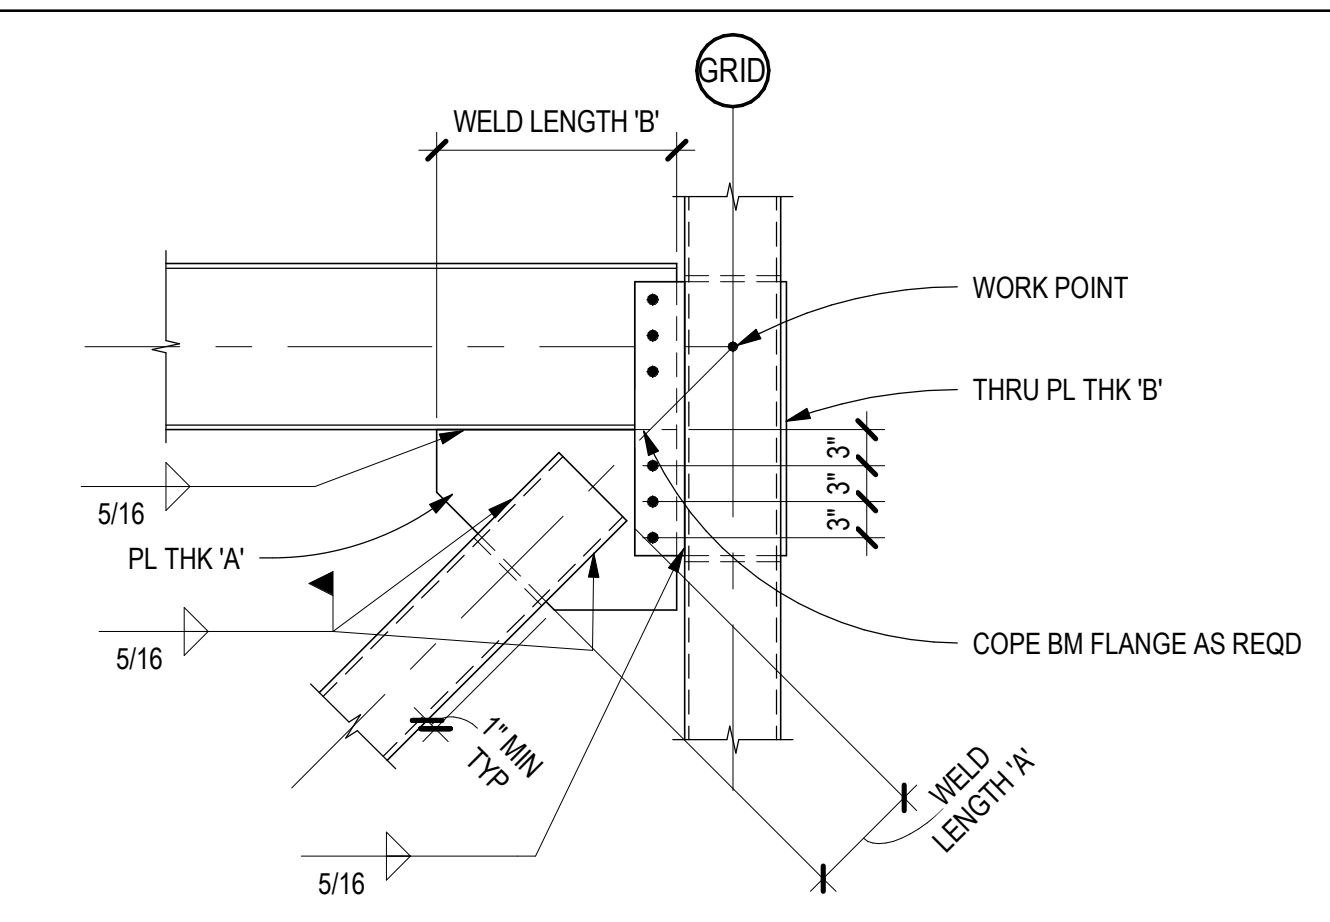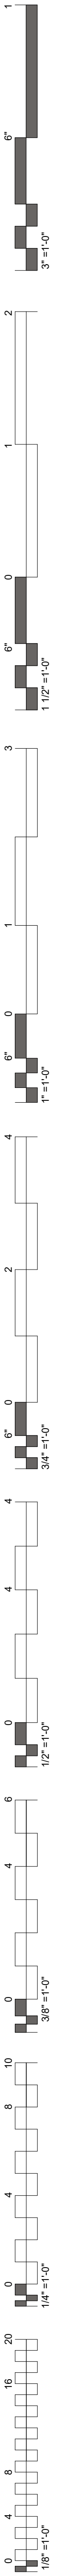

D2 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"

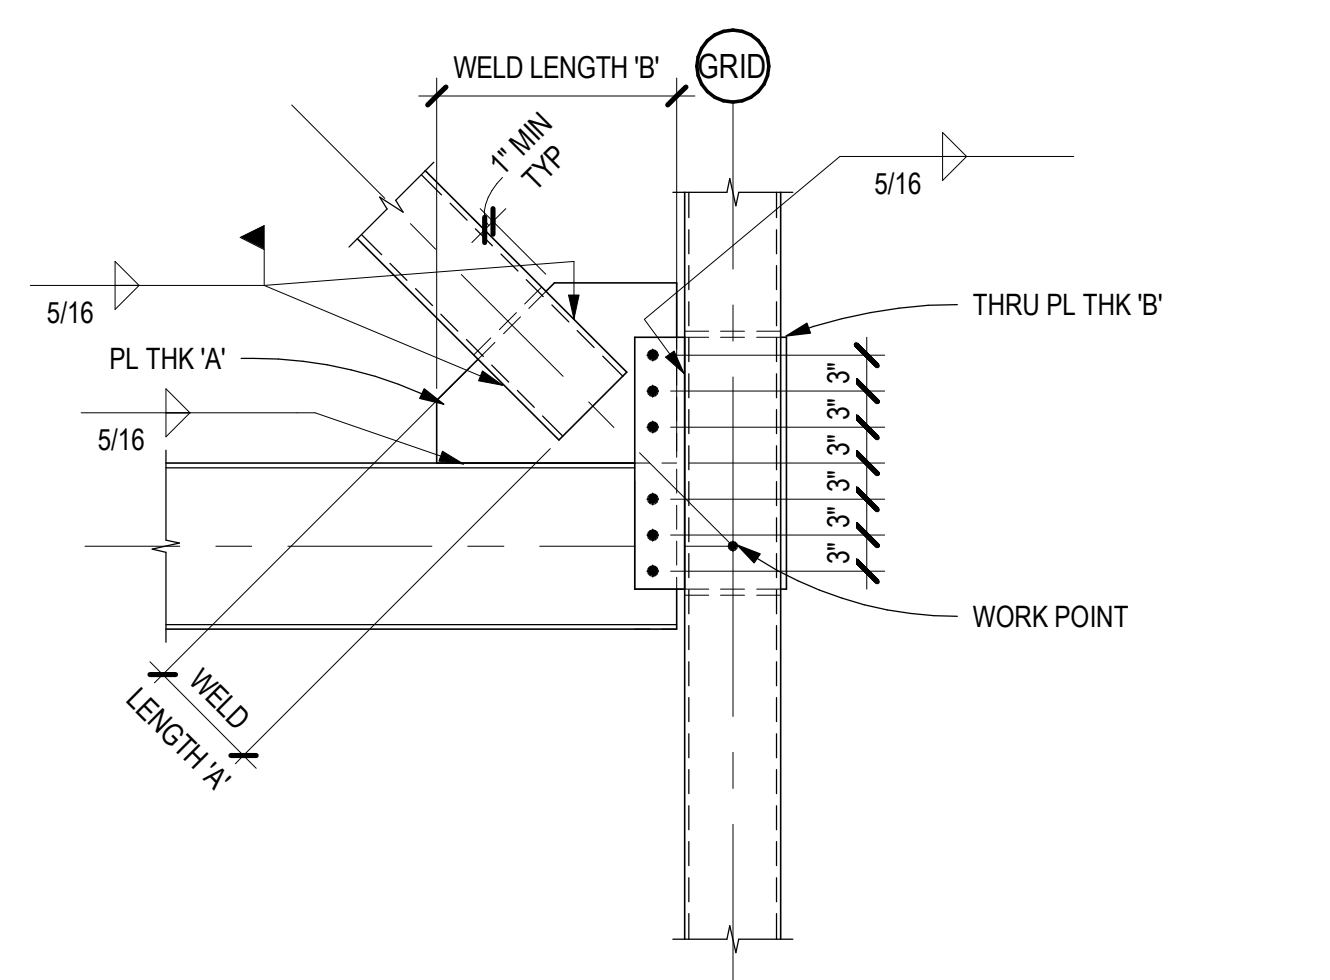


D3 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"

B2 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"


CONNECTION SCHEDULE					
BRACE SIZE	PL THK 'A'	THRU PL THK 'B'	WELD LENGTH 'A'	WELD LENGTH 'B'	GUSSET PL BOLTS
HSS4x4	5/8"	5/8"	4"	20"	3
HSS5x5	5/8"	5/8"	5"	20"	3
HSS6x6	5/8"	5/8"	6"	22"	3
HSS8x8	3/4"	3/4"	8"	24"	4
HSS12x8	1"	1"	12"	28"	5

NOTES
1. LENGTHS GIVEN ARE SINGLE-SIDE LENGTHS AND MINIMUM LENGTHS
2. LONGER GUSSET/WELD LENGTHS MAY BE REQ'D WHERE BRACE SLOPE VARIES FROM 1:1
3. ALL BOLTS IN STANDARD HOLES


C3 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"

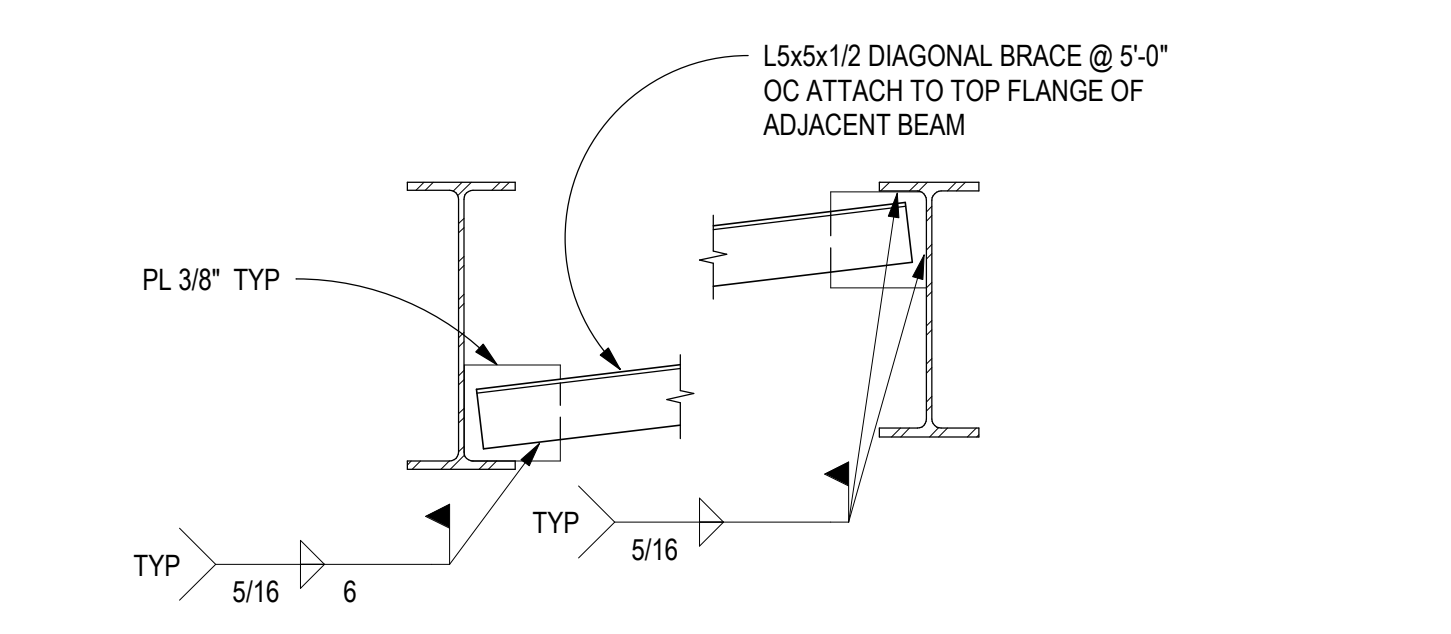

B3 DIAG ANGLE AT MOMENT CONN
SCALE: 3/4" = 1'-0"

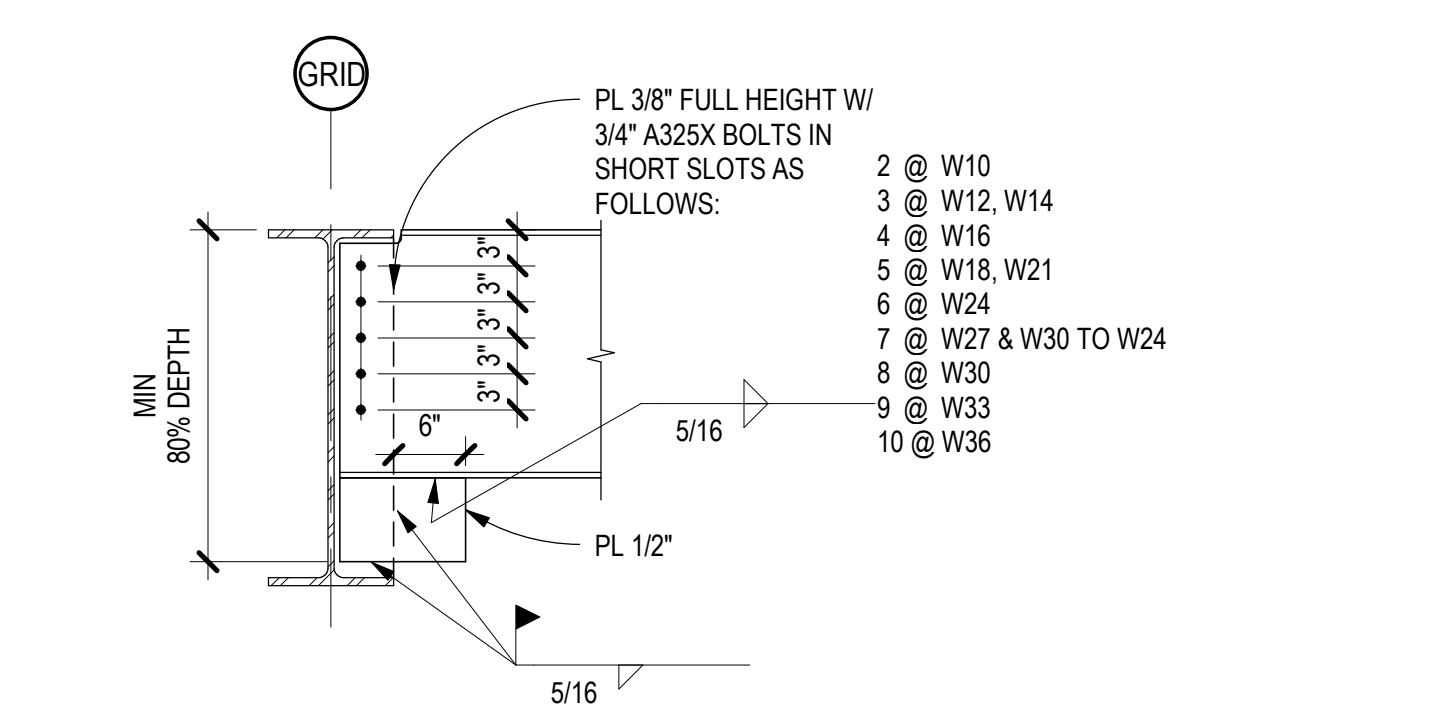


A3 BEAM CONN AT MOMENT (WUF) CONN
SCALE: 3/4" = 1'-0"

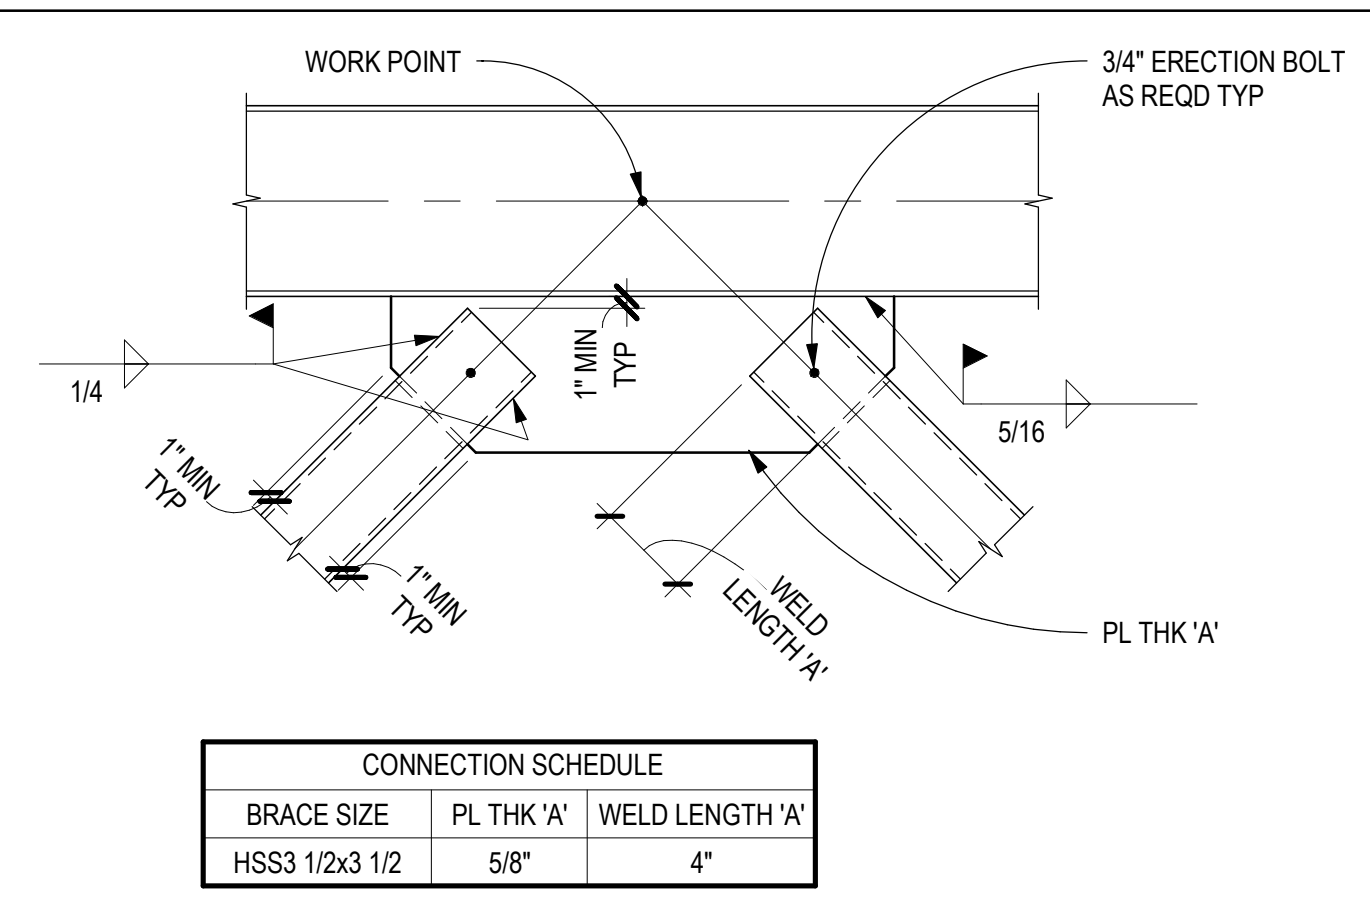


D4 CANOPY COLLECTOR BLOCKING
SCALE: 3/4" = 1'-0"


C4 SWING SUPPORT BETWEEN JOISTS
SCALE: 3/4" = 1'-0"

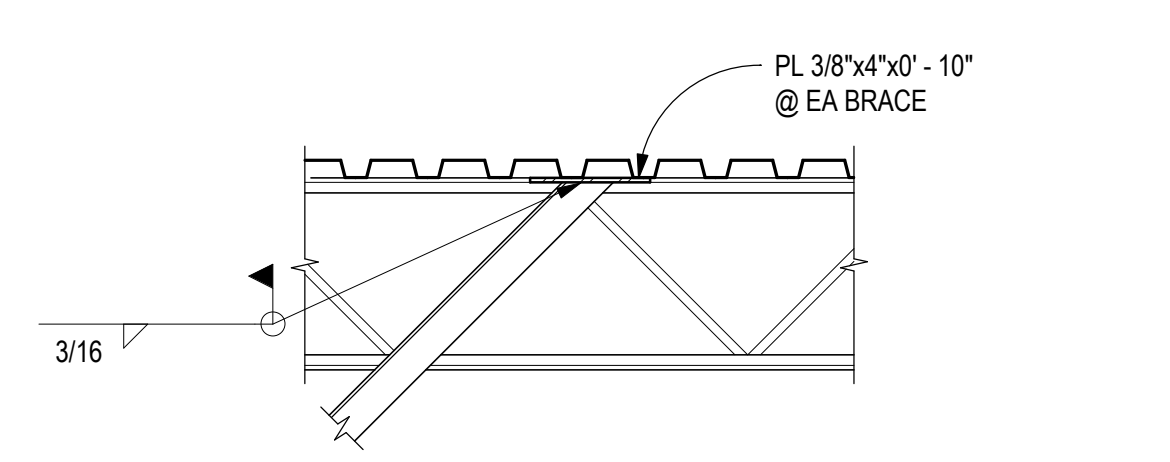

B4 LIGHT SUPPORT BETWEEN JOISTS
SCALE: 3/4" = 1'-0"

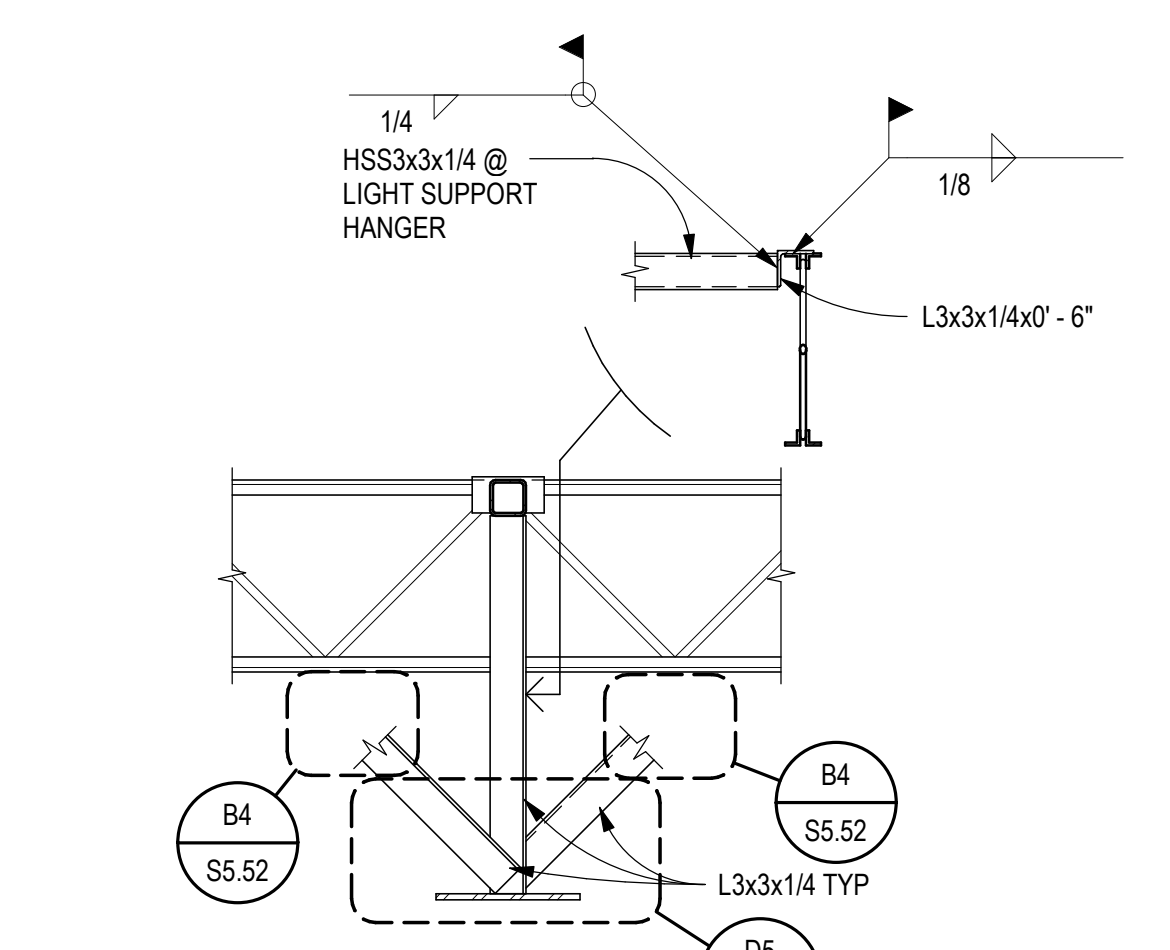


A4 LIGHT SUPPORT BETWEEN JOISTS
SCALE: 3/4" = 1'-0"

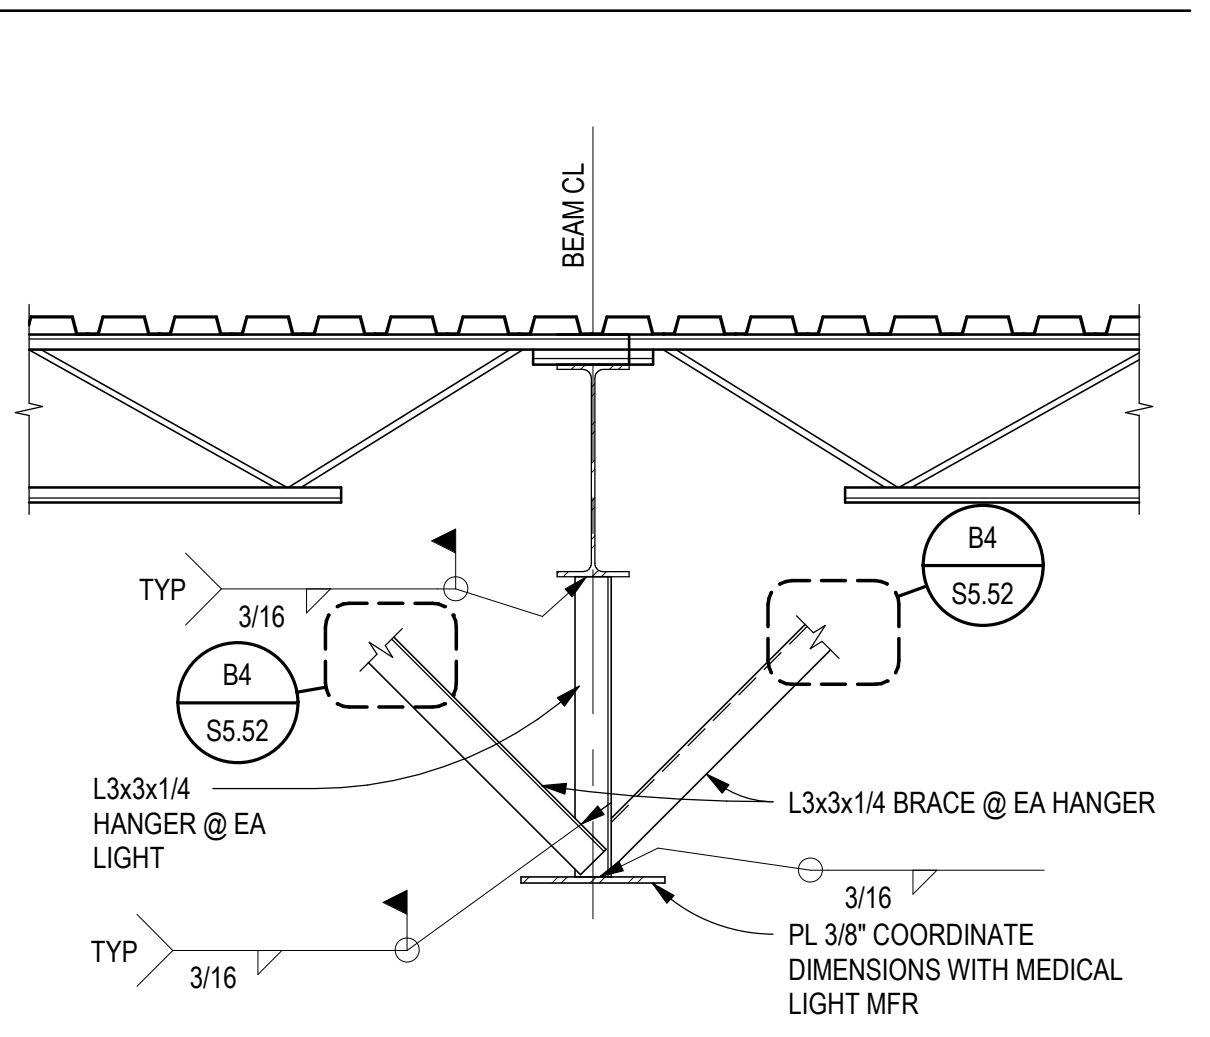


D5 MEDICAL LIGHT SUPPORT
SCALE: 3/4" = 1'-0"

C5 SURGICAL LIGHT SUPPORT
SCALE: 3/4" = 1'-0"


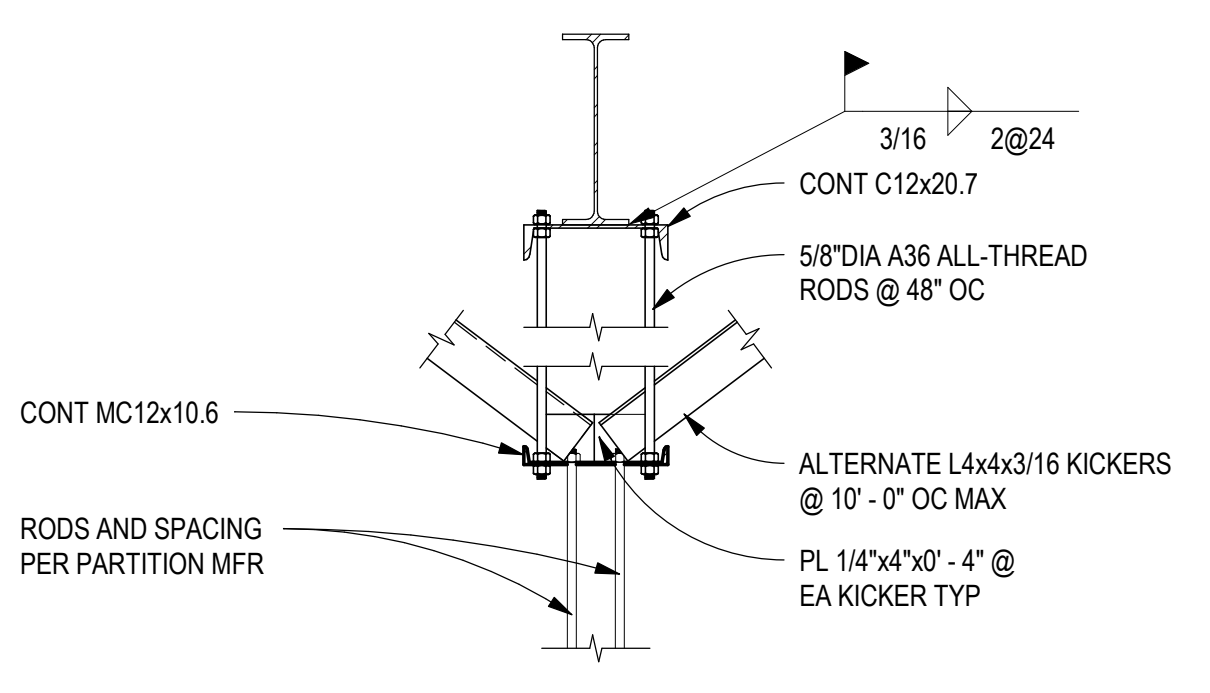


B5 PARTITION SUPPORT SECTION
SCALE: 3/4" = 1'-0"

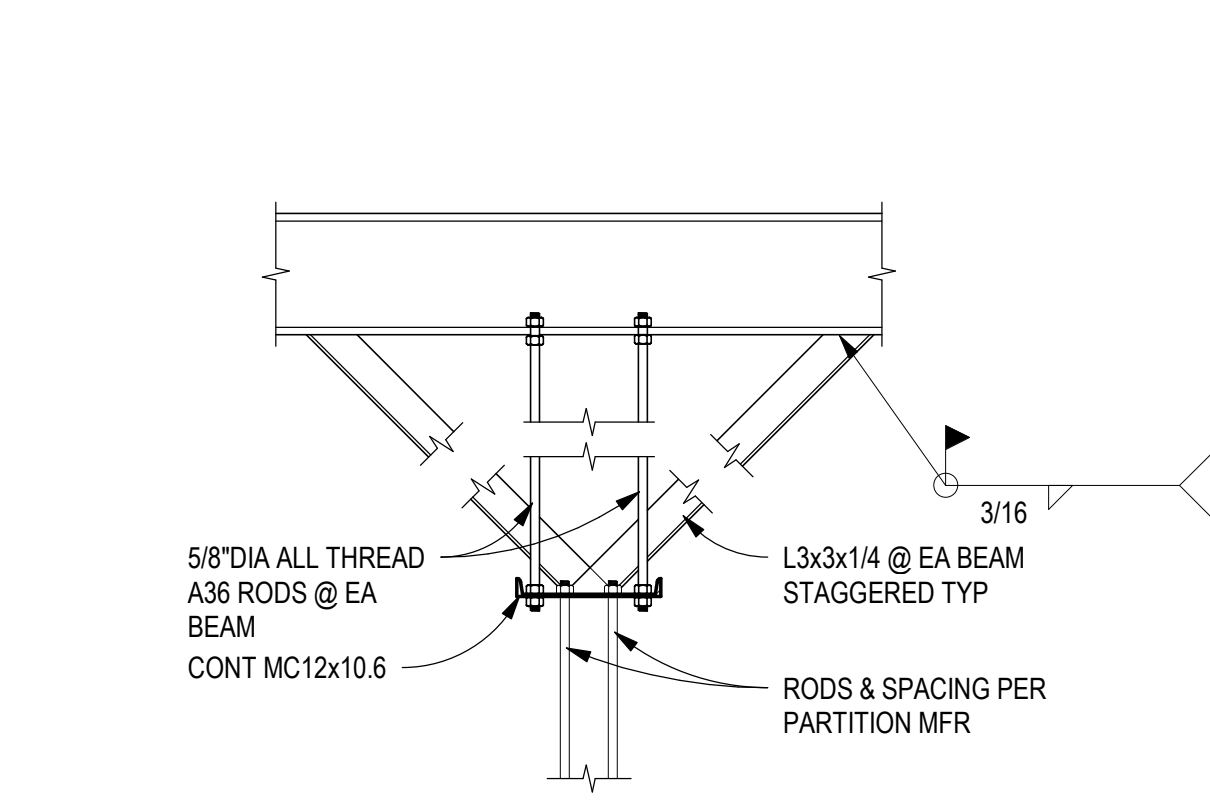

A5 PARTITION FRAMING SECTION
SCALE: 3/4" = 1'-0"

A1 COLLECTOR FRAMING DETAIL
SCALE: 3/4" = 1'-0"

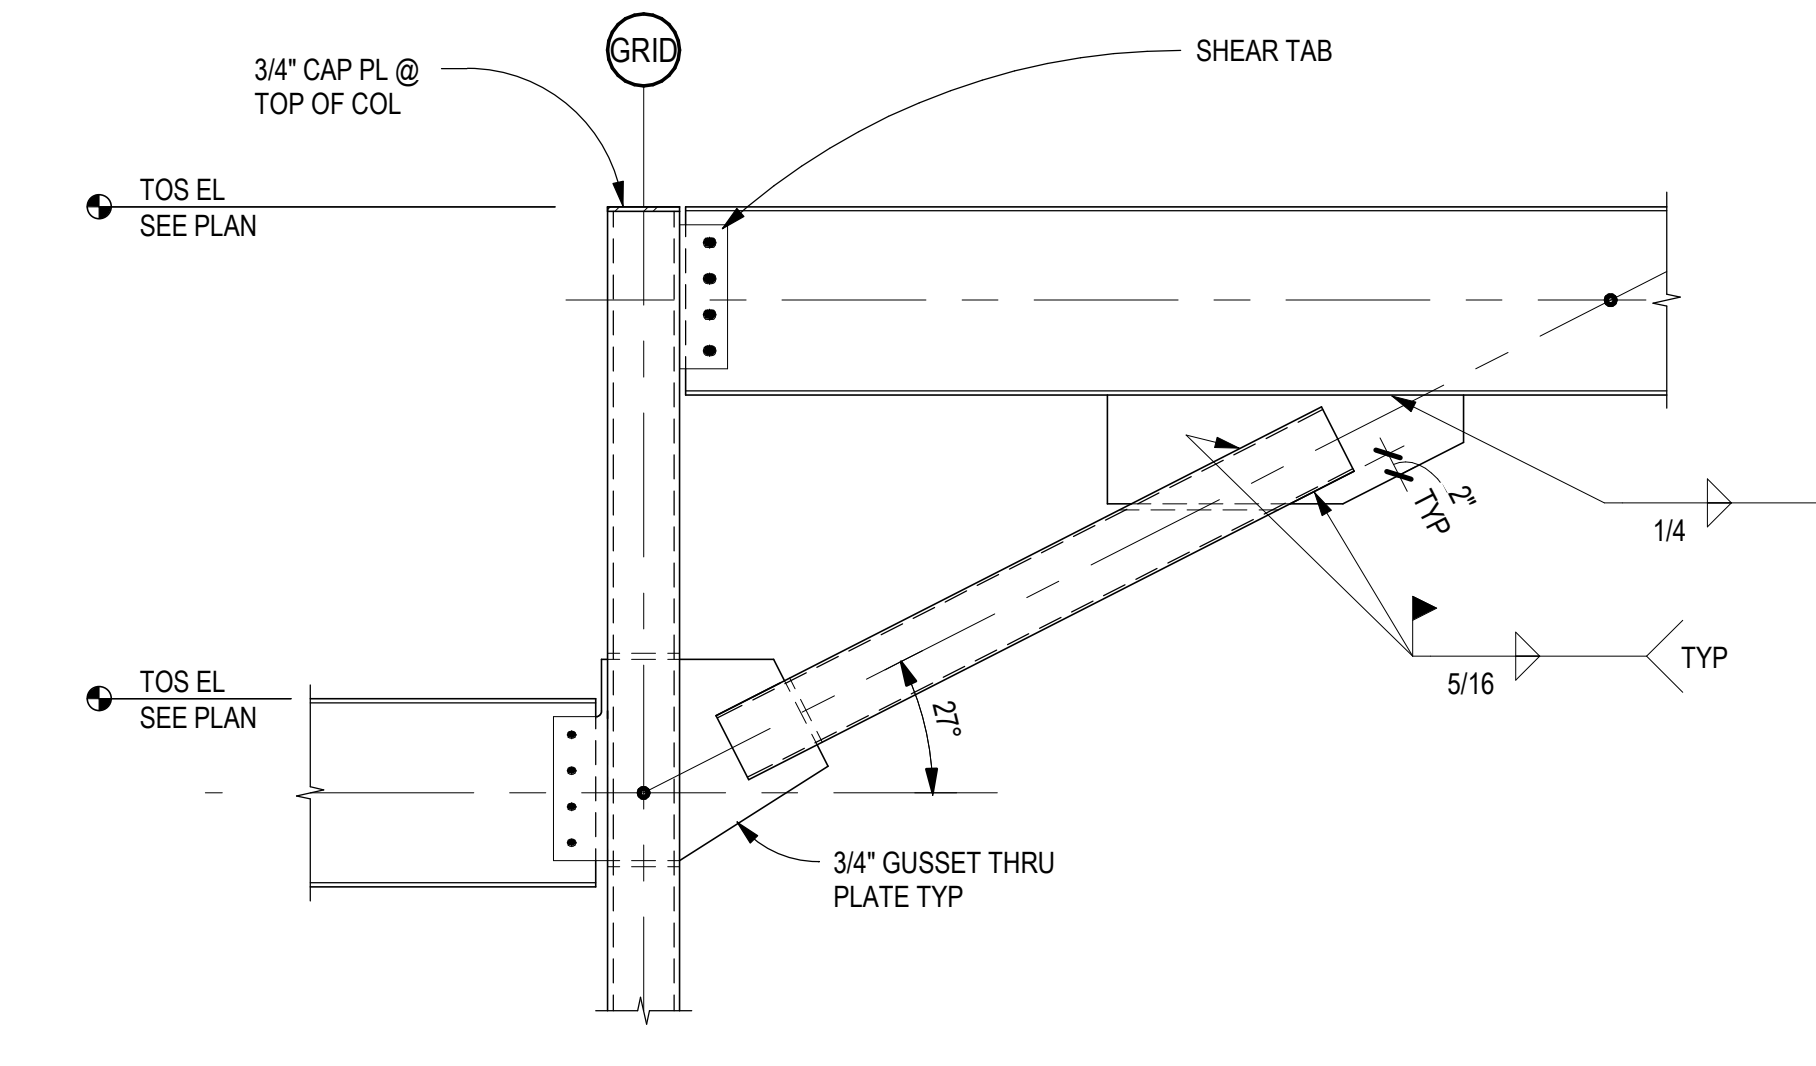

KEY PLAN:

PROJECT PHASE:
BID PACKAGE 01



#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:

S5.52


STEEL DETAILS

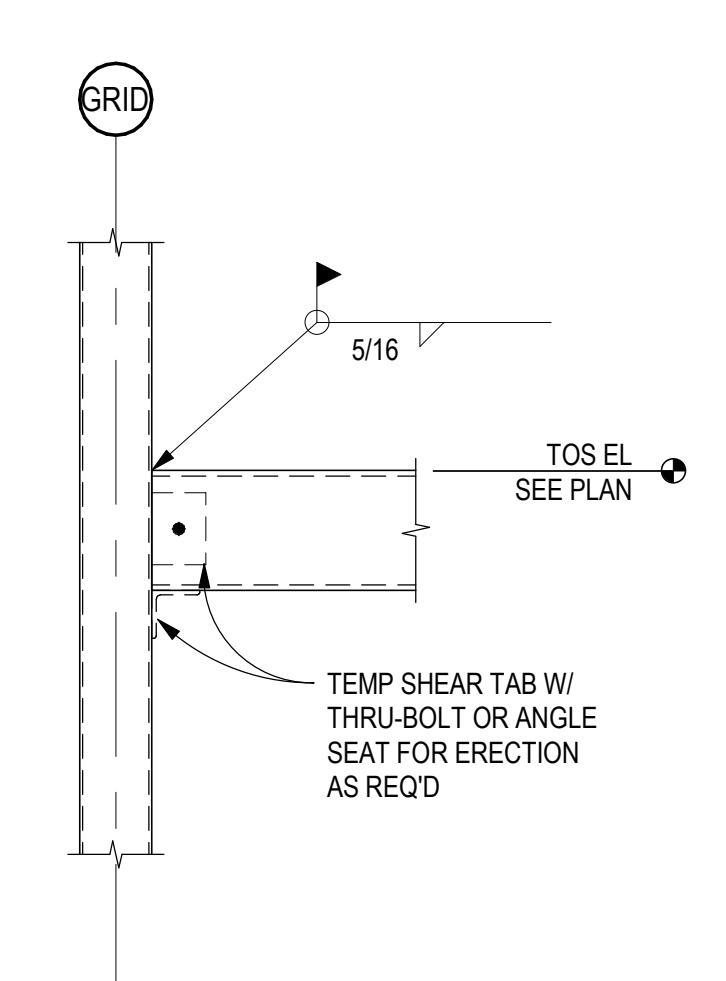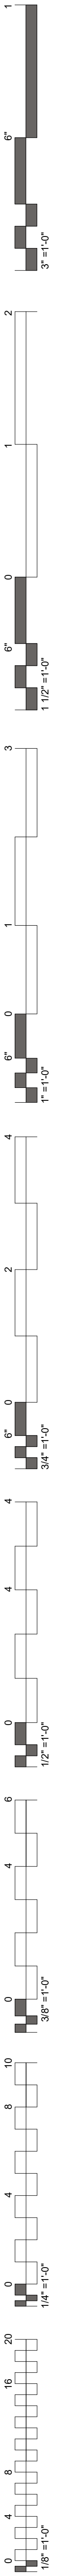


D1 HSS TO COLUMN WITH PARTIAL FIXITY
SCALE: 3/4" = 1'-0"

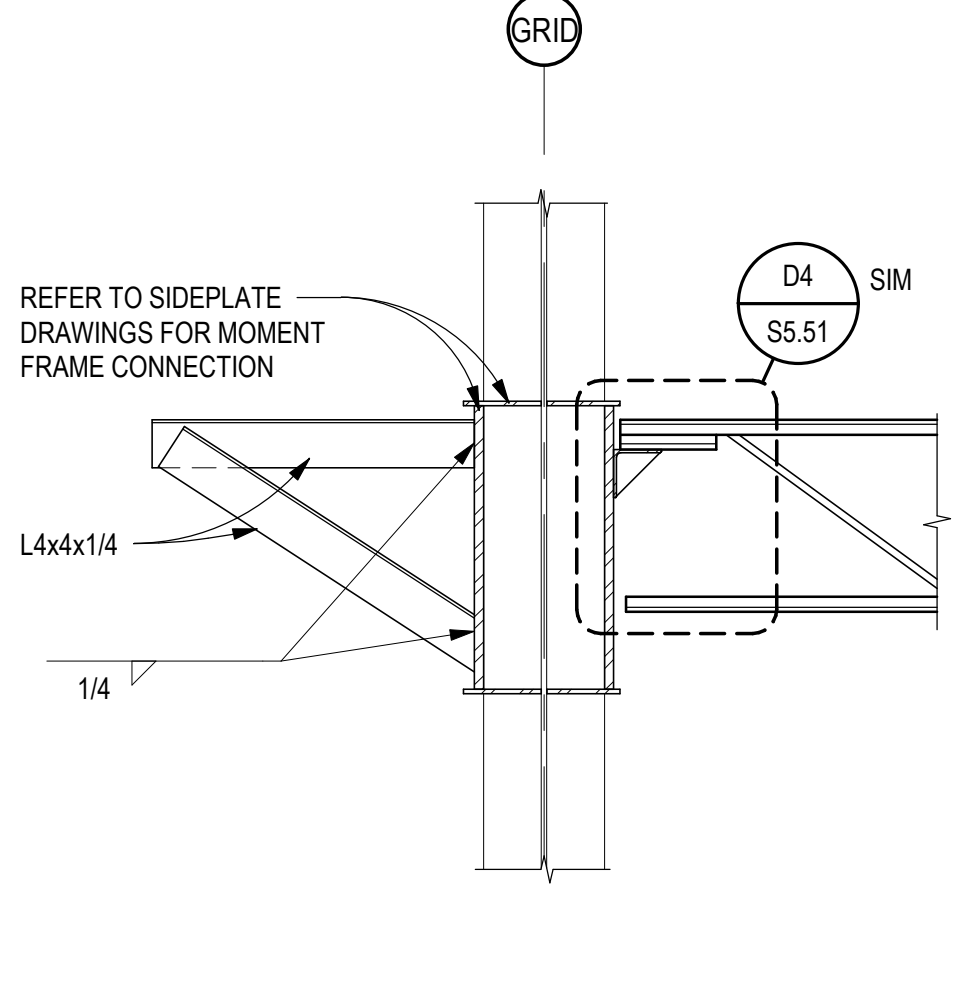


D2 BM TO COL WEB CONN AT SIDEPLATE
SCALE: 3/4" = 1'-0"

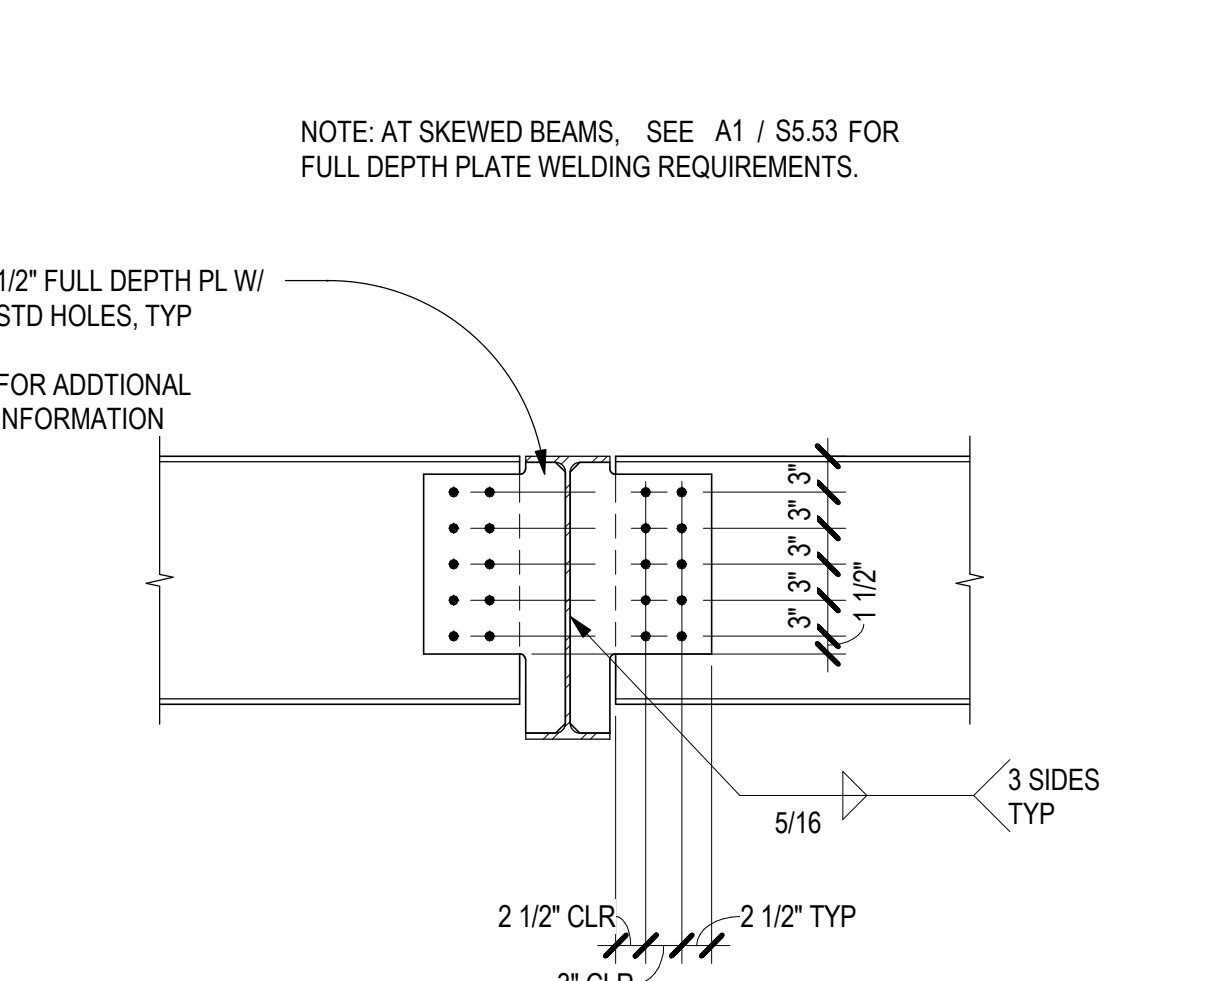


D3 BEAM TO BEAM COLLECTOR DETAIL
SCALE: 3/4" = 1'-0"

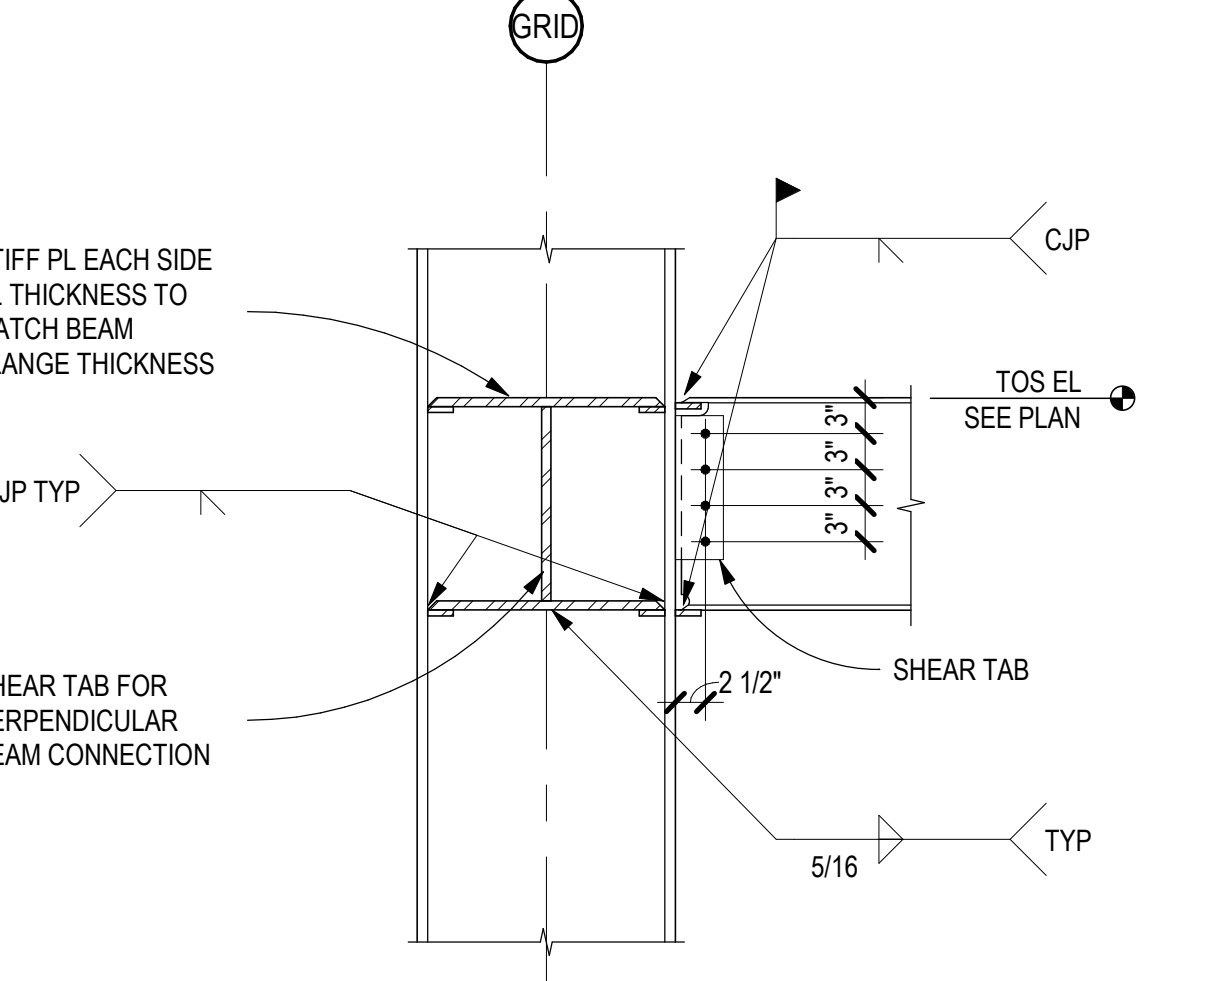


D4 BEAM TO COL FLANGE MOMENT CONN
SCALE: 3/4" = 1'-0"

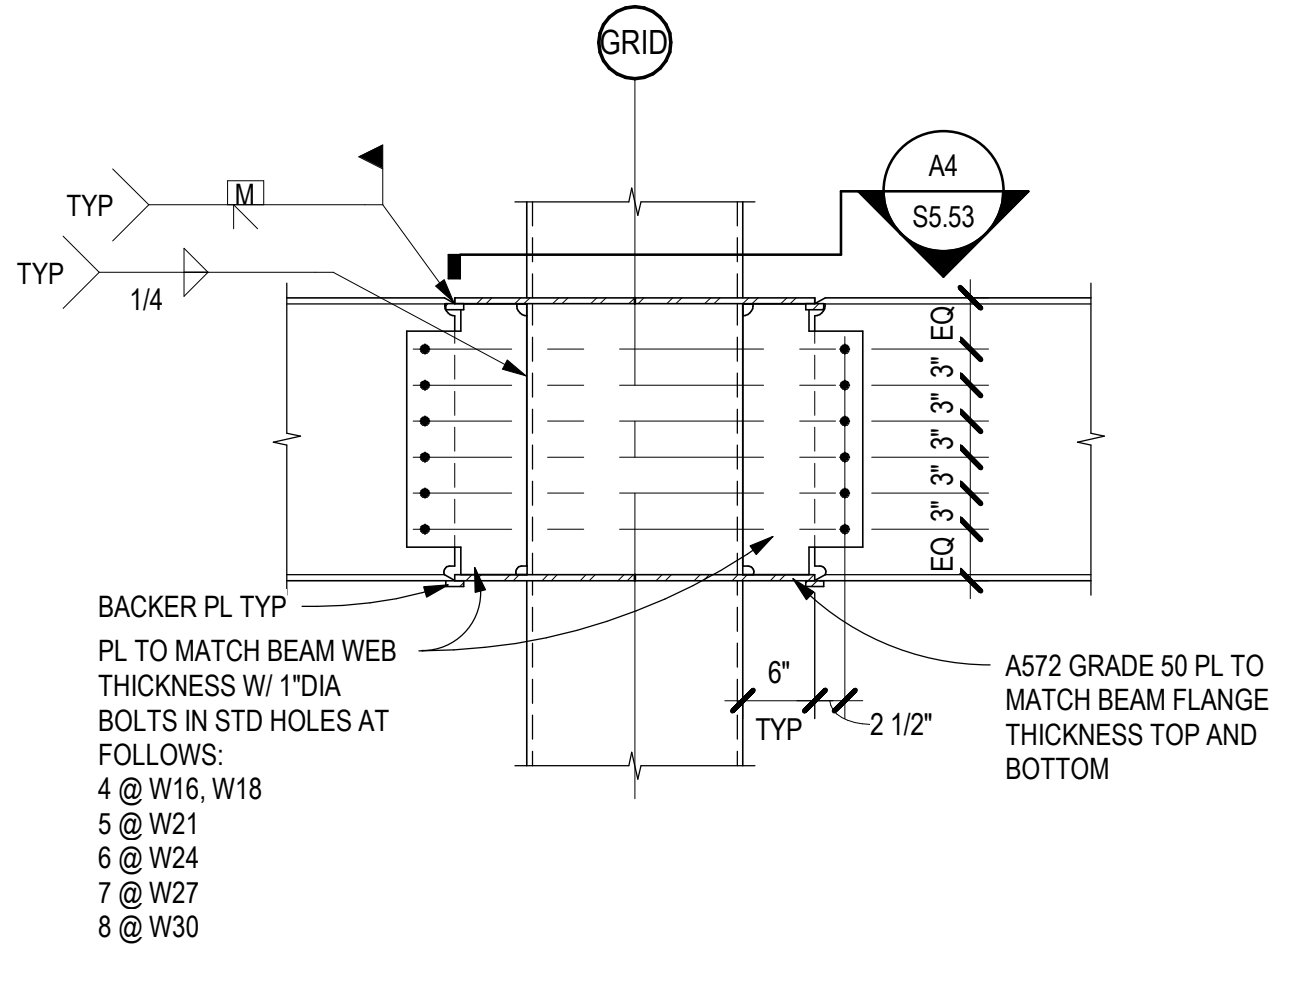


D5 TYPICAL FLANGE PLATE TO COLUMN
SCALE: 3/4" = 1'-0"

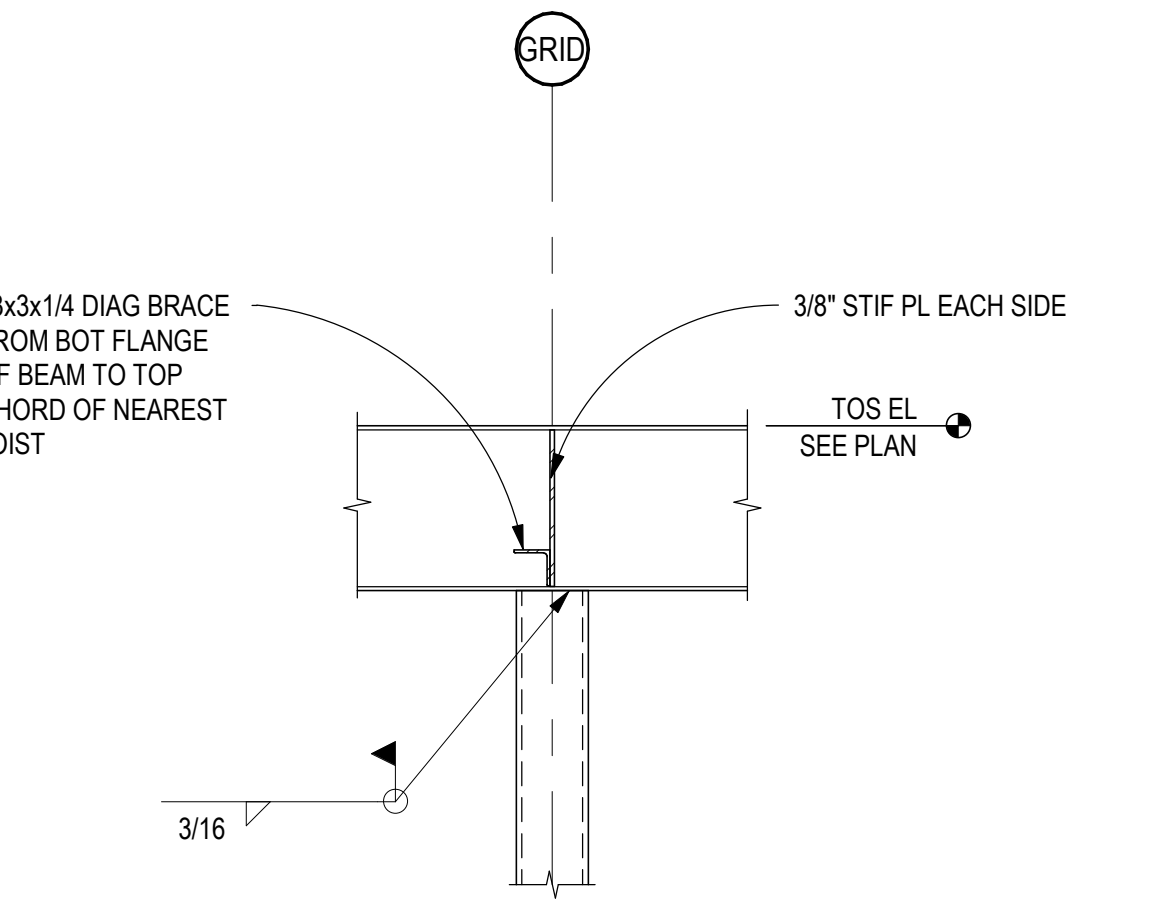



C1 BEAM OVER COLUMN CONN
SCALE: 3/4" = 1'-0"

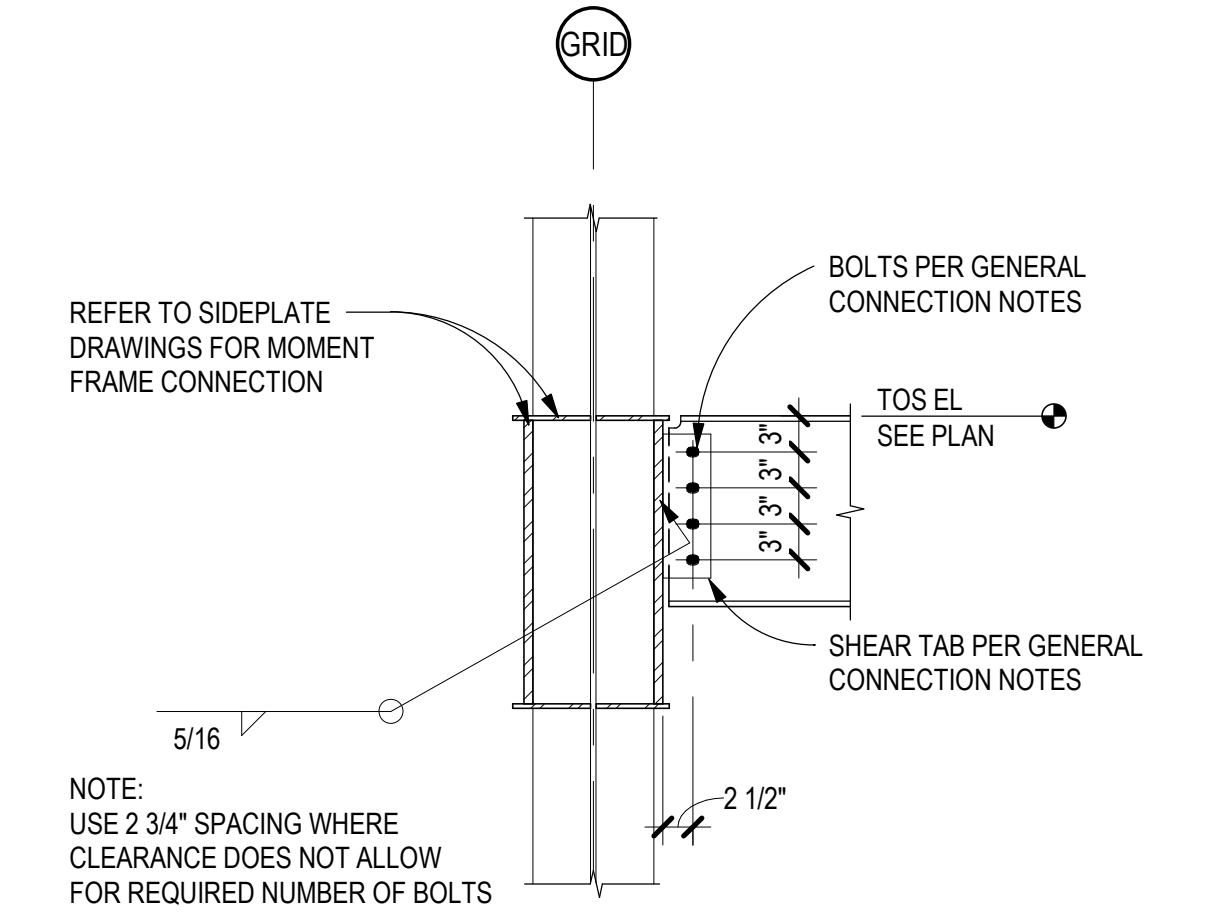

C2 BM TO COL WEB CONN AT SIDEPLATE
SCALE: 3/4" = 1'-0"

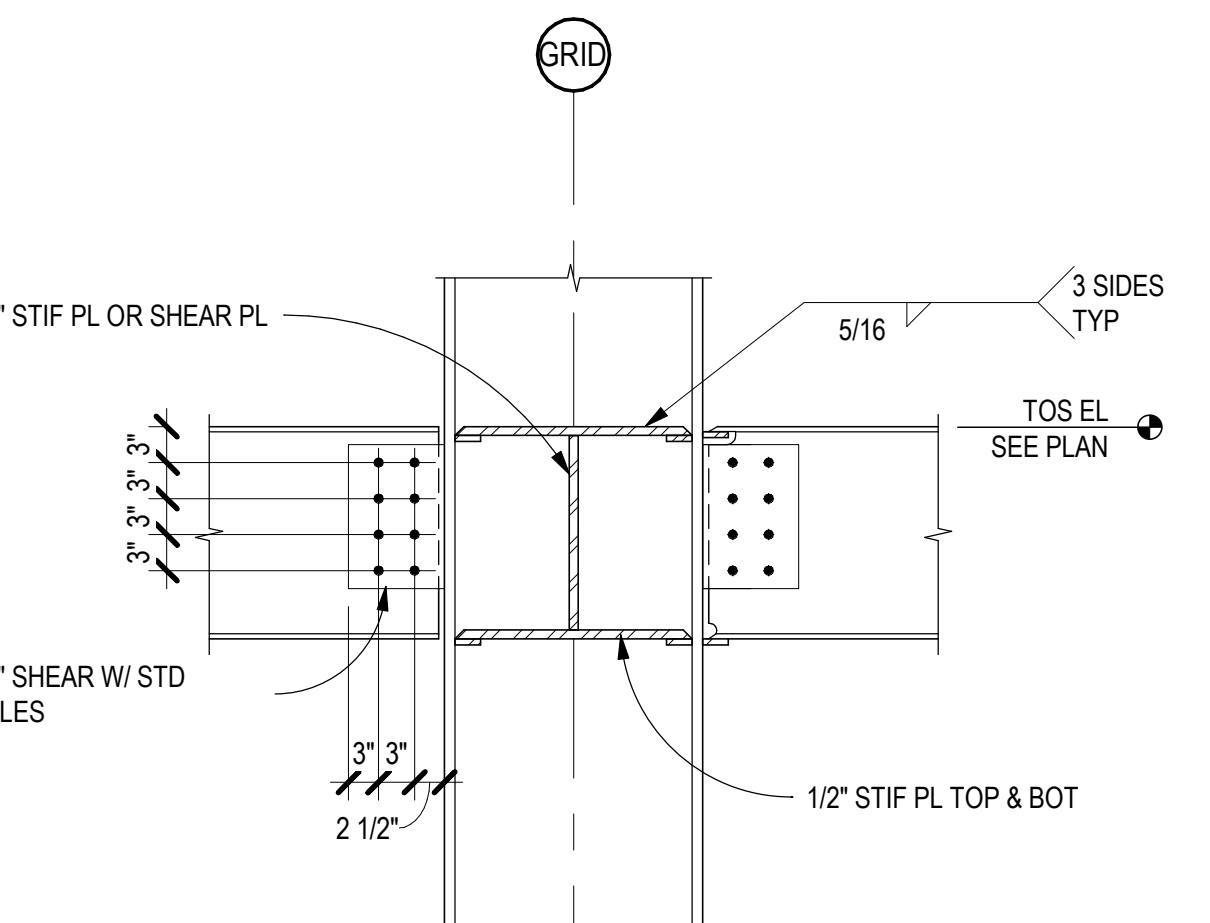


C3 COLLECTOR BM TO COL MOMENT CONN
SCALE: 3/4" = 1'-0"

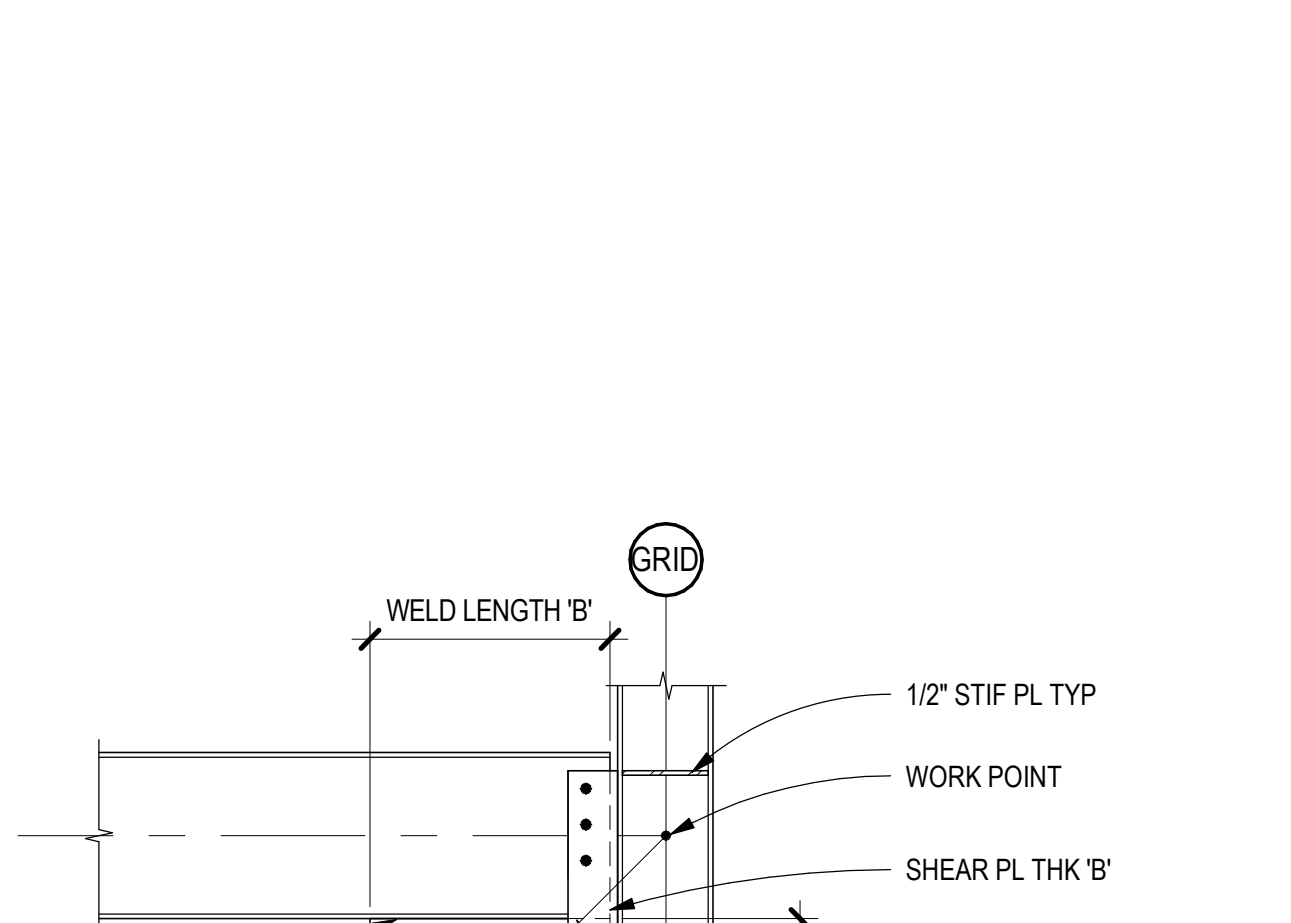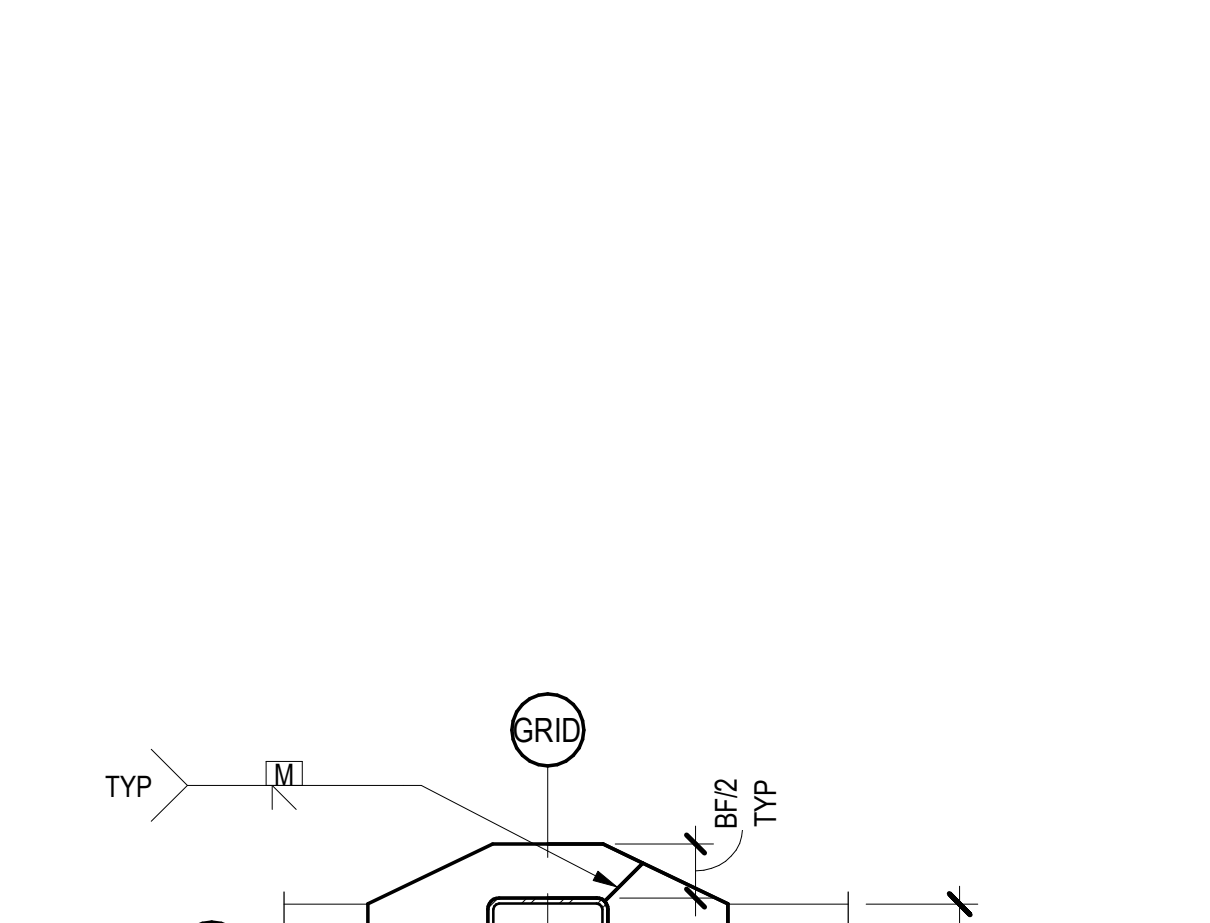


CONNECTION SCHEDULE					
BRACE SIZE	PL THK 'A'	THRU PL THK 'B'	WELD LENGTH 'A'	WELD LENGTH 'B'	GUSSET PL BOLTS
HSS4x4	5/8"	5/8"	4"	20"	3
HSS5x5	5/8"	5/8"	5"	20"	3
HSS6x6	5/8"	5/8"	6"	22"	3
HSS8x8	3/4"	3/4"	8"	24"	4
HSS12x8	1"	1"	12"	28"	5

NOTES:
 1. LENGTHS GIVEN ARE SINGLE-SIDE LENGTHS AND MINIMUM LENGTHS
 2. LONGER GUSSET/WELD LENGTHS MAY BE REQ'D WHERE BRACE SLOPE VARIES FROM 1:1
 3. ALL BOLTS IN STANDARD HOLES


B5 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"

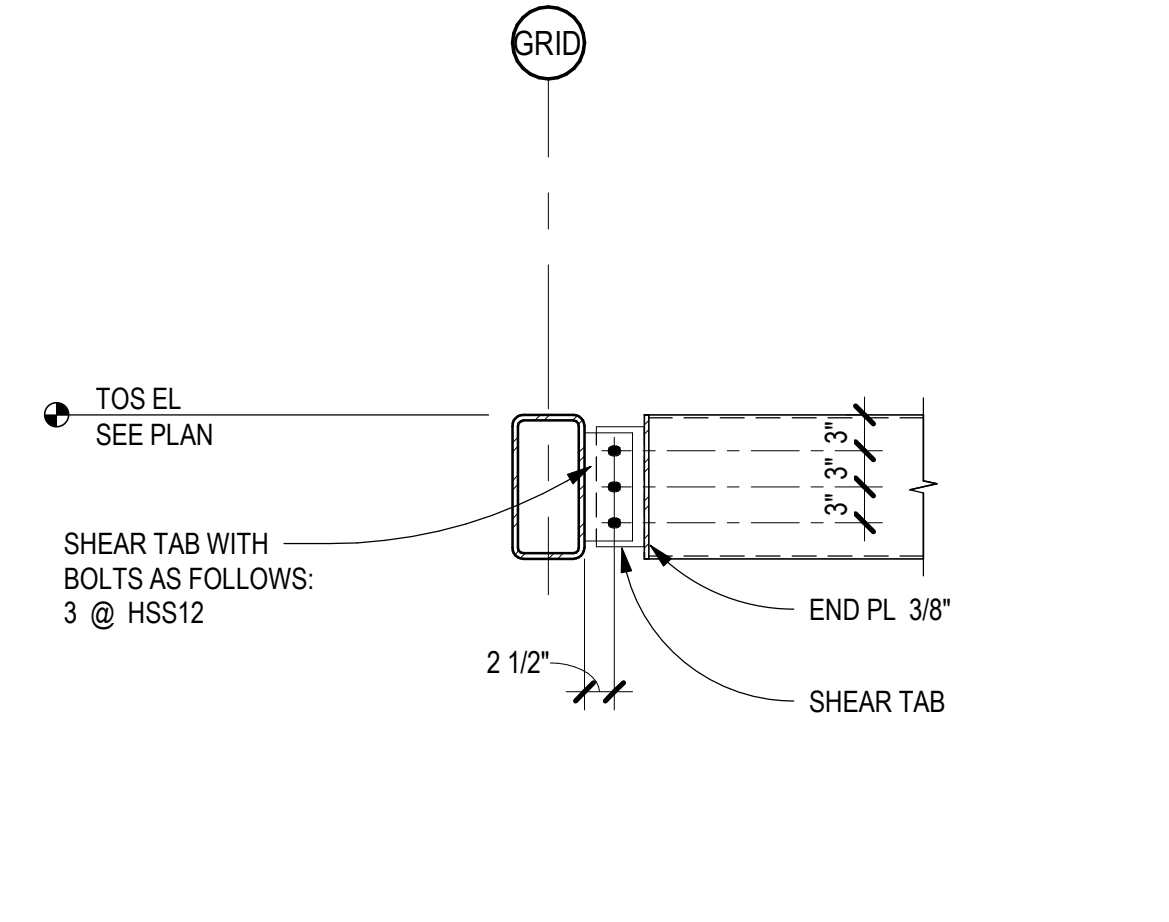



B1 BEAM TO BEAM CONN
SCALE: 3/4" = 1'-0"

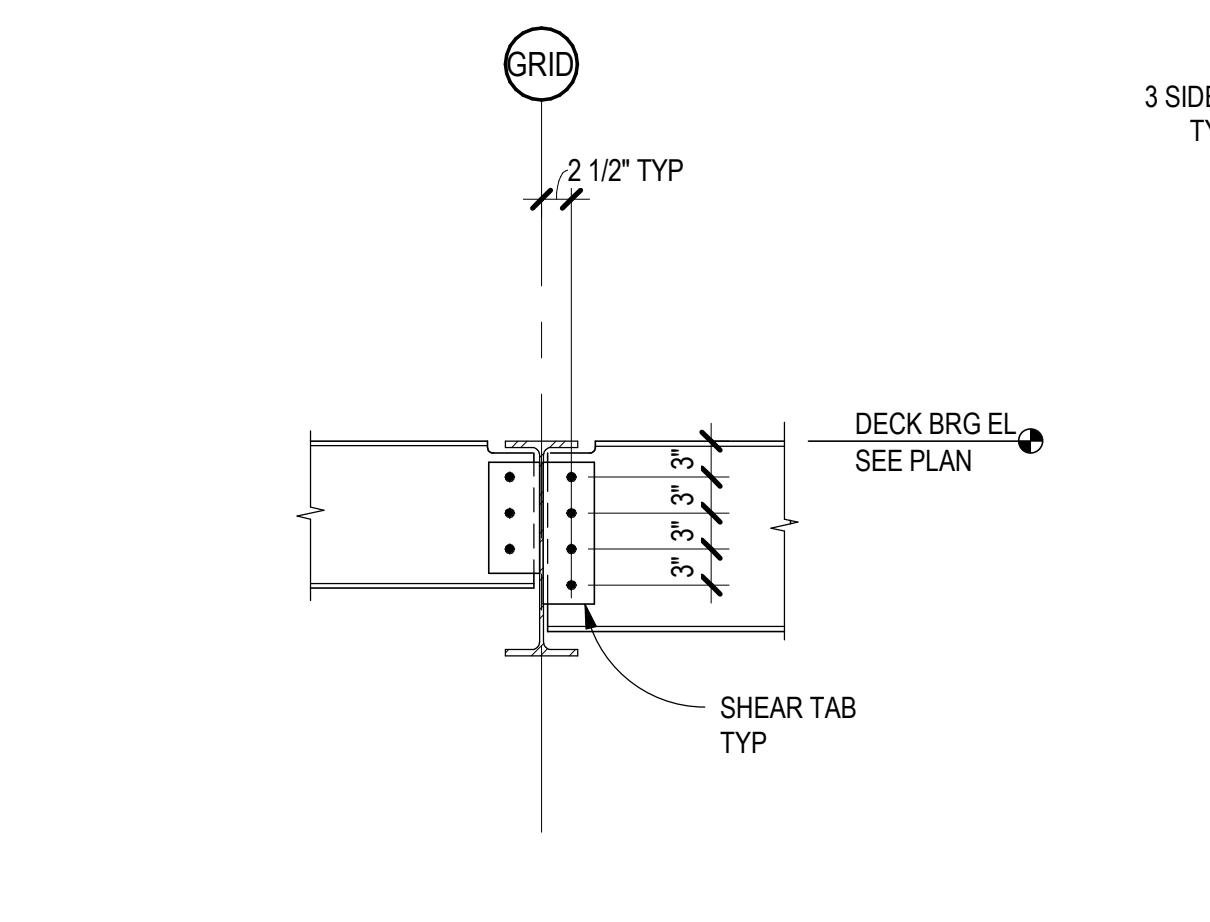

B2 TYPICAL BEAM TO BEAM CONN
SCALE: 3/4" = 1'-0"

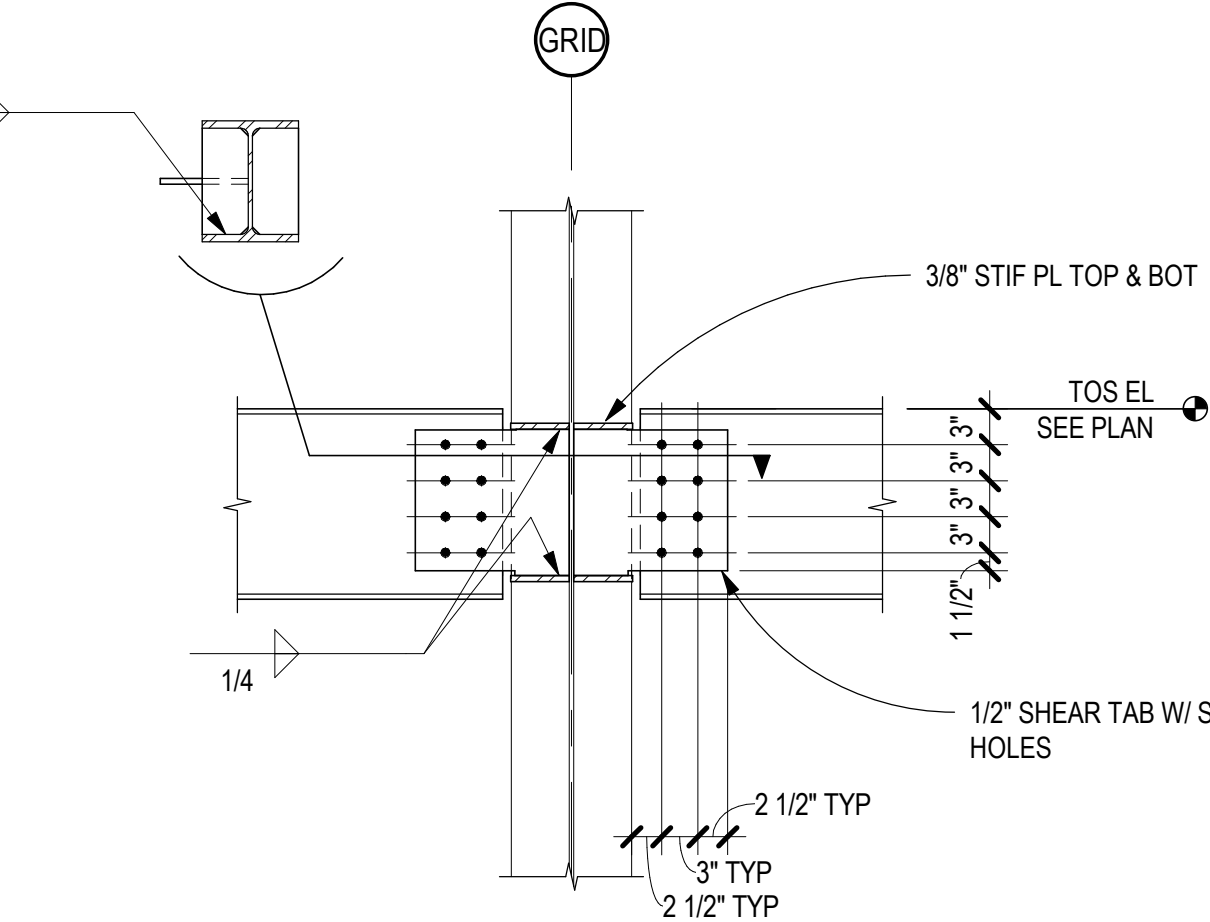


B3 COLLECTOR BM TO COL WEB CONN
SCALE: 3/4" = 1'-0"

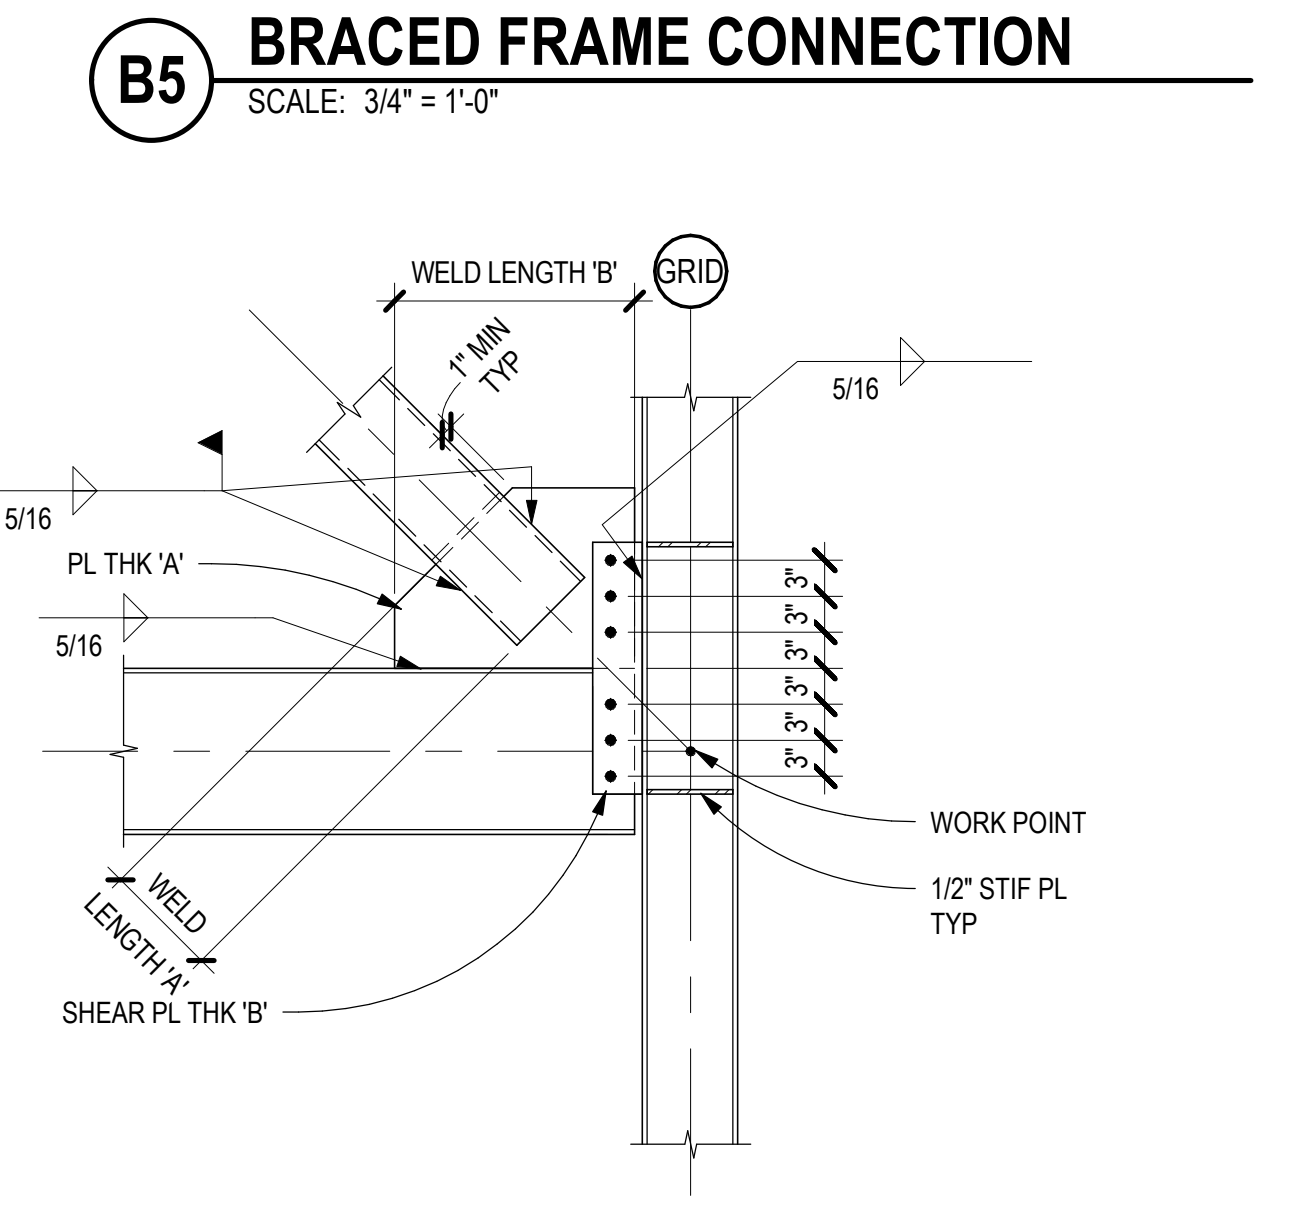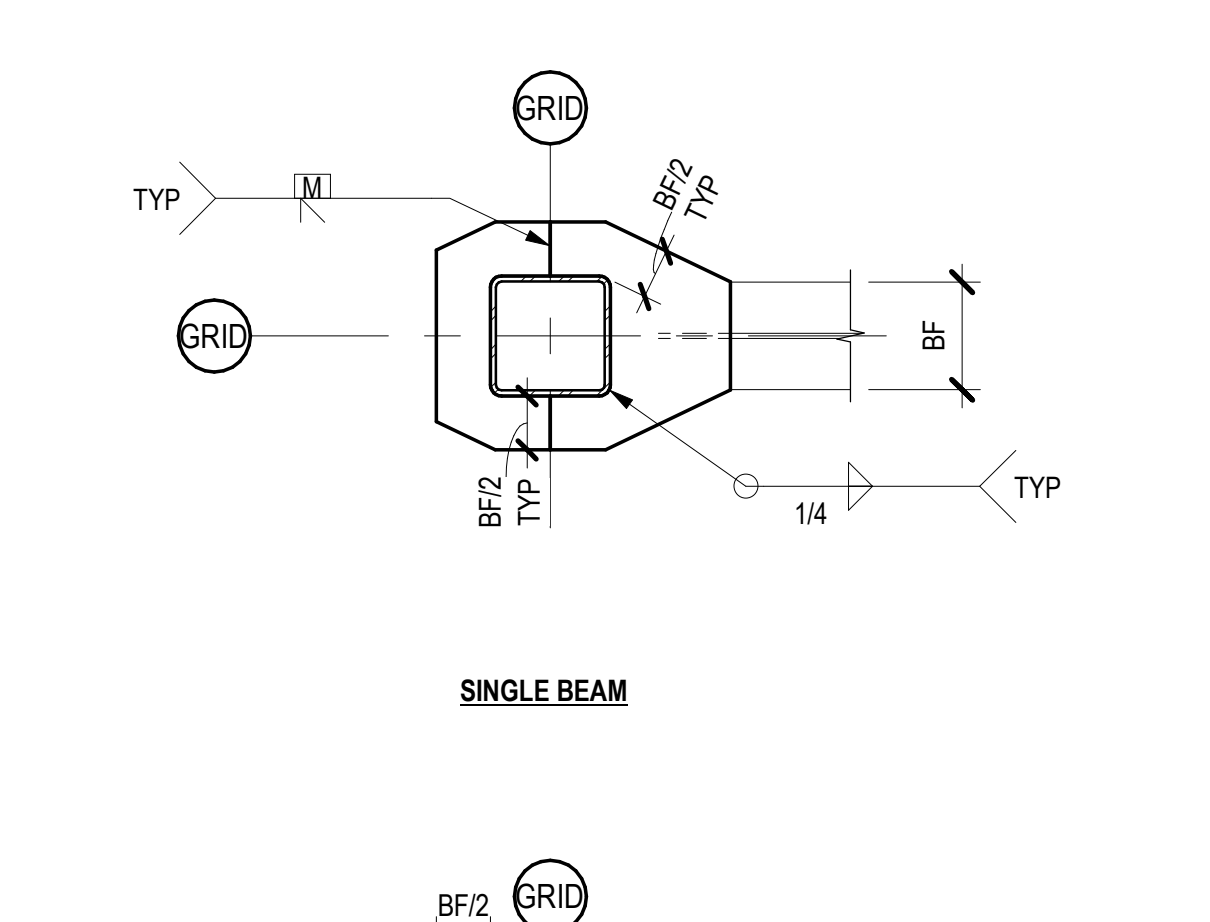


CONNECTION SCHEDULE					
BRACE SIZE	PL THK 'A'	THRU PL THK 'B'	WELD LENGTH 'A'	WELD LENGTH 'B'	GUSSET PL BOLTS
HSS4x4	5/8"	5/8"	4"	20"	3
HSS5x5	5/8"	5/8"	5"	20"	3
HSS6x6	5/8"	5/8"	6"	22"	3
HSS8x8	3/4"	3/4"	8"	24"	4
HSS12x8	1"	1"	12"	28"	5

NOTES:
 1. LENGTHS GIVEN ARE SINGLE-SIDE LENGTHS AND MINIMUM LENGTHS
 2. LONGER GUSSET/WELD LENGTHS MAY BE REQ'D WHERE BRACE SLOPE VARIES FROM 1:1
 3. ALL BOLTS IN STANDARD HOLES


A5 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"

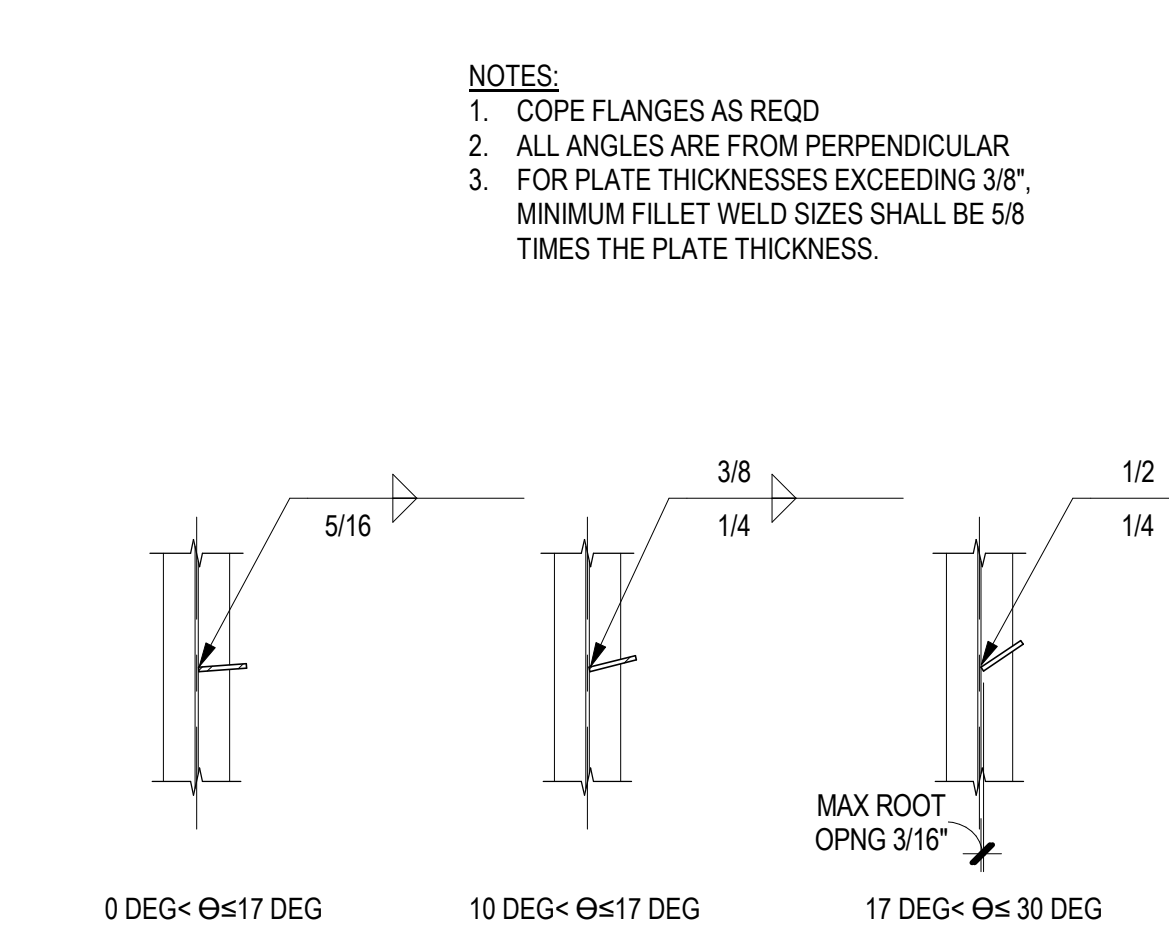


A1 SKEWED BEAM TO BEAM CONN
SCALE: 3/4" = 1'-0"

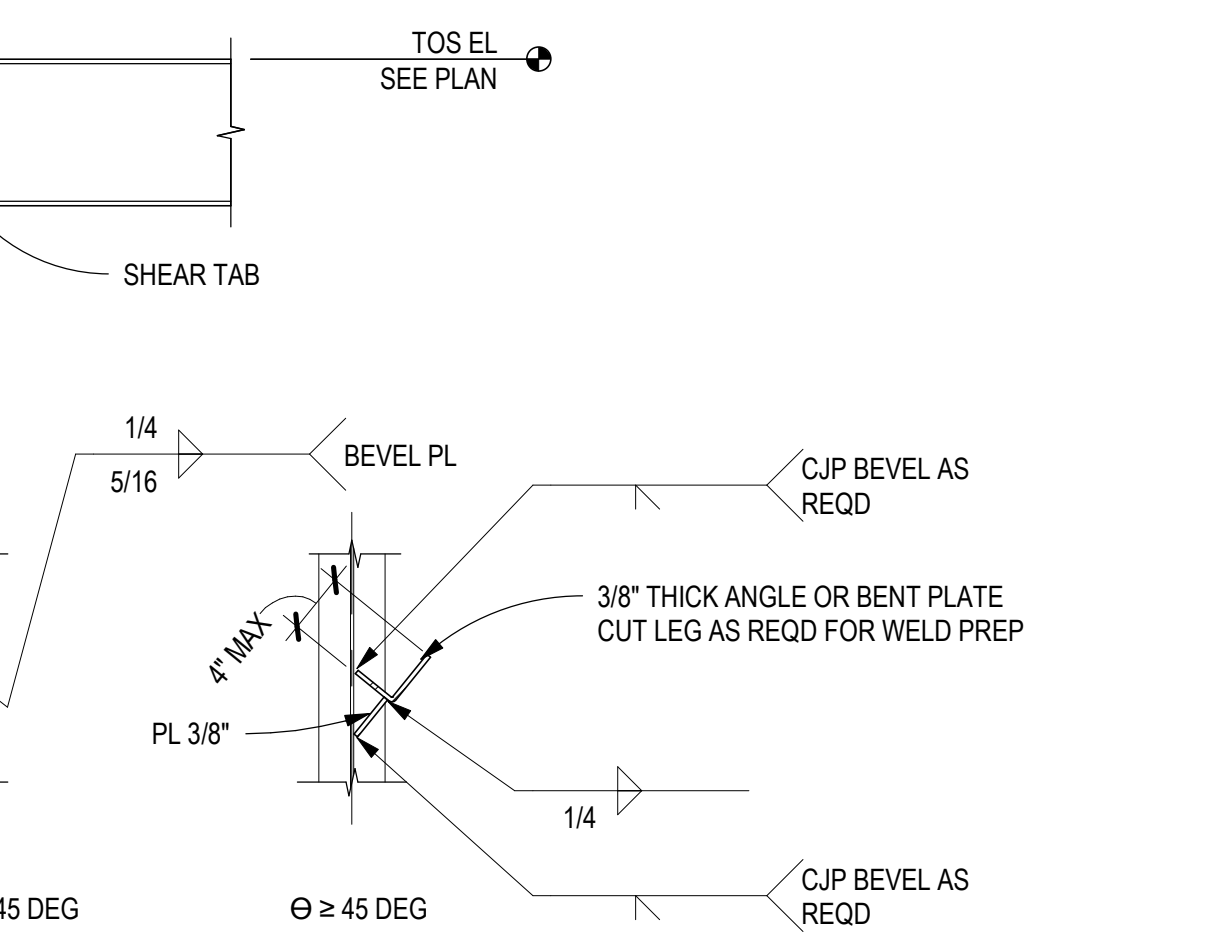


A3 COLLECTOR BEAM TO COLUMN CONN
SCALE: 3/4" = 1'-0"

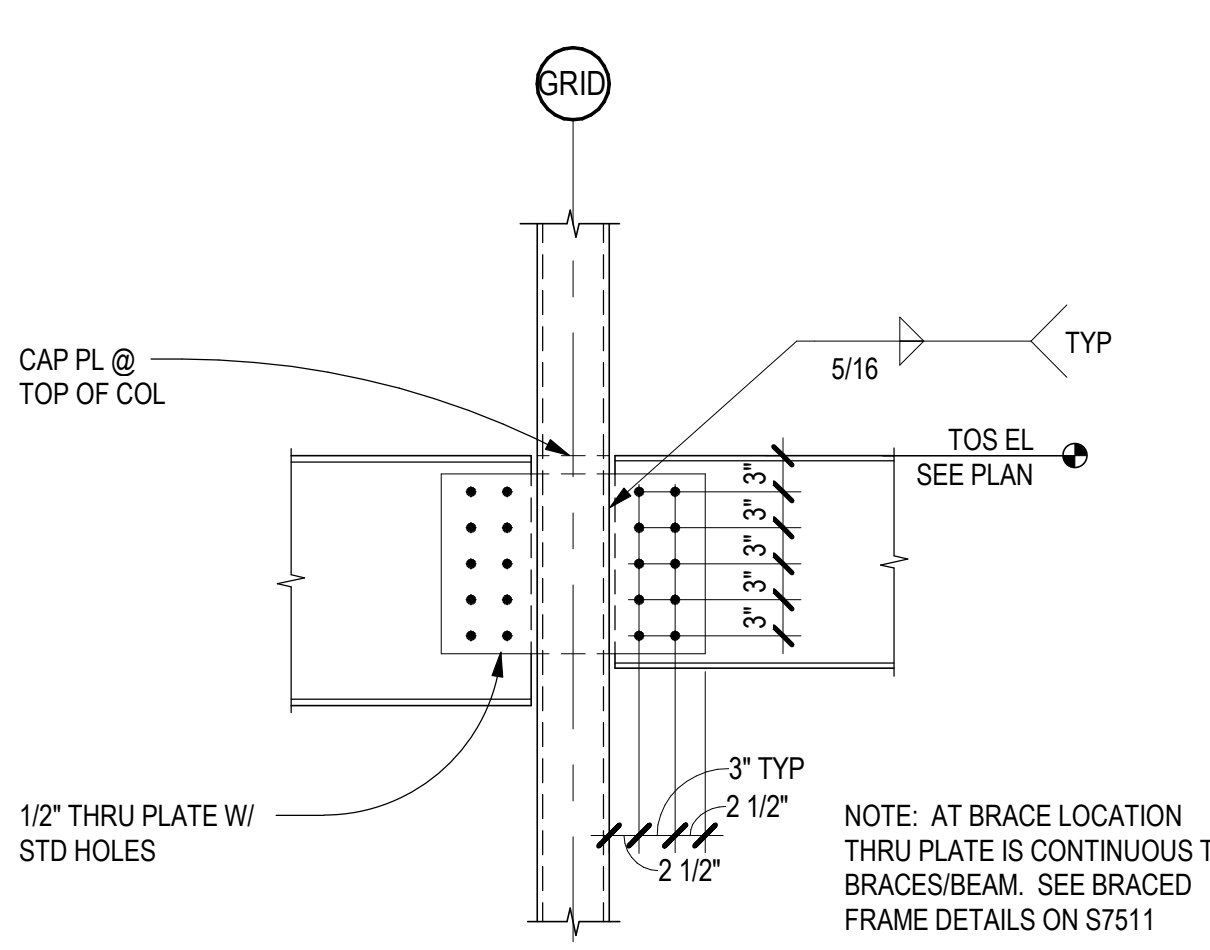

A4 FLANGE PLATE CONN AT HSS COL
SCALE: 3/4" = 1'-0"

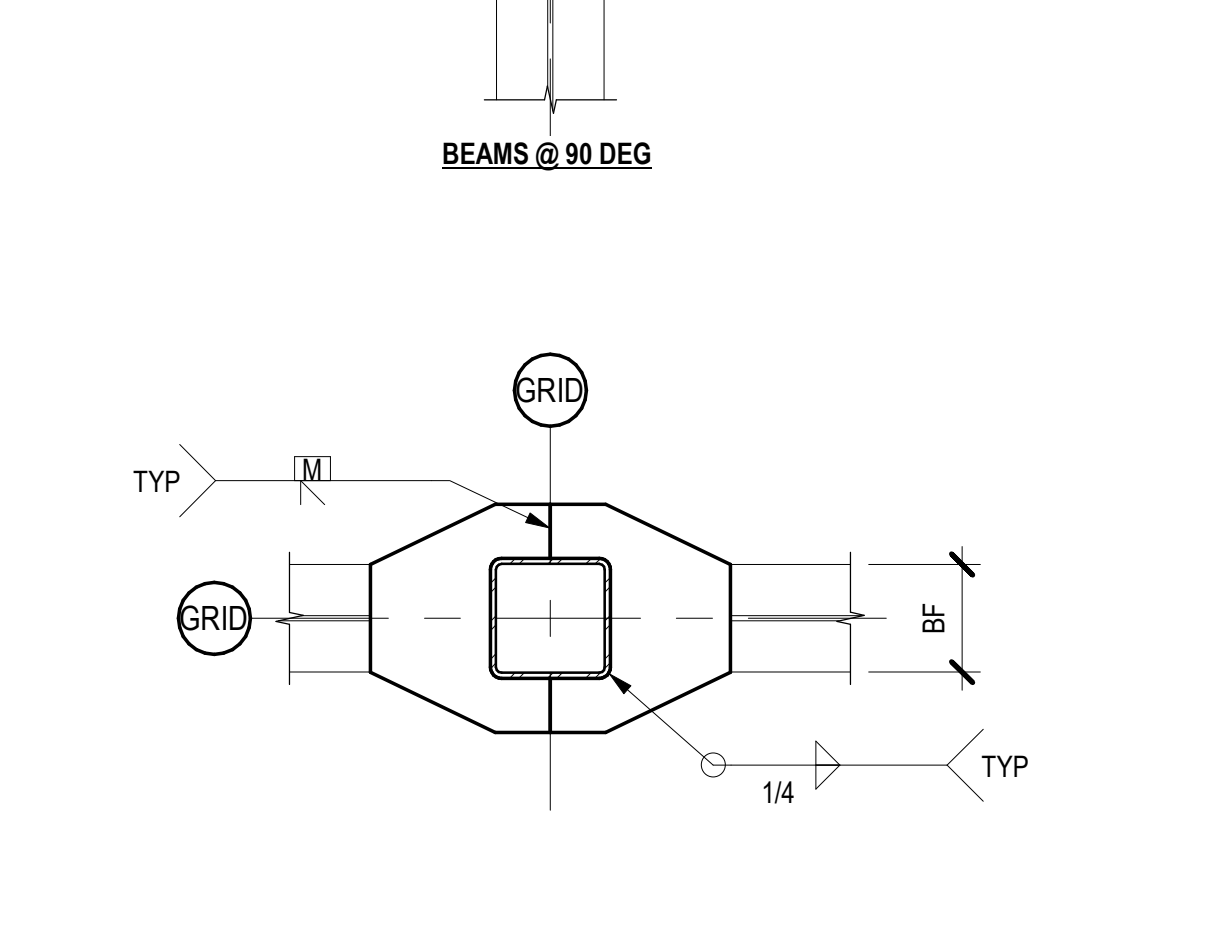

A5 BRACED FRAME CONNECTION
SCALE: 3/4" = 1'-0"



**WILMA P. MANKILLER HEALTH CENTER
 EXPANSION**
 STILWELL, OKLAHOMA

KEY PLAN:
 PROJECT PHASE:
 BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19
 JOB NUMBER: 18-01.01
 SHEET NUMBER:






S5.53
 STEEL DETAILS

CMU LINTEL SCHEDULE						
OPENING WIDTH	WIDTH	DEPTH	LINTEL REINFORCING		SILL	
			TOP	BOTTOM	DEPTH	REINFORCING
0' - 0" - 8' - 0"	12"	32"	2 - #5	2 - #5	8"	2 - #5
						TYPE A

DECK SCHEDULE													
MARK	COMPOSITE SLAB	SLAB			METAL DECK			DECK ATTACHMENTS			TOTAL SLAB / DECK THICKNESS	COMMENTS	
		THICK	MATL	REINF	THICK	TYPE	GAGE	FINISH	ATTACH PERP TO RIBS	ATTACH PARALLEL TO RIBS			ATTACH SIDELAPS
D1.5R	X	3"	NW CONC	6x6 - W2.1xW2.1 WELD WIRE FABRIC IN FLAT SHEETS	1 1/2"	W3	20	GALVANIZED	4-5/8" DIA PUDDLE WELDS PER 36" WIDE SHEET	5/8" DIA PUDDLE WELDS @ 12" OC	#10 SCREWS @ 12" OC	6"	

SLAB-ON-GRADE SCHEDULE					
MARK	SLAB		REINFORCING	BEARING STRATA	COMMENTS
	THICKNESS	MATL			
S5	5"	CONC	#4 @ 18" OC EA WAY	15 MIL VAPOR RETARDER OVER 1/2" SAND BLOTTER LAYER OVER 4" COMPACTED GRANULAR FILL OVER 14" OF COMPACTED STRUCTURAL FILL OVER COMPACTED SUBGRADE. SUBGRADE WILL BE PLACED WITH LASER LEVEL	PREPARE SUBGRADE AND STRUCTURAL FILL PER GEOTECHNICAL REPORT
S6	6"	CONC	#4 @ 12" OC EA WAY	15 MIL VAPOR RETARDER OVER 1/2" SAND BLOTTER LAYER OVER 4" COMPACTED GRANULAR FILL OVER 14" OF COMPACTED STRUCTURAL FILL OVER COMPACTED SUBGRADE. SUBGRADE WILL BE PLACED WITH LASER LEVEL	PREPARE SUBGRADE AND STRUCTURAL FILL PER GEOTECHNICAL REPORT

BASE PLATE SCHEDULE					
MARK	TYPE	SIZE	ANCHOR BOLTS		
			F1554	TYPE	TYPE
BP1	A	PL 1 1/4"x18"x1"-6"	4 - 3/4" DIA x 9"	GRAVITY	
BP2	A	PL 1 3/4"x18"x1"-6"	4 - 3/4" DIA x 9"	GRAVITY	
BP3	A	PL 1 3/4"x20"x1"-8"	4 - 3/4" DIA x 9"	GRAVITY	
BP4	A	PL 1 3/4"x22"x1"-10"	6 - 1" DIA x 18"	GRAVITY	
BP5	A	PL 3/4"x14"x1"-2"	4 - 3/4" DIA x 9"	GRAVITY	
BP6	B	PL 1 3/4"x20"x1"-8"	6 - 1" DIA x 18"	LATERAL	
BP7	B	PL 1 3/4"x22"x1"-8"	6 - 1" DIA x 18"	LATERAL	
BP8	C	PL 1 1/4"x20"x1"-4"	6 - 1" DIA x 18"	LATERAL	
BP9	D	PL 3/4"x14"x1"-2"	4 - 3/4" DIA x 9"	GRAVITY	
BP10	D	PL 3/4"x14"x1"-2"	8 - 3/4" DIA x 9"	GRAVITY	

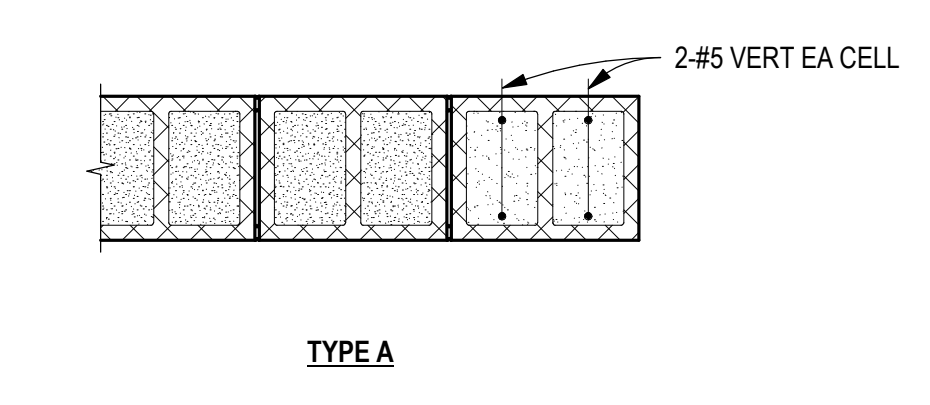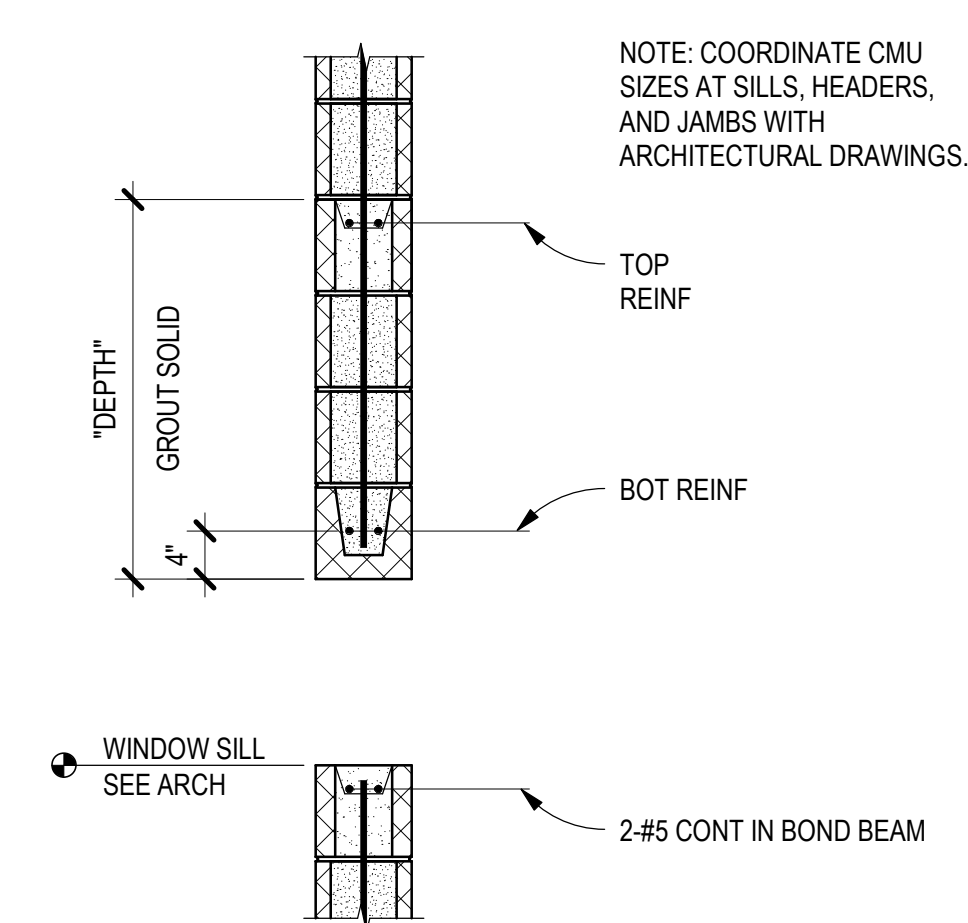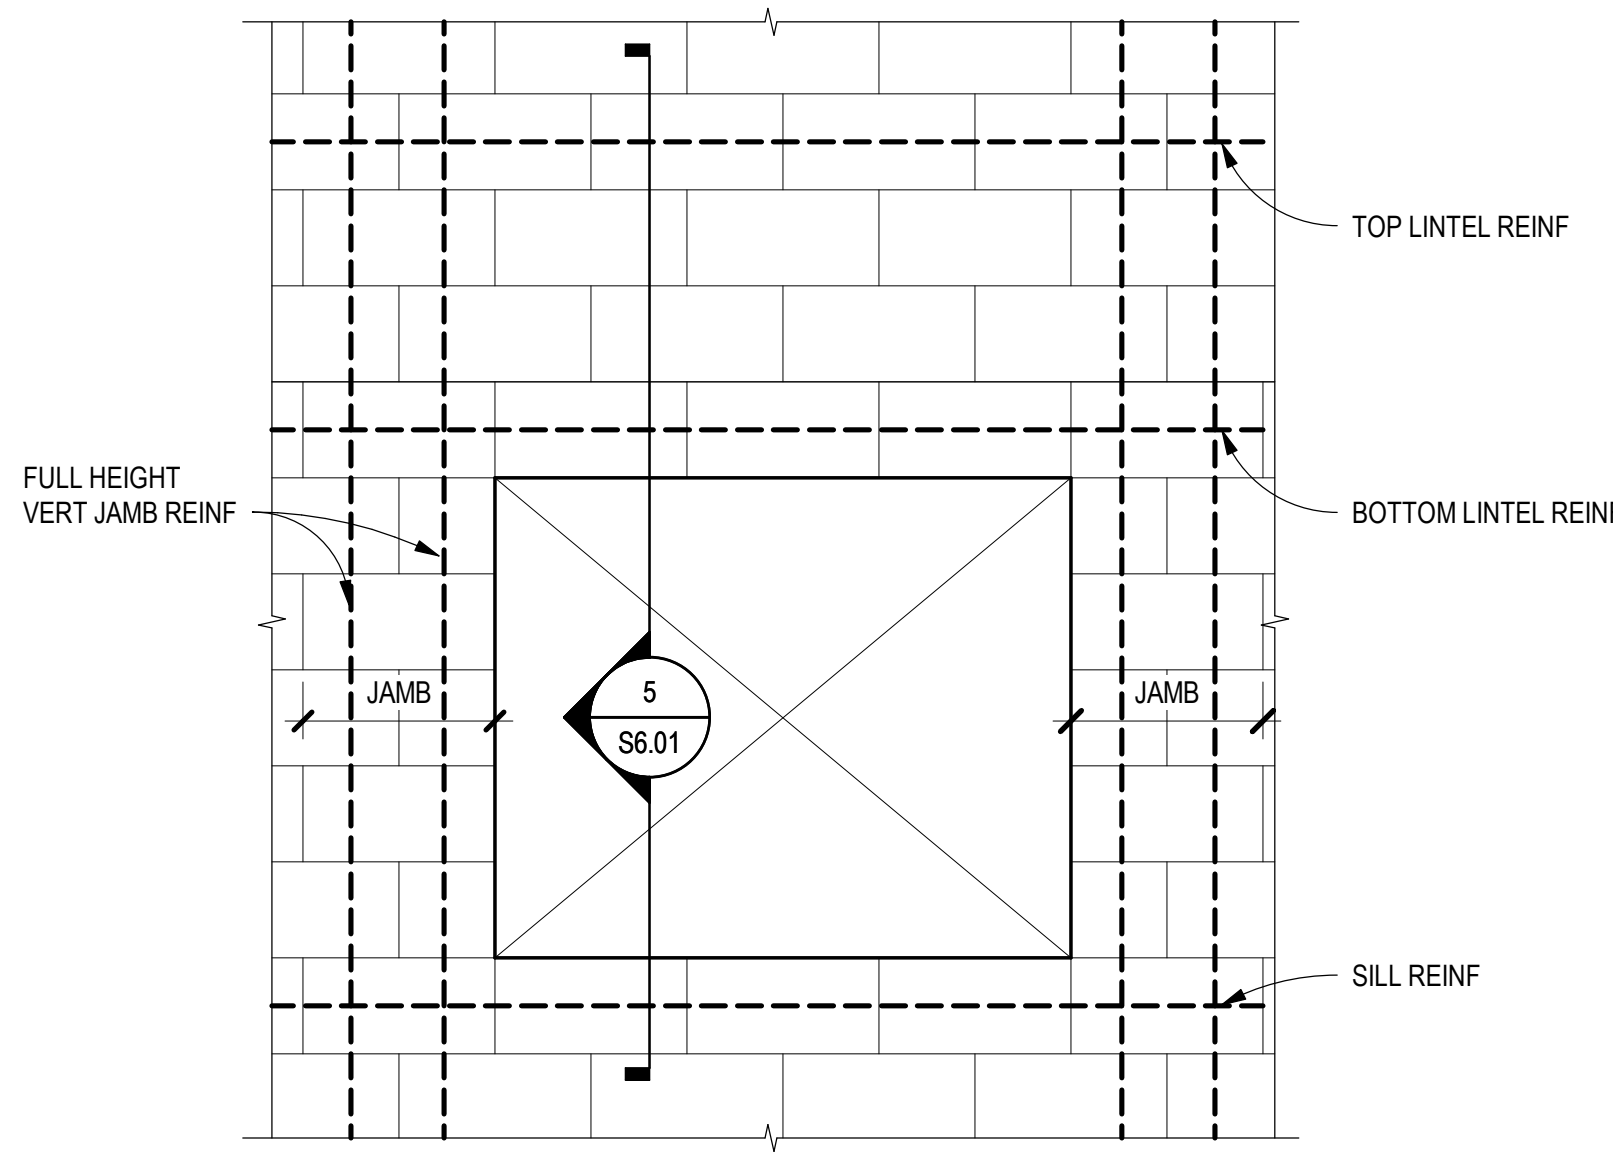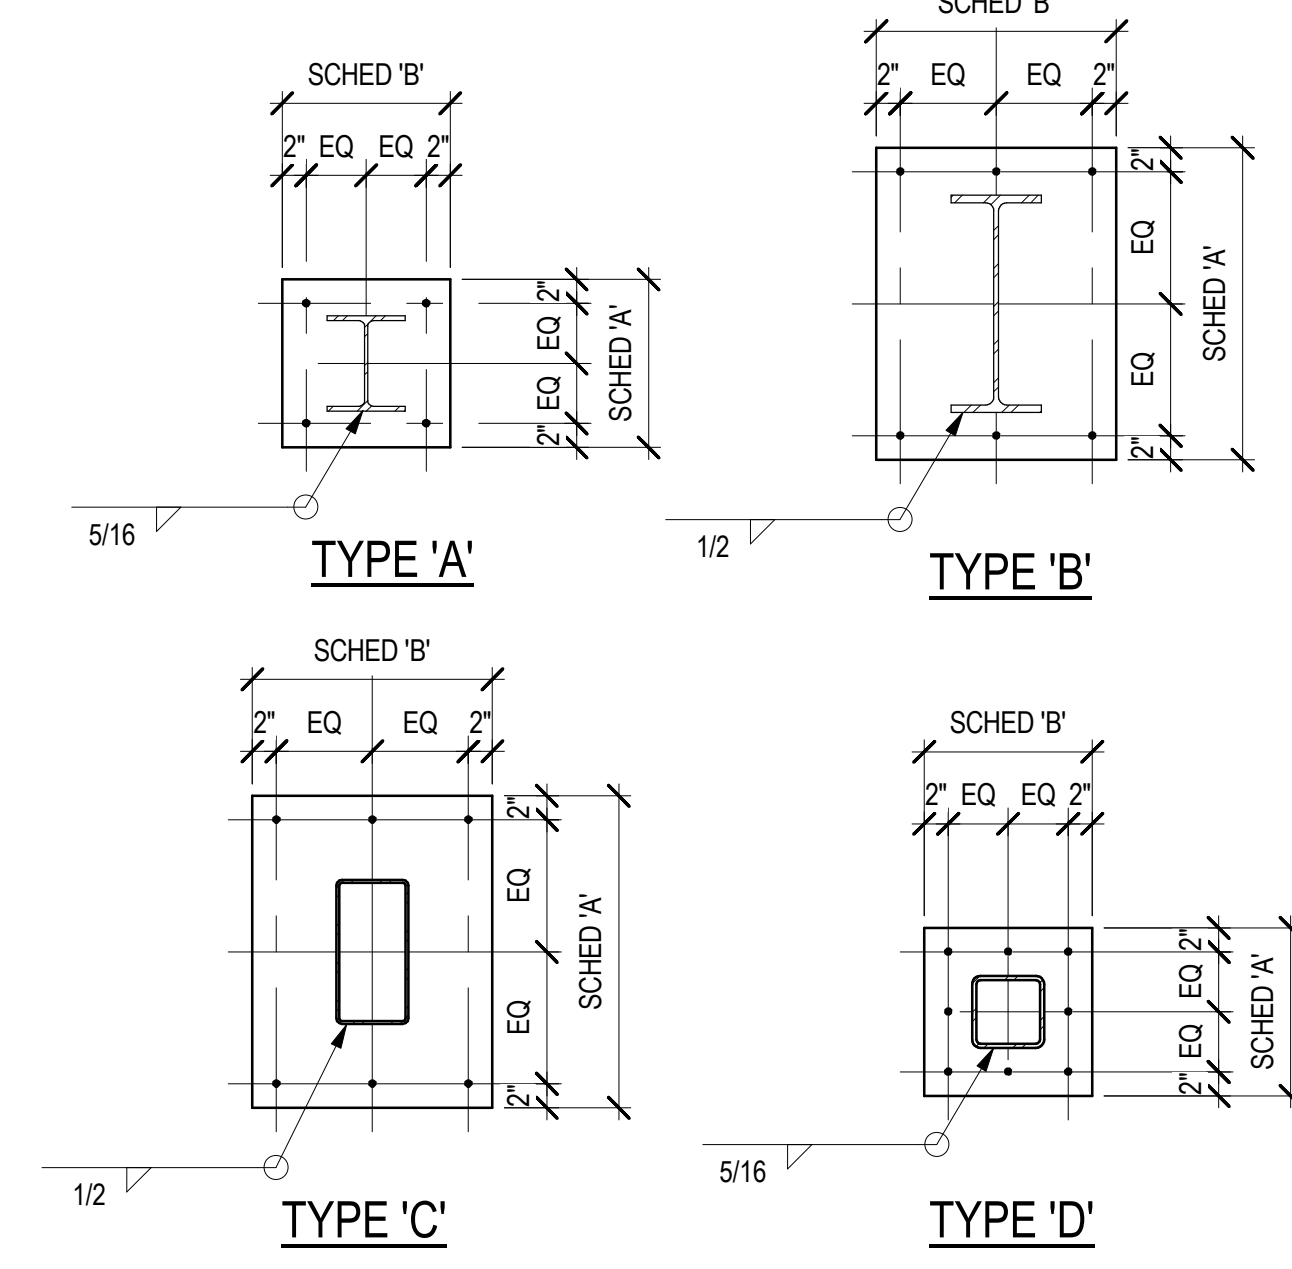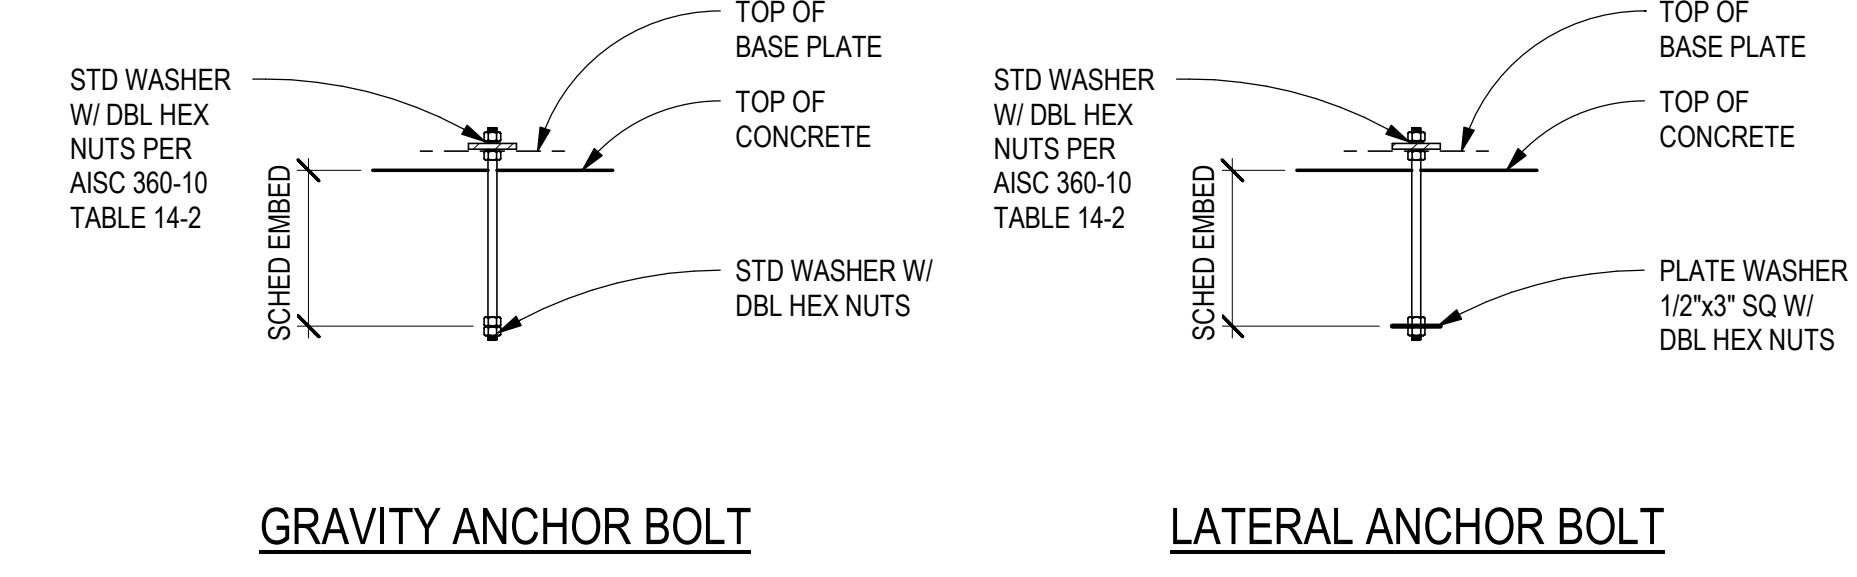

NOTE: SEE TYPICAL CMU PLAN DETAILS SHEET S7.21 FOR TYPICAL HORIZONTAL REINFORCING REQUIREMENTS.

WALL SCHEDULE						
MARK	VENEER	WALL	REINFORCING			COMMENTS
			VERTICAL	HORIZONTAL	GRADE	
WC8	--	8" CONC	#4 @ 12" OC	#4 @ 12" OC	A615	
WC12	SEE ARCH	12" CONC	#5 @ 12" OC EA FACE	#5 @ 12" OC EA FACE	A615	
WM12	SEE ARCH	12" CMU	#7 @ 16" OC EA FACE	#5 @ 24" OC EA FACE & STD LADDER TYPE JOINT REINF @ 16" OC	A615	GROUT ALL CELLS SOLID. SEE 7.21 FOR MASONRY DETAILS. D4/S7.21 FOR HORIZONTAL REINFORCEMENT LOCATION

REINFORCEMENT TYPE	REQUIRED LAP SPLICES ACI 318-14/IBC 2015						MINIMUM LENGTH (IN)	COMMENTS
	#6 AND SMALLER (#6)	#7 THROUGH #11 (#6b)	3000PSI	4000PSI	5000PSI	3000PSI		
CONTINUOUS WALL FOOTINGS AND HORIZONTAL REINFORCEMENT IN SITE WALLS	30	30	30	30	30	30	18	
CONCRETE WALLS: ALL VERTICAL REINFORCEMENT	44	38	34	55	48	43	12	
CONCRETE WALLS: ALL HORIZONTAL REINFORCEMENT, EXCLUDING SITE WALLS AND STEM WALLS	57	50	45	72	62	56	12	
CONCRETE COLUMNS	44	38	34	55	48	43	12	
TOP FLEXURAL REINFORCEMENT, INCLUDING BEAMS, GRADE BEAMS, AND COMBINED COLUMN FOOTINGS	57	50	45	72	62	56	12	
BOTTOM FLEXURAL REINFORCEMENT, INCLUDING BEAMS, GRADE BEAMS, AND COMBINED COLUMN FOOTINGS	44	38	34	55	48	43	12	
MINIMUM EMBEDMENT OF STANDARD HOOKS INTO CONCRETE	22	19	17	22	19	17	6	ALLOWED FOR BARS LARGER THAN #11
SLABS ON GRADE	30	30	30	30	30	30	12	WWF MINIMUM LAP LENGTH = 6 IN
SLABS ON METAL DECK	30	30	30	30	30	30	12	

NOTES:


- LAP SPLICES SHALL NOT BE PERMITTED FOR BARS LARGER THAN #11.
- LAP SPLICES FOR BUNDLED BARS SHALL BE IN ACCORDANCE WITH ACI 318-14 SECTION 25.5.1.4
- LAP LENGTHS FOR LIGHTWEIGHT CONCRETE SHALL BE INCREASED BY 33%
- LAP LENGTHS FOR EPOXY COATED BARS SHALL BE INCREASED BY 50%
- FOR INTERMEDIATE OR LARGER VALUES OF F_{CD}, USE THE CLOSEST LOWER VALUE IN THE TABLE. DO NOT INTERPOLATE

MASONRY LAP SPLICES (#6) ACI 530-13/IBC 2015								
	#3	#4	#5	#6	#7	#8	#9	
8" BLOCK WITH 1-LAYER OF REINFORCEMENT	32	40	51	72	N/A	N/A	N/A	
8" BLOCK WITH 2-LAYERS OF REINFORCEMENT	51	68	72	72	N/A	N/A	N/A	
12" BLOCK WITH 1-LAYER OF REINFORCEMENT	32	24	23	37	43	57	65	
12" BLOCK WITH 2-LAYERS OF REINFORCEMENT	51	68	72	72	72	N/A	N/A	
16" BLOCK WITH 1-LAYER OF REINFORCEMENT	32	24	23	30	32	42	48	
16" BLOCK WITH 2-LAYERS OF REINFORCEMENT	51	68	72	72	72	72	72	



BARS LARGER THAN #9 SHALL BE SPLICED USING MECHANICAL CONNECTIONS

SPOT FOOTING SCHEDULE						
MARK	WIDTH	SIZE		REINFORCING		COMMENTS
		LENGTH	DEPTH	REINFORCING	GRADE	
F48	4'-0"	4'-0"	1'-0"	4 - #5 EA WAY BOT	A615	
F48P	4'-0"	4'-0"	1'-0"	4 - #5 EA WAY BOT	A615	
F60	5'-0"	5'-0"	1'-6"	5 - #6 EA WAY BOT	A615	
F60A	5'-0"	5'-0"	2'-0"	6 - #6 EA WAY TOP & BOT	A615	
F72	6'-0"	6'-0"	1'-6"	6 - #6 EA WAY BOT	A615	
F72A	6'-0"	6'-0"	2'-0"	8 - #6 EA WAY TOP & BOT	A615	TOP BARS TO HAVE STD HOOKS AT ENDS
F72P	6'-0"	6'-0"	1'-6"	6 - #6 EA WAY TOP & BOT	A615	TOP BARS TO HAVE STD HOOKS AT ENDS
F84	7'-0"	7'-0"	2'-0"	9 - #6 EA WAY BOT	A615	
F84A	7'-0"	7'-0"	2'-0"	9 - #6 EA WAY TOP & BOT	A615	TOP BARS TO HAVE STD HOOKS AT ENDS
F84P	7'-0"	7'-0"	2'-0"	9 - #6 EA WAY TOP & BOT	A615	TOP BARS TO HAVE STD HOOKS AT ENDS
F96	8'-0"	8'-0"	2'-0"	7 - #7 EA WAY BOT	A615	
F96A	8'-0"	8'-0"	2'-0"	7 - #7 EA WAY TOP & BOT	A615	TOP BARS TO HAVE STD HOOKS AT ENDS
F276	23'-0"	21'-0"	2'-9"	#8 @ 9" OC EA WAY TOP & BOT	A615	TOP BARS TO HAVE STD HOOKS AT ENDS

CONTINUOUS FOOTING SCHEDULE					
MARK	WIDTH	DEPTH	REINFORCING		COMMENTS
			CONTINUOUS	TRANSVERSE	
CF16	1'-4"	1'-0"	3 - #4	#4 @ 48" OC	
CF24	2'-0"	1'-0"	3 - #4	#4 @ 48" OC	
CF84	7'-0"	2'-9"	8 - #8	#8 @ 9" OC	TOP BARS TO HAVE STD HOOKS AT ENDS

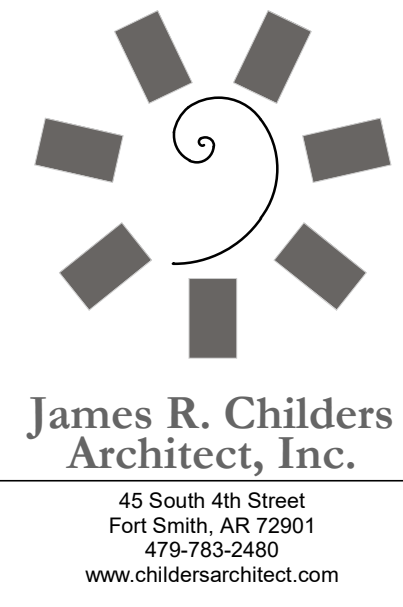



James R. Childers
Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com

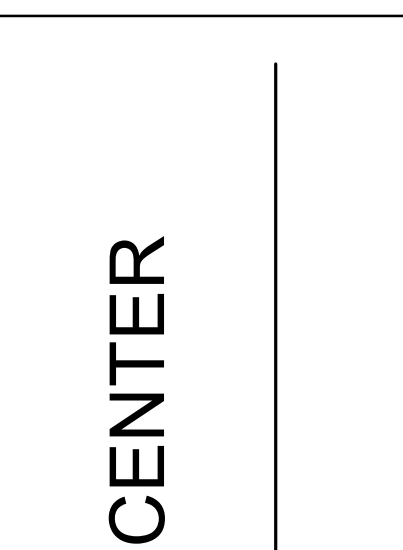


WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

PROJECT PHASE:
BID PACKAGE 01



DATE: 11-01-19
JOB NUMBER: 18-01.01
SHEET NUMBER: S6.01
SCHEDULES

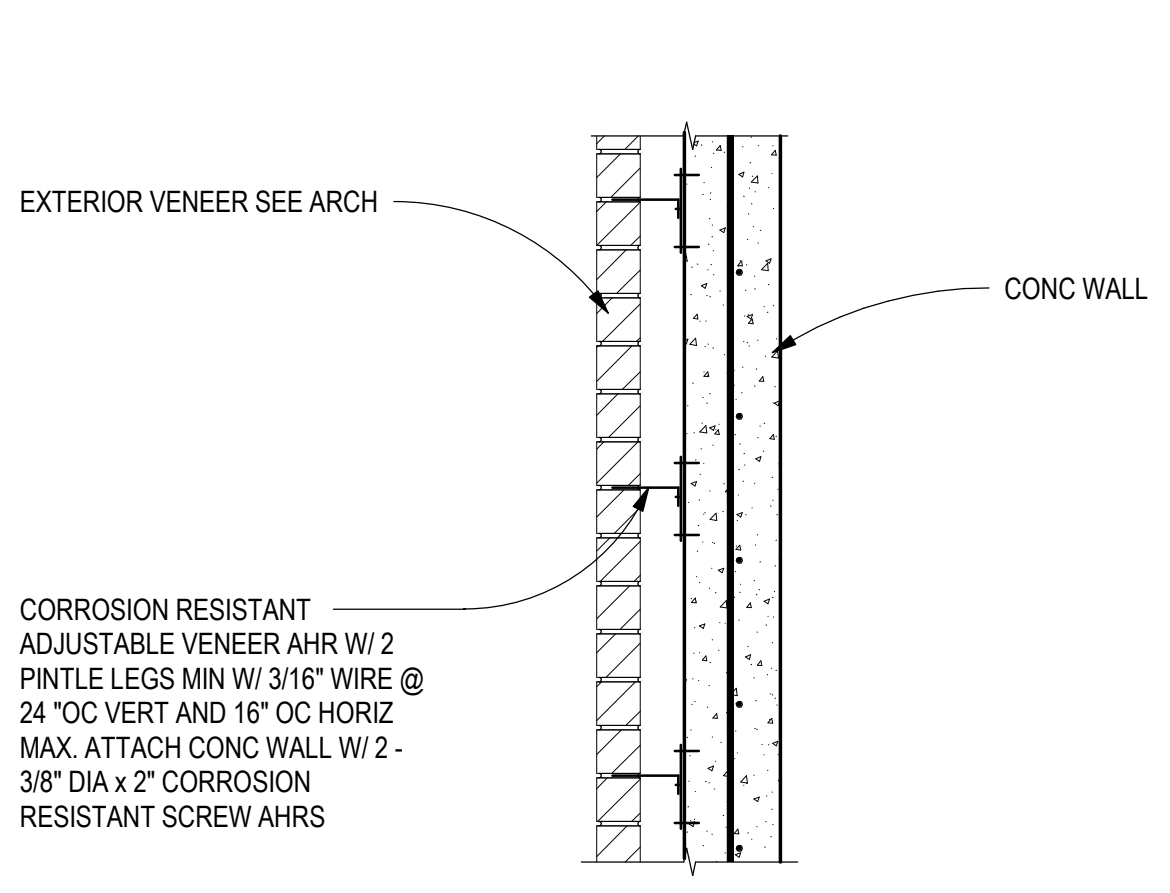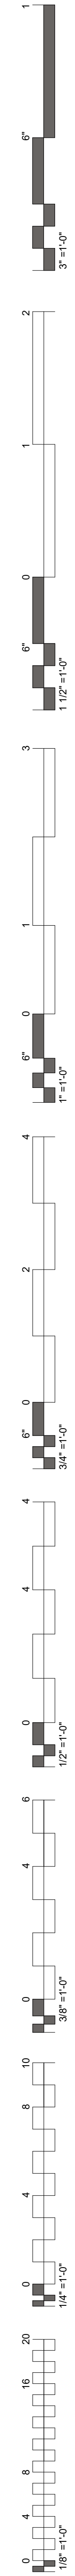


D1 TYPICAL VENER TO CONC WALL
SCALE: NTS

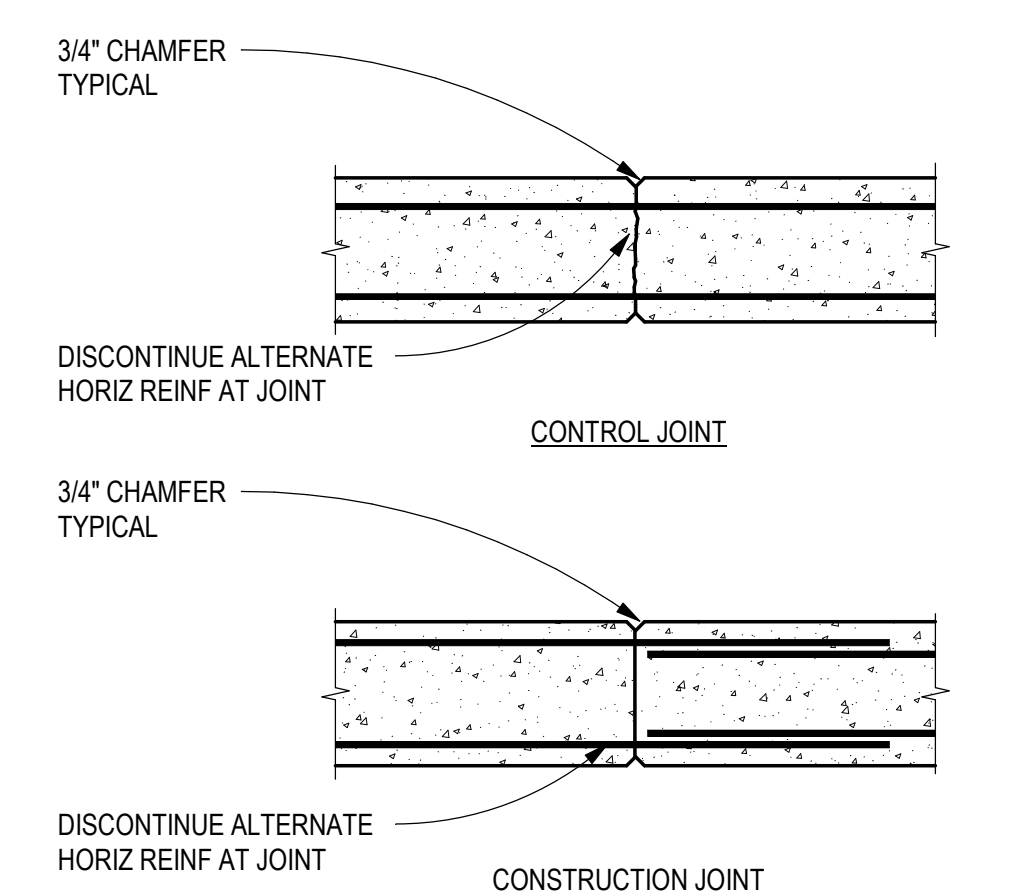


D2 TYPICAL WALL JOINT DETAIL
SCALE: NTS

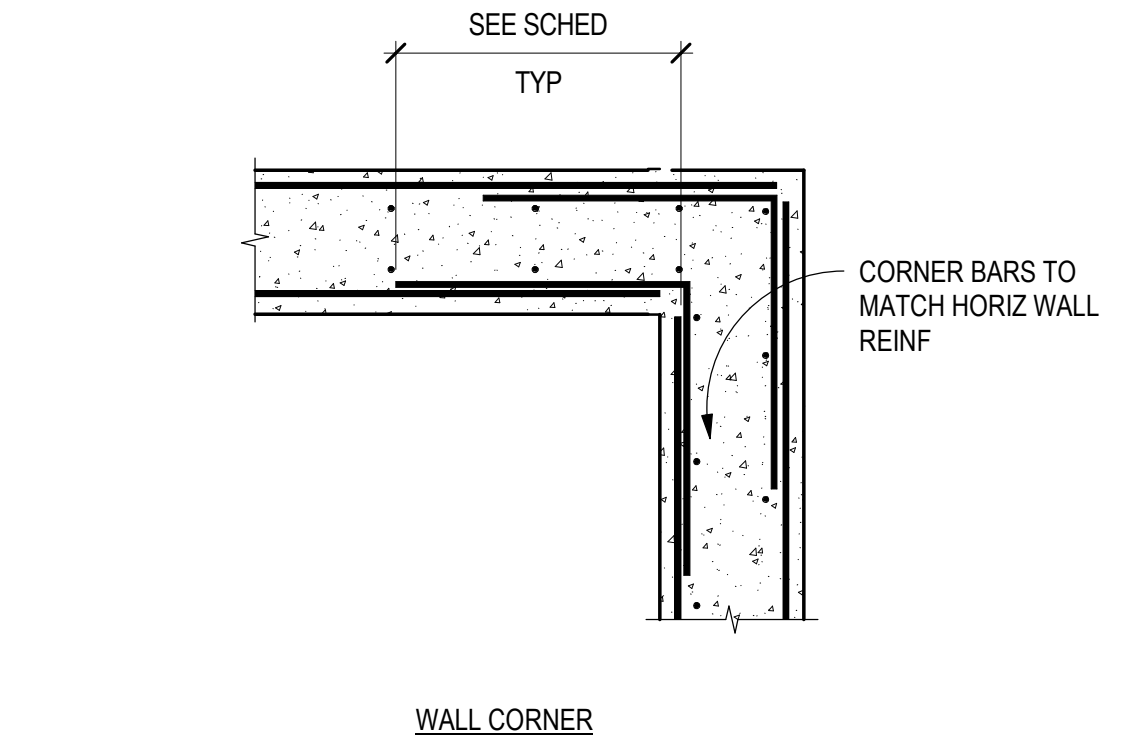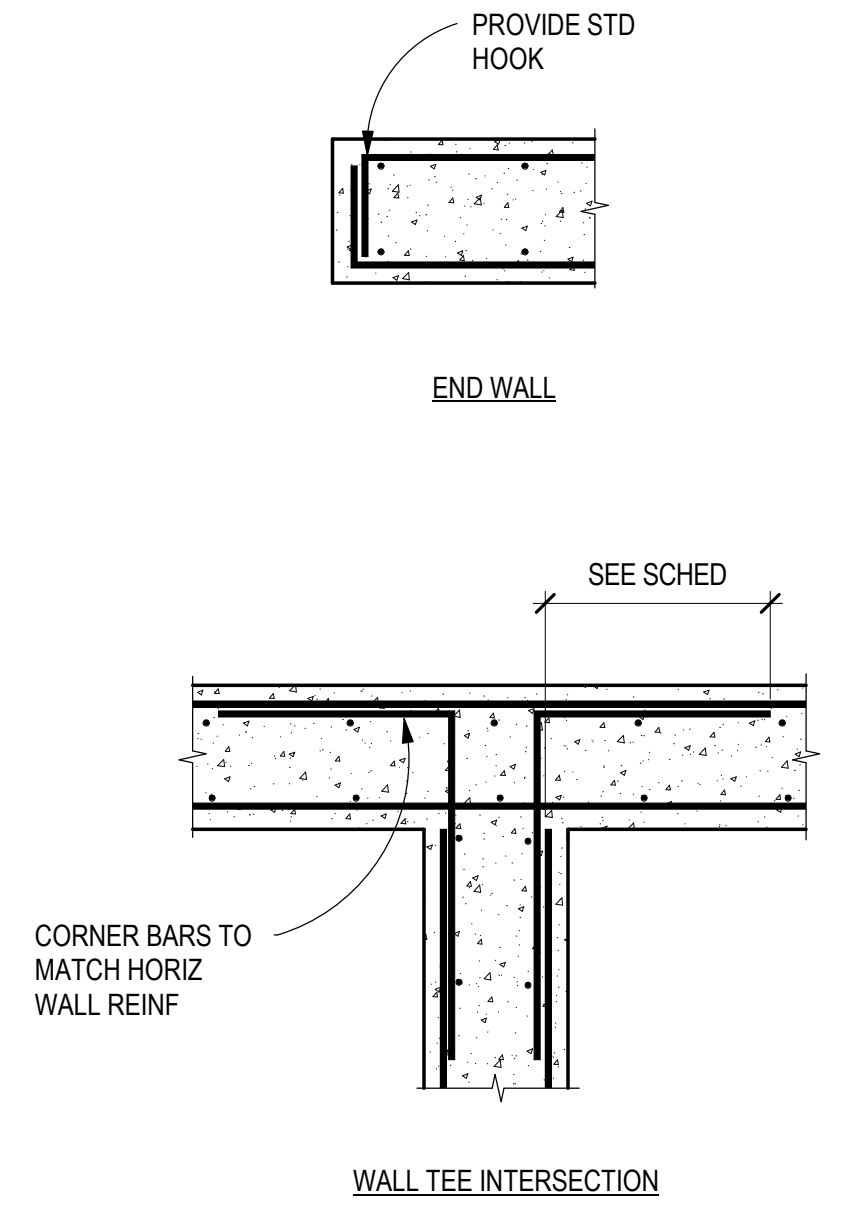


C3 TYPICAL DOUBLE MAT WALL REINF
SCALE: NTS

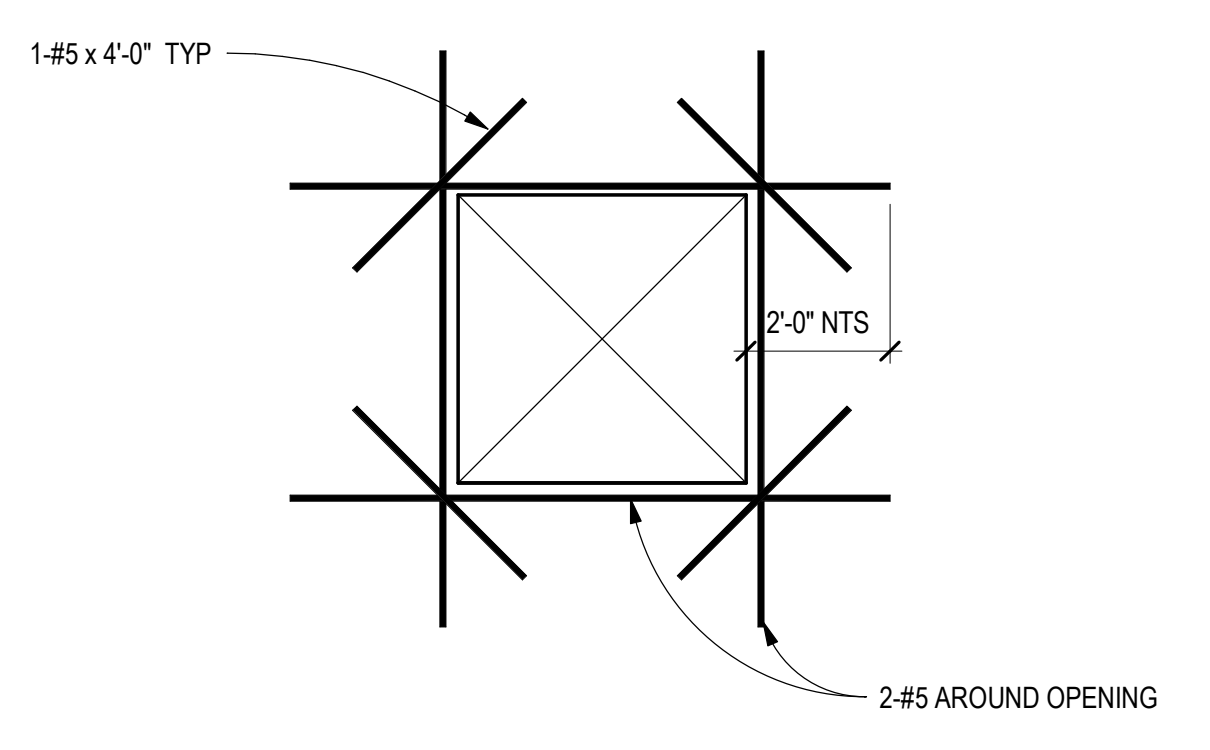


D4 TYPICAL OPNG IN CONC WALL DETAIL
SCALE: NTS

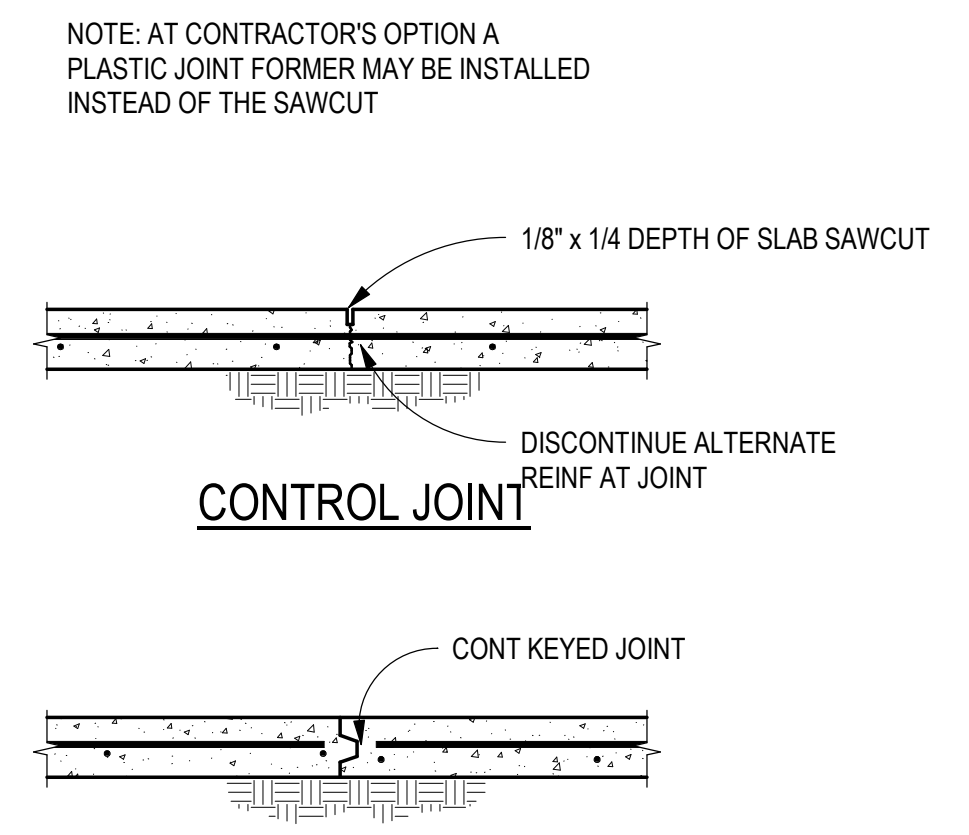


D5 TYPICAL SLAB JOINT
SCALE: NTS

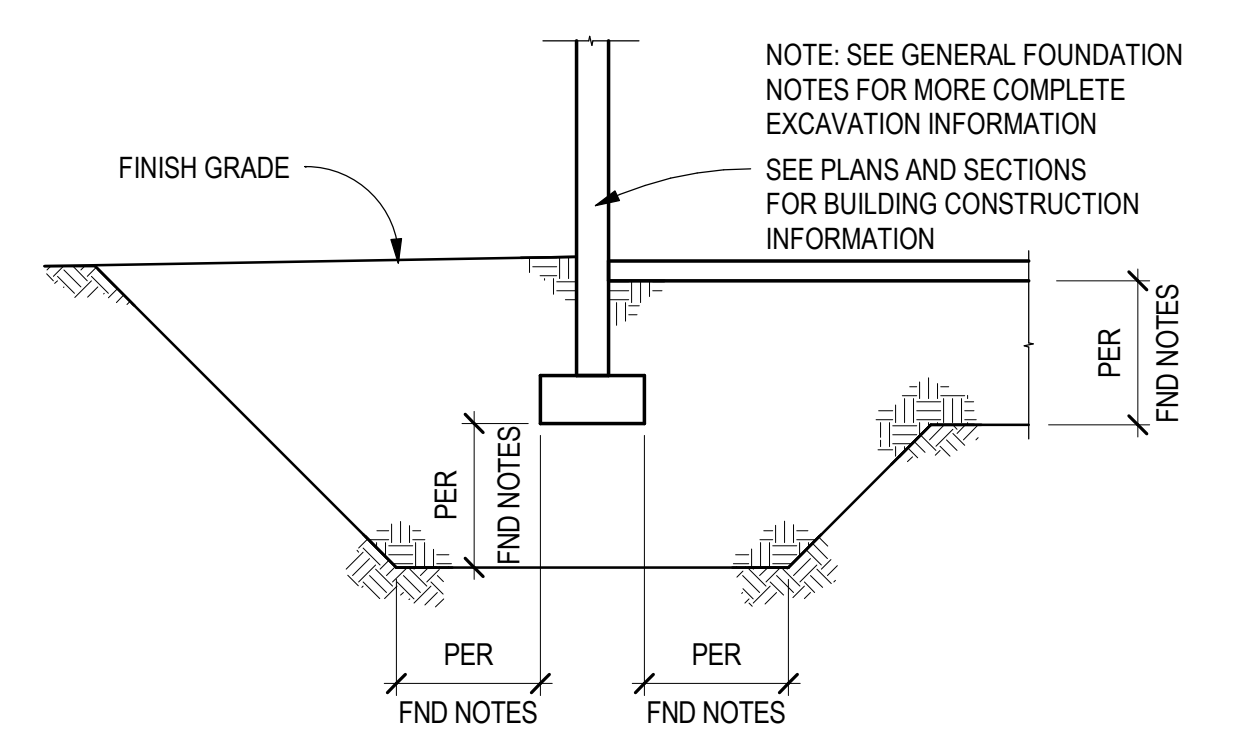


C1 TYPICAL FND EXCAVATION DETAIL
SCALE: NTS

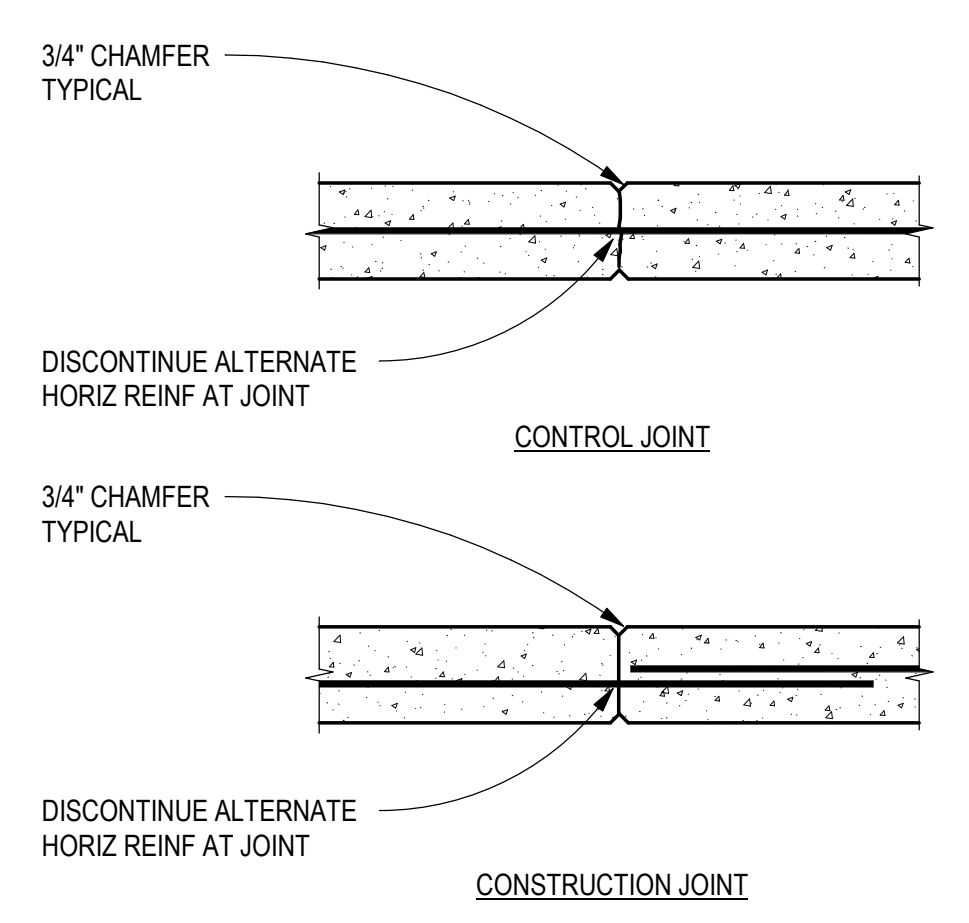


C2 TYPICAL WALL JOINT DETAIL
SCALE: NTS

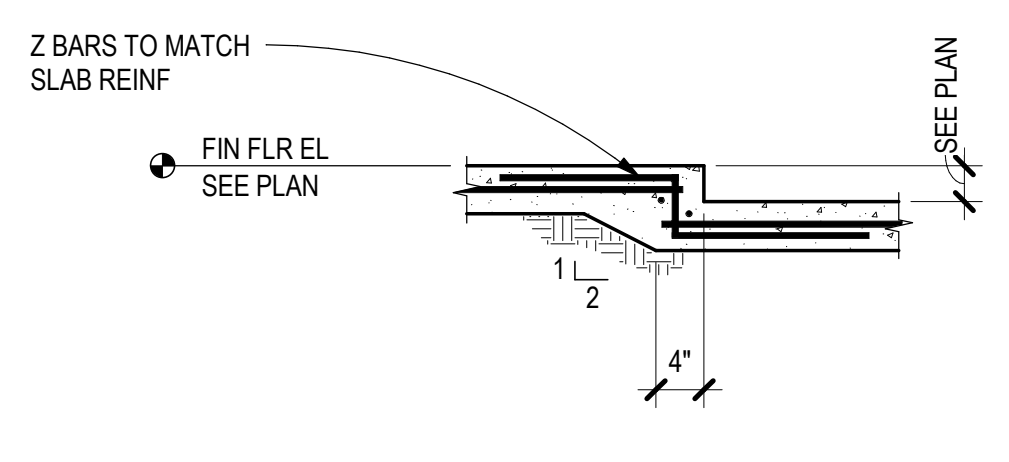


C4 TYPICAL DEPRESSED SLAB
SCALE: 3/4\"/>

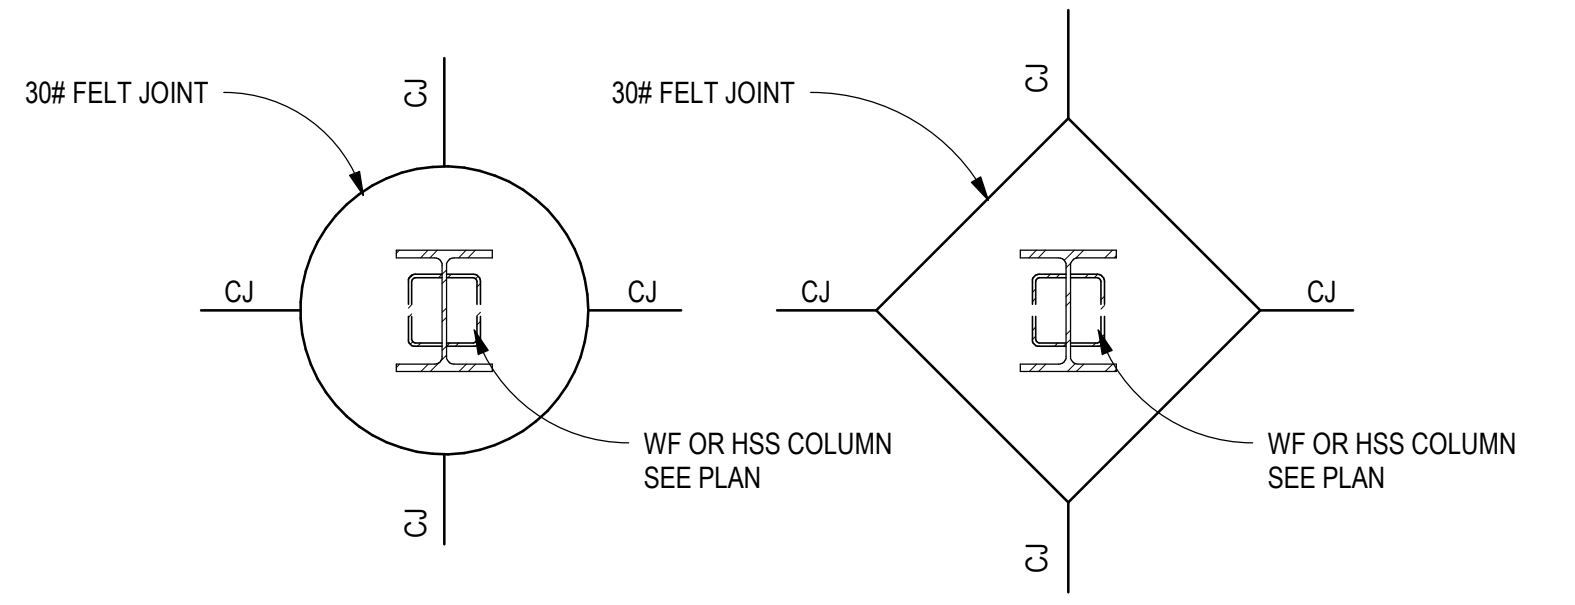


C5 TYPICAL COLUMN BLOCKOUT
SCALE: NTS

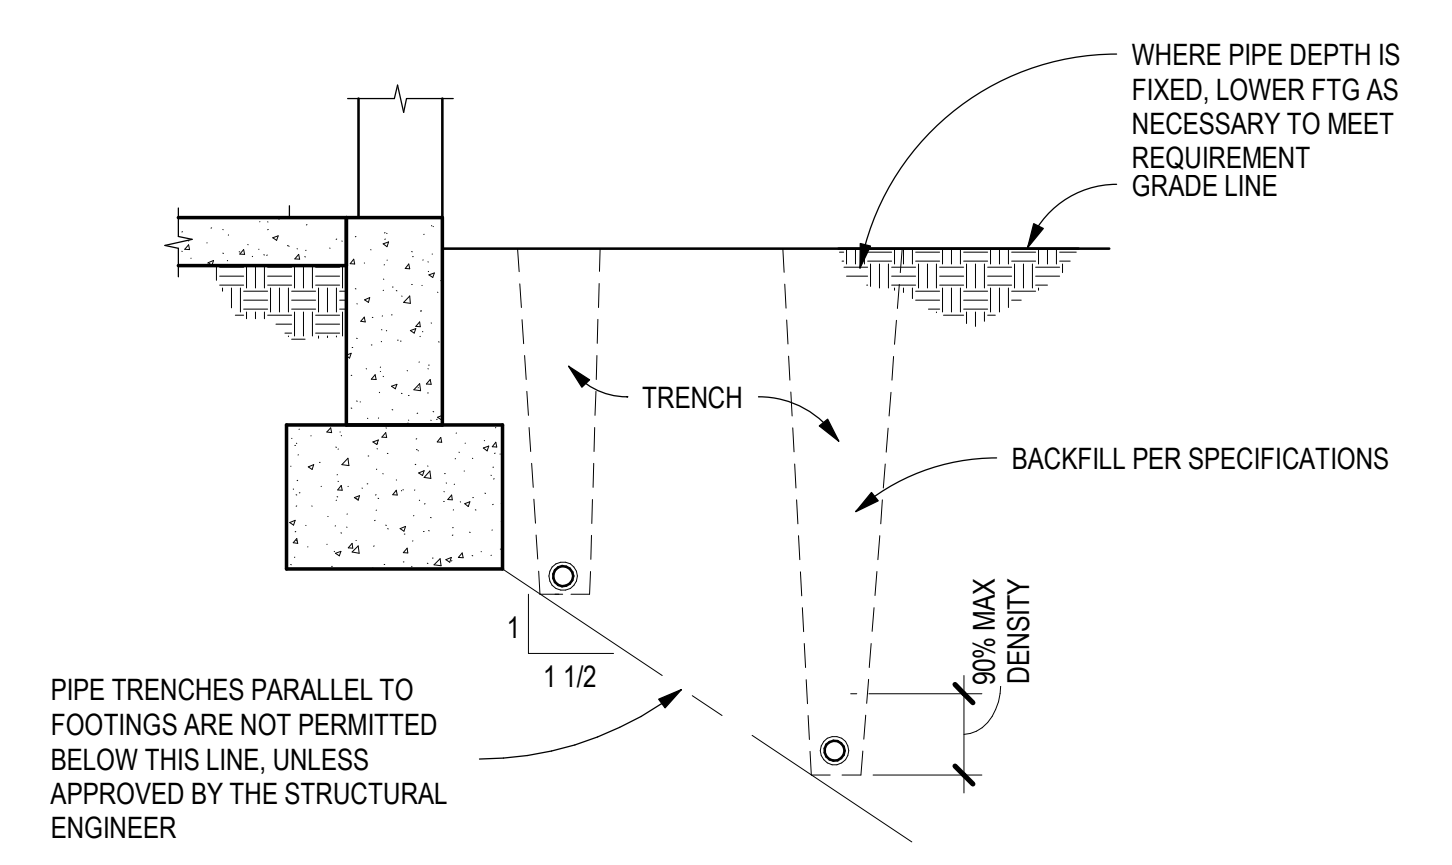


A1 TYPICAL PIPE PENETRATION AND TRENCH DETAILS
SCALE: NTS

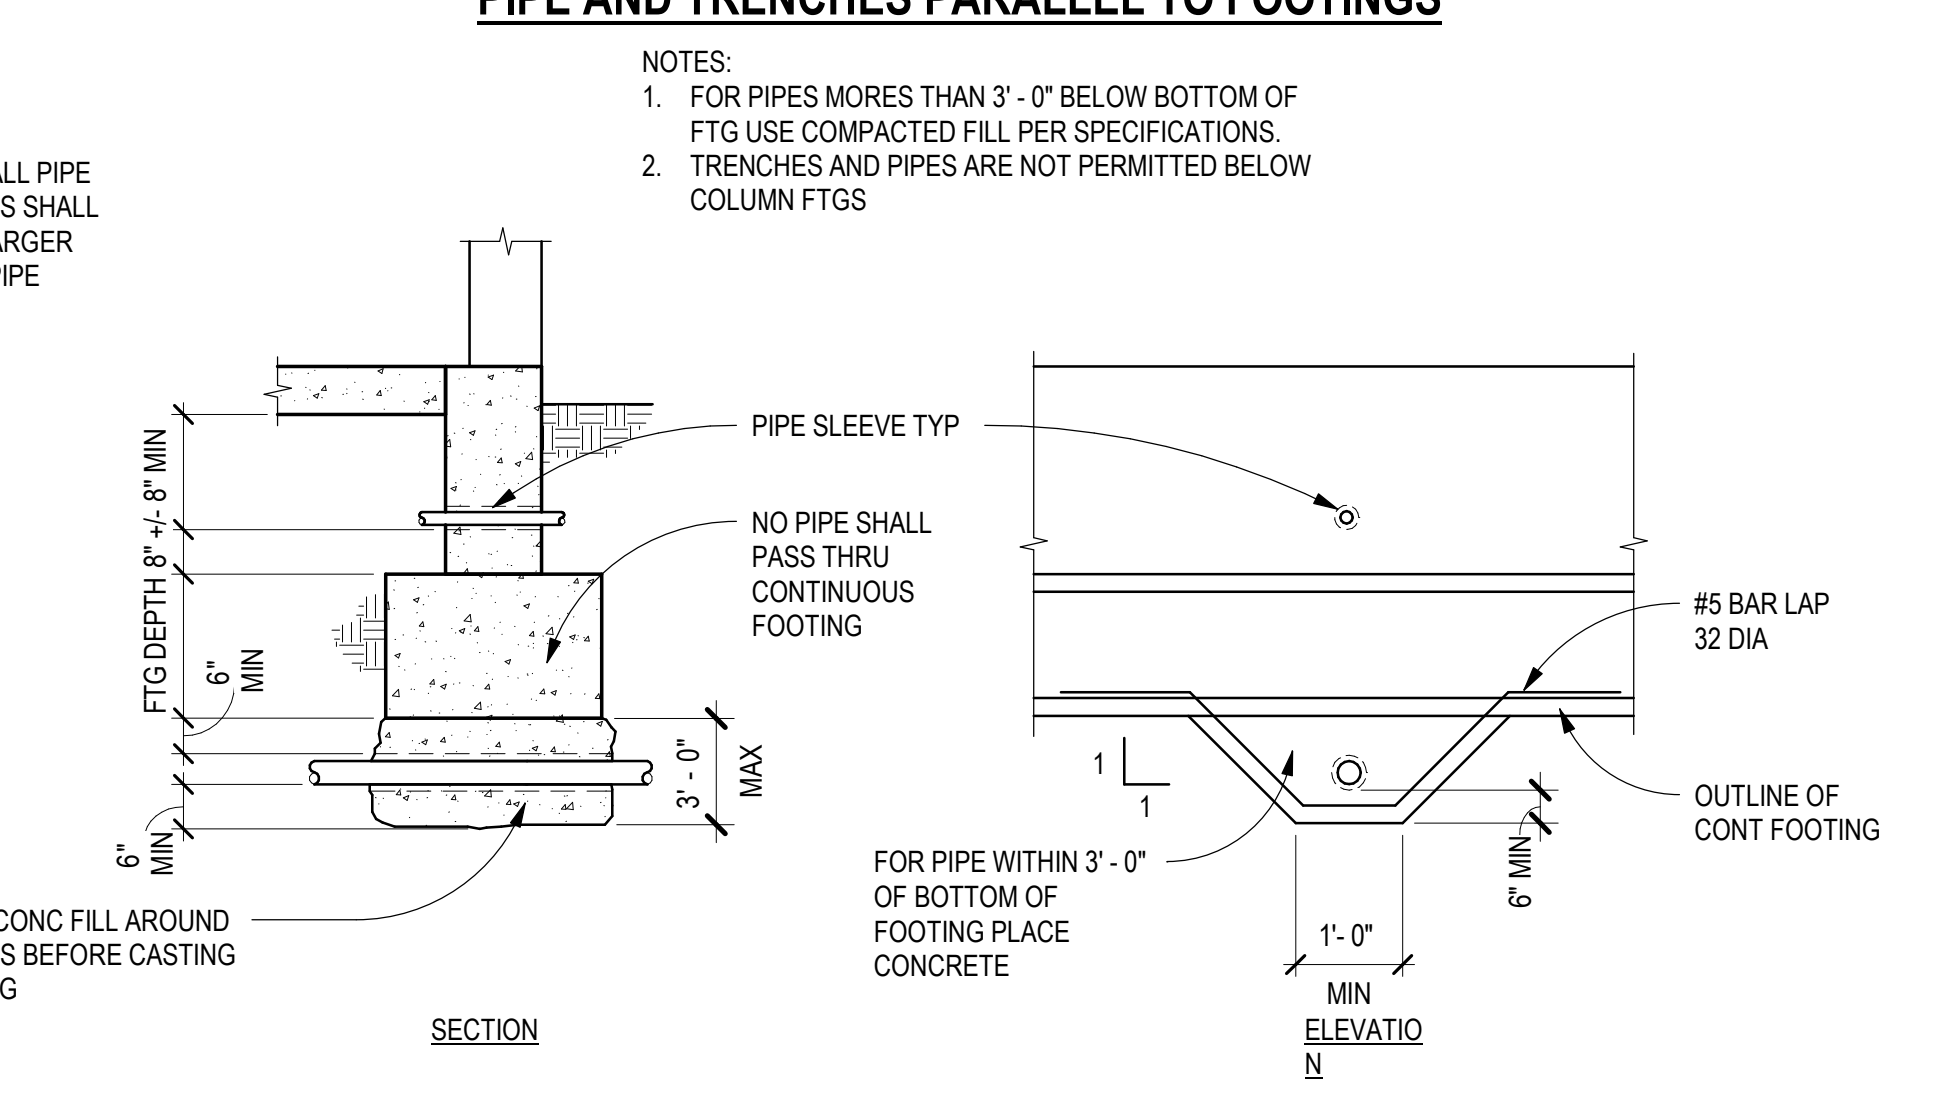


PIPE AND TRENCHES TRANSVERSE TO FOOTINGS

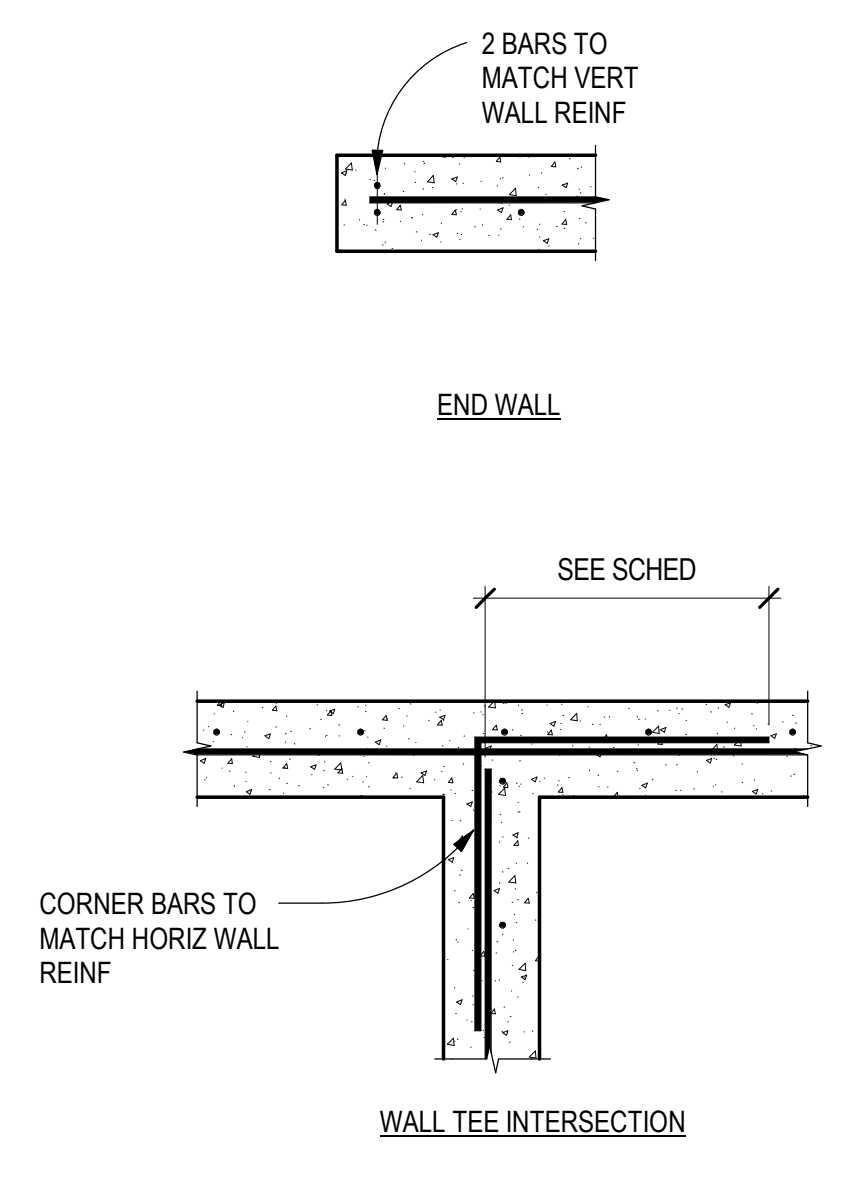


A3 TYPICAL SINGLE MAT WALL REINF
SCALE: NTS

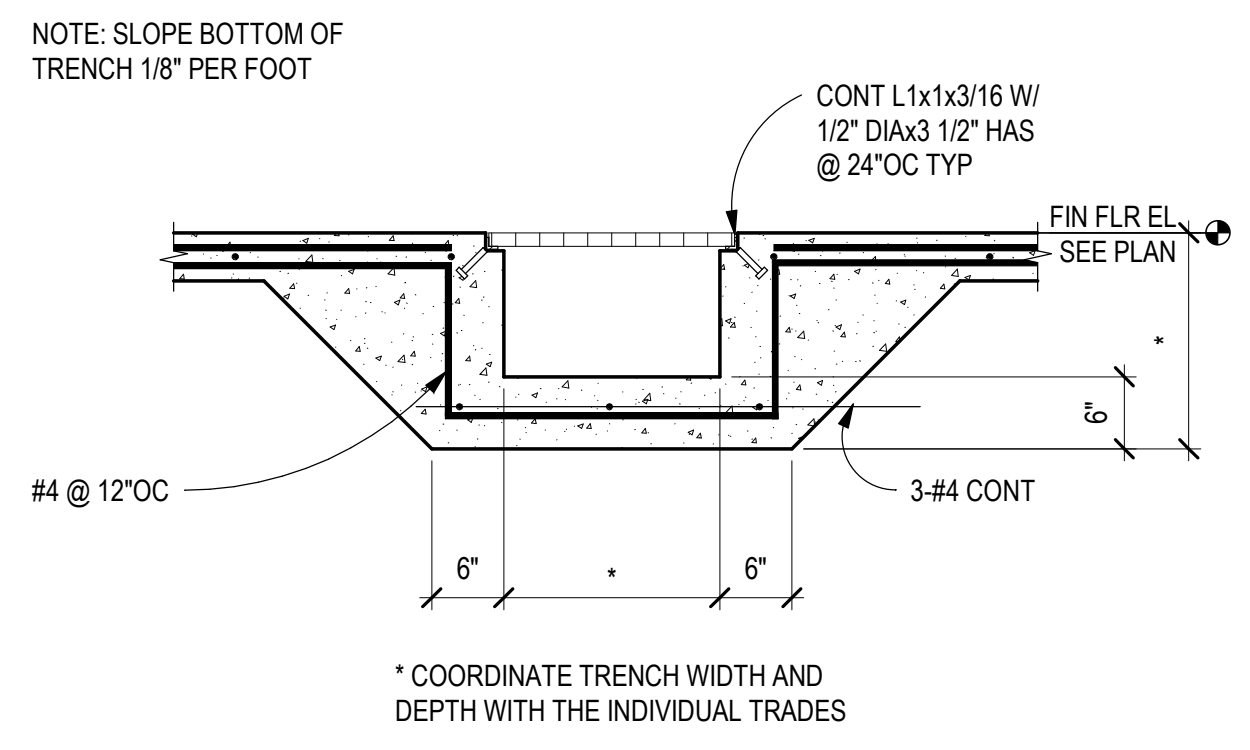


B4 TYPICAL TRENCH SECTION
SCALE: NTS

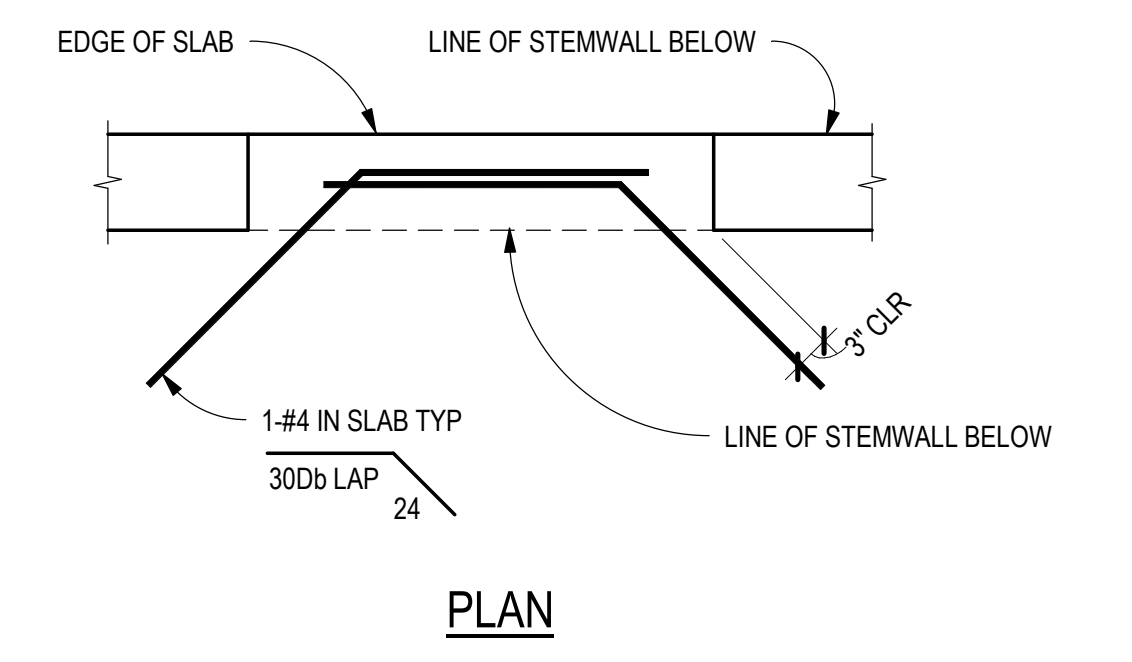


B5 TYPICAL SLAB REINF AT OPNG
SCALE: NTS

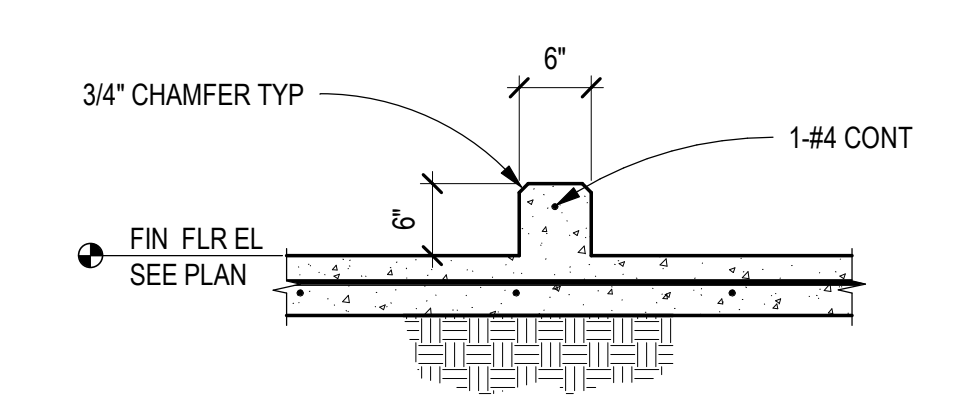


A4 TYPICAL CURB SECTION
SCALE: NTS

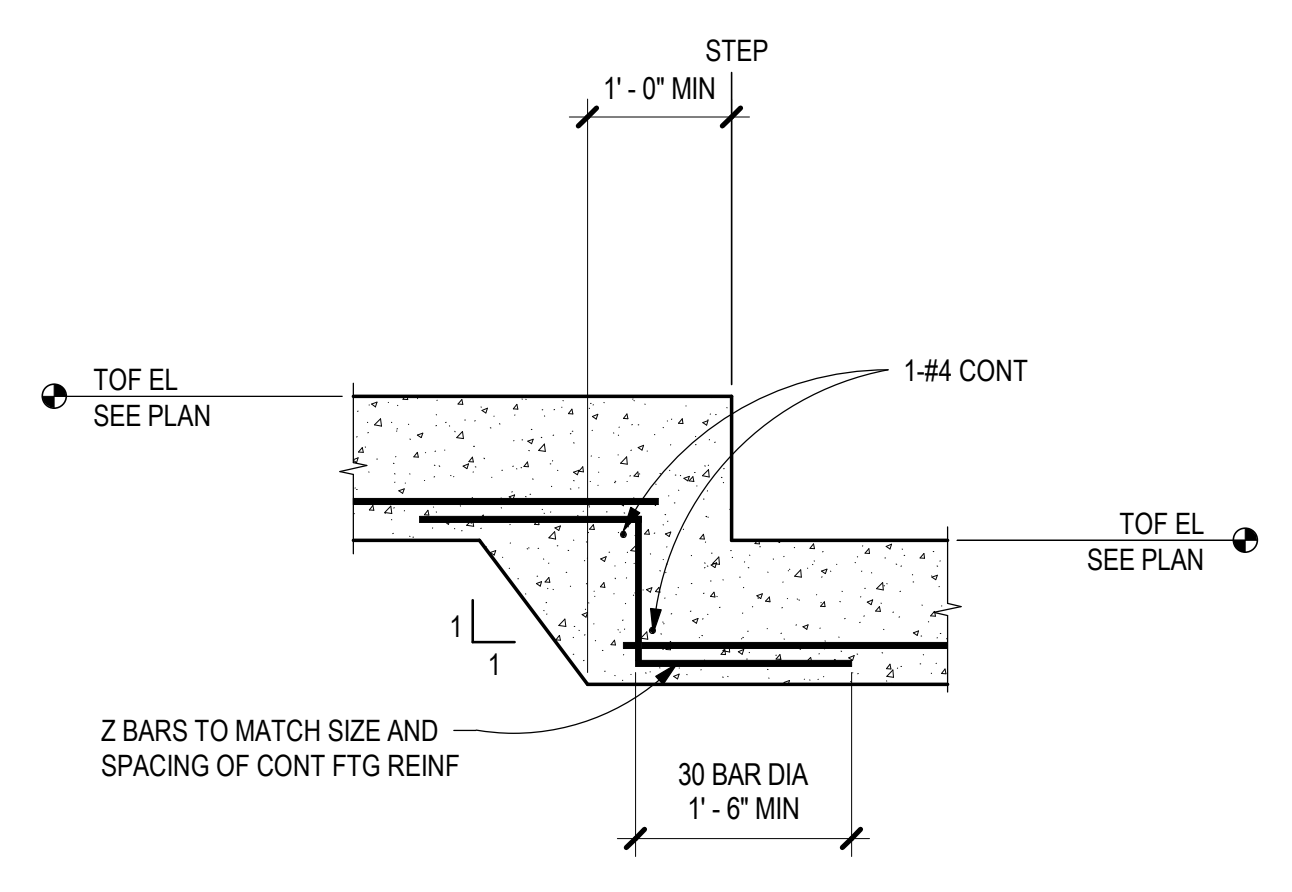

A5 TYPICAL STEPPED FOOTING DETAIL
SCALE: NTS

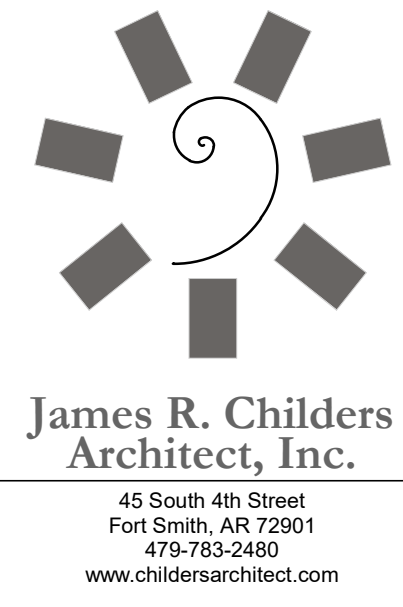

James R. Childers Architect, Inc.
45 South 4th Street
Fort Smith, AR 72901
479-783-2450
www.childersarchitect.com





**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:
PROJECT PHASE:
BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19
JOB NUMBER: 18-01.01


SHEET NUMBER: S7.11
TYPICAL CONCRETE DETAILS

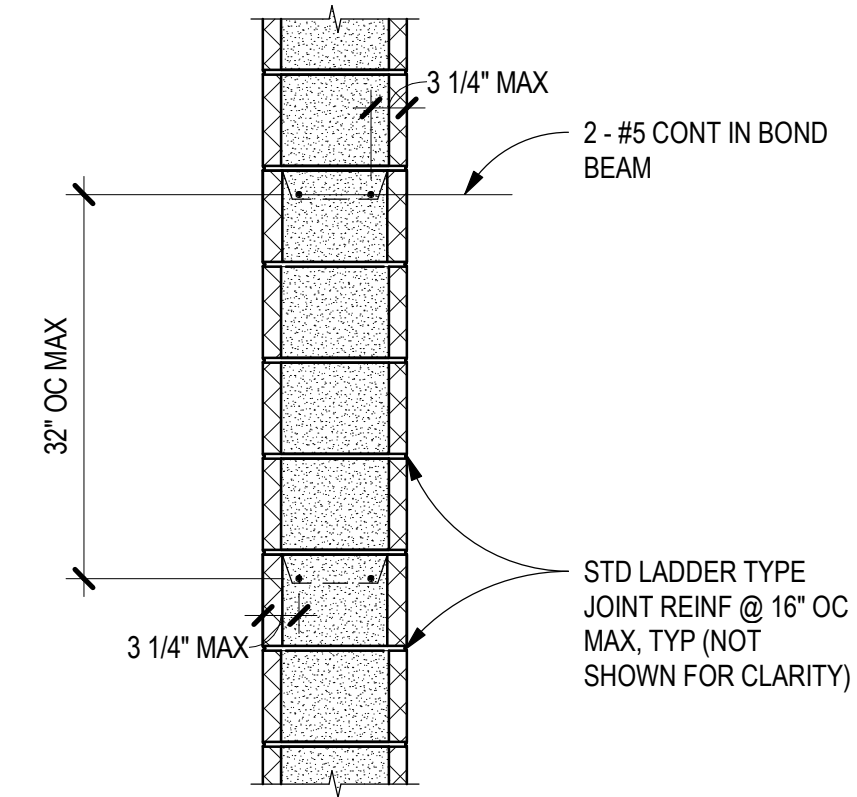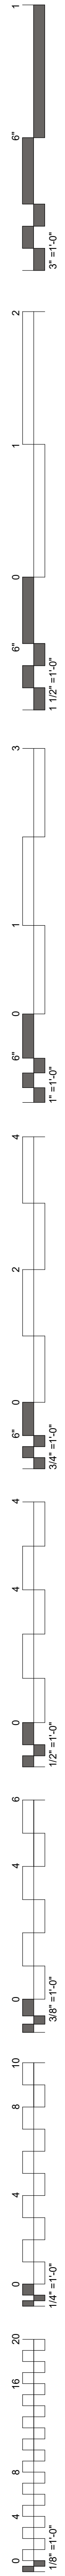


D4 TYPICAL BOND BEAM DETAIL
SCALE: 3/4" = 1'-0"

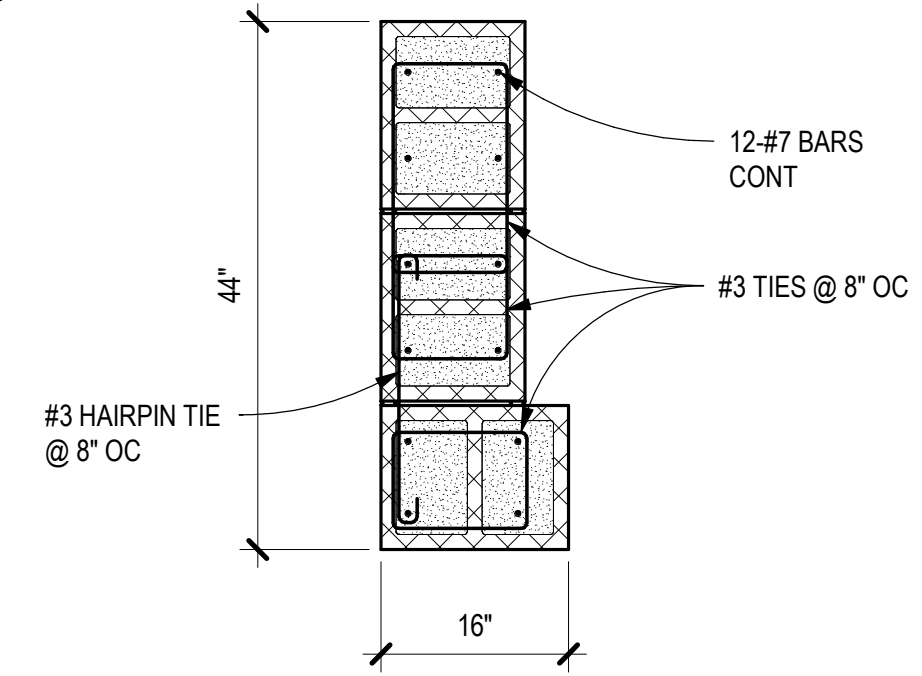


C4 PILASTER DETAIL
SCALE: 3/4" = 1'-0"

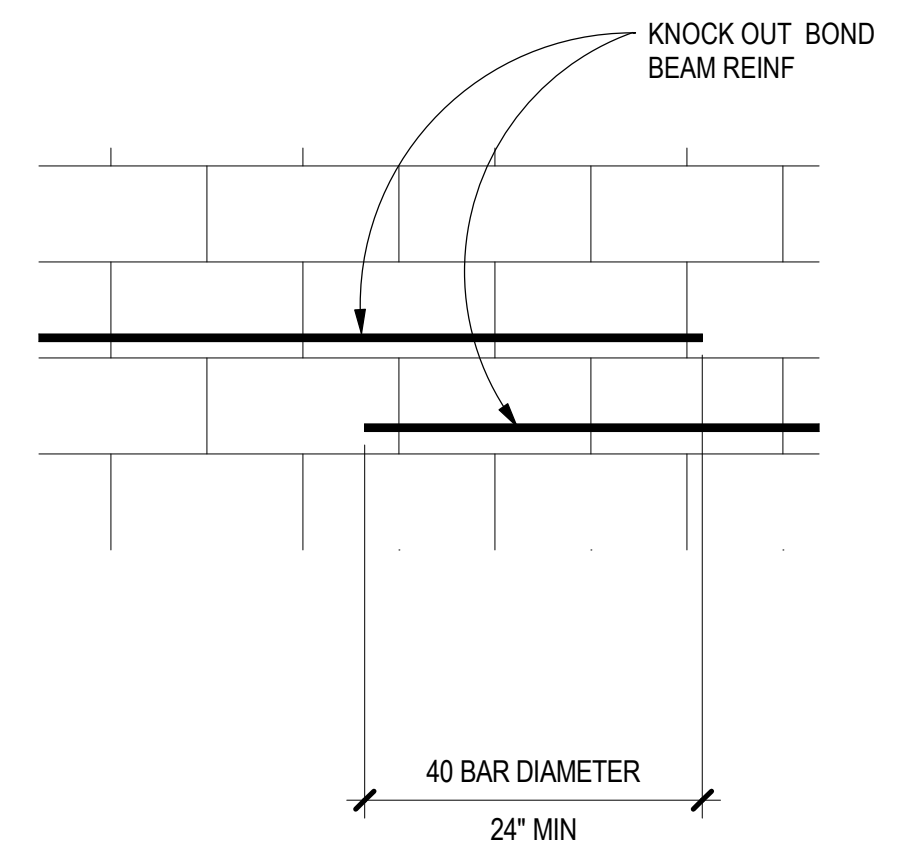


B4 TYPICAL STEP IN BOND BEAM
SCALE: 3/4" = 1'-0"

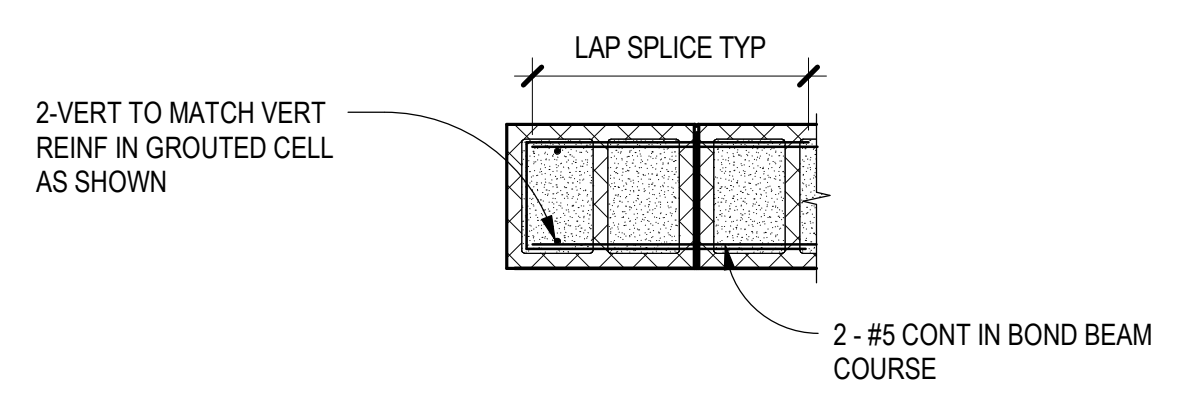


BOND BEAM AT WALL END

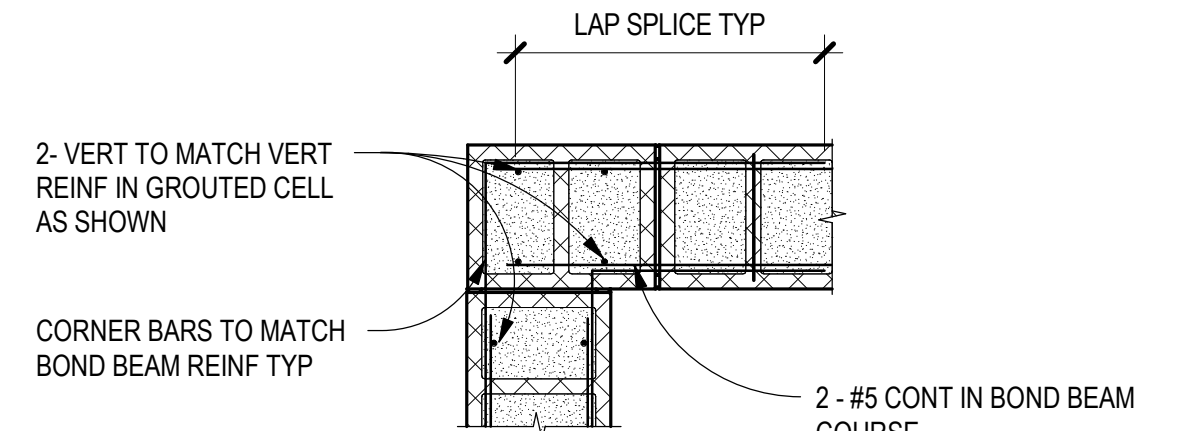

BOND BEAM AT WALL CORNER

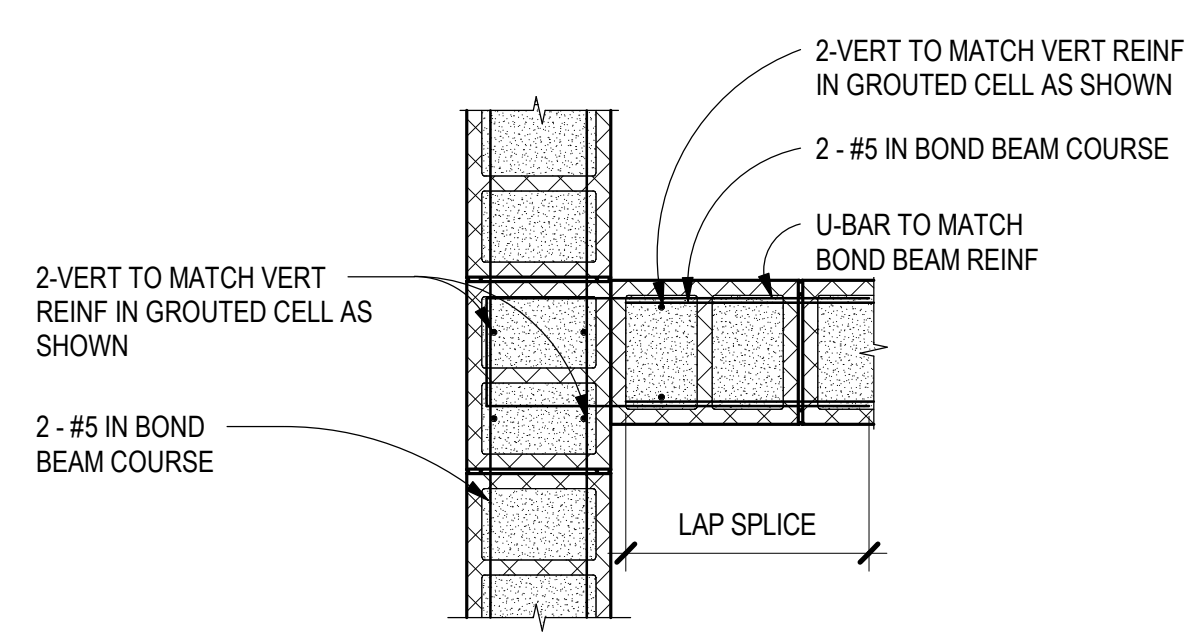


BOND BEAM AT WALL TEE

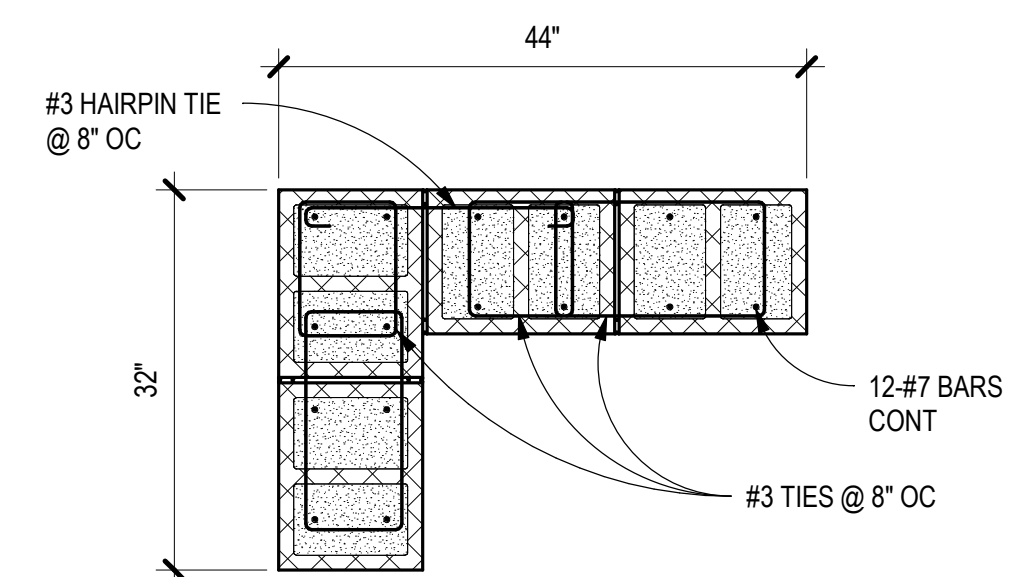


A3 PILASTER DETAIL
SCALE: 3/4" = 1'-0"


NOTES:
1. ALL PILASTER REINFORCING IS IN ADDITION TO REINFORCING SPECIFIED IN WALL SCHEDULE.
2. ALL REINFORCING SHALL BE CONTINUOUS ALONG ENTIRE HEIGHT OF WALL, UNLESS NOTED OTHERWISE.

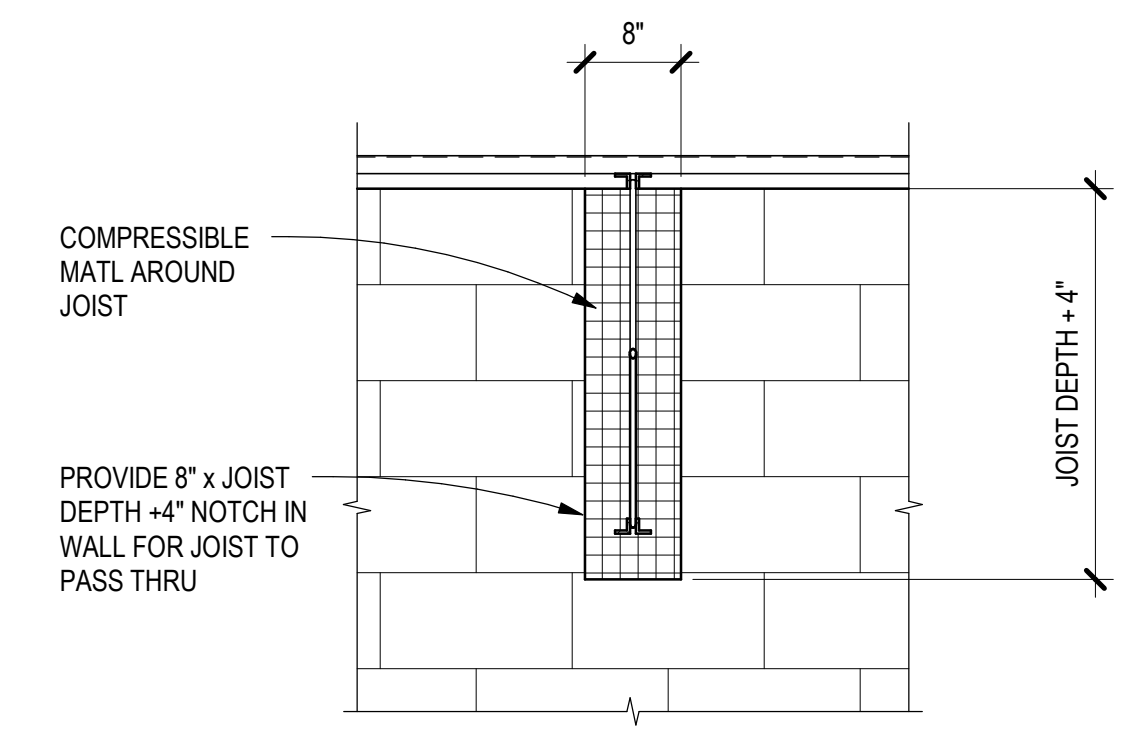


D5 TYPICAL JOIST THRU CMU WALL
SCALE: 3/4" = 1'-0"

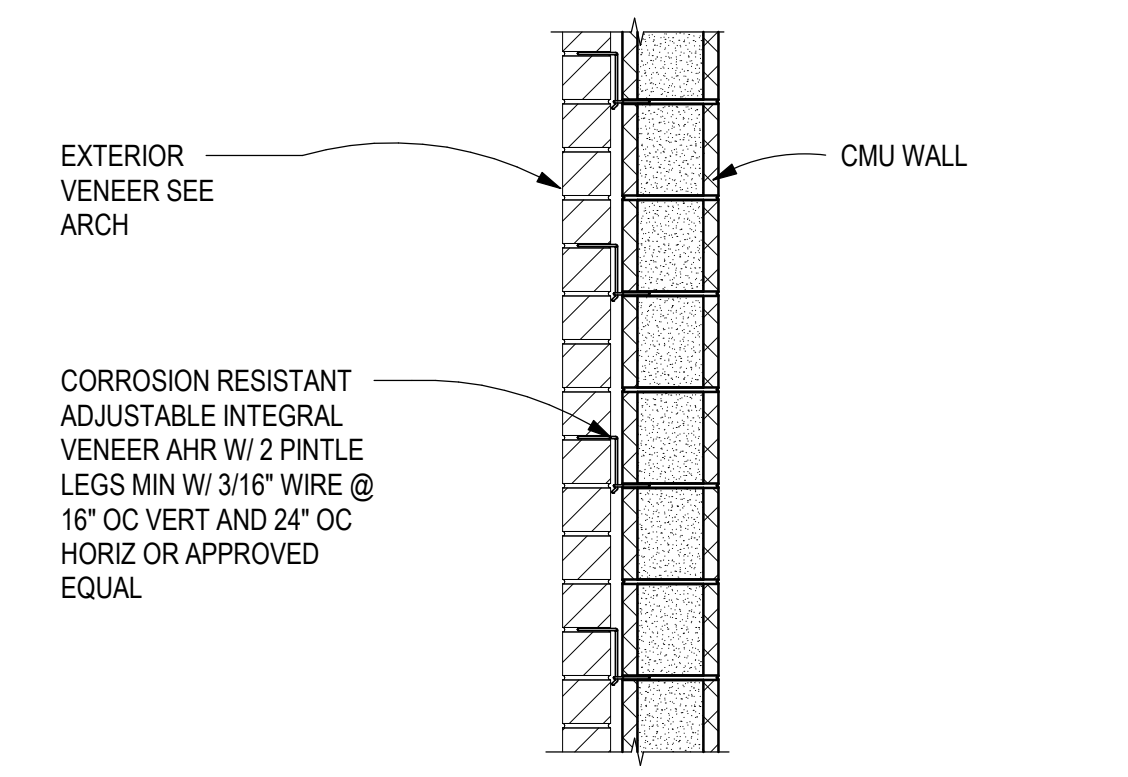


C5 TYPICAL VENEER TO CMU WALL DETAIL
SCALE: 3/4" = 1'-0"

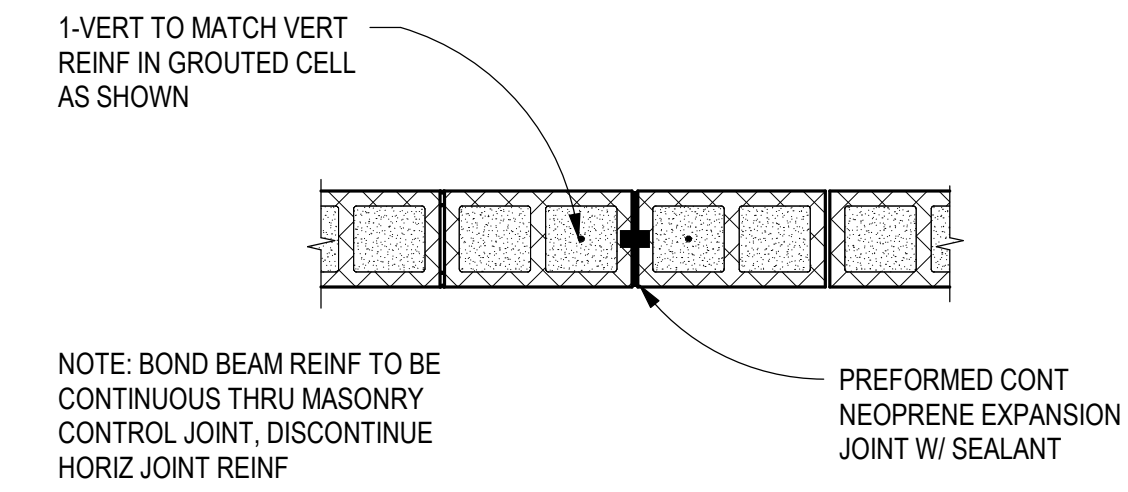


B5 TYPICAL CMU CNRTL JOINT (MCJ)
SCALE: 3/4" = 1'-0"

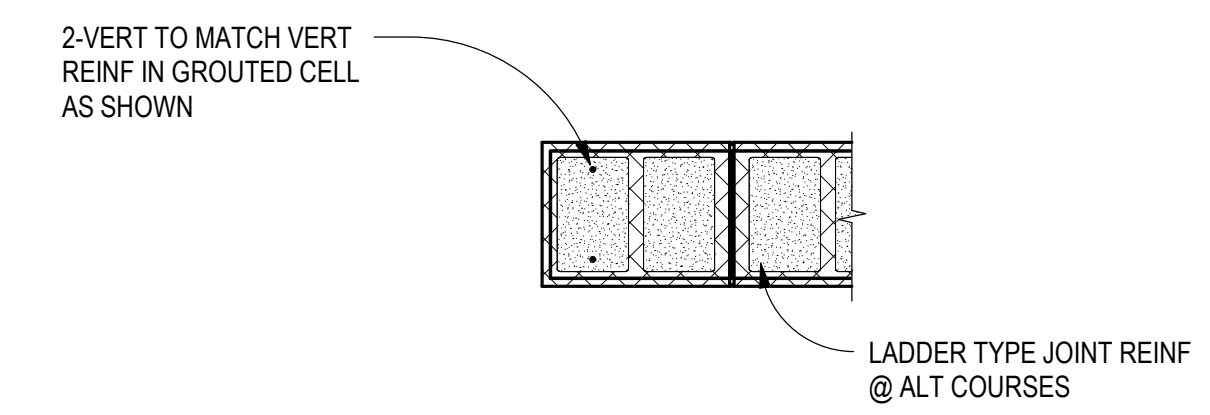

WALL END

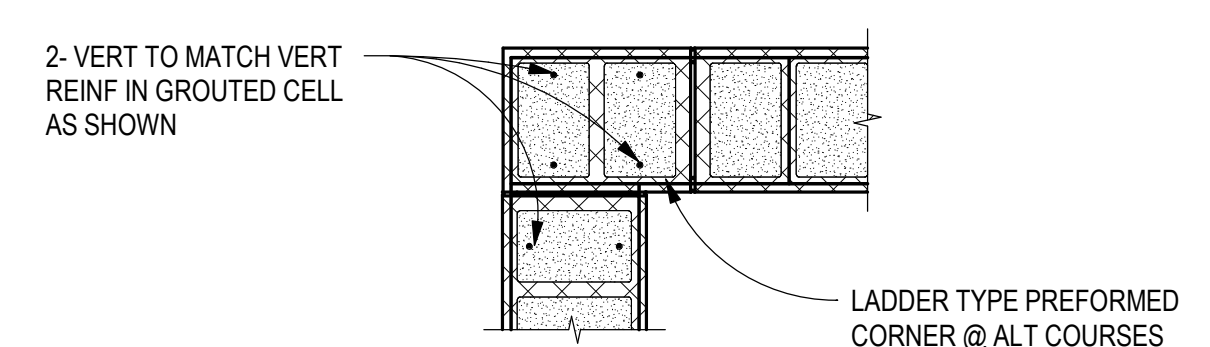


WALL CORNER

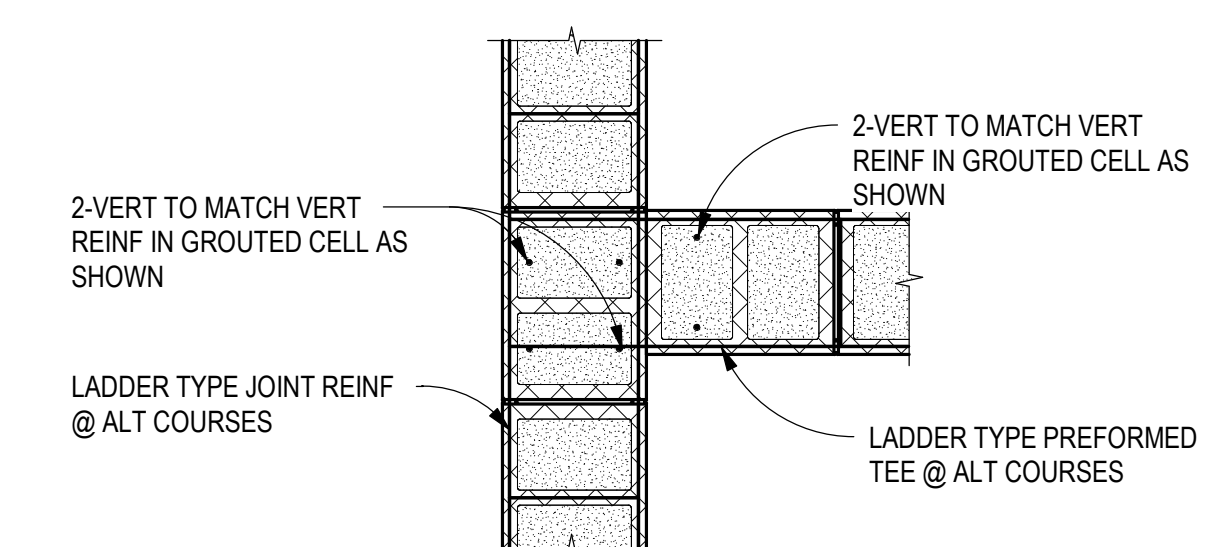

WALL TEE

A5 TYPICAL 12" CMU PLAN DETAILS
SCALE: 3/4" = 1'-0"



**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:

PROJECT PHASE:
BID PACKAGE 01



#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:

S7.21


TYPICAL MASONRY DETAILS

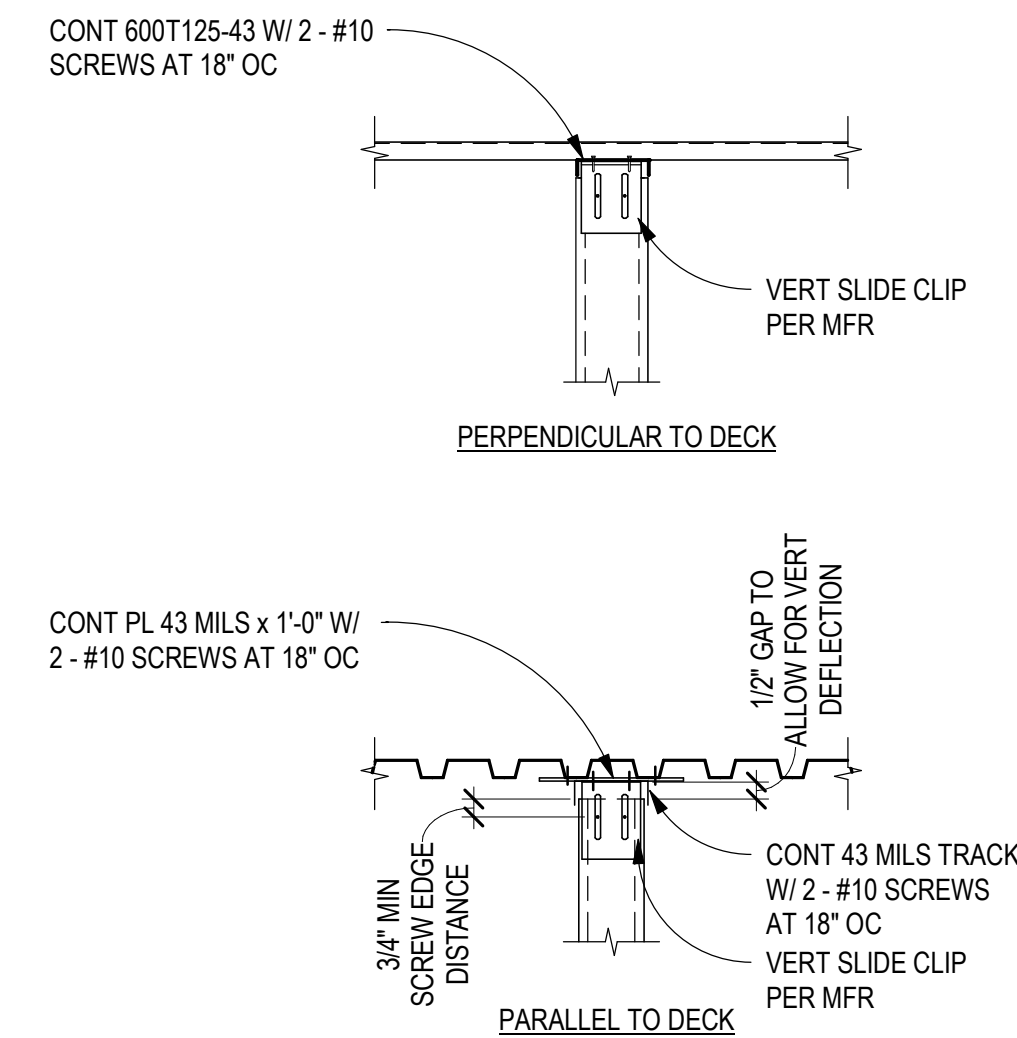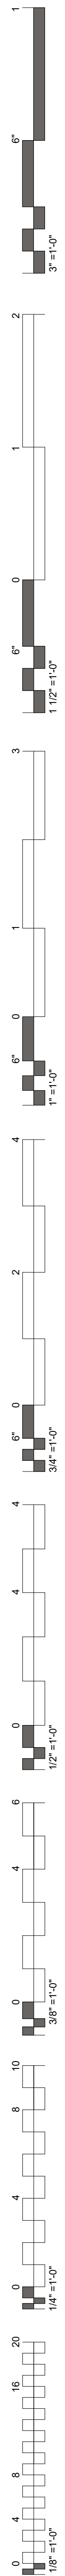


D4 TYPICAL SLIP TRACK ASSEMBLY
SCALE: NTS

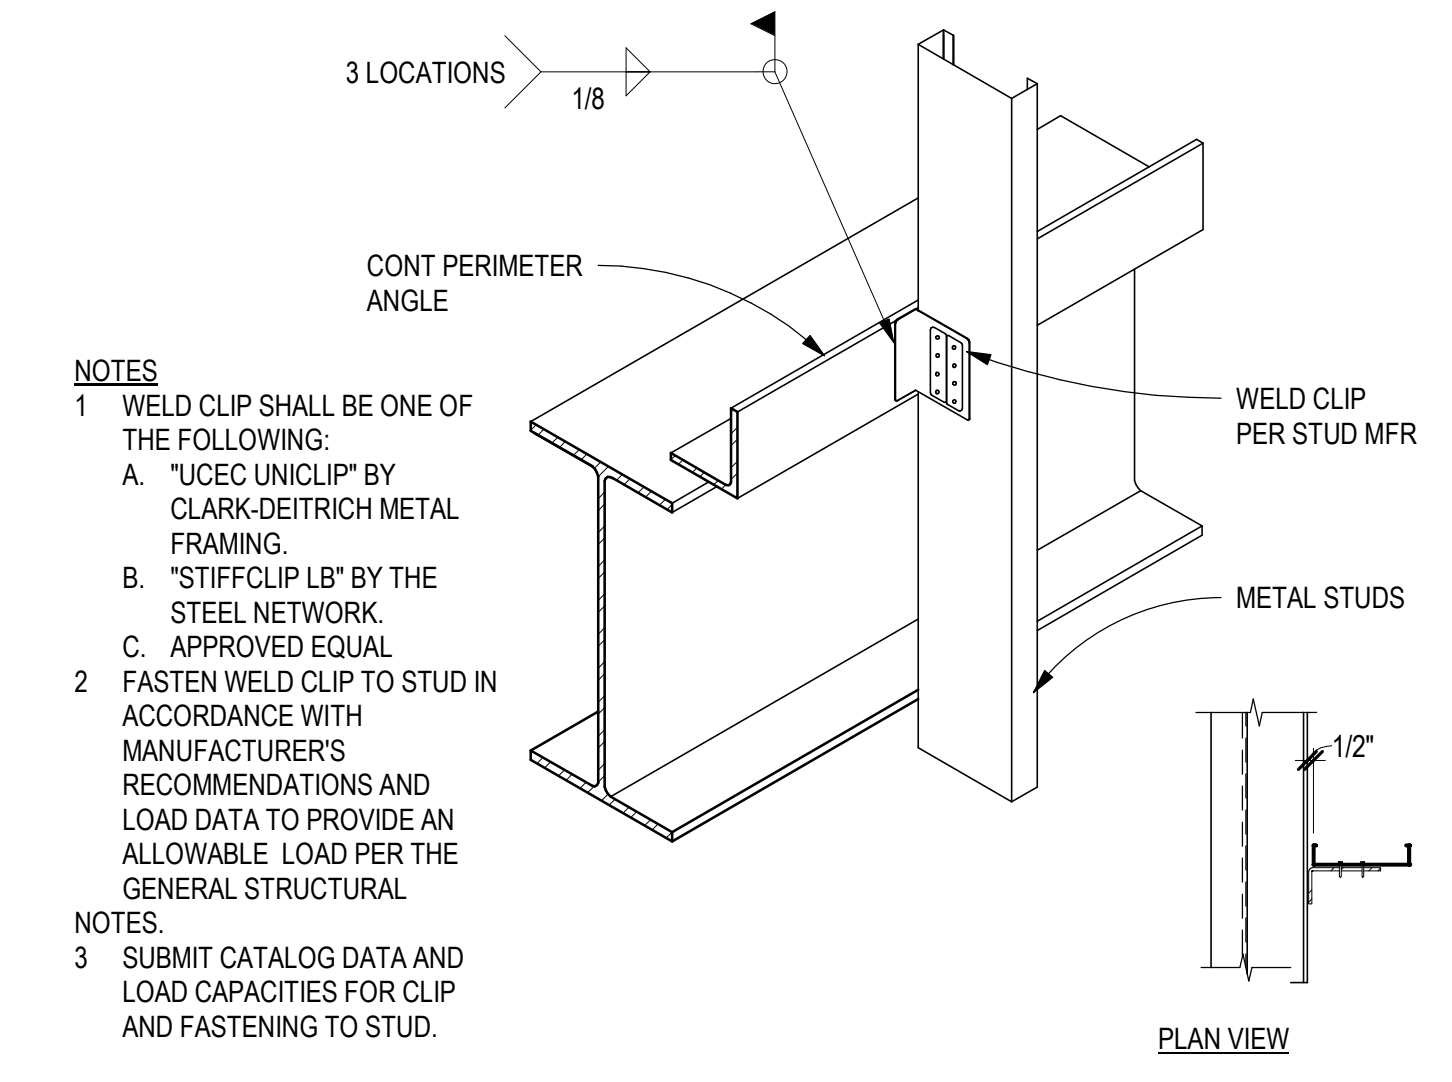

D5 TYPICAL WELD CLIP
SCALE: NTS

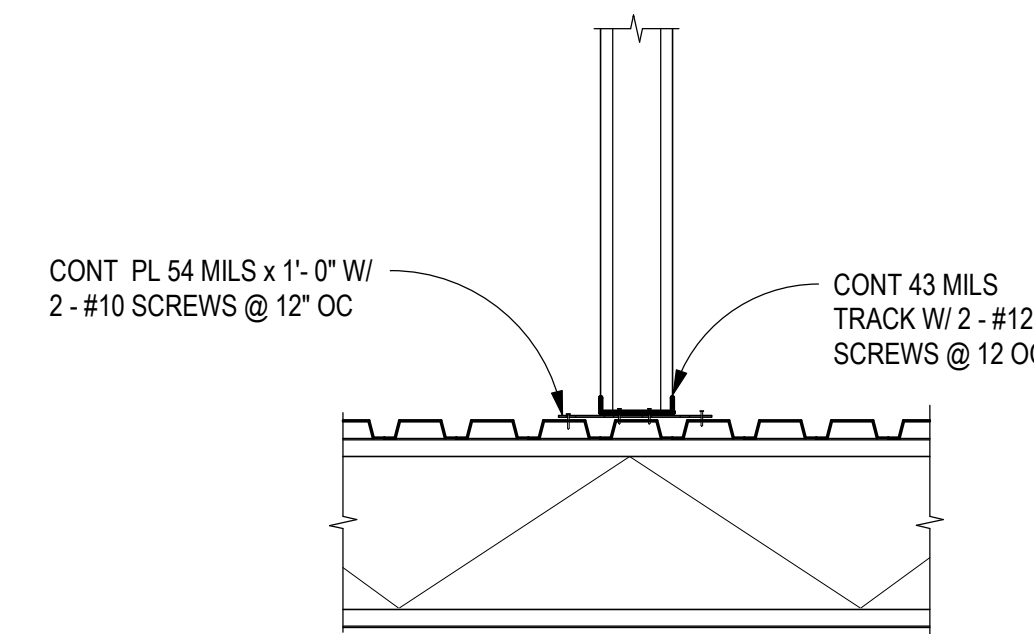


C4 TYPICAL STUD AT METAL DECK
SCALE: 3/4" = 1'-0"

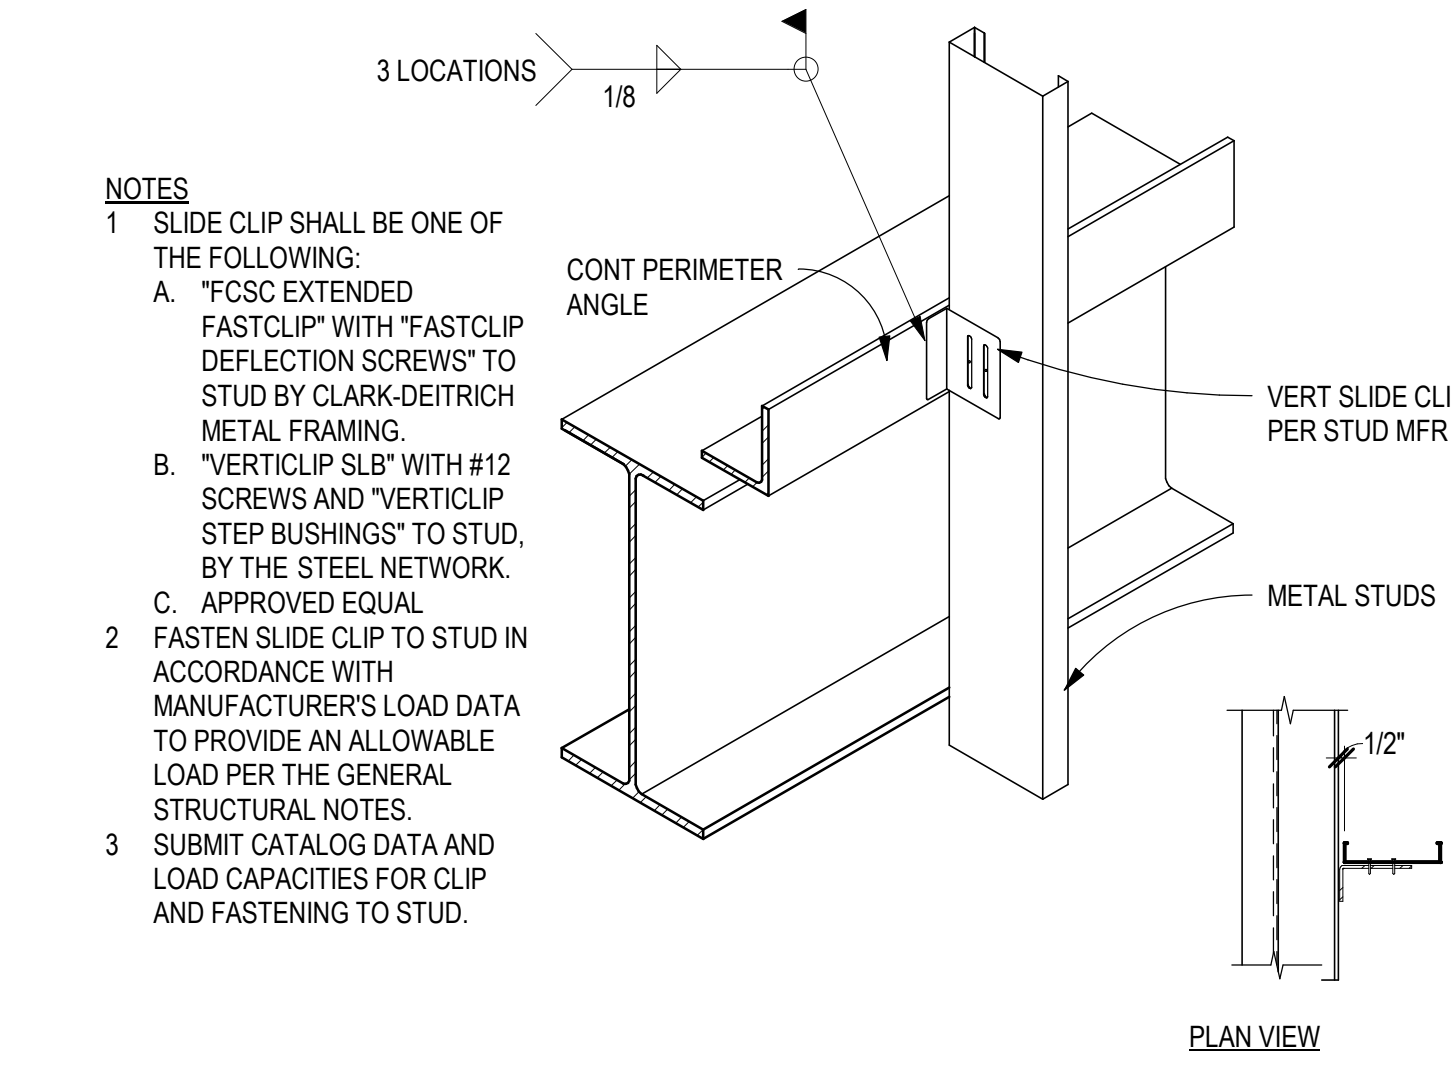


C5 TYPICAL VERTICAL SLIDE CLIP
SCALE: NTS


VENEER LINTEL	
OPENING WIDTH	ANGLE
0' - 0" TO 2' - 0"	L5x3x1/4 LLH
2' - 1" TO 3' - 4"	L5x3x3/8 LLH
3' - 5" TO 4' - 0"	L5x3x3/8 LLH
4' - 1" TO 6' - 4"	L6x6x1/2
6' - 5" TO 8' - 0"	L6x6x1/2

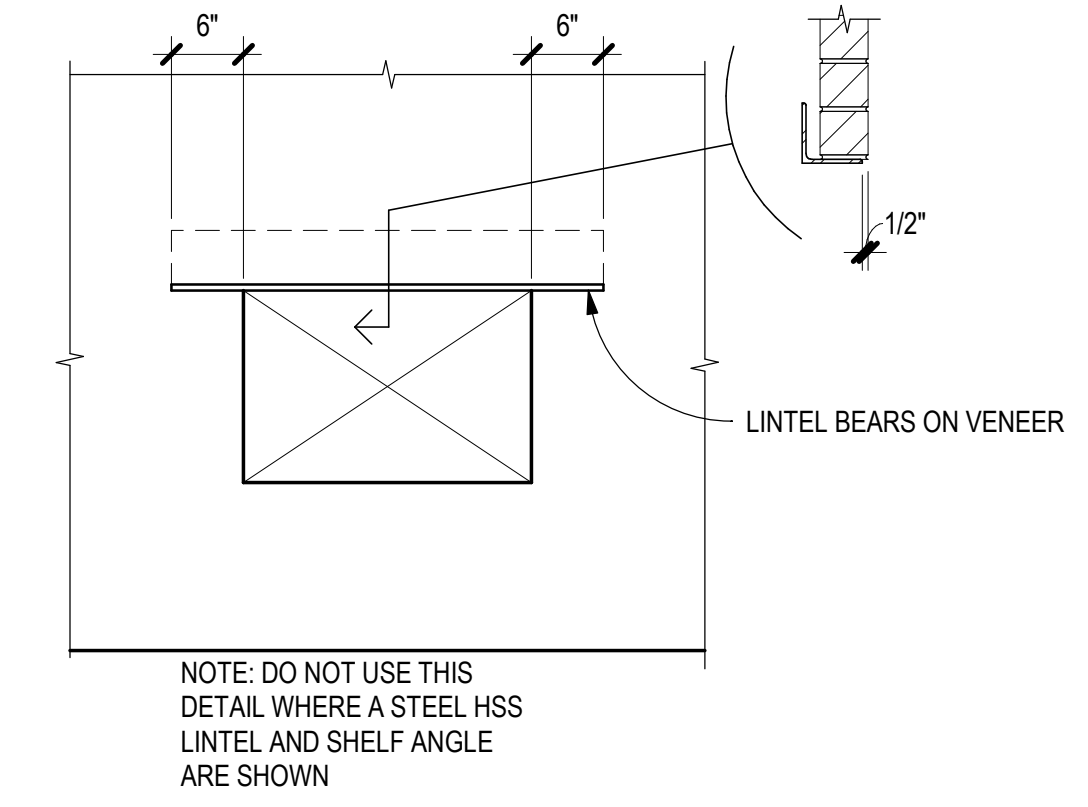


B3 COLD-FORMED LINTEL SECTION @ VENEER
SCALE: 3/4" = 1'-0"

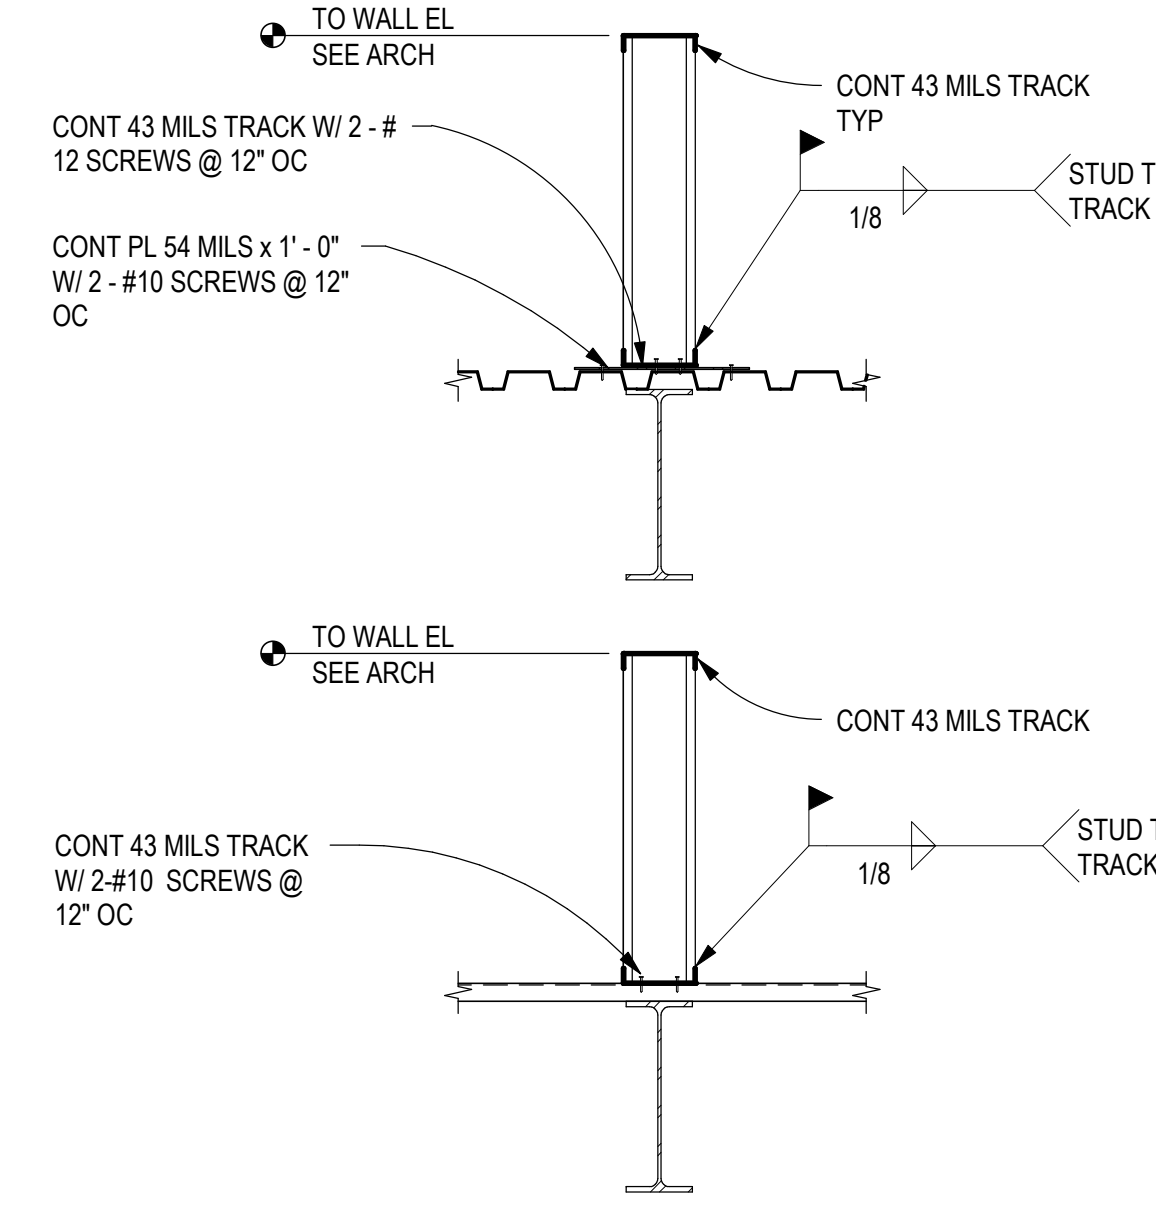


B4 TYPICAL PARAPET TO DECK
SCALE: 3/4" = 1'-0"

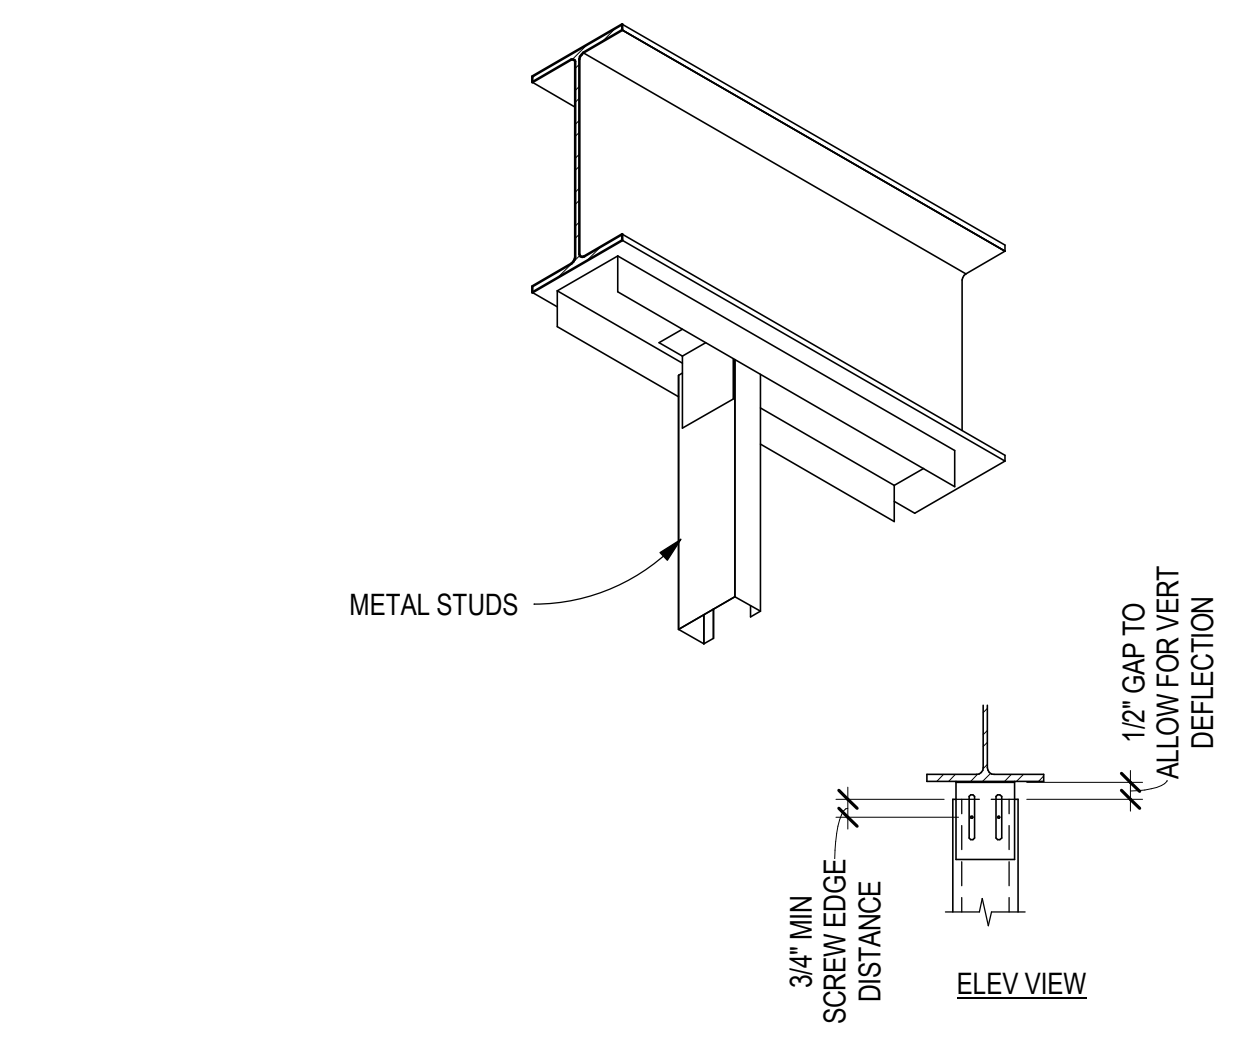


B5 TYPICAL SLIP TRACK ASSEMBLY
SCALE: NTS

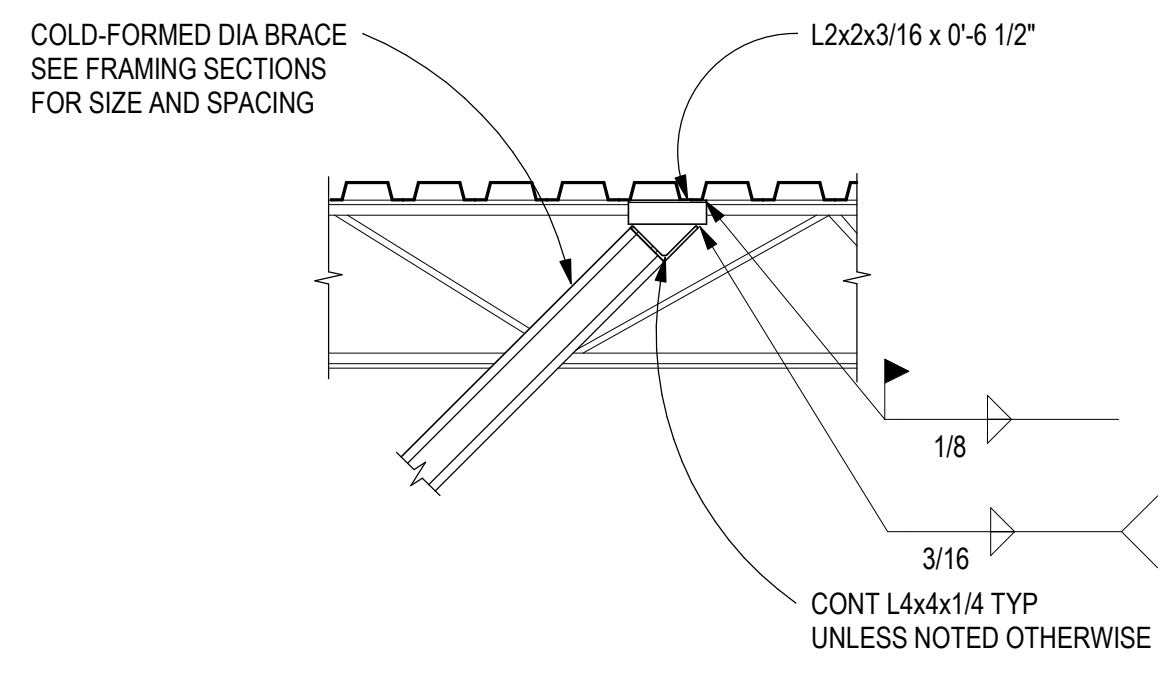


A3 TYPICAL DIAG BRACE TO DECK
SCALE: 3/4" = 1'-0"

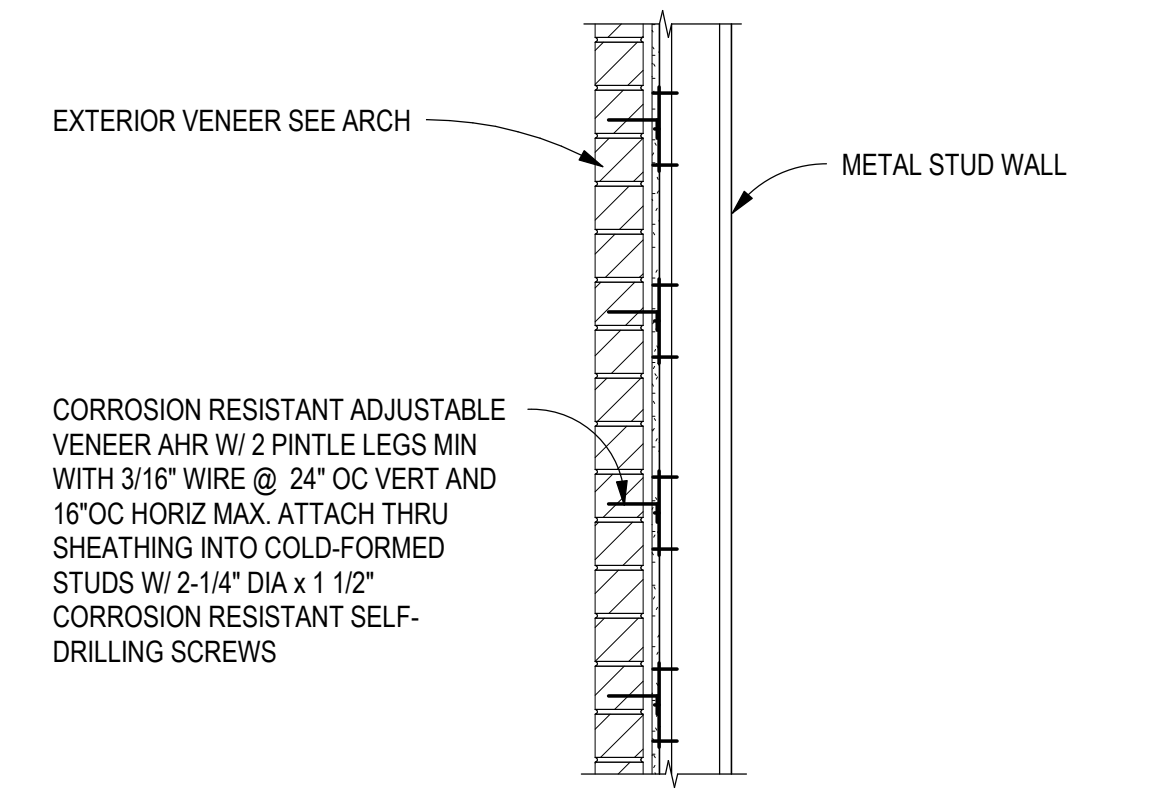


A4 TYPICAL VENEER ON MTL STUDS
SCALE: 3/4" = 1'-0"

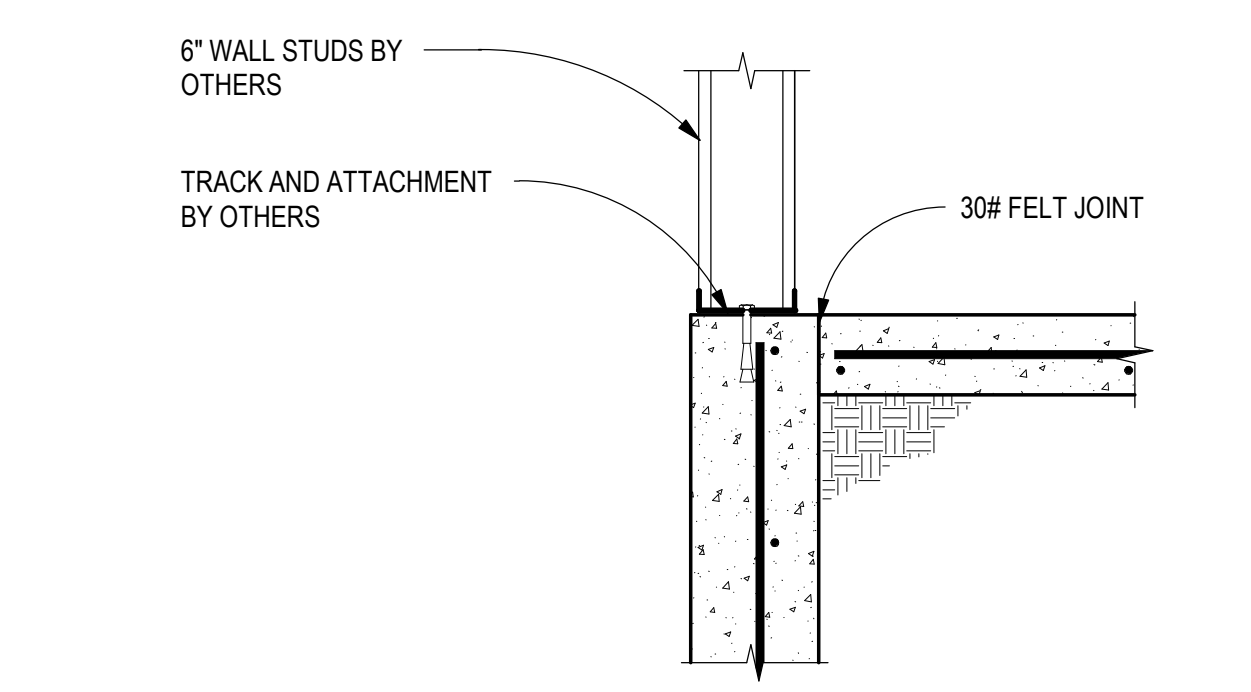




A5 TYPICAL STUDS AT STEMWALL
SCALE: 1" = 1'-0"

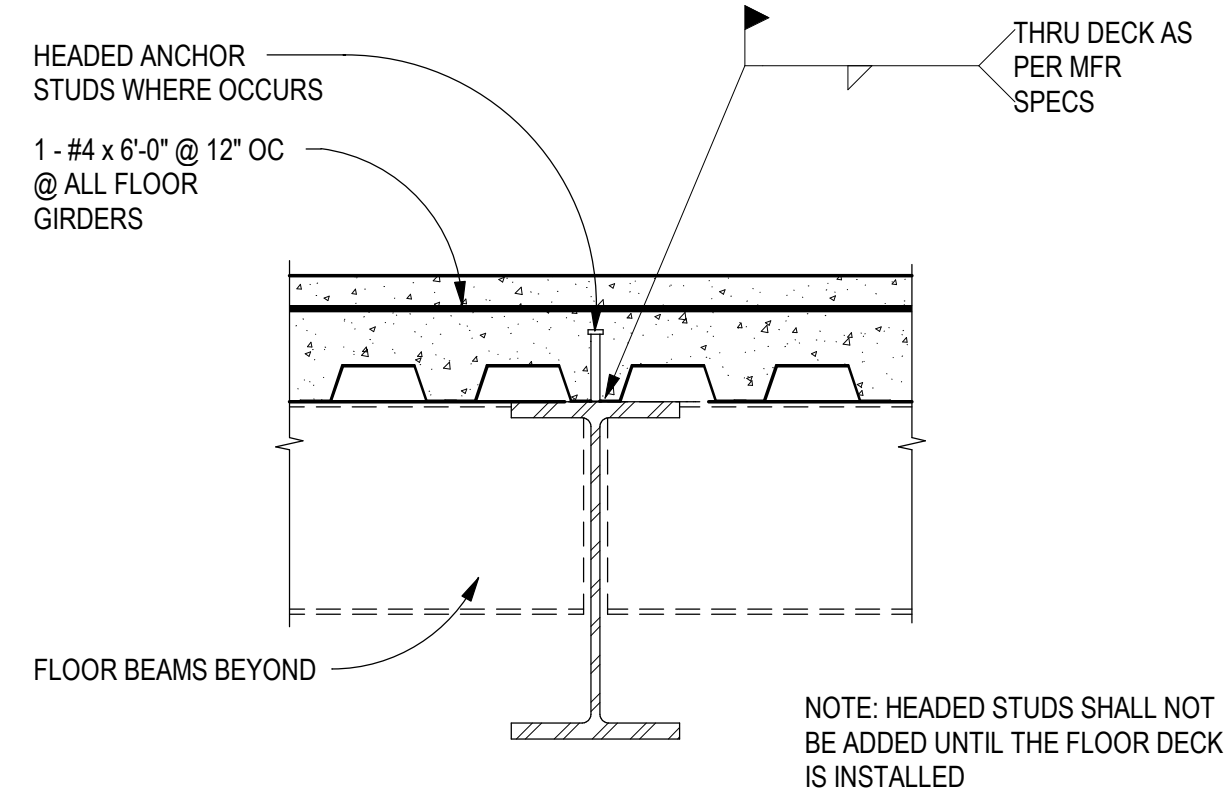


D1 TYPICAL FLOOR GIRDER
SCALE: 3/4" = 1'-0"

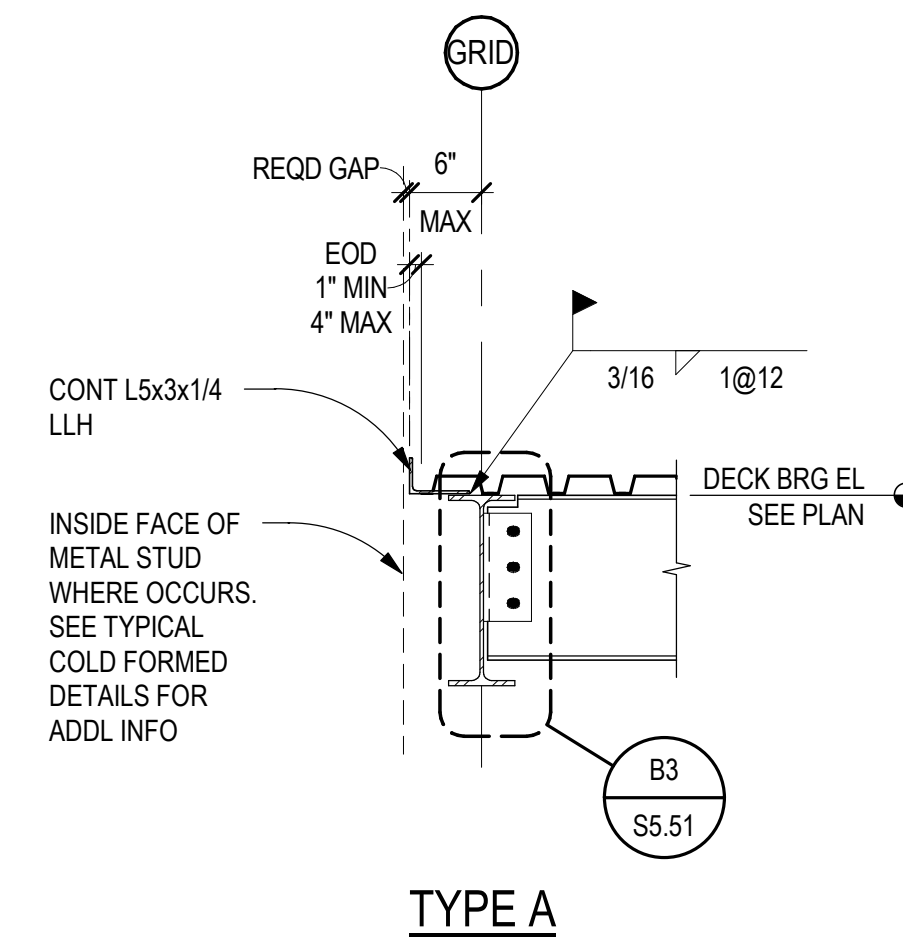


D3 TYPICAL DECK EDGE AT NON-BEARING BEAM
SCALE: 3/4" = 1'-0"

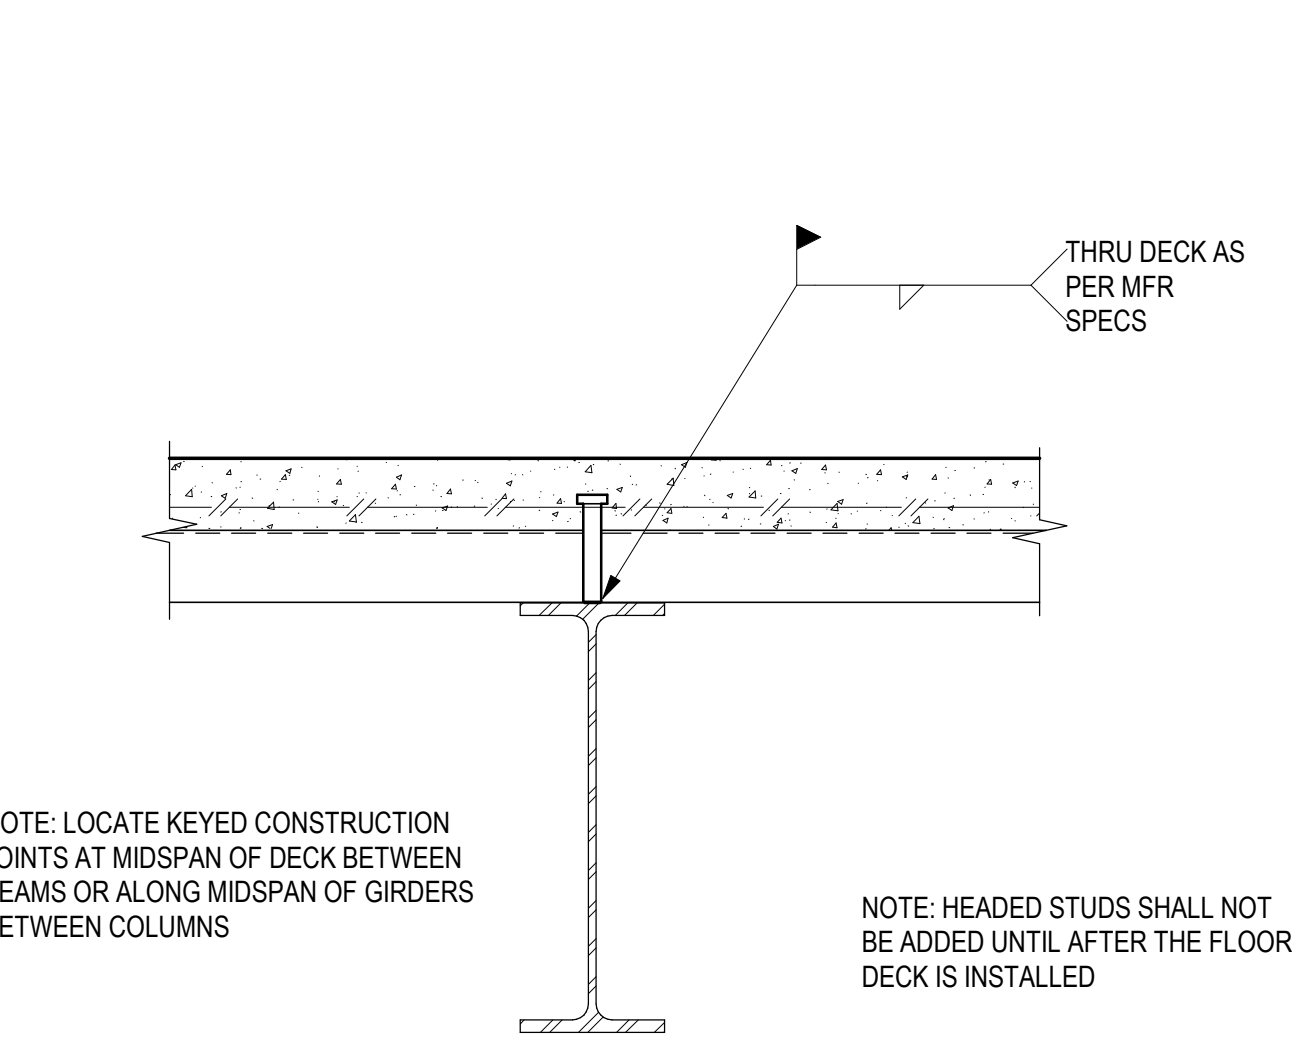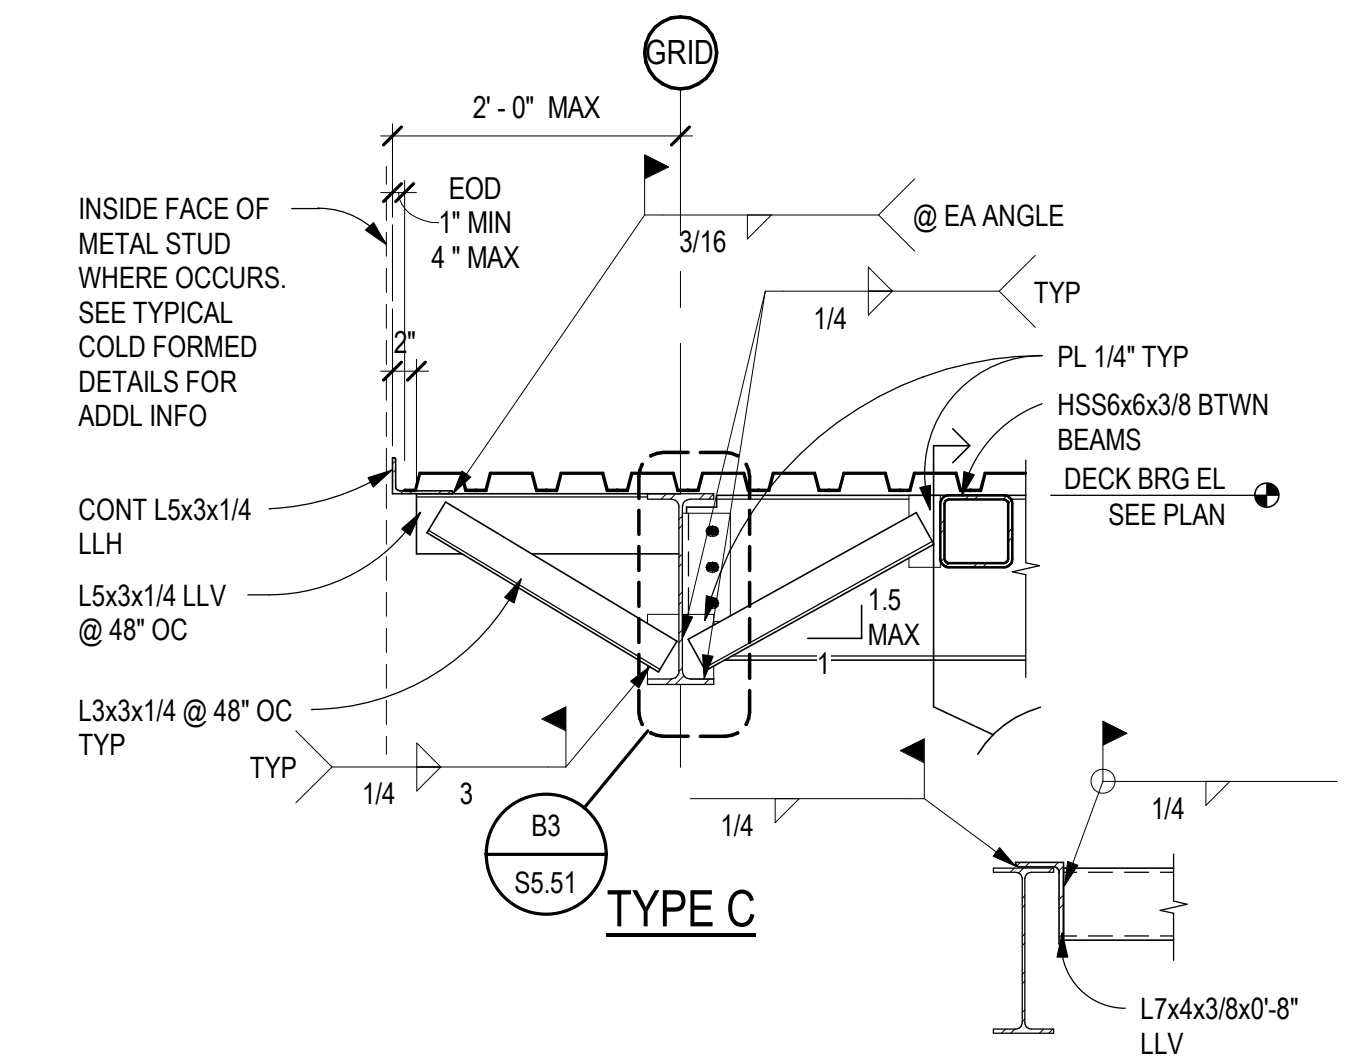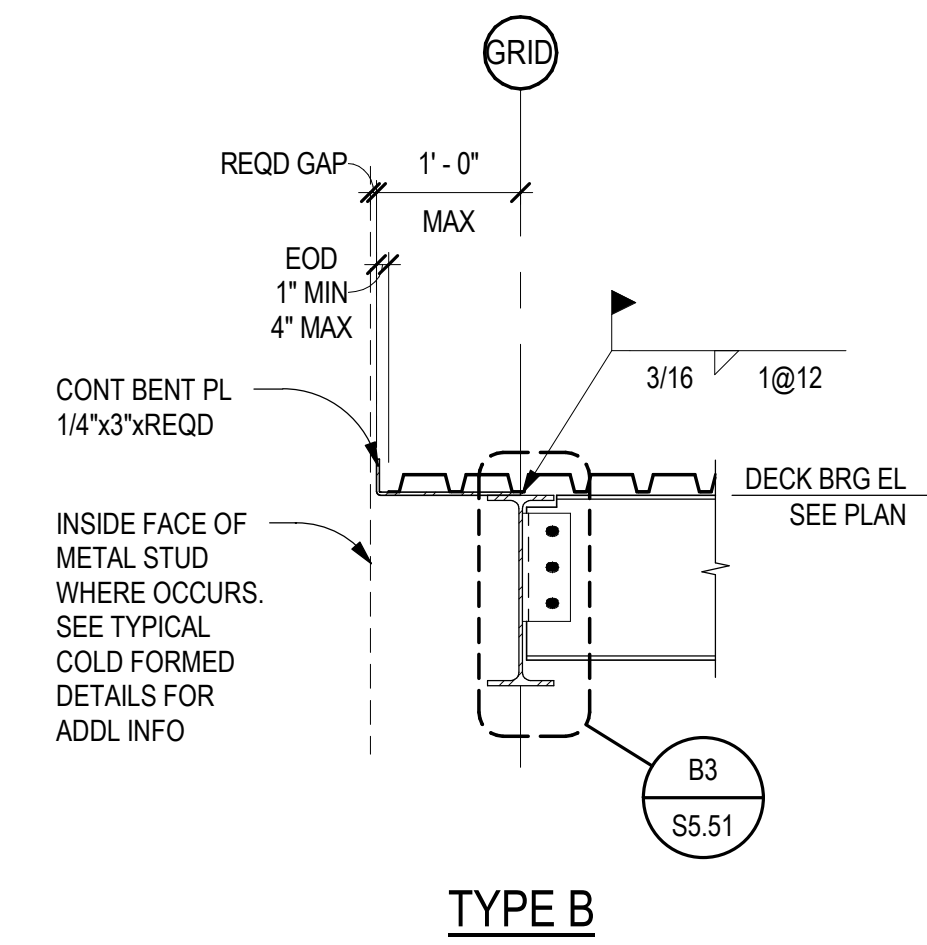




C1 TYPICAL COMPOSITE BEAM
SCALE: 1 1/2" = 1'-0"

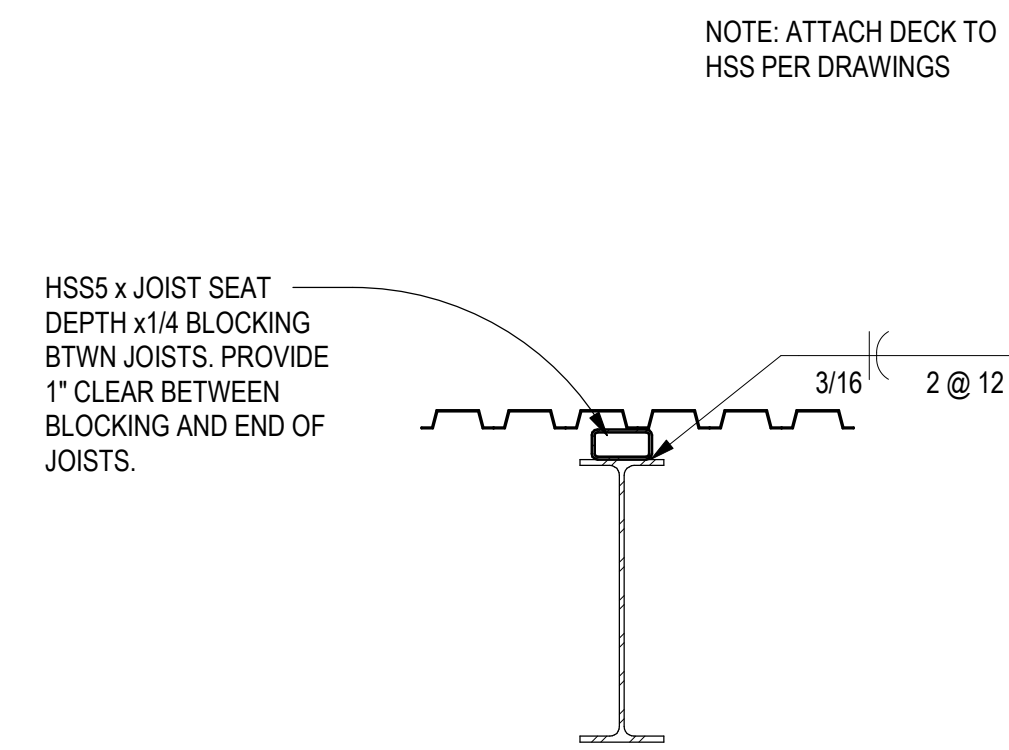


C2 TYPICAL HSS BLOCKING DETAIL
SCALE: 3/4" = 1'-0"

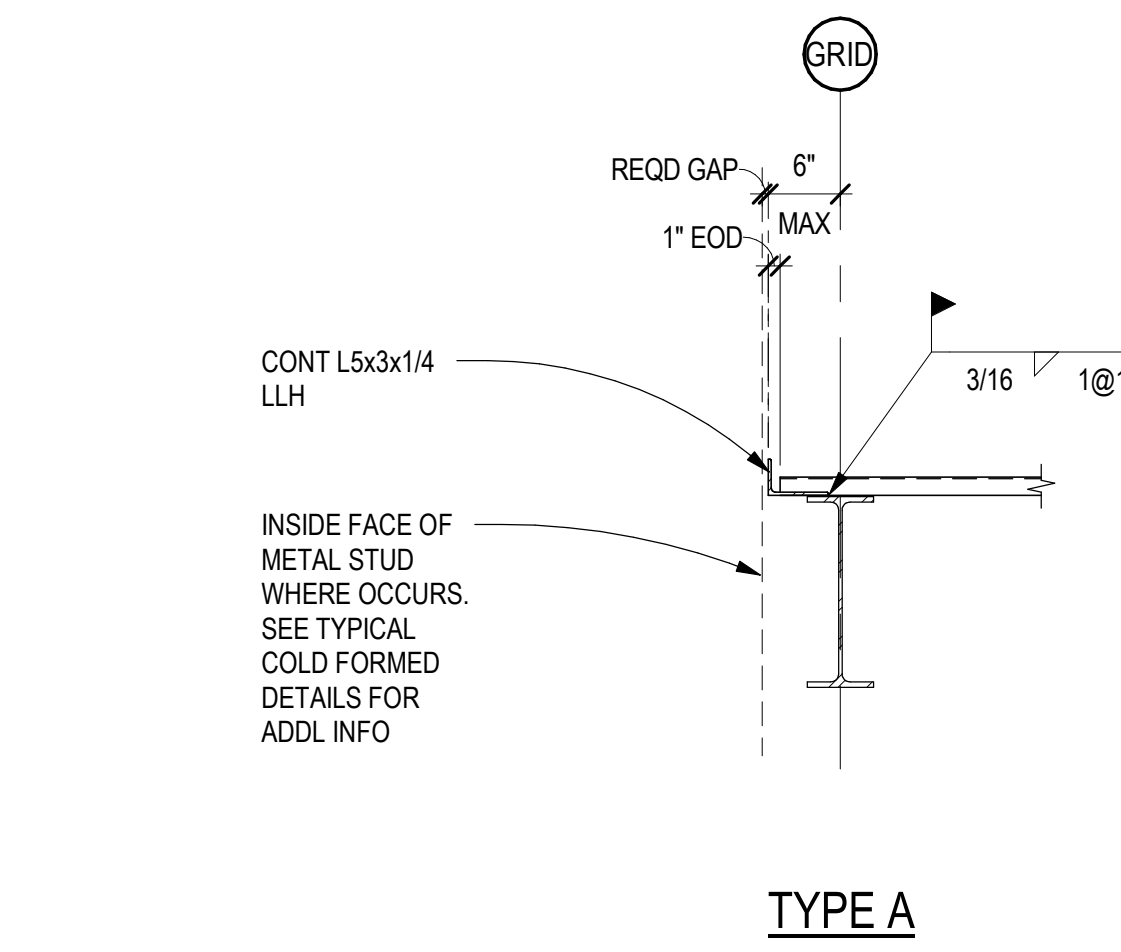


C3 TYPICAL DECK EDGE AT NON-BEARING
SCALE: 3/4" = 1'-0"

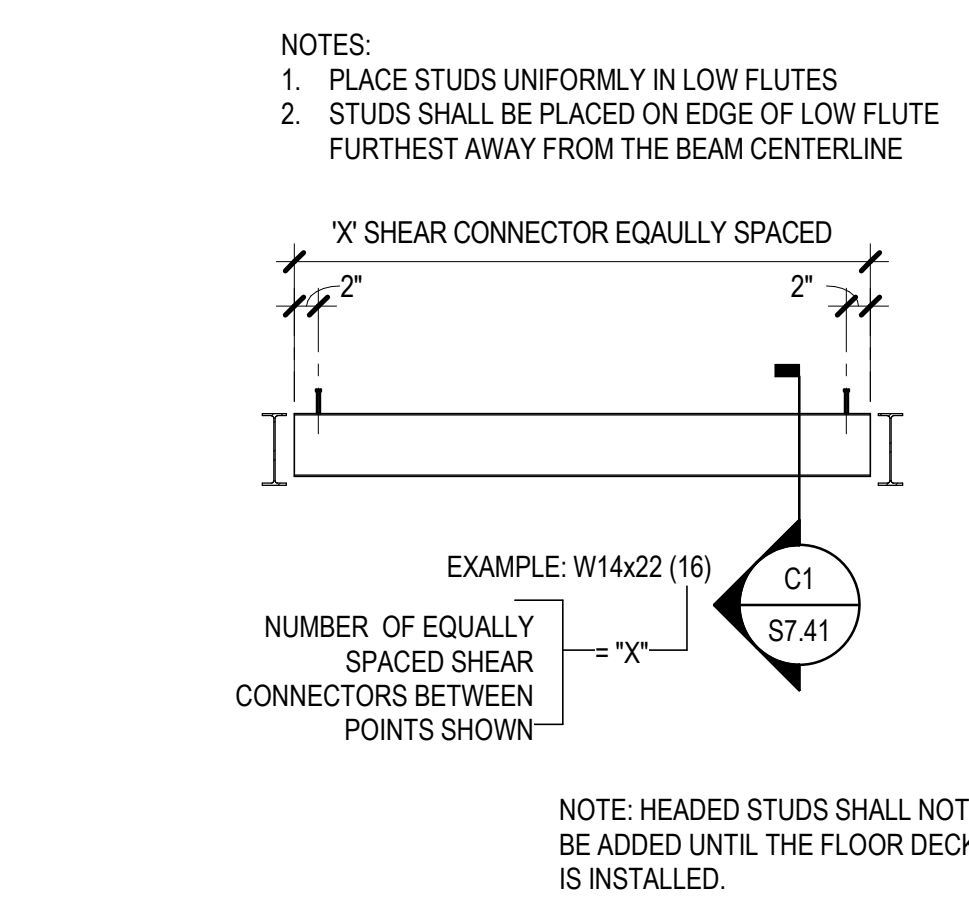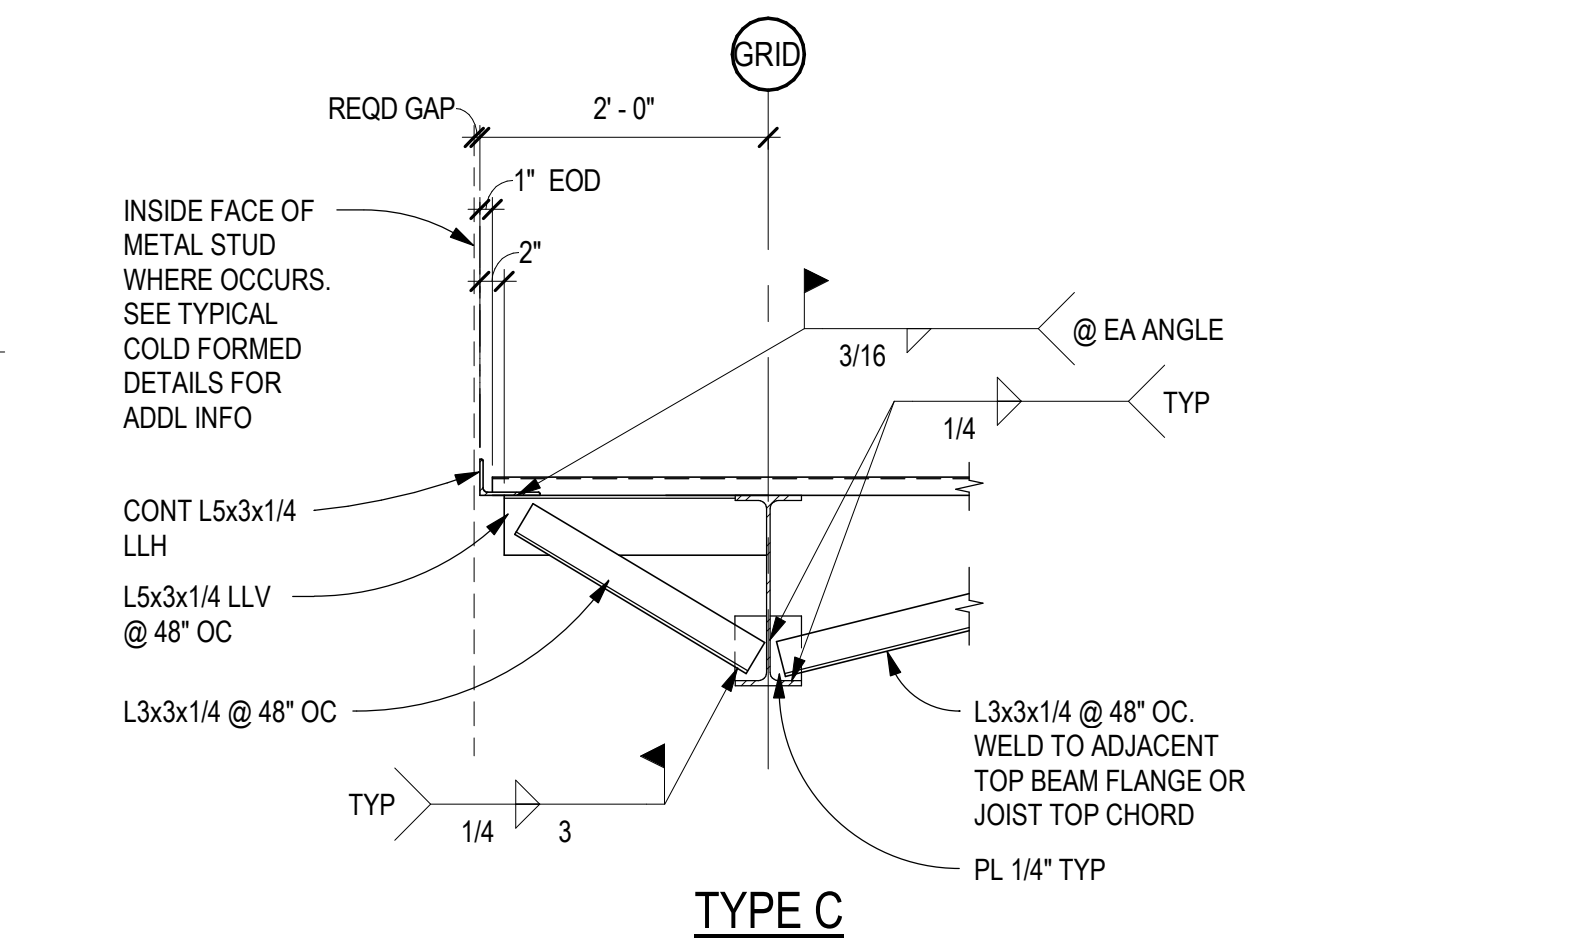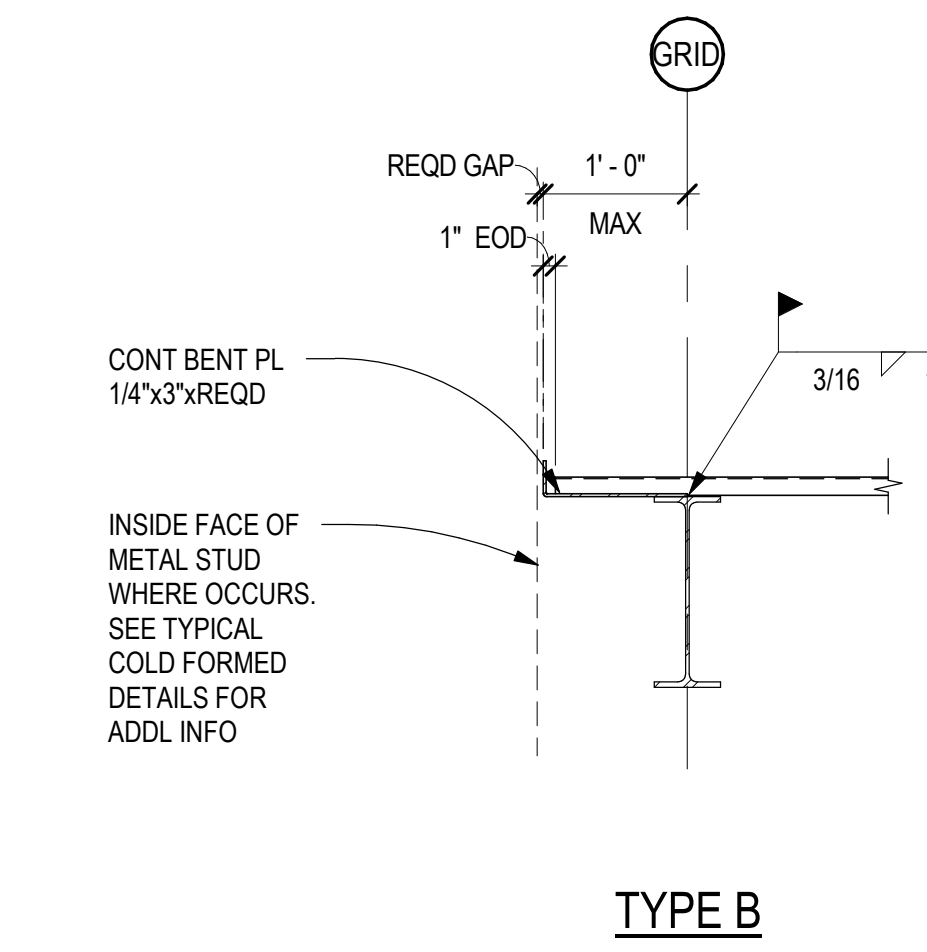




B1 TYPICAL COMPOSITE BEAM ELEV
SCALE: 1/4" = 1'-0"

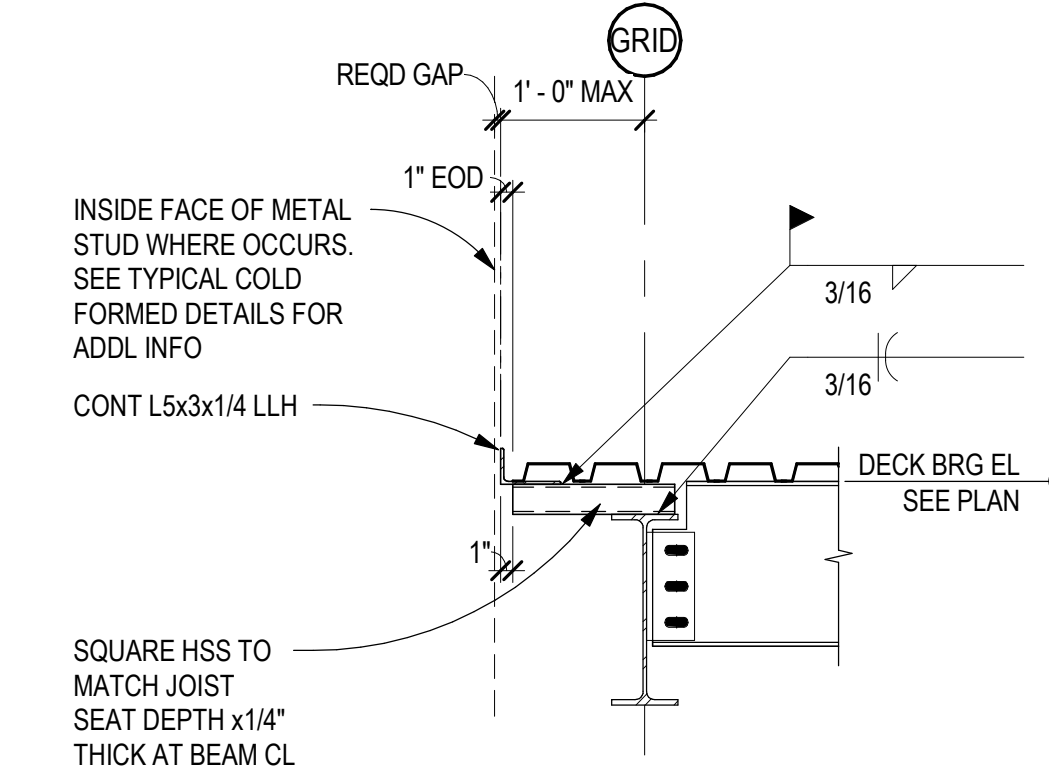


B2 TYPICAL DECK EDGE AT BEAM
SCALE: 3/4" = 1'-0"

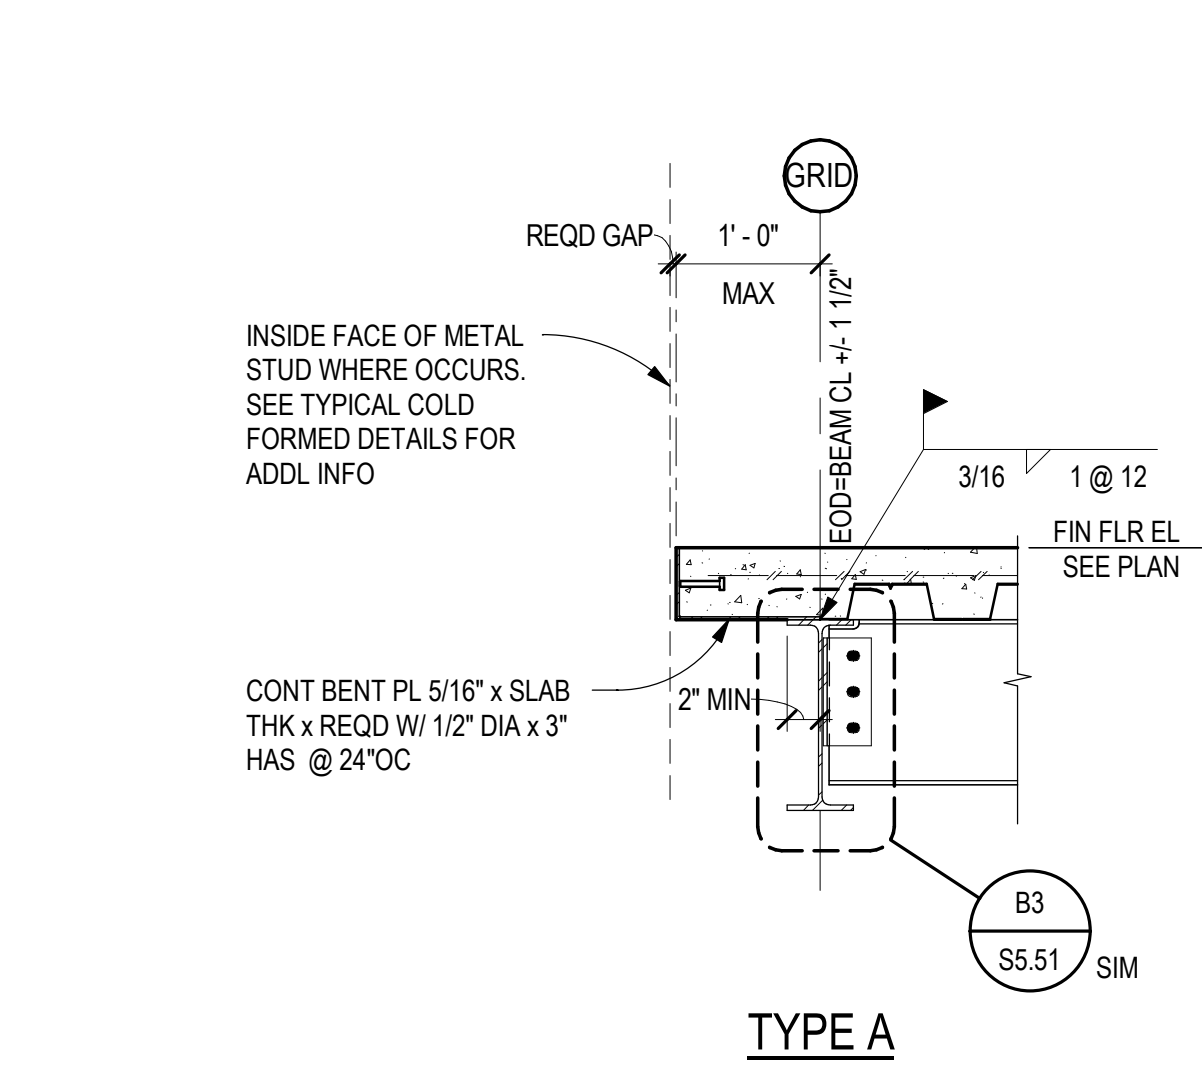


B3 TYPICAL SLAB EDGE AT BEARING CONDITION
SCALE: 3/4" = 1'-0"

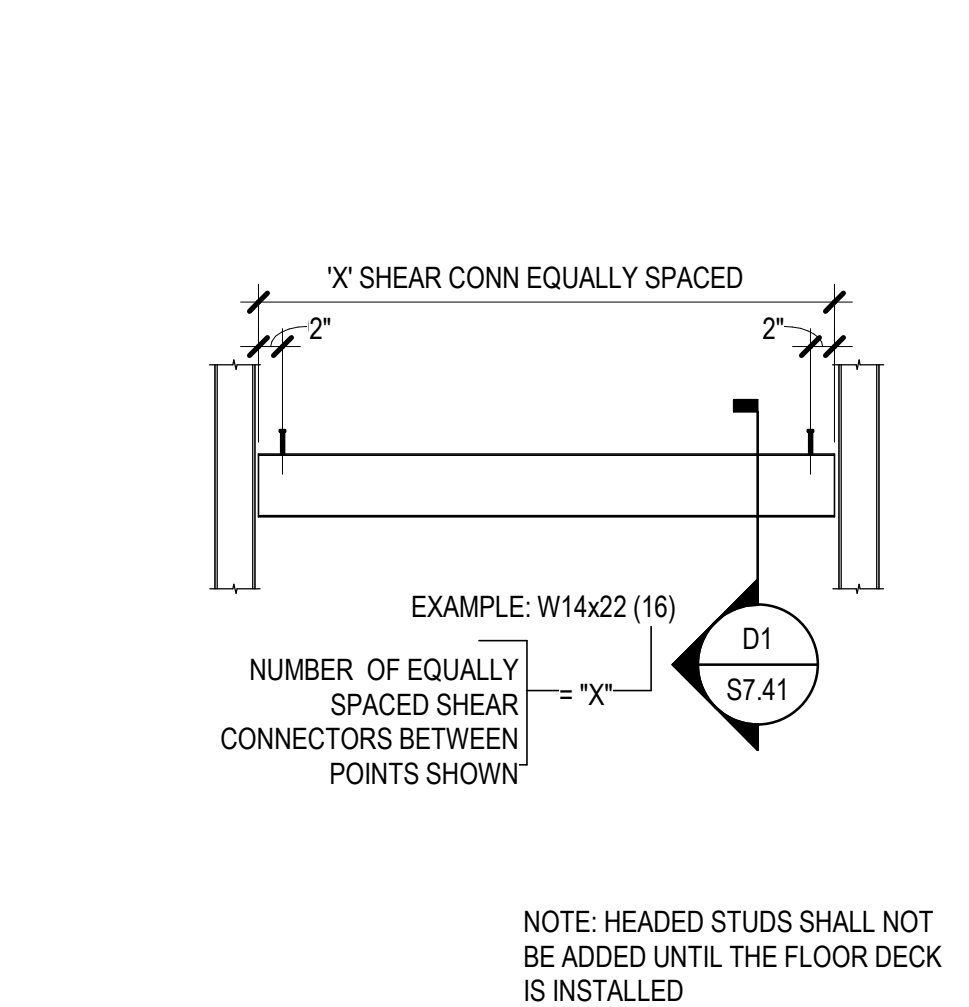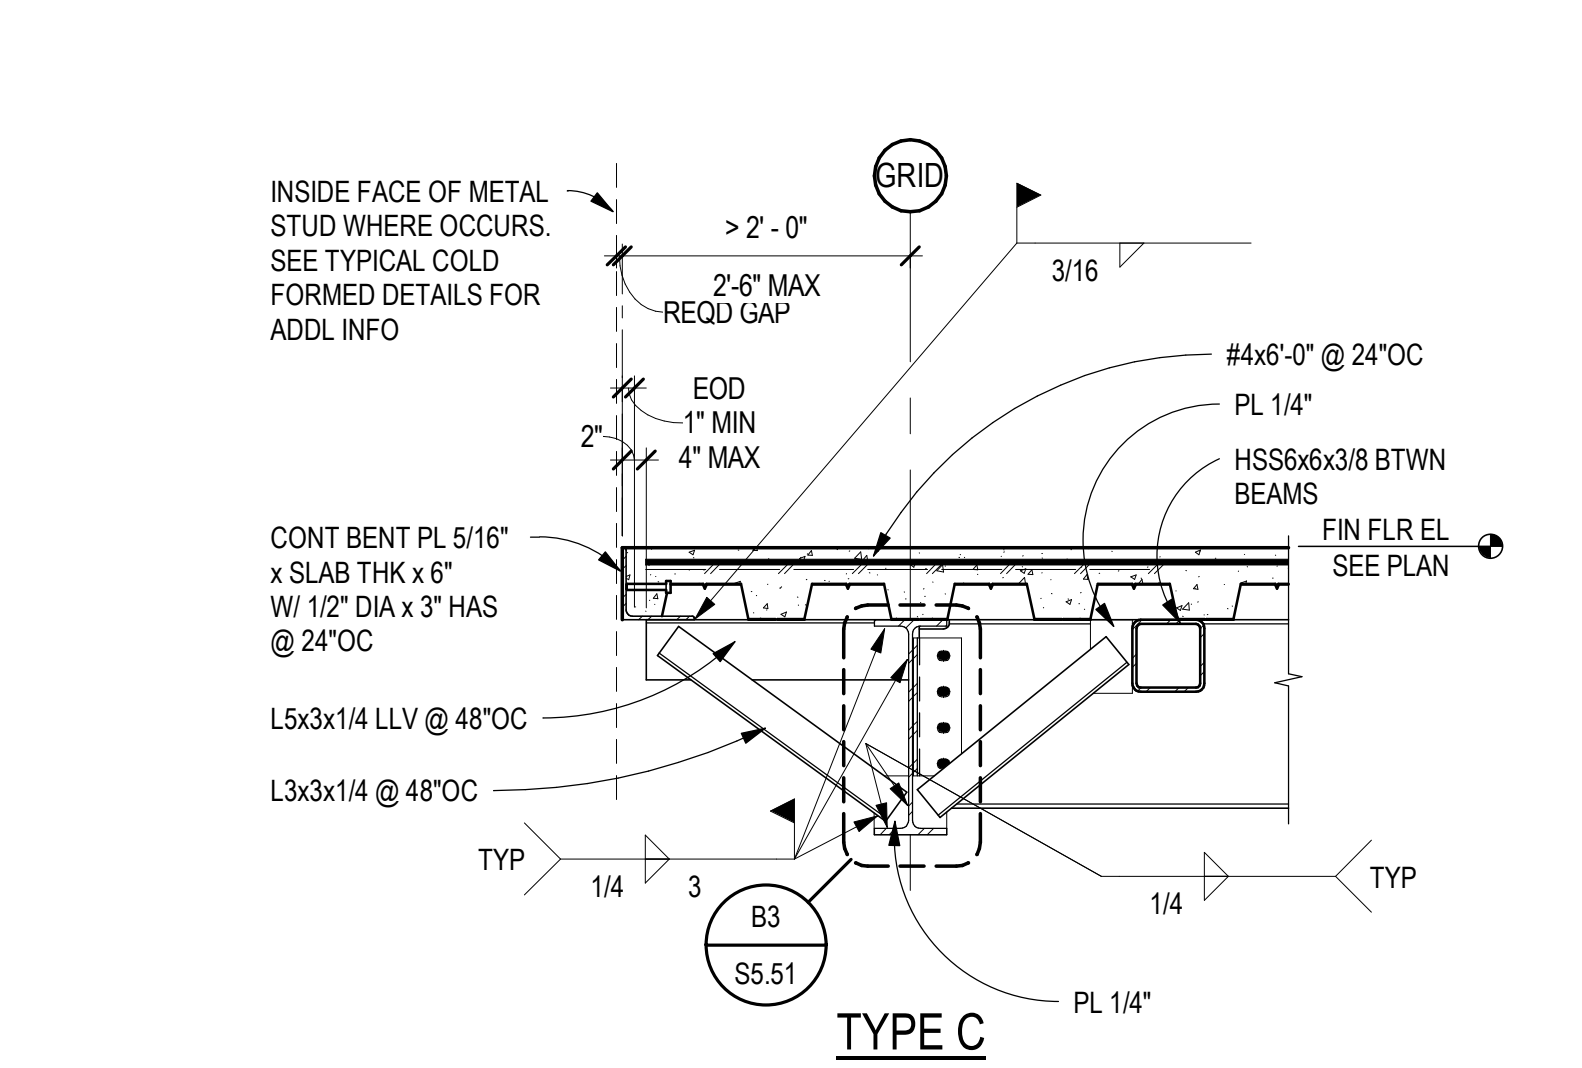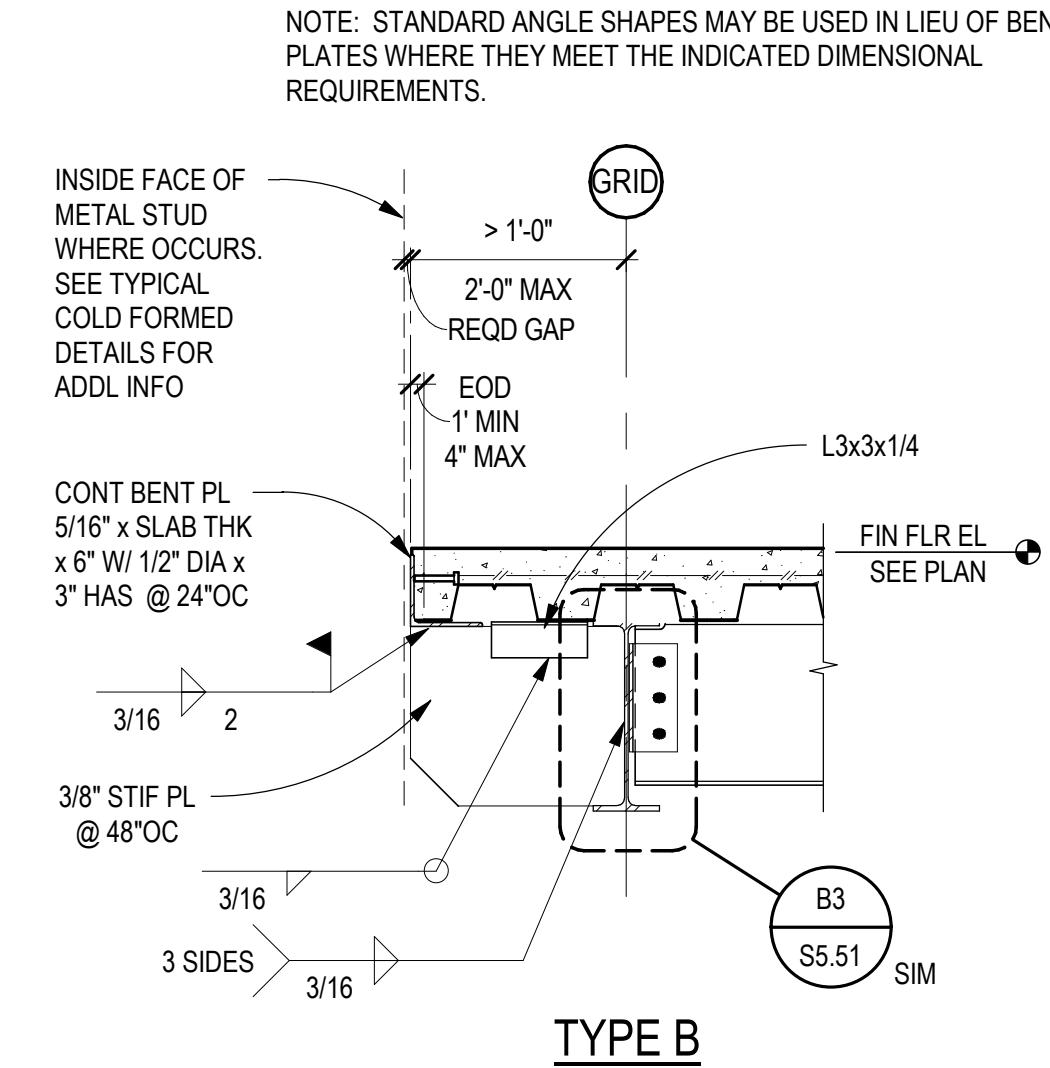





A1 TYPICAL COMPOSITE GIRDER ELEV
SCALE: 1/4" = 1'-0"

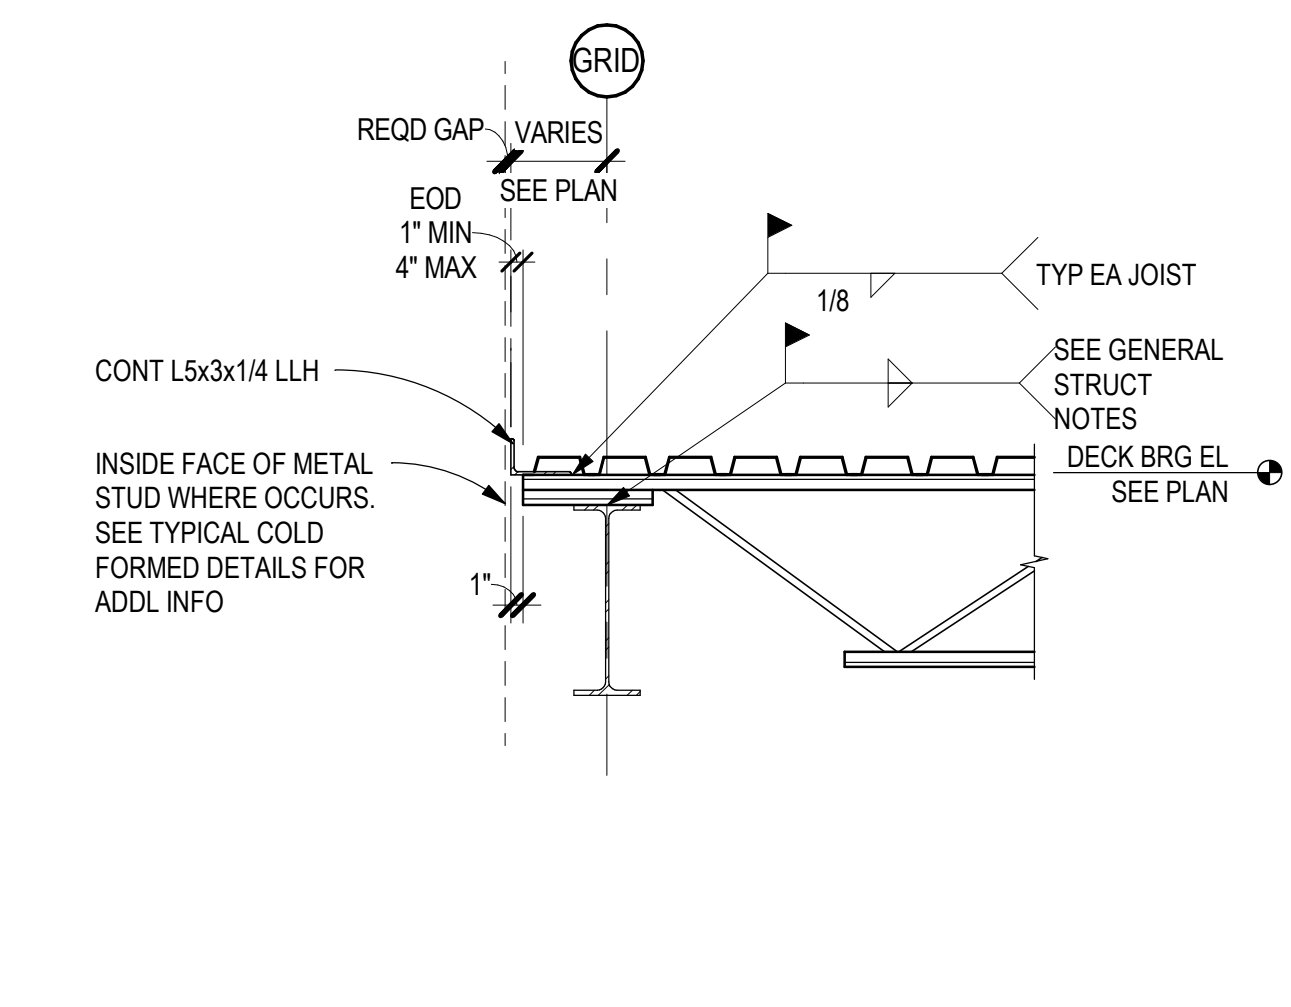

A2 TYPICAL ROOF BRG DECK EDGE
SCALE: 3/4" = 1'-0"

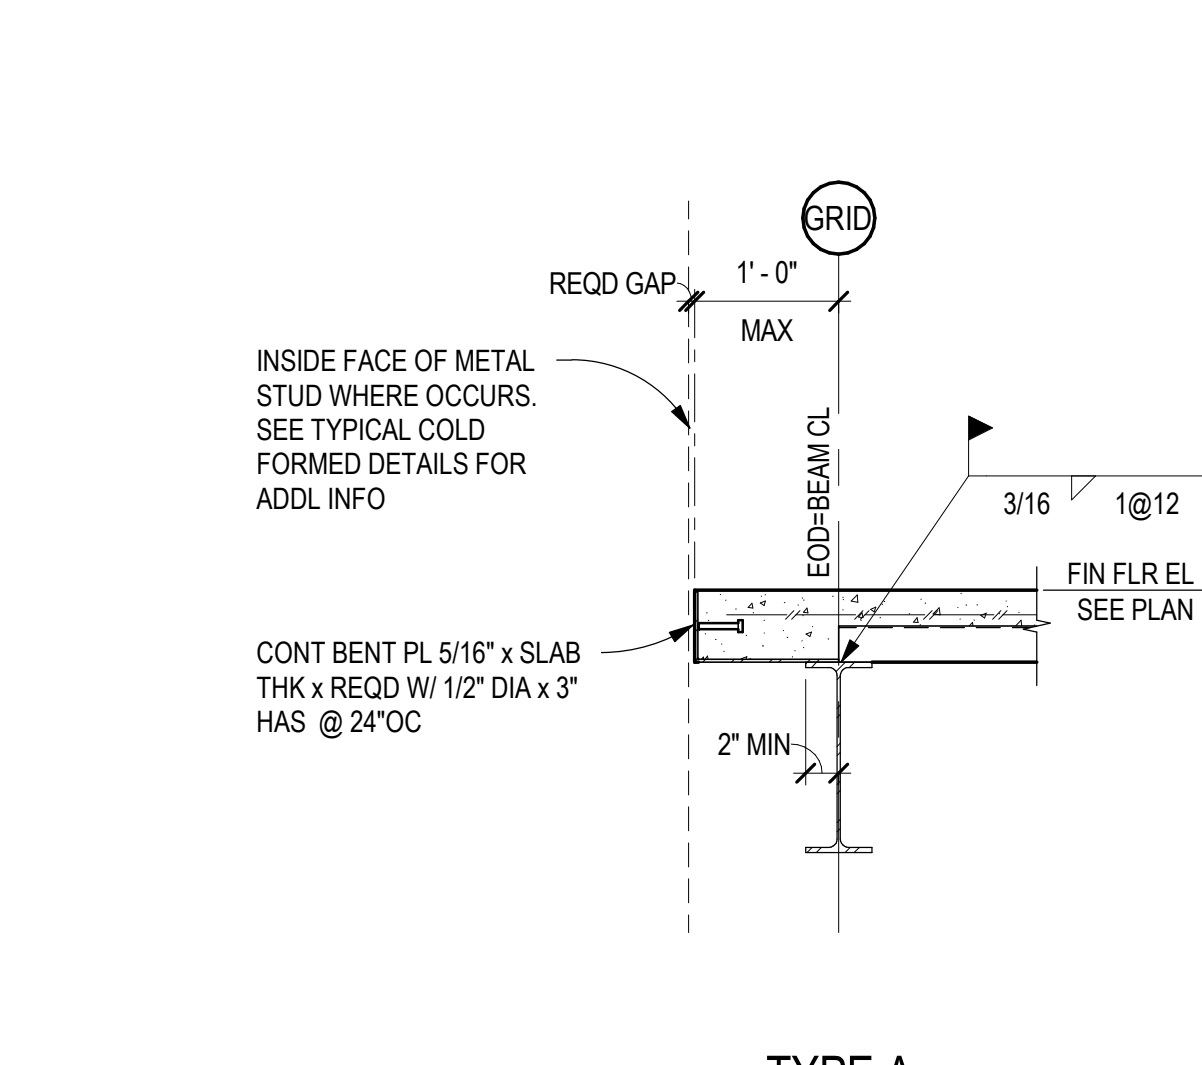

A3 TYPICAL SLAB EDGE AT NON-BEARING CONDITION
SCALE: 3/4" = 1'-0"

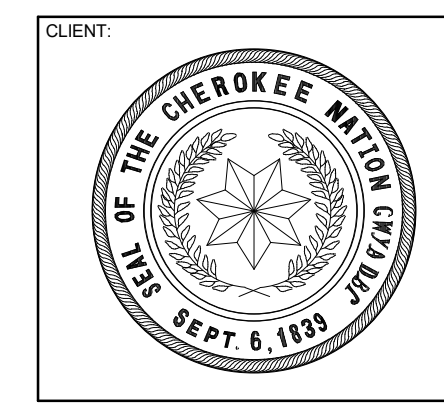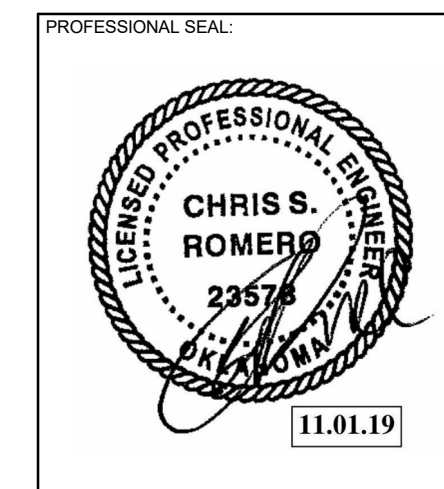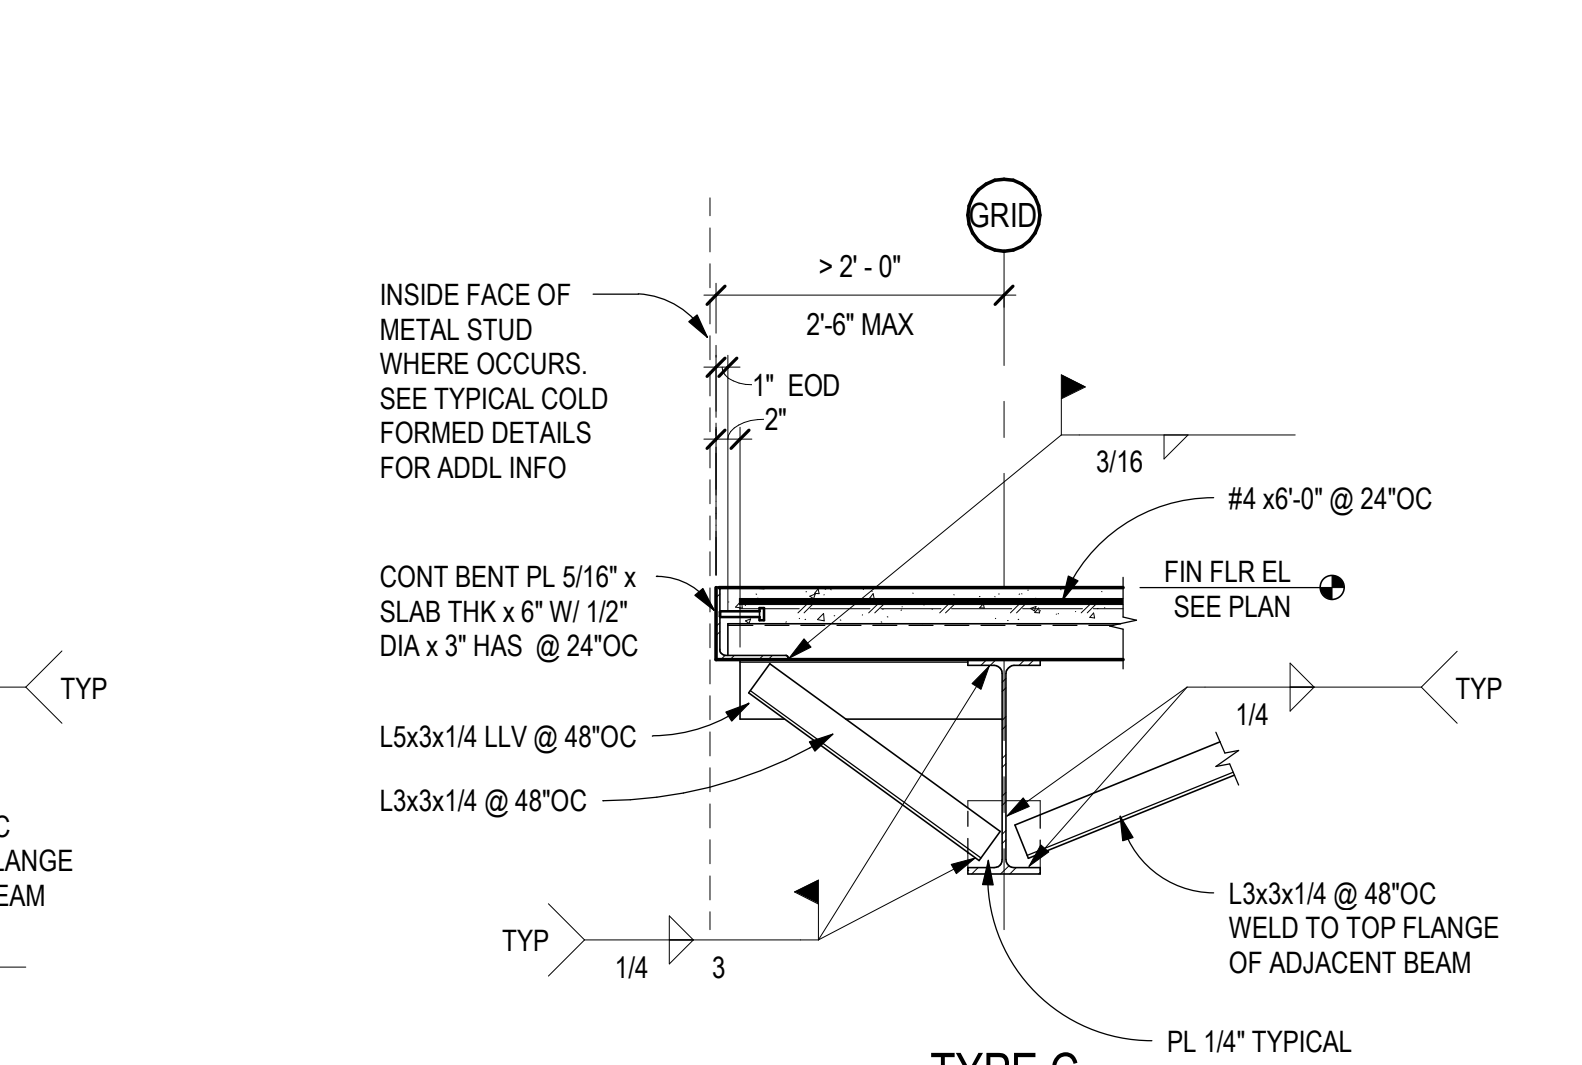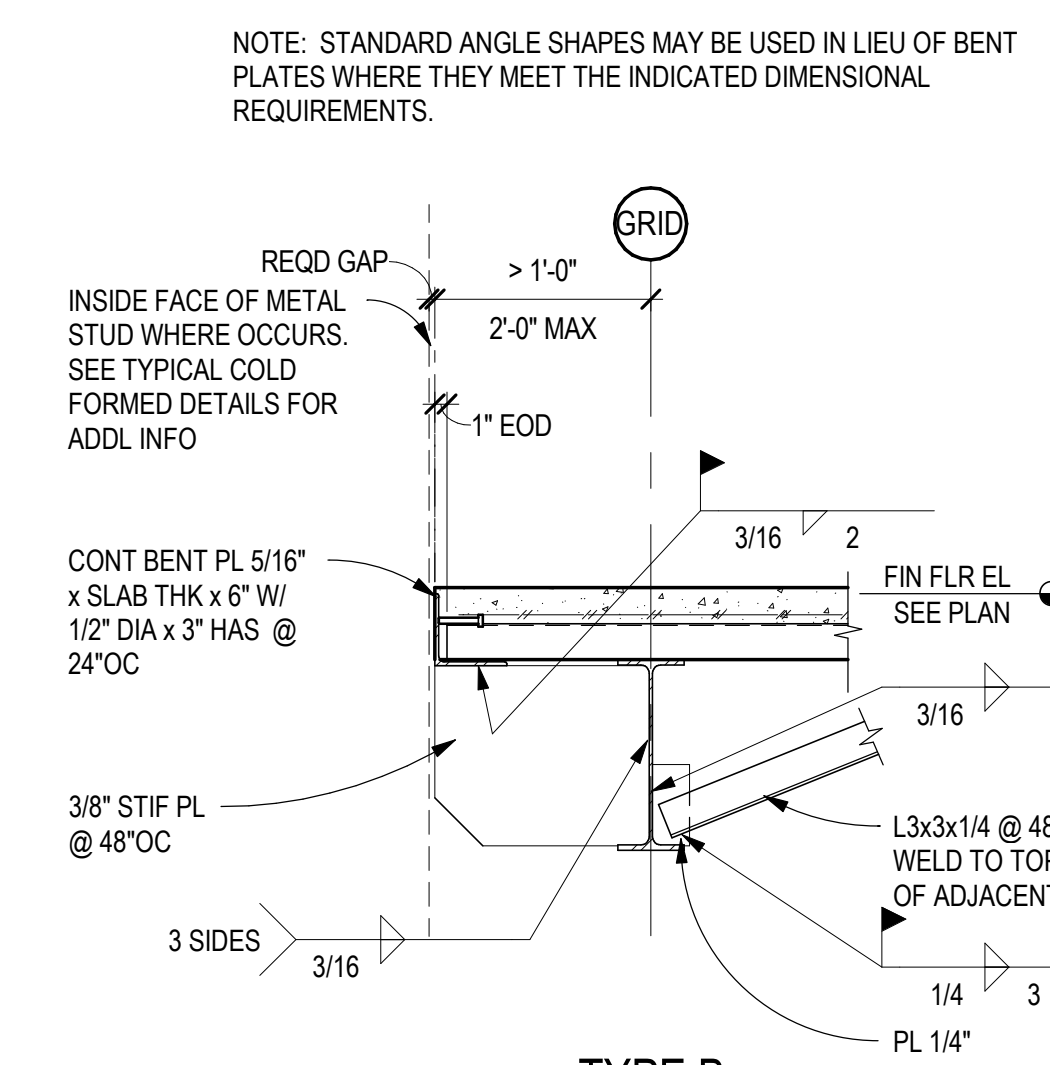


WILMA P. MANKILLER HEALTH CENTER
EXPANSION
STILWELL, OKLAHOMA

KEY PLAN:


PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01
SHEET NUMBER: S7.41
TYPICAL STEEL DETAILS

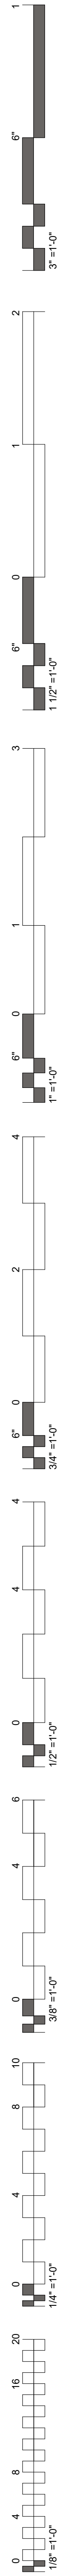

NOTE: INSTALL OPENINGS IN COMPLIANCE WITH OSHA REQUIREMENTS INCLUDING 1926.754 OF 29 CFR

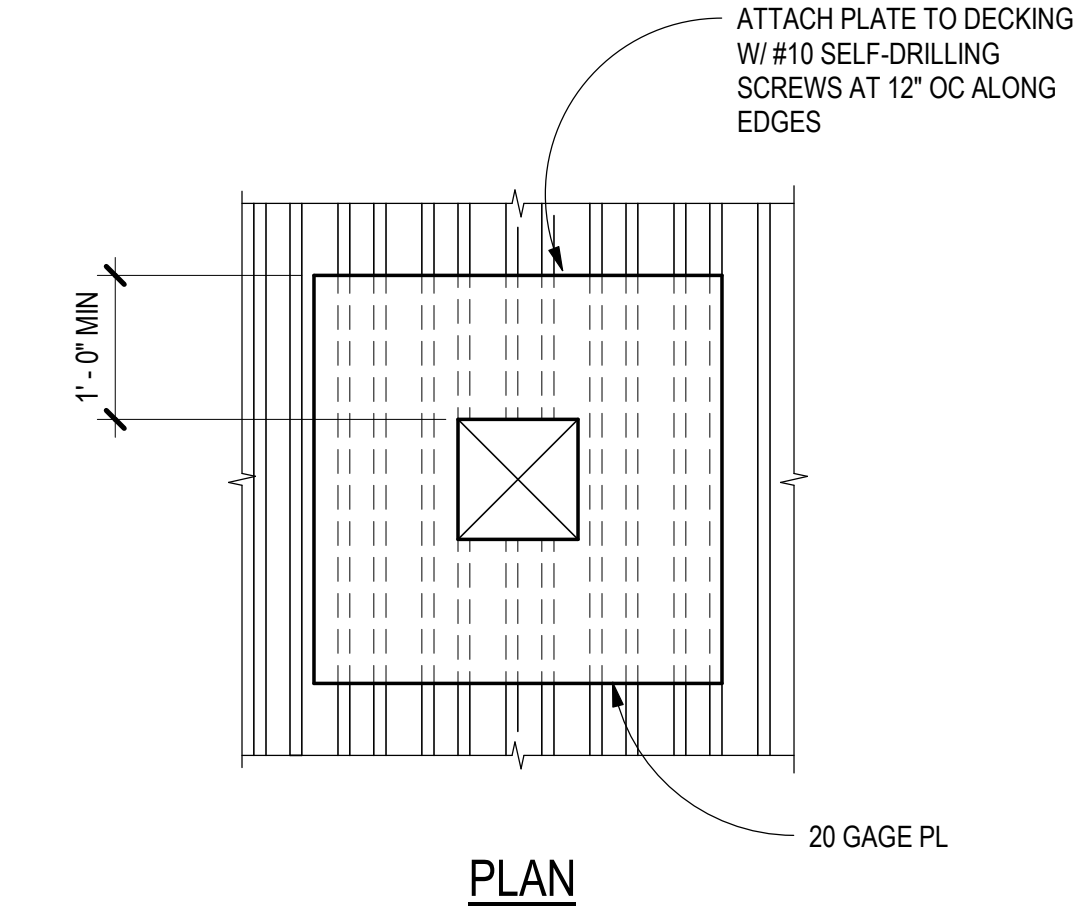

D5 TYPICAL ROOF OPENING 0"-12"
SCALE: 3/4" = 1'-0"

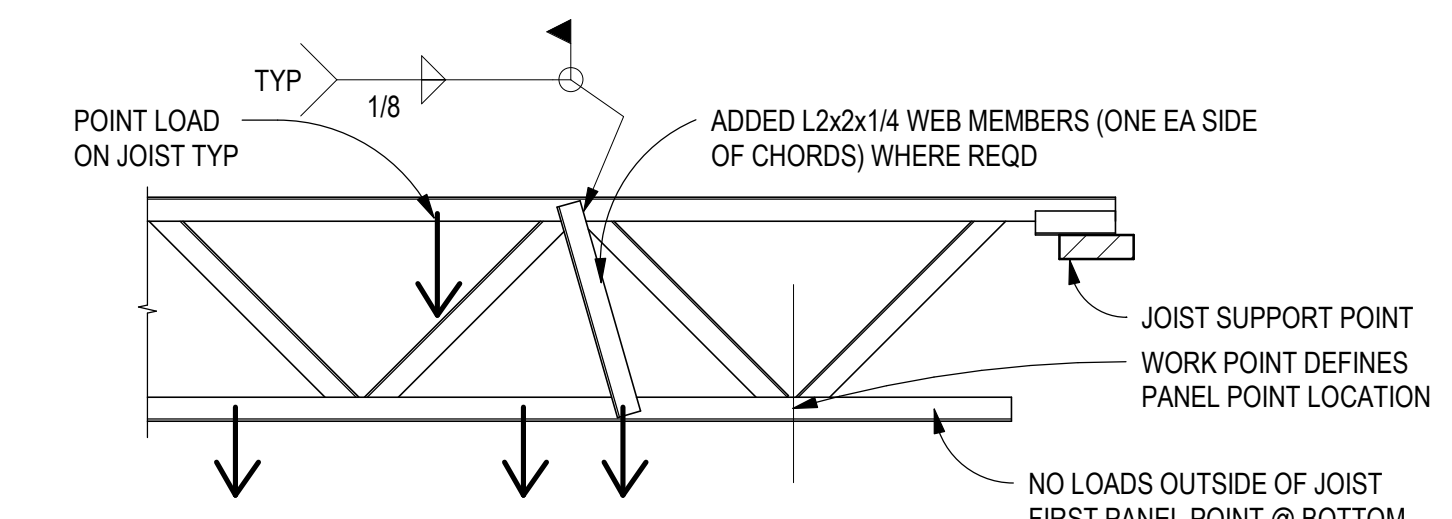


POINT LOADS ON K-SERIES OR LH-SERIES (NON SP JOISTS) SHALL MEET ALL OF THE FOLLOWING REQUIREMENTS:


- POINT LOADS ON THE JOIST TOP CHORD OR BOTTOM CHORD THAT EXCEED 100LBS SHALL BE PLACED WITHIN 4" OF A JOIST PANEL POINT, OR ADDITIONAL WEB MEMBERS SHALL BE ADDED AT THE POINT OF LOAD APPLICATION.
- WHERE MULTIPLE POINT LOADS ARE PLACED BETWEEN THE SAME TWO PANEL POINTS, THE SUM OF THOSE LOADS THAT ARE NOT REINFORCED WITH ADDITIONAL WEB MEMBERS SHALL NOT EXCEED 100LBS.
- POINT LOADS SHALL BE CONCENTRIC WITH THE CHORD FROM WHICH IT IS HUNG. BEAM CLAMPS OR OTHER CONNECTIONS THAT INDUCE NON-CONCENTRIC LOADS ARE NOT PERMITTED.
- POINT LOADS SHALL BE SPACED SO THAT THE COMBINED TOP CHORD PLUS BOTTOM CHORD POINT LOADS DO NOT EXCEED AN EQUIVALENT LINE LOAD OF 65PLF AT ANY POINT ALONG THE JOIST.
- LOADS SHALL NOT BE PLACED ON THE BOTTOM CHORD OUTSIDE OF THE FIRST PANEL POINT.
- POINT LOADS IN EXCESS OF 350LBS THAT ARE NOT SPECIFICALLY NOTED ON THE STRUCTURAL DRAWINGS SHALL NOT BE PLACED WITHOUT APPROVAL FROM THE ENGINEER OF RECORD AND THE JOIST MANUFACTURER.

NOTE: JOISTS LABELED AS "SP" HAVE BEEN DESIGNED FOR THE LOADS NOTED ON THE STRUCTURAL PLANS. THOSE LOADS SHALL BE PLACED WITHIN 2" OF A PANEL POINT, OR ADDITIONAL WEB MEMBERS SHALL BE ADDED.


C4 TYPICAL JOIST REINFORCING
SCALE: 1/2" = 1'-0"

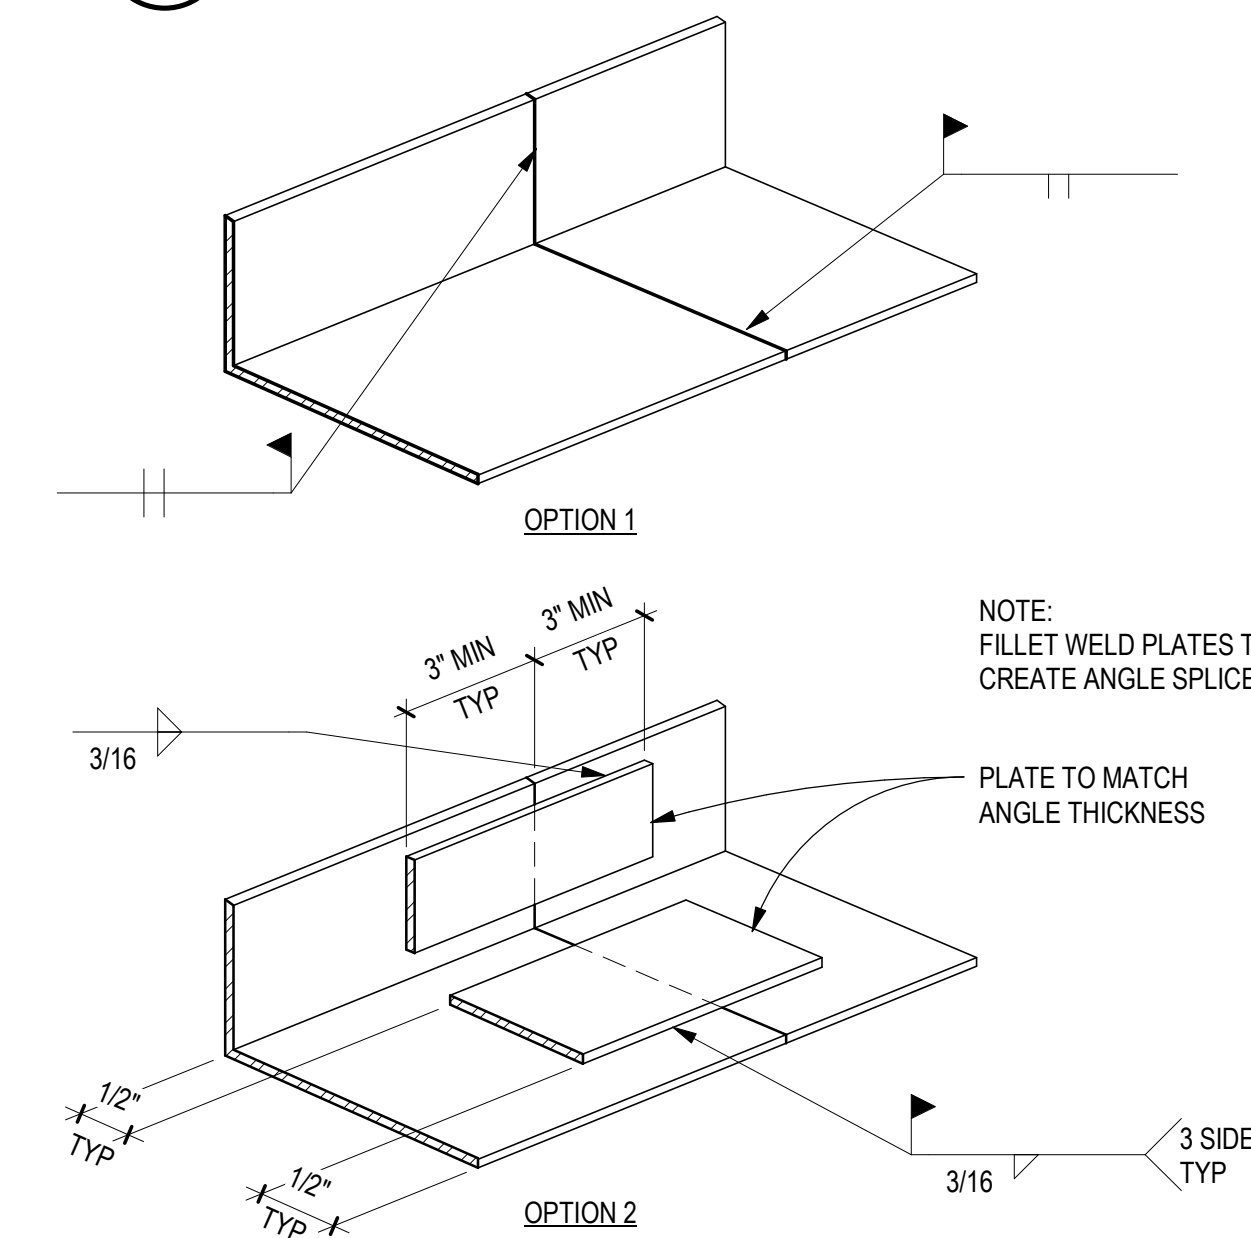


B4 TYPICAL PERIMETER ANGLE SPLICE
SCALE: 3/4" = 1'-0"

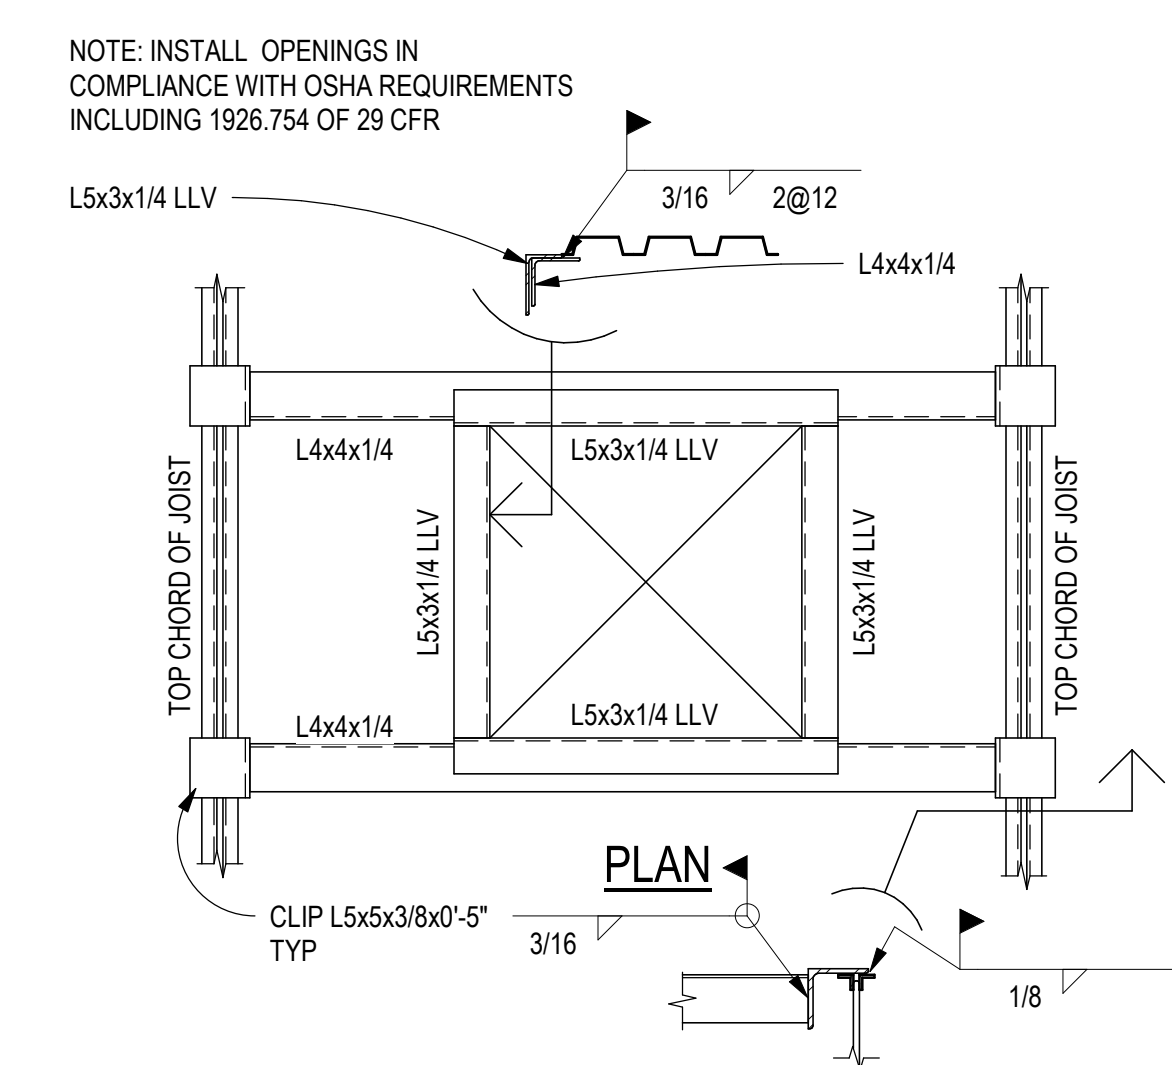


A4 TYPICAL ROOF OPENING > 12"
SCALE: 3/4" = 1'-0"

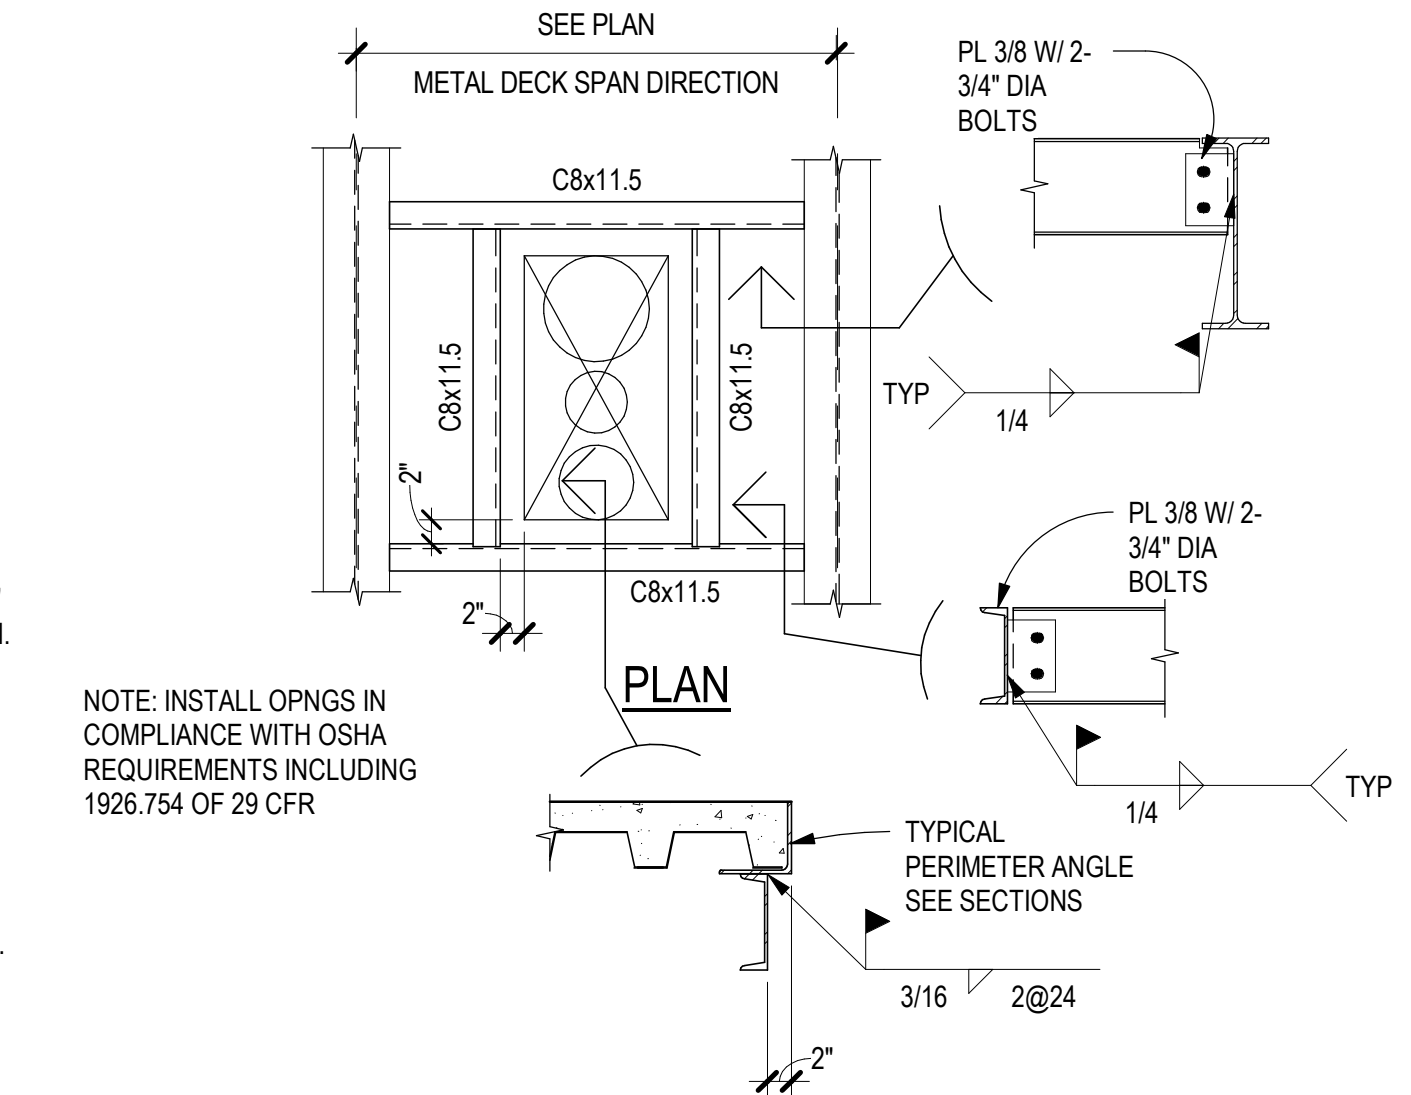


C5 TYPICAL SLAB OPNG > 24"
SCALE: 3/4" = 1'-0"

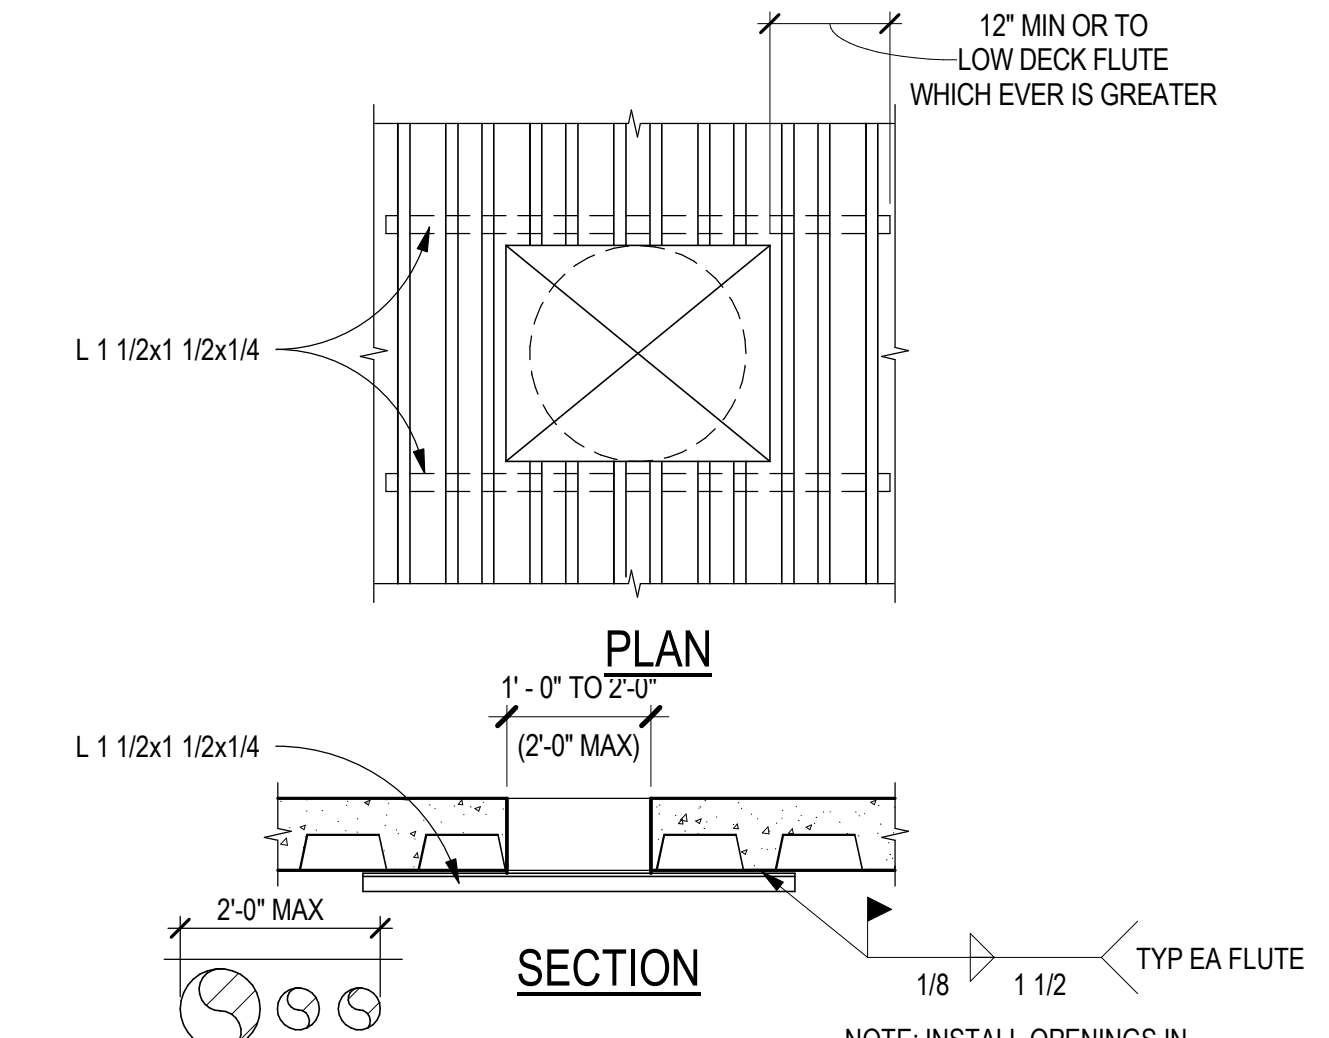

B5 TYPICAL SLAB OPENING 12"-24"
SCALE: 3/4" = 1'-0"

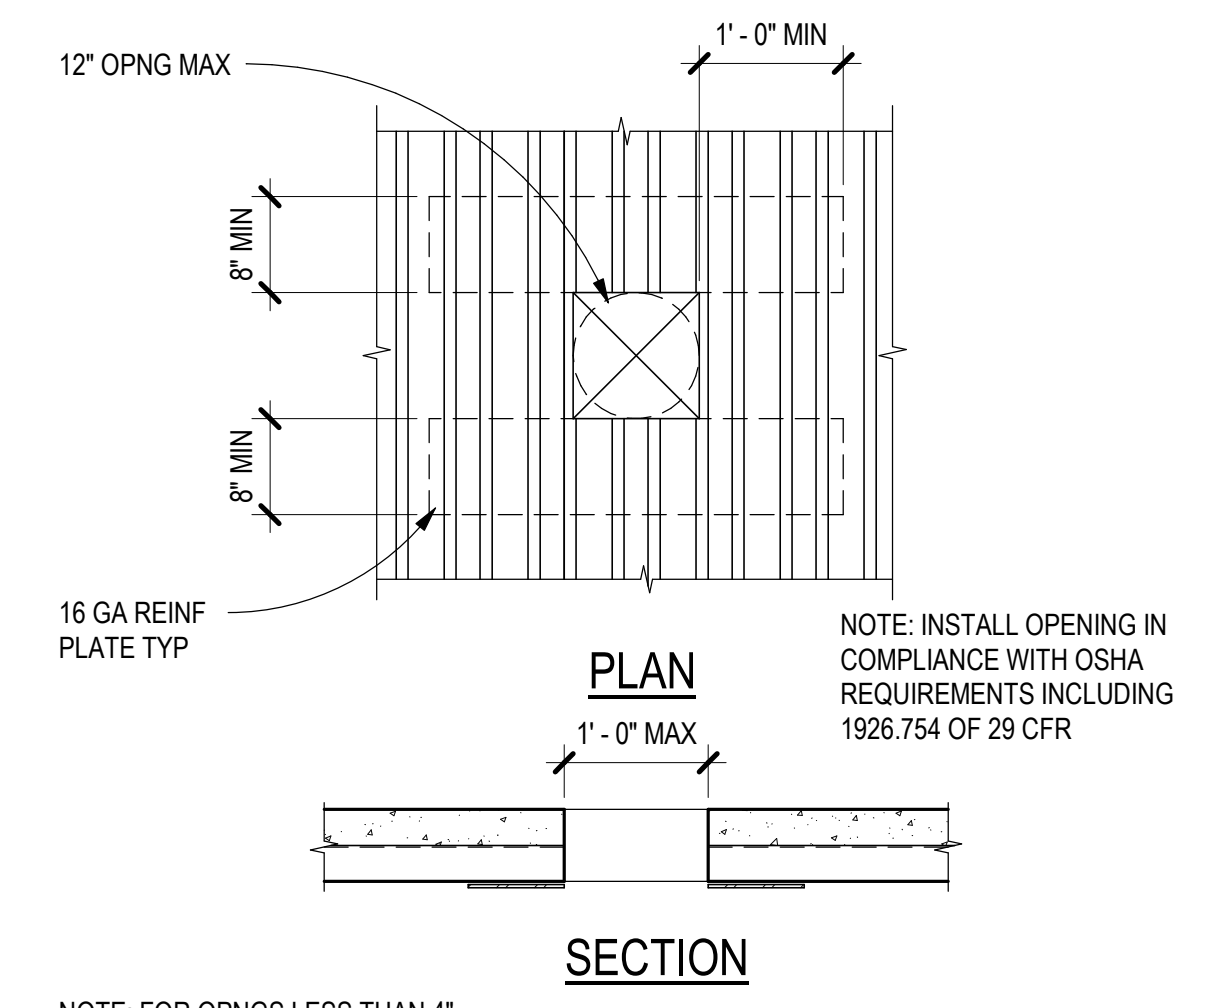

A5 TYPICAL SLAB OPENING 4"-12"
SCALE: 3/4" = 1'-0"



WILMA P. MANKILLER HEALTH CENTER EXPANSION
STILWELL, OKLAHOMA

KEY PLAN:

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19
JOB NUMBER: 18-01.01


SHEET NUMBER:
S7.42
TYPICAL STEEL DETAILS

INTELLECTUAL PROPERTY RIGHTS NOTICE
 The SIDEPLATE® steel frame connection system is covered by one or more of U.S. Pat. Nos. 6,138,427; 6,516,583; 6,591,573; 7,178,296; 8,122,671; 8,122,672; 8,146,322; 8,176,706; 8,205,408; and 9,091,065 and foreign counterparts. Other U.S. and foreign applications pending.

SIDEPLATE® is a registered trademark of Mitek Holdings, Inc., an affiliate of SidePlate Systems, Inc.


Copyright © 2019 SidePlate Systems, Inc. All rights reserved. Without limitation, this drawing and the information hereon may be used only following payment of a license fee to SidePlate Systems, Inc. and for the design, construction, operation, repair, maintenance, restoration or demolition of the building(s) specifically identified.

18-01-01

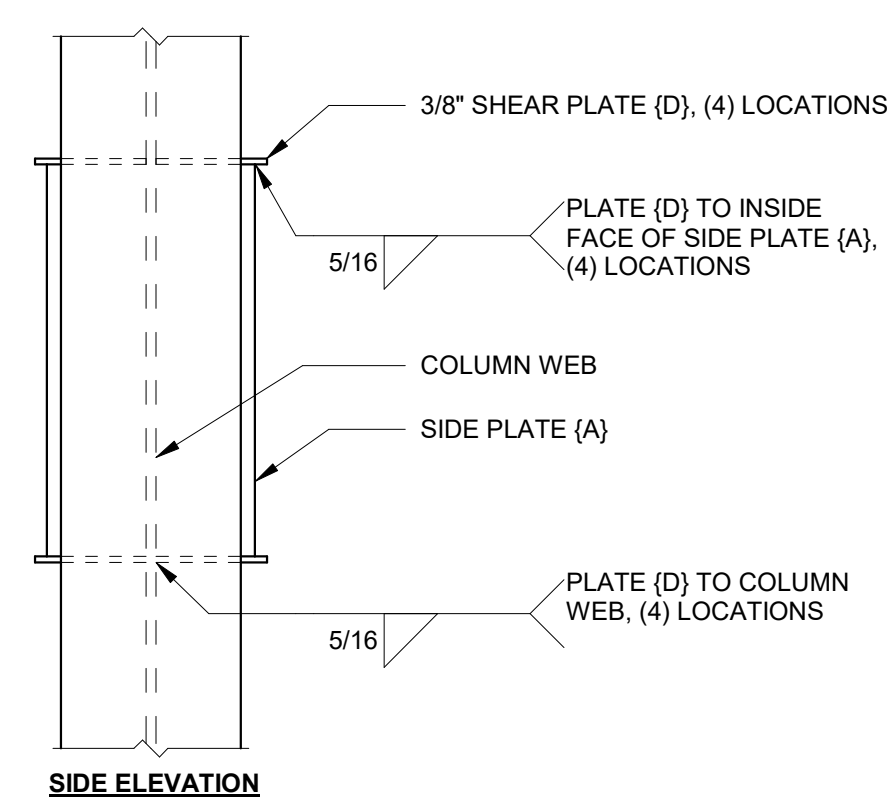


NOTE(S):
 1. LONGITUDINAL ANGLES (G) NOT SHOWN FOR CLARITY.

8 PLATE (D) DETAIL FOR SLOPED CONDITIONS
 N.T.S.

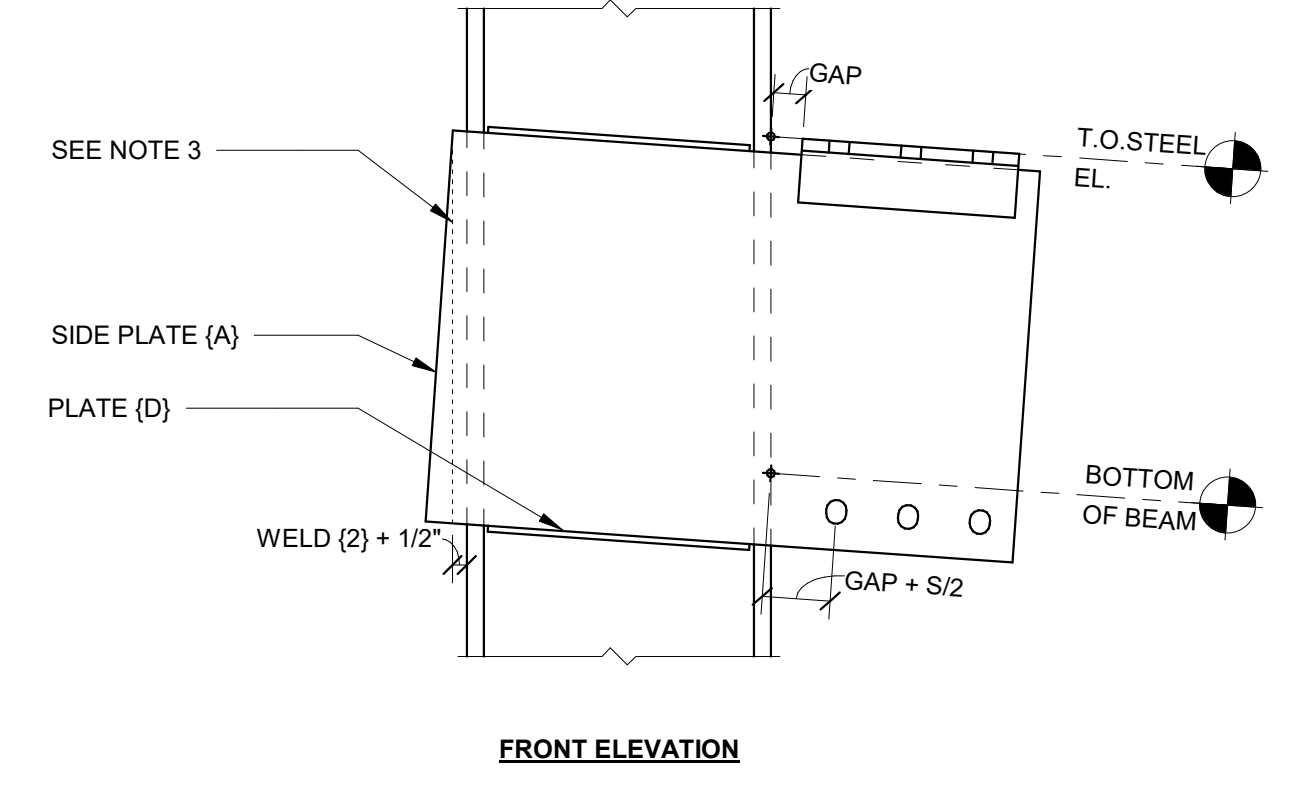

NOTE(S):
 1. FOR BEAM SLOPES > 1" PER FOOT, CONTACT SIDEPLATE SYSTEMS, INC.
 2. COORDINATE PLATES, ANGLES, AND DIMENSIONS WITH RESPECT TO THE SLOPE OF THE CONNECTION.
 3. AT CONTRACTOR'S DISCRETION, SIDE PLATE (A) MAY BE CUT AS SHOWN.
 4. HORIZONTAL SHEAR PLATES (D) AND ASSOCIATED WELDS ARE REQUIRED FOR SLOPED SIDE PLATE CONDITIONS. SEE 8 / S8.02

4 SLOPED DOWN CONNECTION (AS APPLICABLE)
 N.T.S.

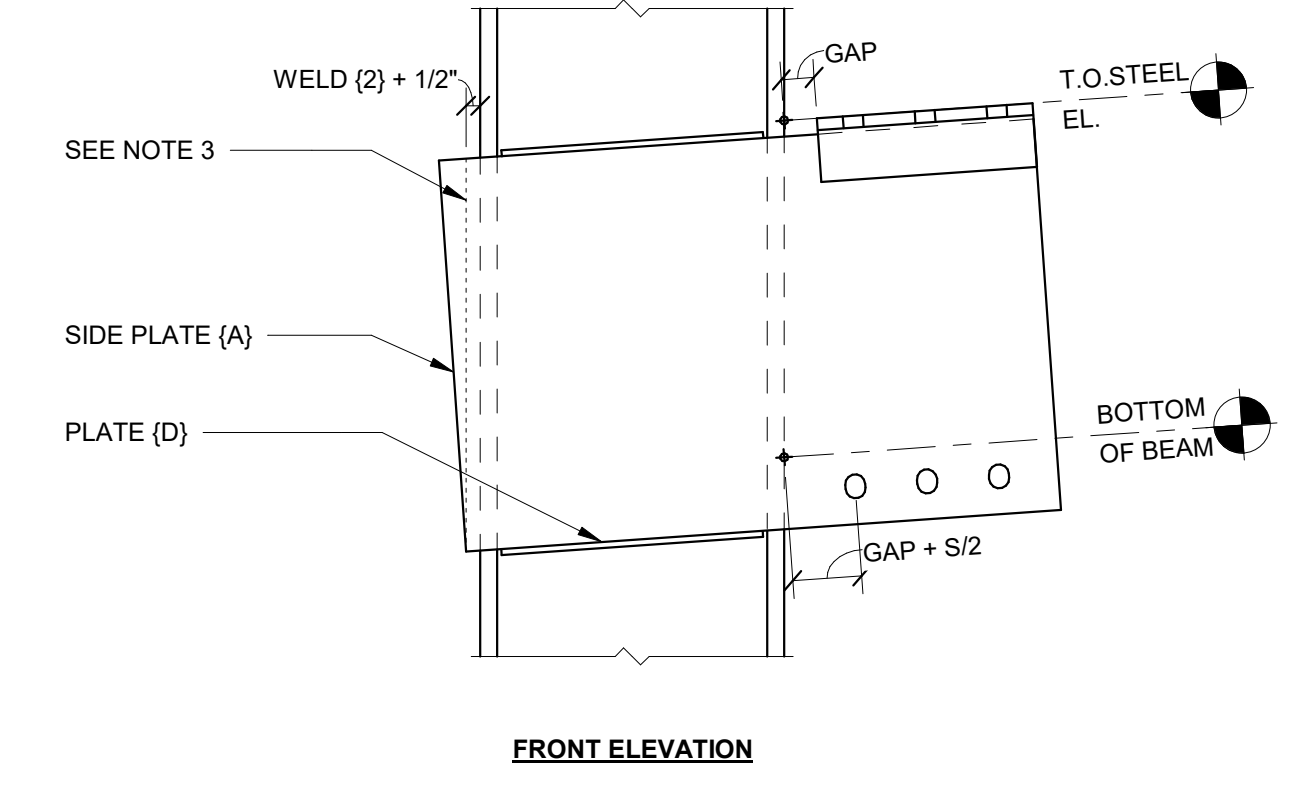


NOTE(S):
 1. FOR BEAM SLOPES > 1" PER FOOT, CONTACT SIDEPLATE SYSTEMS, INC.
 2. COORDINATE PLATES, ANGLES, AND DIMENSIONS WITH RESPECT TO THE SLOPE OF THE CONNECTION.
 3. AT CONTRACTOR'S DISCRETION, SIDE PLATE (A) MAY BE CUT AS SHOWN.
 4. HORIZONTAL SHEAR PLATES (D) AND ASSOCIATED WELDS ARE REQUIRED FOR SLOPED SIDE PLATE CONDITIONS. SEE 8 / S8.02

3 SLOPED UP CONNECTION (AS APPLICABLE)
 N.T.S.

ID	COLUMN PANEL ZONE DESIGN (INCHES)				SIDE PLATE (A) EXTENSION DESIGN (INCHES)								
	SERIES	WELD SIZE	BEAM SHAPE	GAP	PLATE (A)			BOLT					
					THICKNESS	B	E	Y	DIAMETER	HORIZONTAL #	VERTICAL #	G	S
A15	W14x	3/8	W24X68	2	5/8	31 3/4	1 3/8	2 1/2	1 1/8	4	2	2 1/8	4 1/2
A25	W14x	3/8	W24X94	2	5/8	32 1/4	1 3/8	3 5/8	1 1/8	5	2	2 1/8	4 1/2
A45	W14x	3/8	W36X160	2	5/8	44	1 3/8	5	1 1/8	6	3	2 1/8	4 1/2

6 A TYPE NARROW COLUMN CONNECTION SCHEDULE
 N.T.S.


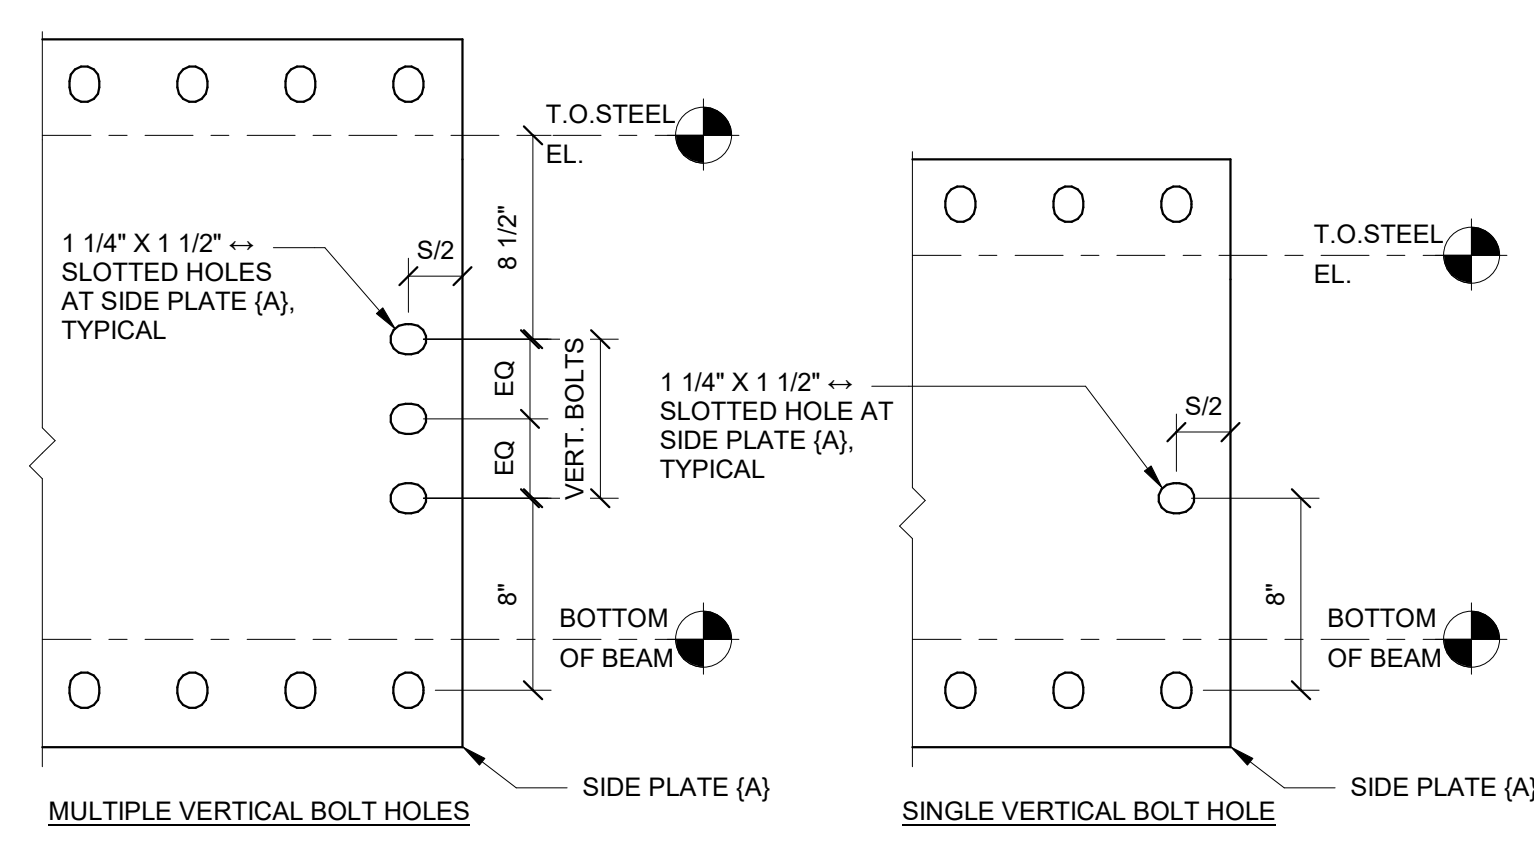


NOTE(S):
 1. SEE COLUMN SCHEDULE FOR BOLT QUANTITY.

7 SIDE PLATE (A) VSE BOLT HOLE DETAIL
 N.T.S.




ID	COLUMN PANEL ZONE DESIGN (INCHES)				SIDE PLATE (A) EXTENSION DESIGN (INCHES)										
	SERIES	WELD SIZE	BEAM SHAPE	GAP	PLATE (A)			ANGLE (G)		WELD SIZE	BOLT				
					THICKNESS	B	Y	SUGGESTED SIZE	HORIZONTAL LEG		VERTICAL LEG	DIAMETER	HORIZONTAL #	G	S
A10, A11, A19	W14x	3/8	W24X68	2	5/8	27 1/4	2 1/2	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	4	2 1/8	4 1/2
A12	W14x	7/16	W24X68	2 1/4	1	27 1/4	1 7/8	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	4	2 1/8	4 1/2
A20	W14x	3/8	W24X94	2	7/8	27 3/4	2 7/8	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	5	2 1/8	4 1/2
A30	W14x	3/8	W36X150	2	5/8	39 3/8	5	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	6	2 1/8	4 1/2

2 A TYPE COLUMN CONNECTION SCHEDULE
 N.T.S.

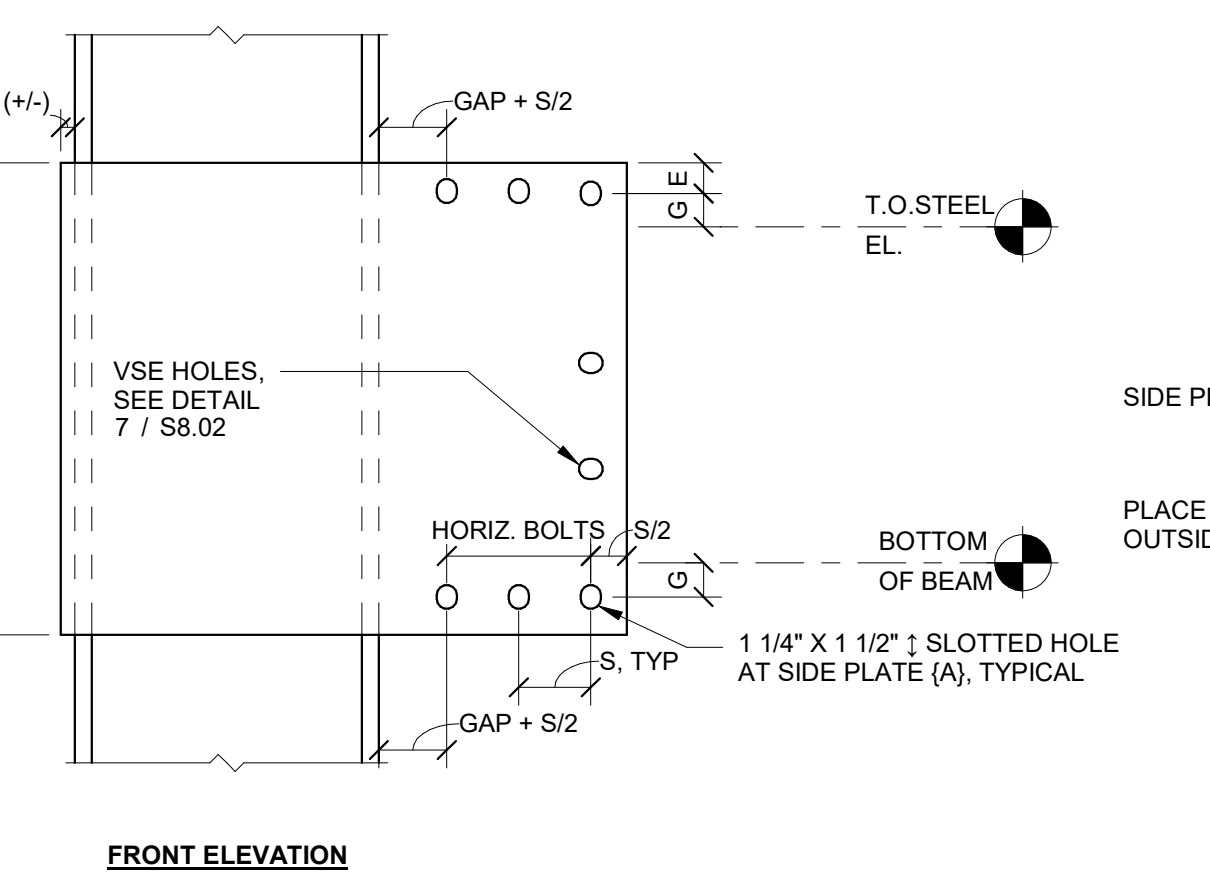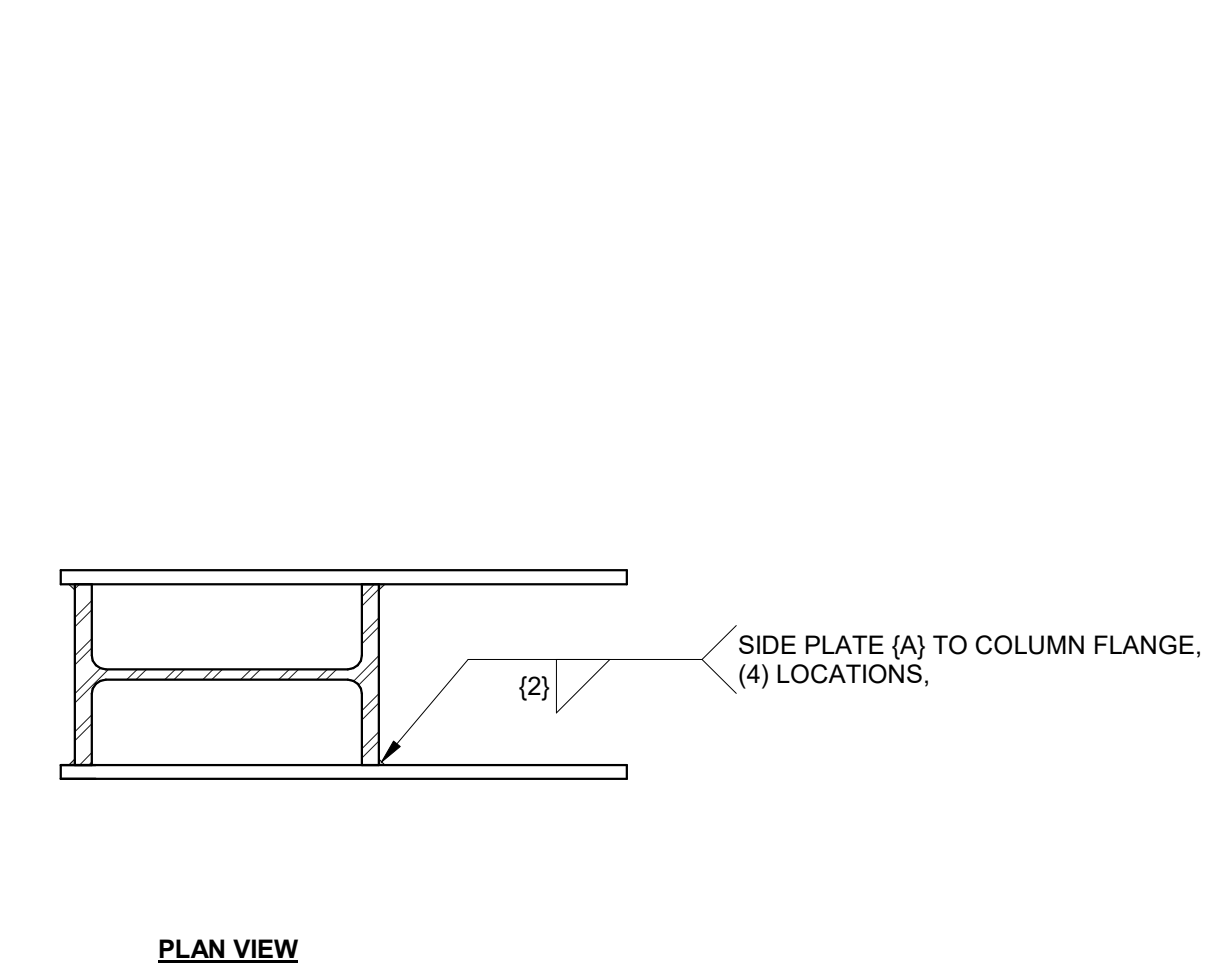




NOTE(S):
 1. THE 1/2 INCH OVERHANG ON THE SIDE PLATE (A) IS TO ENSURE SUFFICIENT ROOM FOR WELD (2). THE +/- TOLERANCE IS APPLIED SO THAT IF DESIRED, THE DETAILER CAN MAKE THE SIDE PLATES (A) THE SAME LENGTH WITH SLIGHTLY VARYING COLUMN DEPTHS WITHIN A GROUP OF THE SAME CONNECTION ID'S.

5 A TYPE NARROW BOLTED CONNECTION
 N.T.S.

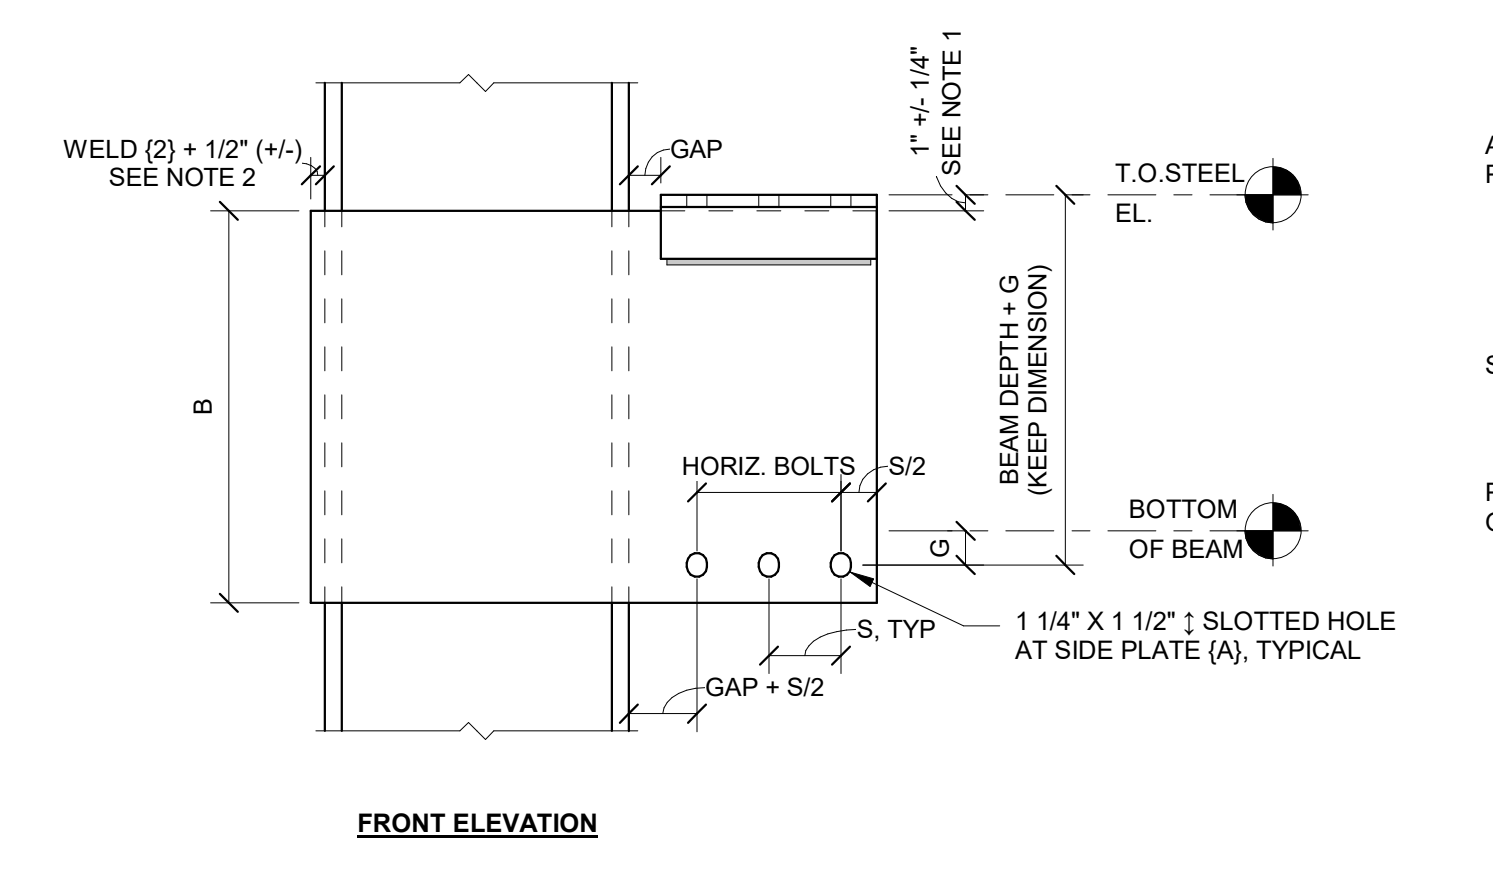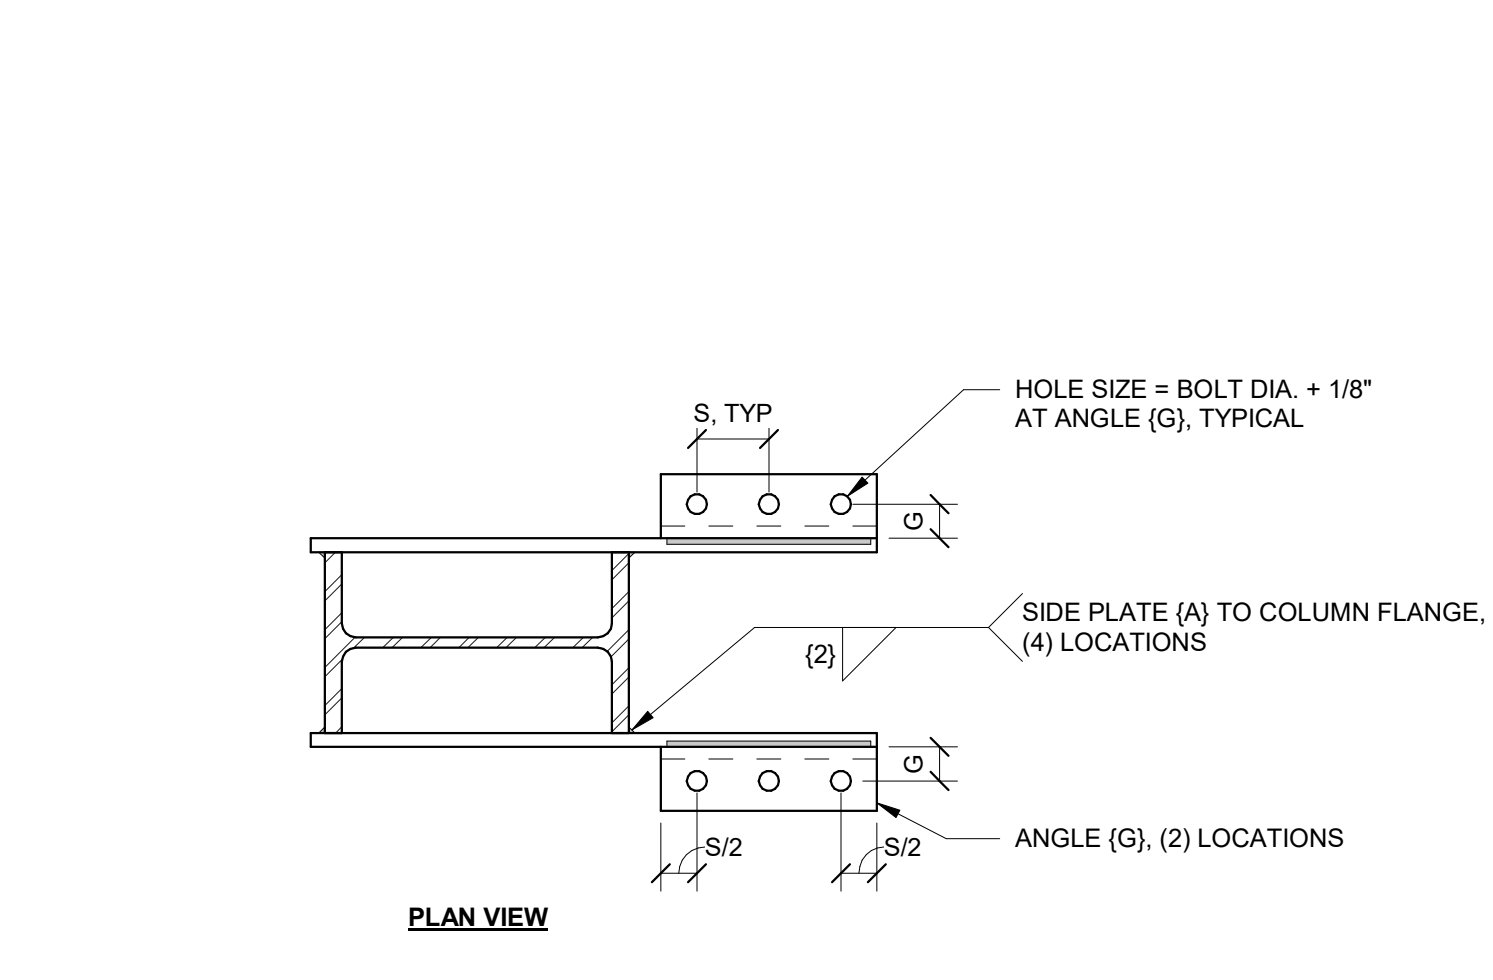
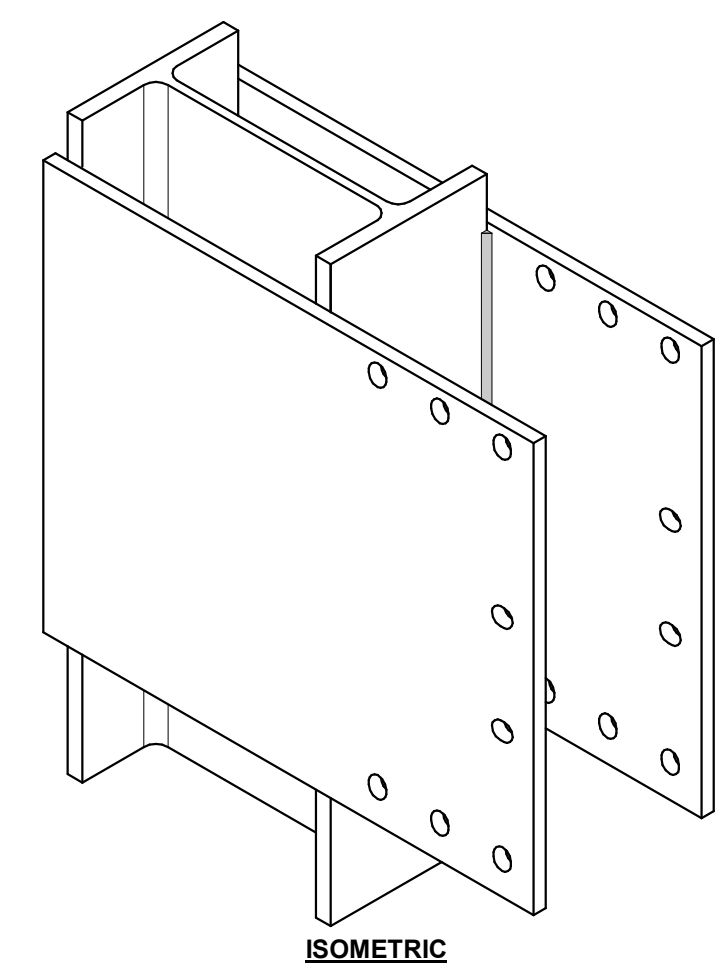


NOTE(S):
 1. THE +/- 1/4 INCH TOLERANCE FOR PLACEMENT OF ANGLES (G) IS TO ENSURE CORRECT TOP OF STEEL PLACEMENT RELATIVE TO THE CENTERLINE OF THE BOTTOM HORIZONTAL ROW OF BOLT HOLES. THE PLACEMENT OF ANGLES (G) SHALL NEVER BE MEASURED FROM THE BOTTOM EDGE OF SIDE PLATE (A) TO ESTABLISH THE CORRECT TOP OF STEEL.
 2. THE 1/2 INCH OVERHANG ON THE SIDE PLATE (A) IS TO ENSURE SUFFICIENT ROOM FOR WELD (2). THE +/- TOLERANCE IS APPLIED SO THAT IF DESIRED, THE DETAILER CAN MAKE THE SIDE PLATES (A) THE SAME LENGTH WITH SLIGHTLY VARYING COLUMN DEPTHS WITHIN A GROUP OF THE SAME CONNECTION ID'S.

4 A TYPE BOLTED CONNECTION
 N.T.S.

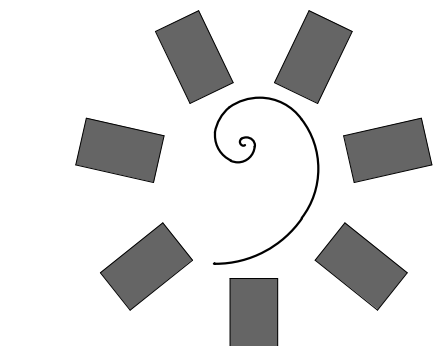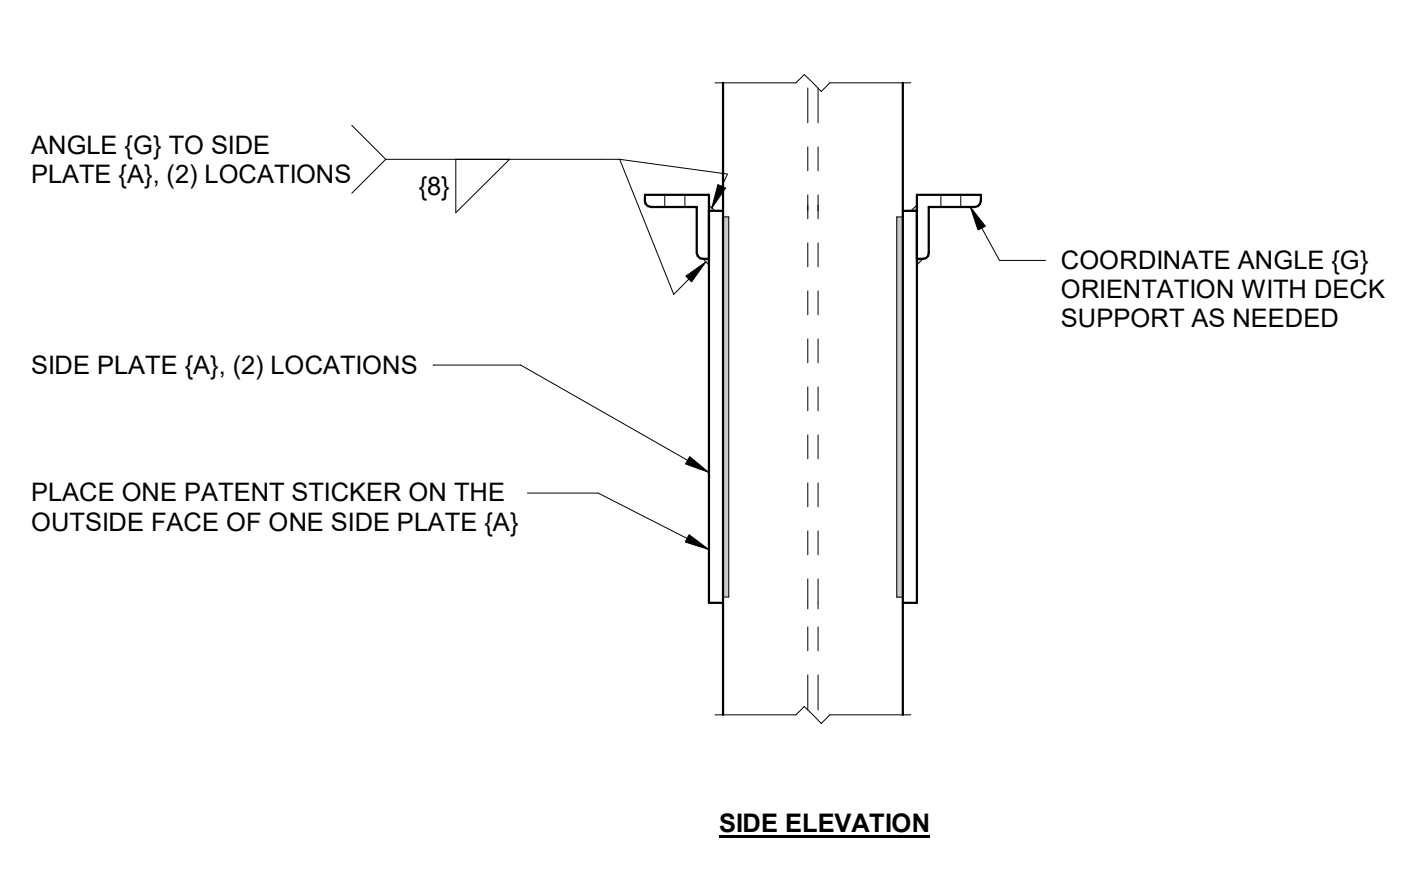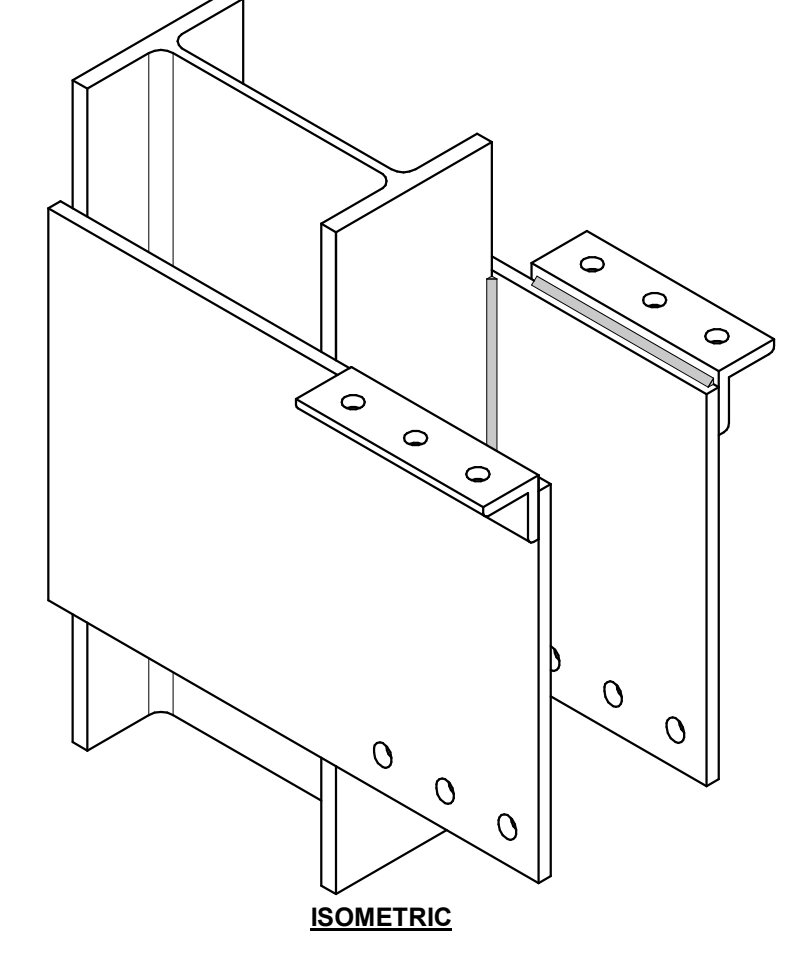

James R. Childers Architect, Inc.
 45 South 4th Street
 Fort Smith, AR 72901
 479-783-2450
 www.childersarchitect.com

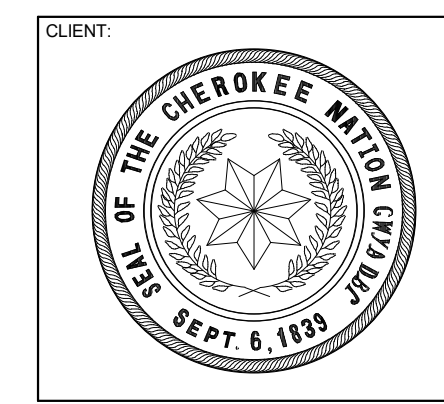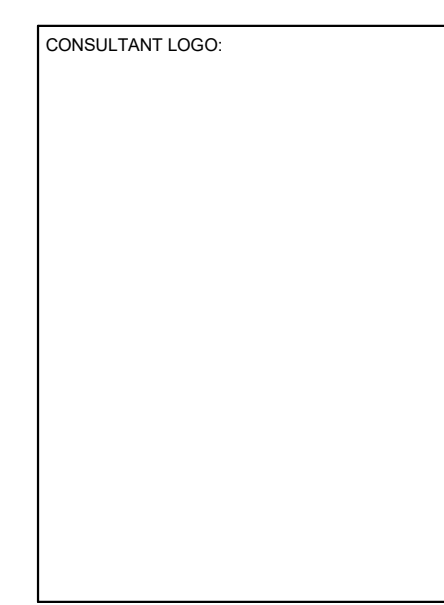

**WILMA P. MANKILLER HEALTH CENTER
 EXPANSION**
 STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE
 BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER: S8.02


SIDEPLATE COLUMN DETAILS, A TYPE

INTELLECTUAL PROPERTY RIGHTS NOTICE
 The SIDEPLATE® steel frame connection system is covered by one or more of U.S. Pat. Nos. 6,138,427; 6,516,583; 6,591,573; 7,178,296; 8,122,671; 8,122,672; 8,146,322; 8,176,706; 8,205,408; and 9,091,065 and foreign counterparts. Other U.S. and foreign applications pending.

SIDEPLATE® is a registered trademark of Mitek Holdings, Inc., an affiliate of SidePlate Systems, Inc.


Copyright © 2019 SidePlate Systems, Inc. All rights reserved. Without limitation, this drawing and the information herein may be used only following payment of a license fee to SidePlate Systems, Inc. and for the design, construction, operation, repair, maintenance, restoration or demolition of the building(s) specifically identified.

S8.03

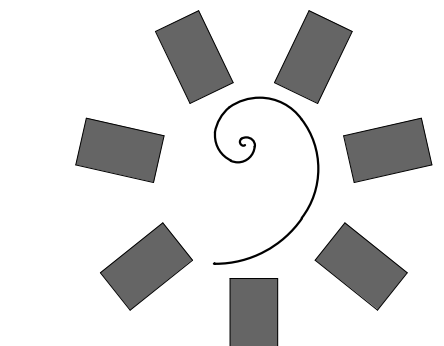


James R. Childers
 Architect, Inc.

45 South 4th Street
 Fort Smith, AR 72901
 479-783-2450
 www.childersarchitect.com

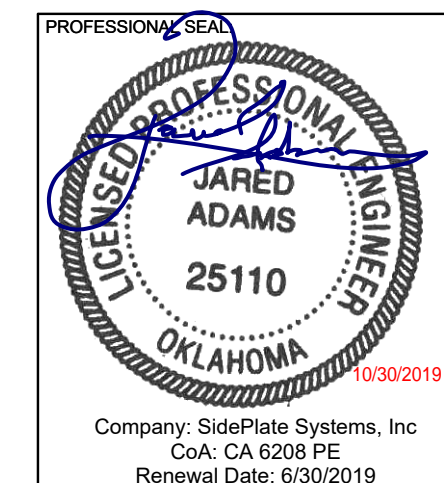

CONSULTANT LOGO

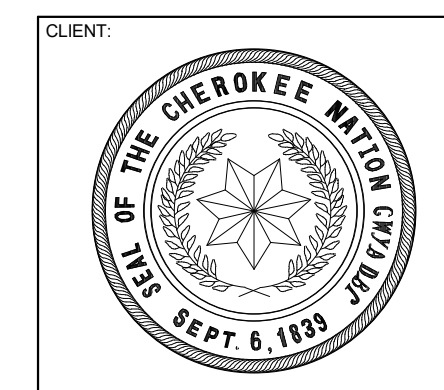

WILMA P. MANKILLER HEALTH CENTER
 EXPANSION
 STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE

BID PACKAGE 01

#	DATE	REVISIONS	DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:

S8.03

SIDEPLATE COLUMN
 DETAILS, B TYPE

ID	COLUMN PANEL ZONE DESIGN (INCHES)				SIDE PLATE (A) EXTENSION DESIGN (INCHES)								
	COLUMN	WELD	BEAM	PLATE (A)	BOLT			G	S				
	SERIES	SIZE	SHAPE		GAP	THICKNESS	HORIZONTAL #			VERTICAL #			
B15	W14x	3/8	W24X68	2	5/8	31 3/4	1 3/8	2 1/2	1 1/8	4	2	2 1/8	4 1/2
B25	W14x	1/2	W24X94	2	5/8	32 1/4	1 3/8	3 5/8	1 1/8	5	2	2 1/8	4 1/2
B45	W14x	1/2	W36X160	2	5/8	44	1 3/8	5	1 1/8	6	3	2 1/8	4 1/2

6 B TYPE NARROW COLUMN CONNECTION SCHEDULE
 N.T.S.

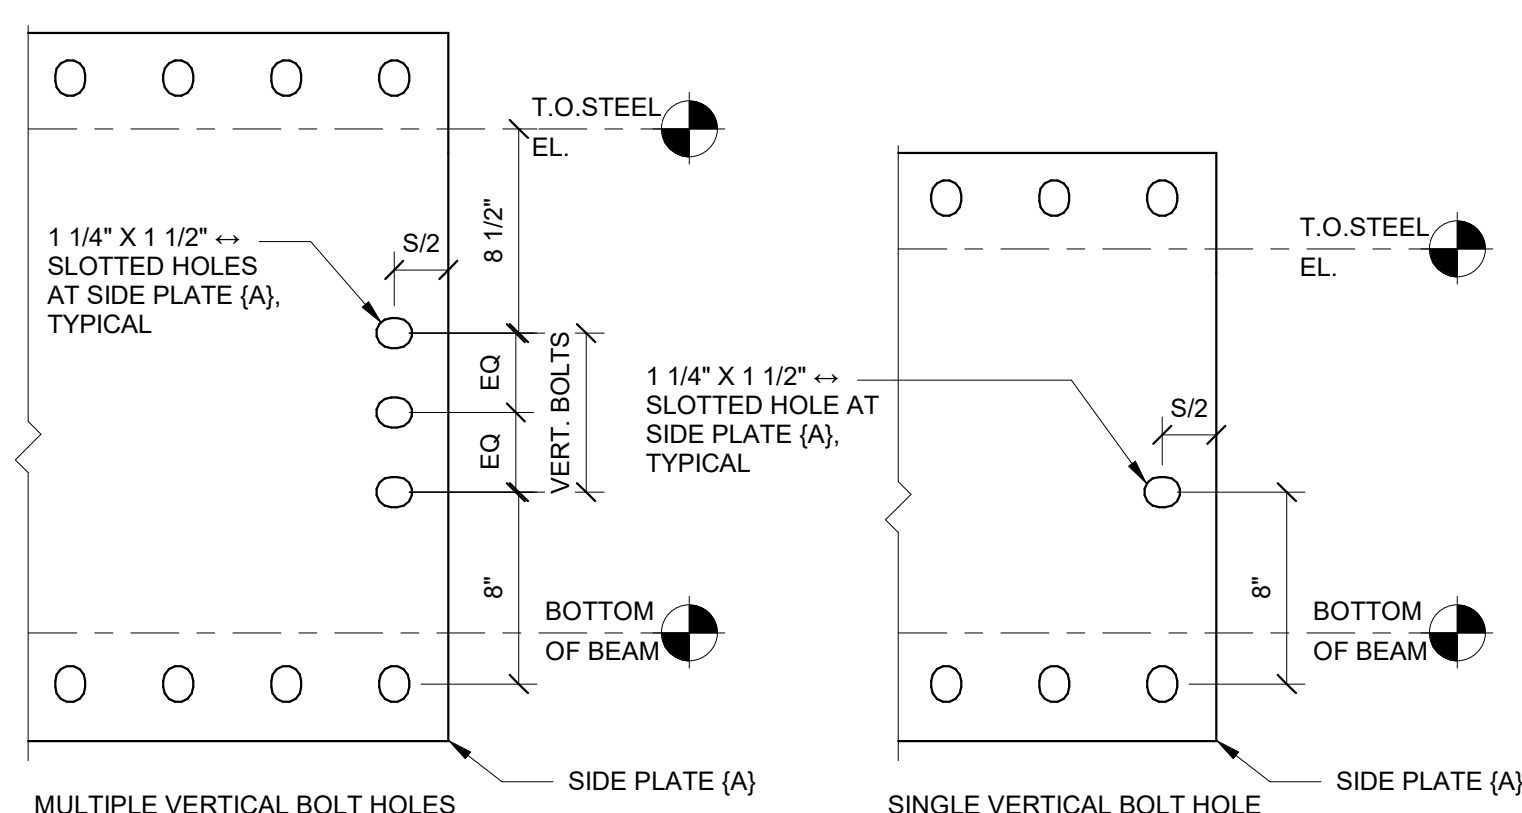


NOTE(S):
 1. SEE COLUMN SCHEDULE FOR BOLT QUANTITY.

7 SIDE PLATE (A) VSE BOLT HOLE DETAIL
 N.T.S.


ID	COLUMN PANEL ZONE DESIGN (INCHES)				SIDE PLATE (A) EXTENSION DESIGN (INCHES)										
	COLUMN	WELD	BEAM	PLATE (A)	ANGLE			WELD		BOLT					
	SERIES	SIZE	SHAPE		GAP	THICKNESS	B	Y	SUGGESTED SIZE	HORIZONTAL LEG	VERTICAL LEG	SIZE	DIAMETER	HORIZONTAL #	G
B11	W14x	3/8	W24X68	2	5/8	27 1/4	2 1/2	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	4	2 1/8	4 1/2
B12	W14x	7/16	W24X68	2 1/4	1	27 1/4	1 7/8	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	4	2 1/8	4 1/2
B19	W14x	1/2	W24X68	2	5/8	27 1/4	2 1/2	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	4	2 1/8	4 1/2
B20	W14x	3/4	W24X94	2	7/8	27 3/4	2 7/8	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	5	2 1/8	4 1/2
B30	W14x	1/2	W36X150	2	5/8	39 3/8	5	L5X3-1/2X5/8	3-1/2 to 6	4 to 6	5/16	1 1/8	6	2 1/8	4 1/2

2 B TYPE COLUMN CONNECTION SCHEDULE
 N.T.S.

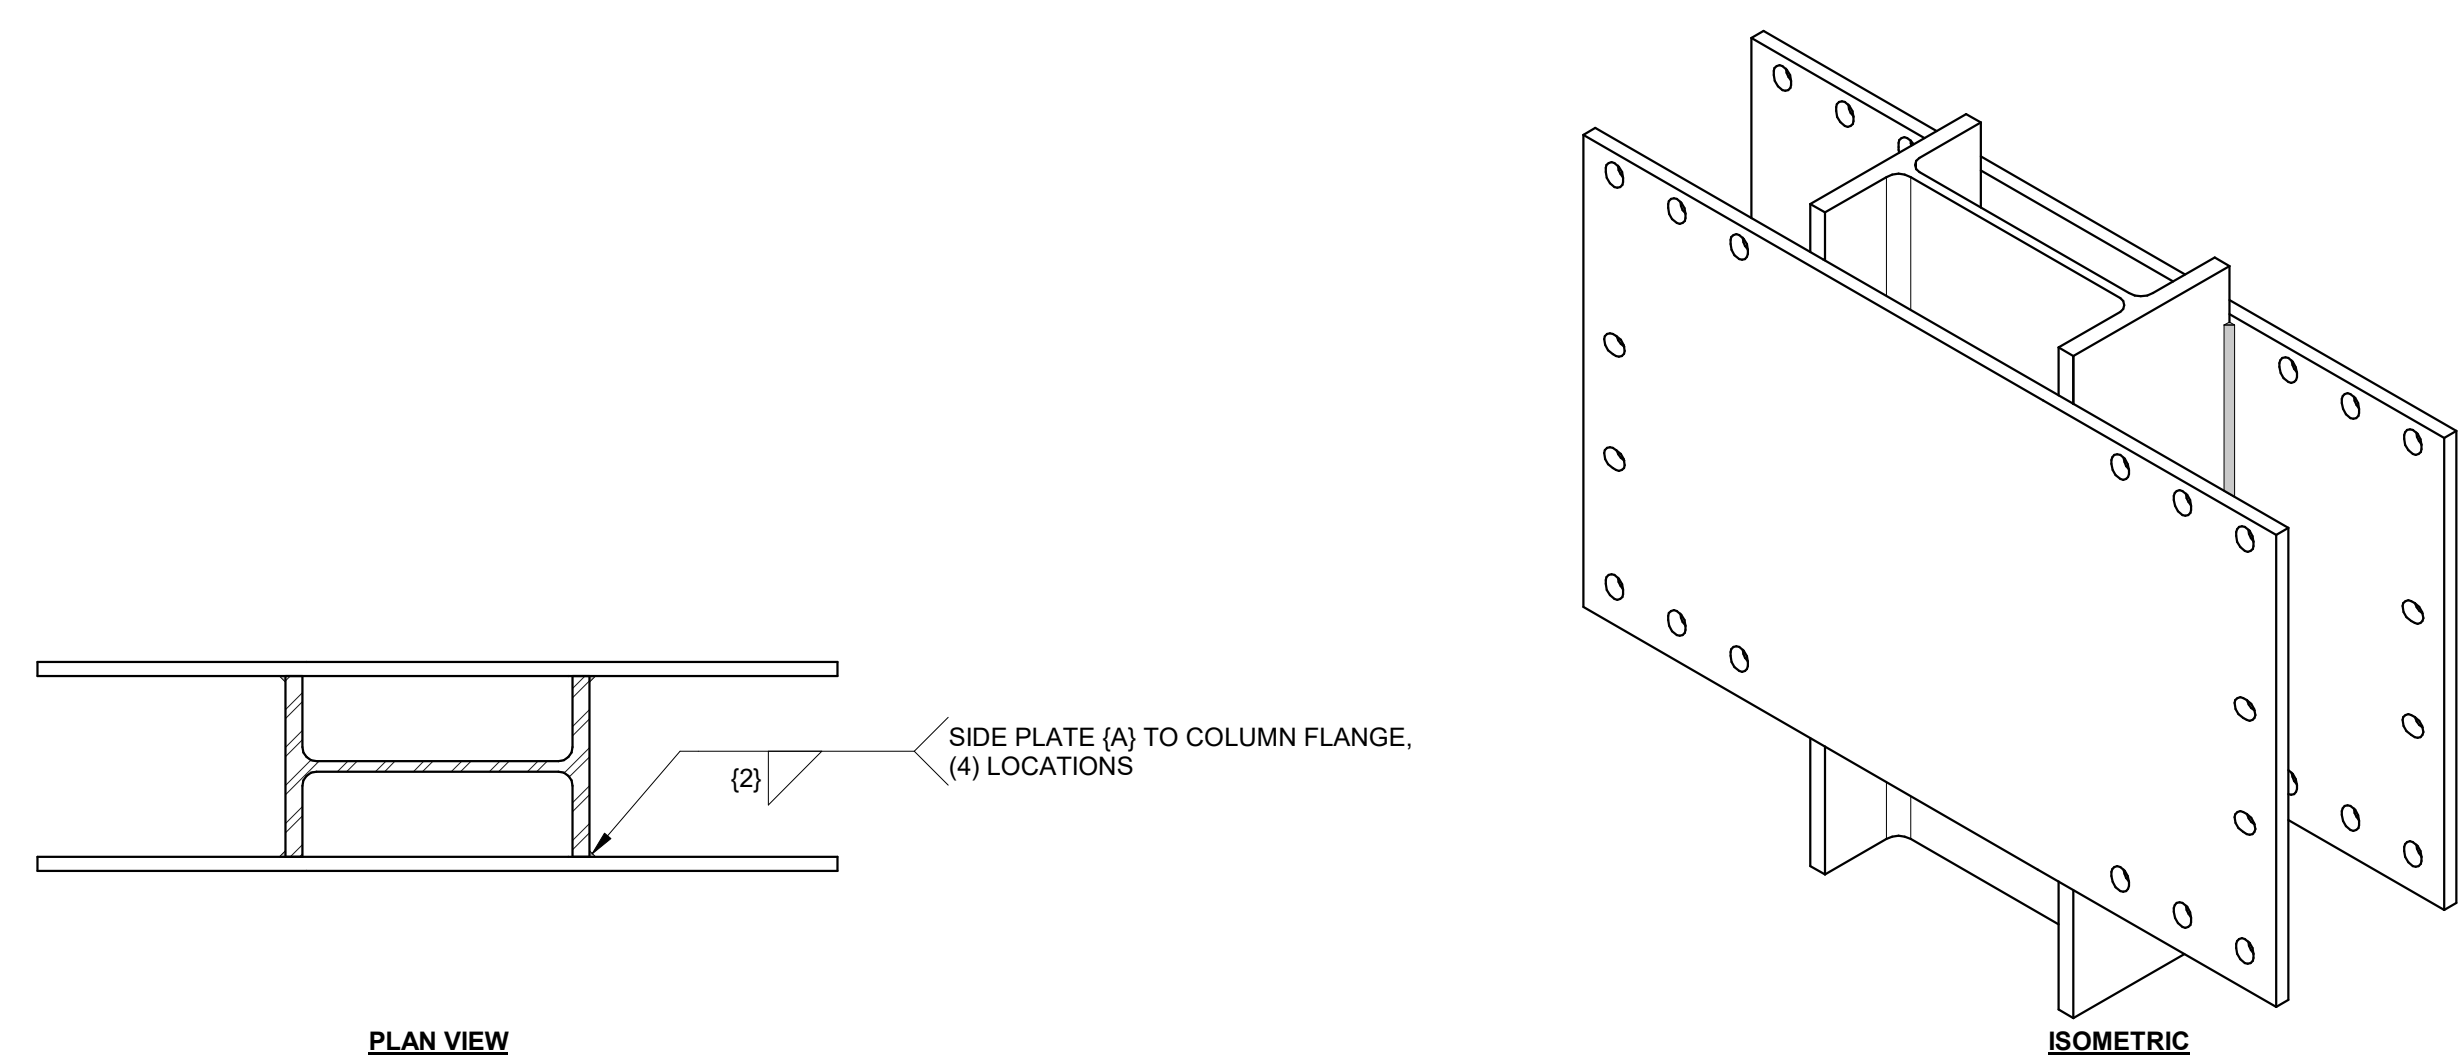


PLAN VIEW

ISOMETRIC

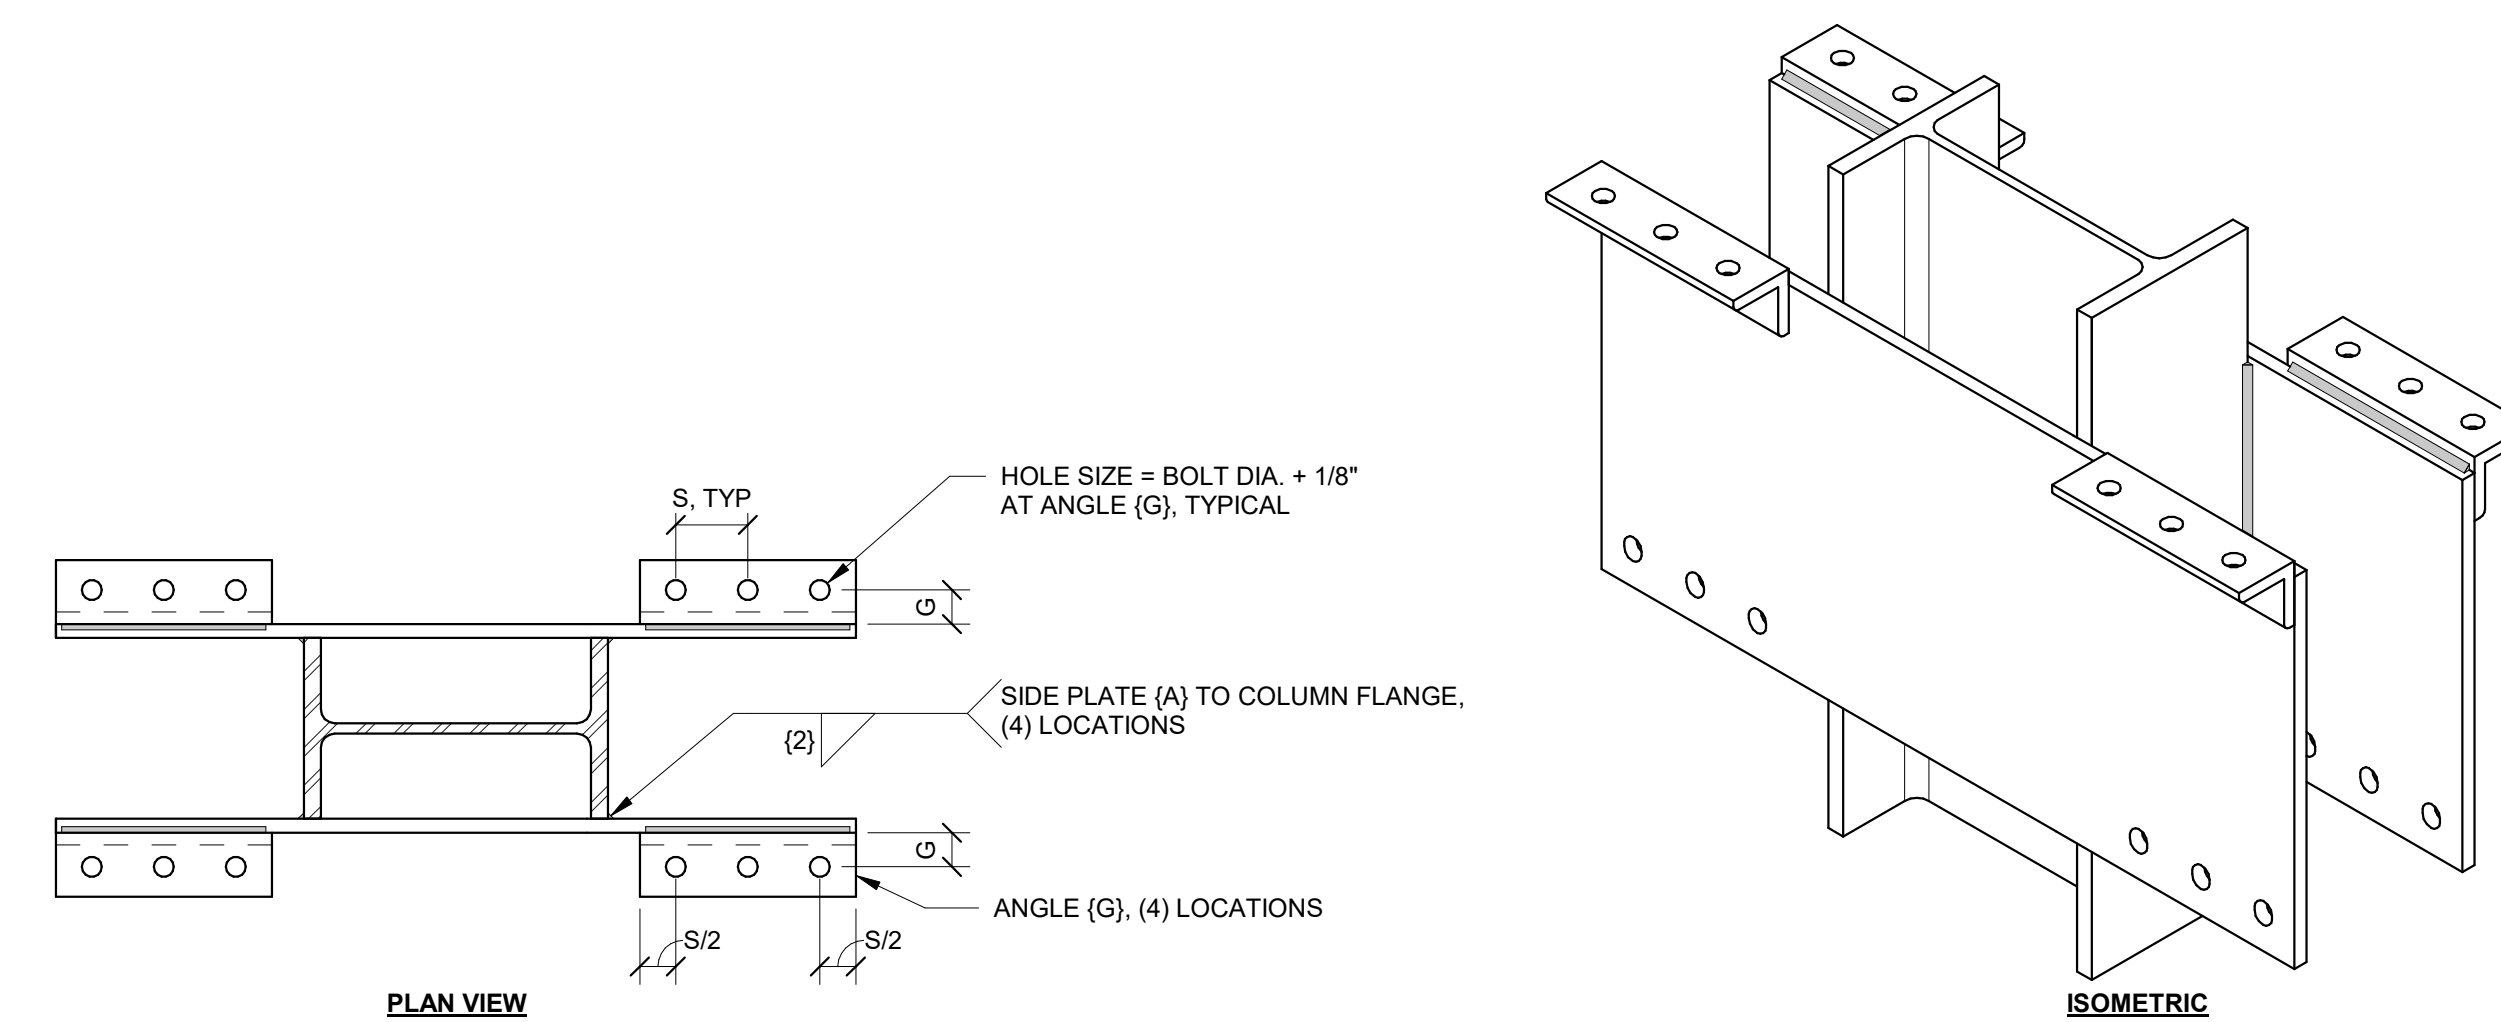


PLAN VIEW

ISOMETRIC

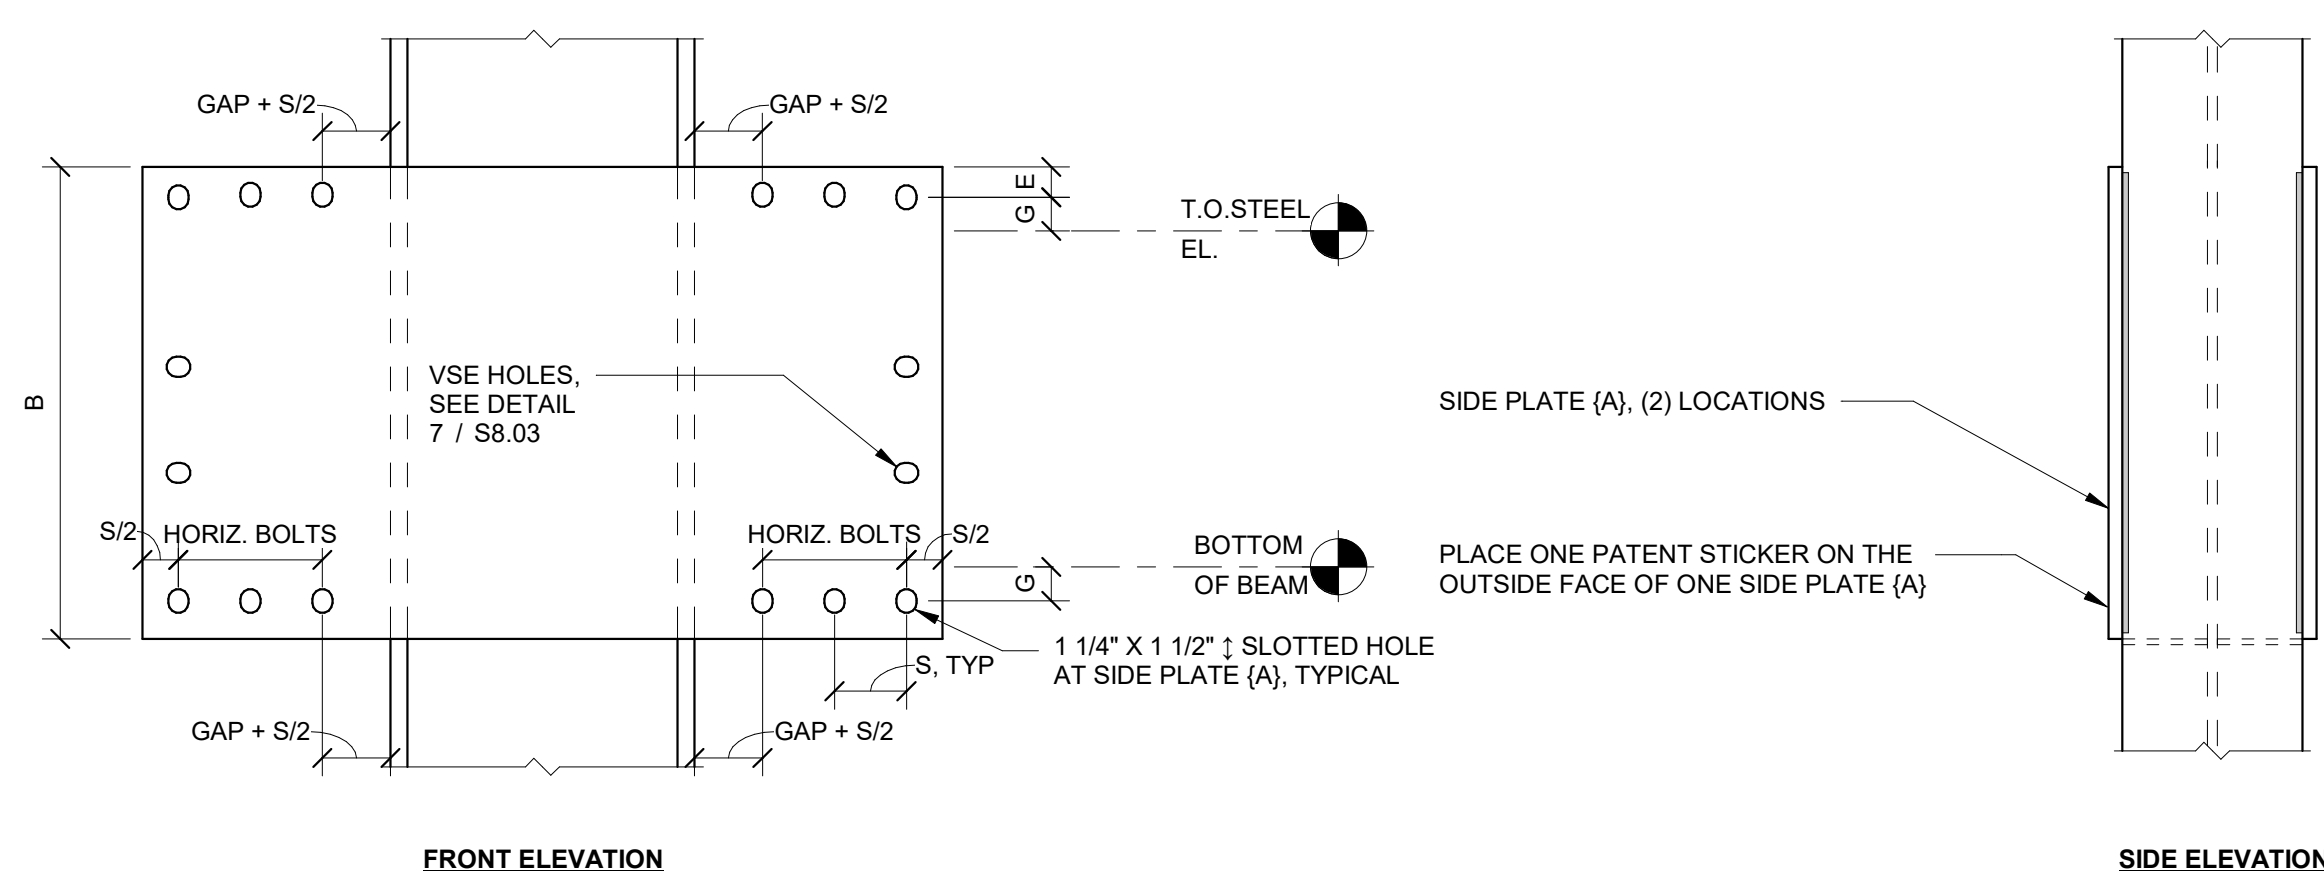

FRONT ELEVATION

SIDE ELEVATION

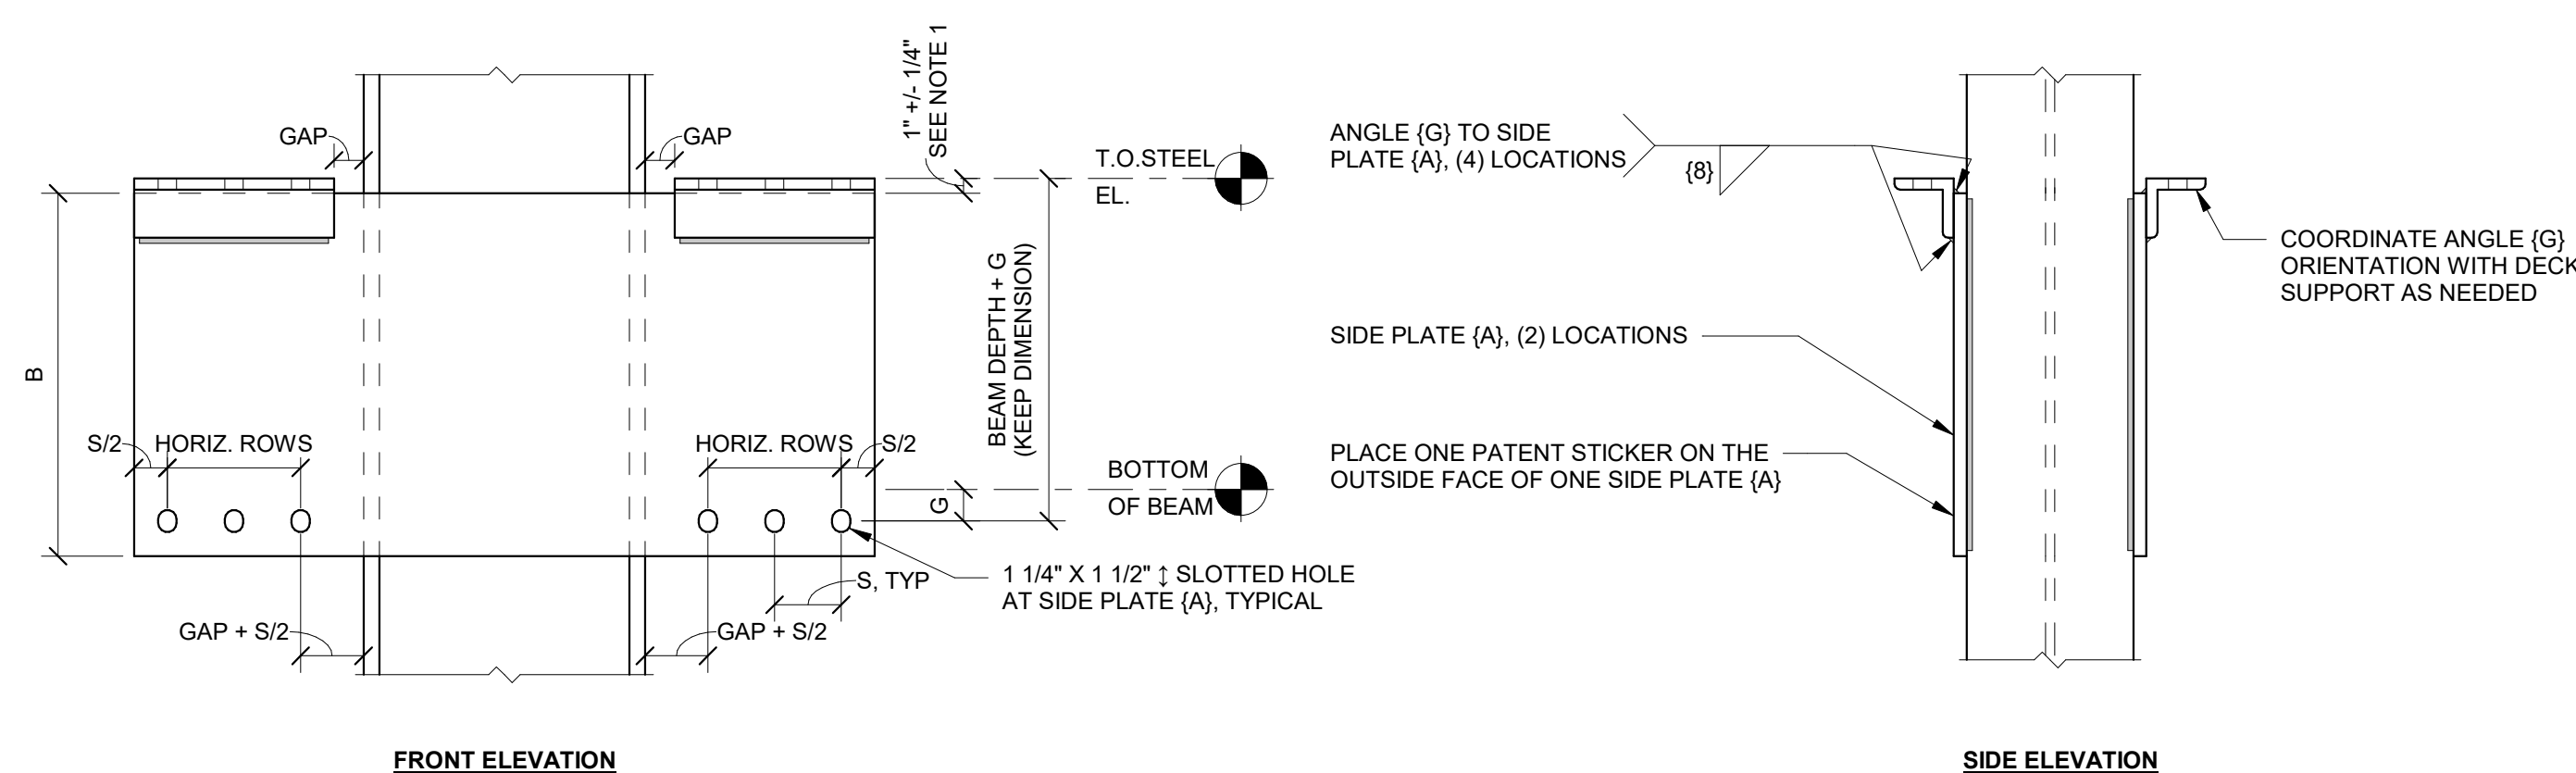

FRONT ELEVATION

SIDE ELEVATION

NOTE(S):
 T. THE +/- .14 INCH TOLERANCE FOR PLACEMENT OF ANGLES (G) IS TO ENSURE CORRECT TOP OF STEEL PLACEMENT RELATIVE TO THE CENTERLINE OF THE BOTTOM HORIZONTAL ROW OF BOLT HOLES. THE PLACEMENT OF ANGLES (G) SHALL NEVER BE MEASURED FROM THE BOTTOM EDGE OF SIDE PLATE (A) TO ESTABLISH THE CORRECT TOP OF STEEL.

5 B TYPE NARROW BOLTED CONNECTION
 N.T.S.


1 B TYPE BOLTED CONNECTION
 N.T.S.

INTELLECTUAL PROPERTY RIGHTS NOTICE
 The SIDEPLATE® steel frame connection system is covered by one or more of U.S. Pat. Nos. 6,138,427; 6,516,583; 6,591,573; 7,178,296; 8,122,671; 8,122,672; 8,140,322; 8,176,706; 8,205,408; and 9,091,065 and foreign counterparts.
 Other U.S. and foreign applications pending.

SIDEPLATE® is a registered trademark of Mitek Holdings, Inc., an affiliate of SidePlate Systems, Inc.


Copyright © 2019 SidePlate Systems, Inc. All rights reserved. Without limitation, this drawing and the information hereon may be used only following payment of a license fee to SidePlate Systems, Inc. and for the design, construction, operation, repair, maintenance, restoration or demolition of the building(s) specifically identified.

vis.06.02 3/19/2019

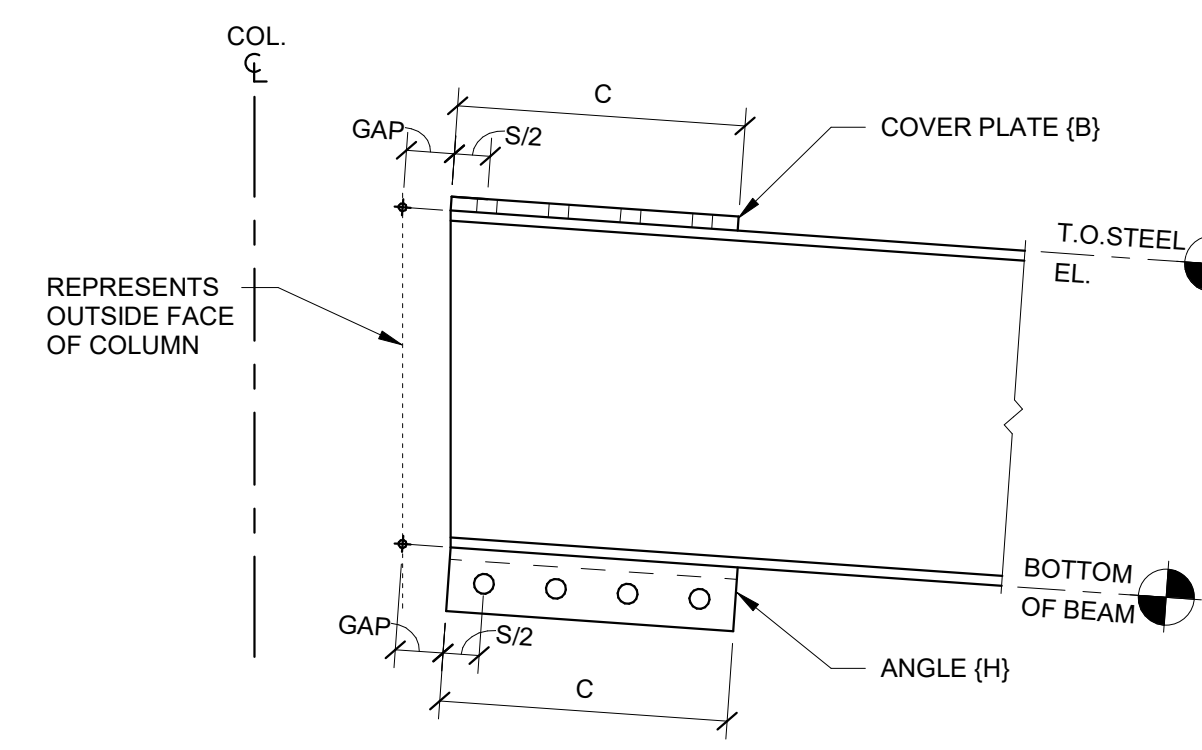

ELEVATION VIEW

NOTE(S):
 1. FOR BEAM SLOPES > 1" PER FOOT, CONTACT SIDEPLATE SYSTEMS, INC.

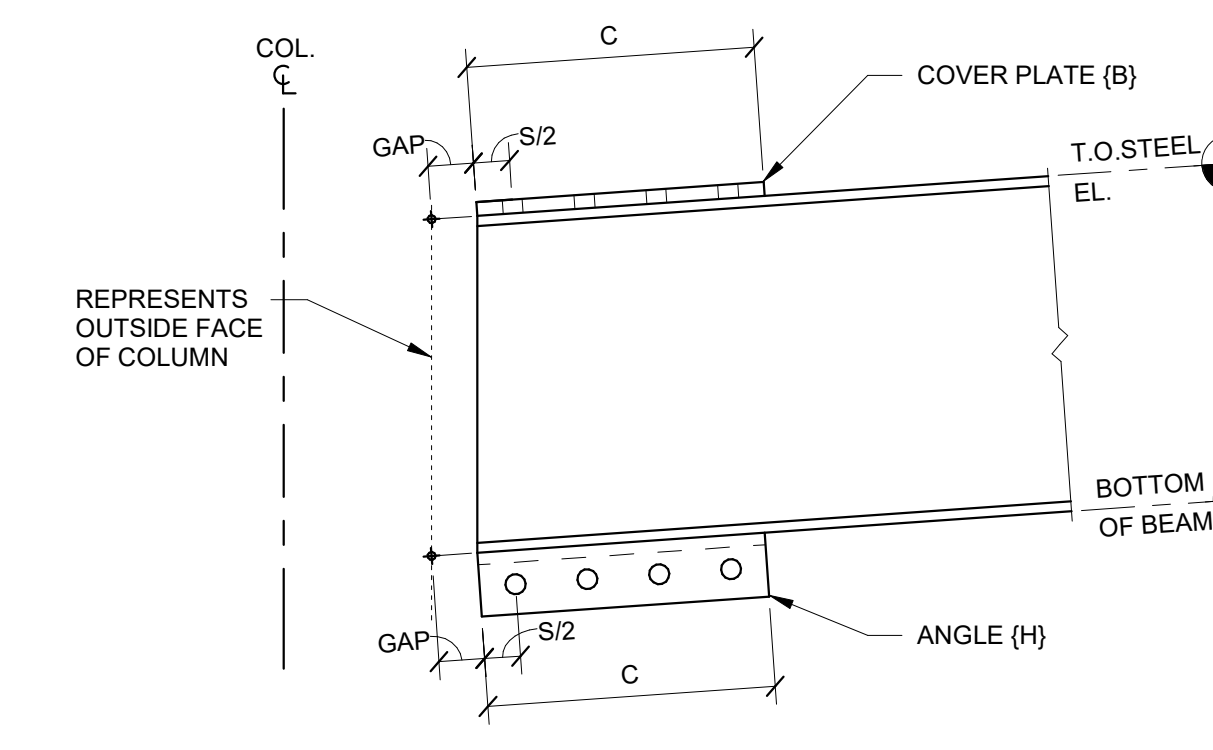

ELEVATION VIEW


NOTE(S):
 1. FOR BEAM SLOPES > 1" PER FOOT, CONTACT SIDEPLATE SYSTEMS, INC.

④ SLOPED DOWN BEAM END (AS APPLICABLE)
 N.T.S.

③ SLOPED UP BEAM END (AS APPLICABLE)
 N.T.S.


ID	BEAM	BEAM DESIGN (INCHES)																					
		SHAPE	GAP	PLATE				ANGLE				WELD				BOLT							
				COVER PLATE TYPE	THICKNESS	E	H	THICKNESS	LENGTH X WIDTH	X	SS	SUGGESTED SIZE	C	HORIZONTAL LEG	VERTICAL LEG	SIZE	SIZE	SIZE	SIZE (SINGLE)	SIZE (DOUBLE)	DIAMETER	HORIZONTAL #	G
A10	W24X68	2	Slotted	1 1/8	1 3/8	8 1/4	-	-	-	-	L6X4X5/8	18	6	4	5/16	5/16	5/16	-	-	1 1/8	4	2 1/8	4 1/2
A11	W24X68	2	Slotted	7/8	1 3/8	8 1/4	-	-	-	L7X4X5/8	18	7	4	5/16	5/16	5/16	-	-	1 1/8	4	2 1/8	4 1/2	
A12, B12	W24X68	2 1/4	Slotted	3/4	1 3/8	9	-	-	-	L7X4X5/8	18	7	4	5/16	5/16	5/16	-	-	1 1/8	4	2 1/8	4 1/2	
A19, B19	W24X68	2	Slotted	1	1 3/8	8 1/4	1/4	4 X 4	3	6 3/4	L6X4X5/8	18	6	4	5/16	5/16	5/16	1/4	1/8	1 1/8	4	2 1/8	4 1/2
A20, B20	W24X94	2	Slotted	1 1/4	1 3/8	8 3/4	-	-	-	L6X4X5/8	22 1/2	6	4	5/16	5/16	5/16	-	-	1 1/8	5	2 1/8	4 1/2	
A30, B30	W36X150	2	Slotted	1 1/4	1 3/8	8 1/4	-	-	-	L5X3-1/2X5/8	27	5	3 1/2	5/16	5/16	5/16	-	-	1 1/8	6	2 1/8	4 1/2	
B11	W24X68	2	Slotted	3/4	1 3/8	8 1/4	-	-	-	L7X4X5/8	18	7	4	5/16	5/16	5/16	-	-	1 1/8	4	2 1/8	4 1/2	

⑥ BEAM END SCHEDULE
 N.T.S.

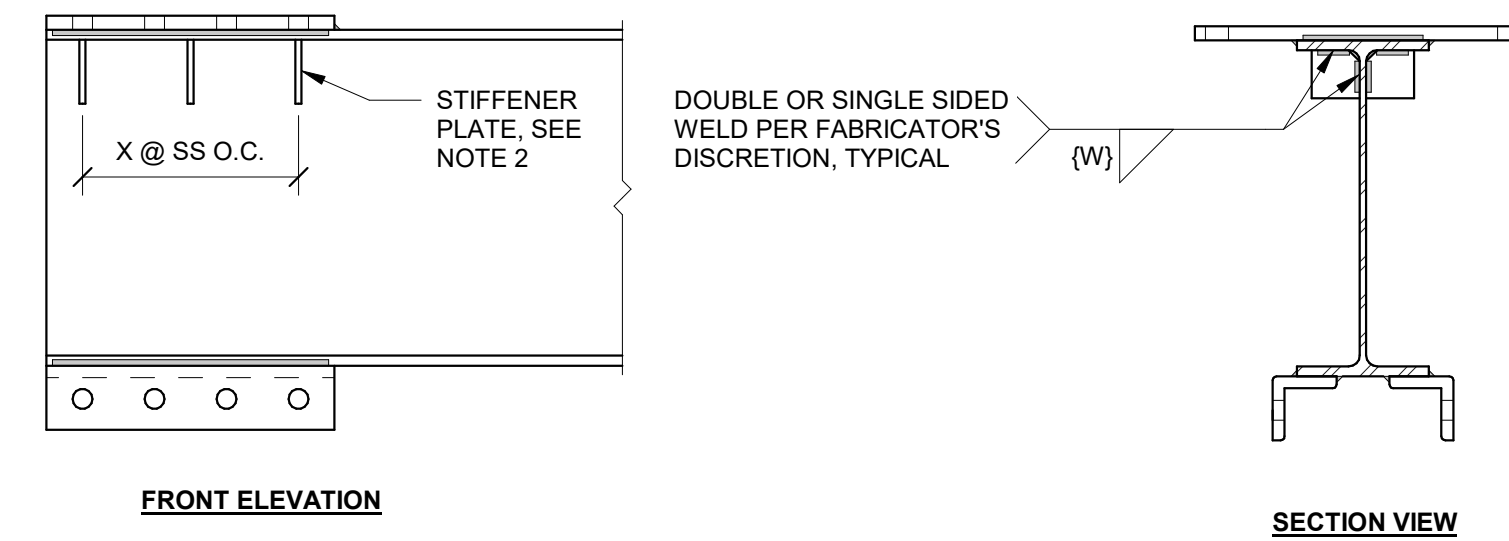


NOTE(S):
 1. SEE BEAM END SCHEDULE FOR QUANTITY, SPACING, AND WELDING OF STIFFENER PLATES.
 2. STIFFENER PLATES SHALL BE MADE OF GRADE 50 MATERIAL.
 3. STIFFENER PLATES AND WELDS ARE NOT CREATED BY SIDEPLATE CUSTOM COMPONENT TOOL.


⑥ STIFFENER PLATES
 N.T.S.

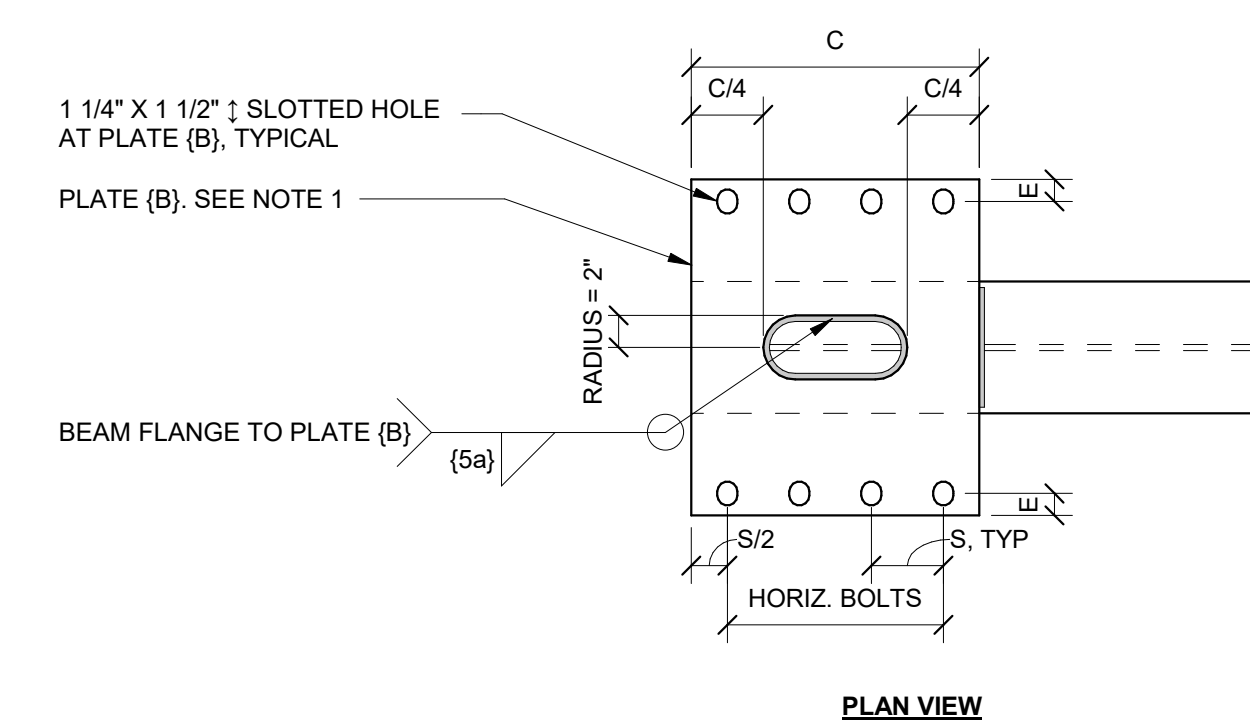

PLAN VIEW

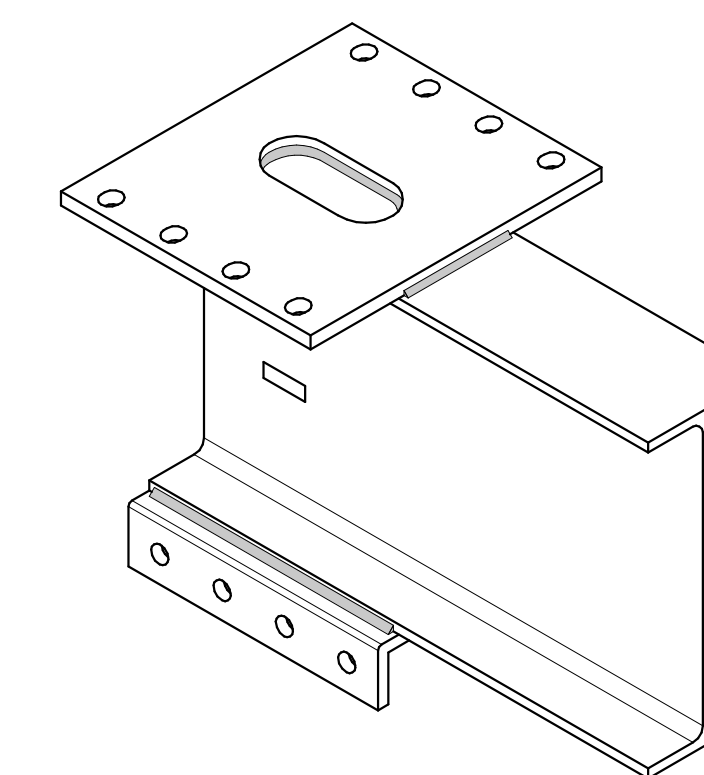


ISOMETRIC VIEW

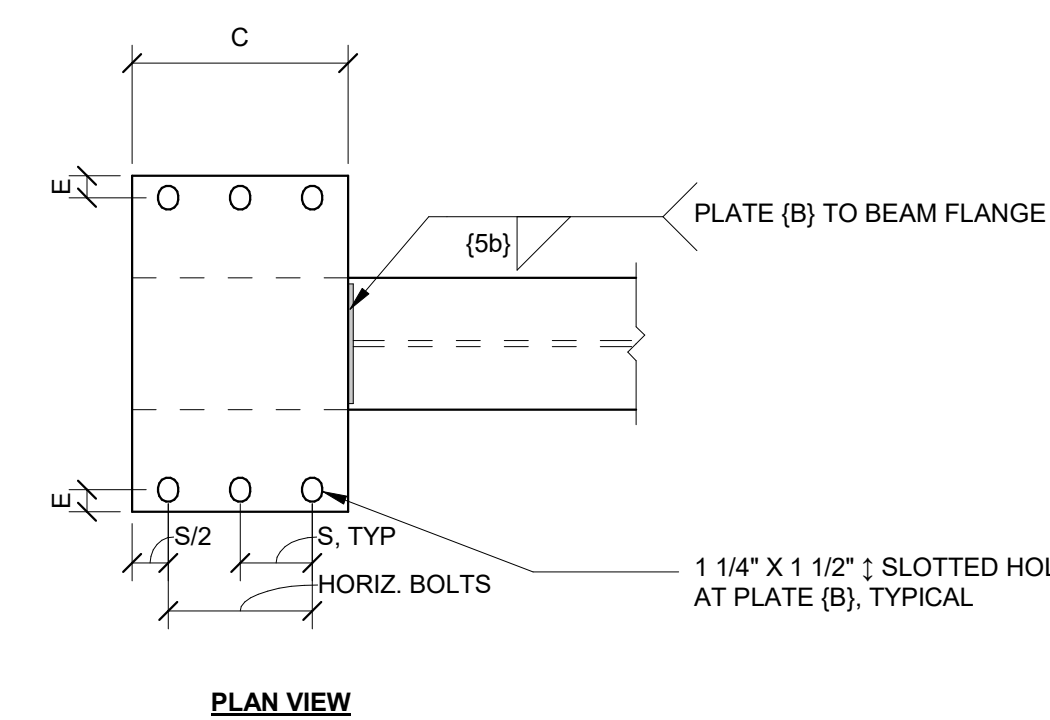

PLAN VIEW

NOTE(S):
 1. FOR ITEMS NOT NOTED, SEE DETAIL 1 / S8.04


⑤ RECTANGULAR COVER PLATE (B)
 N.T.S.

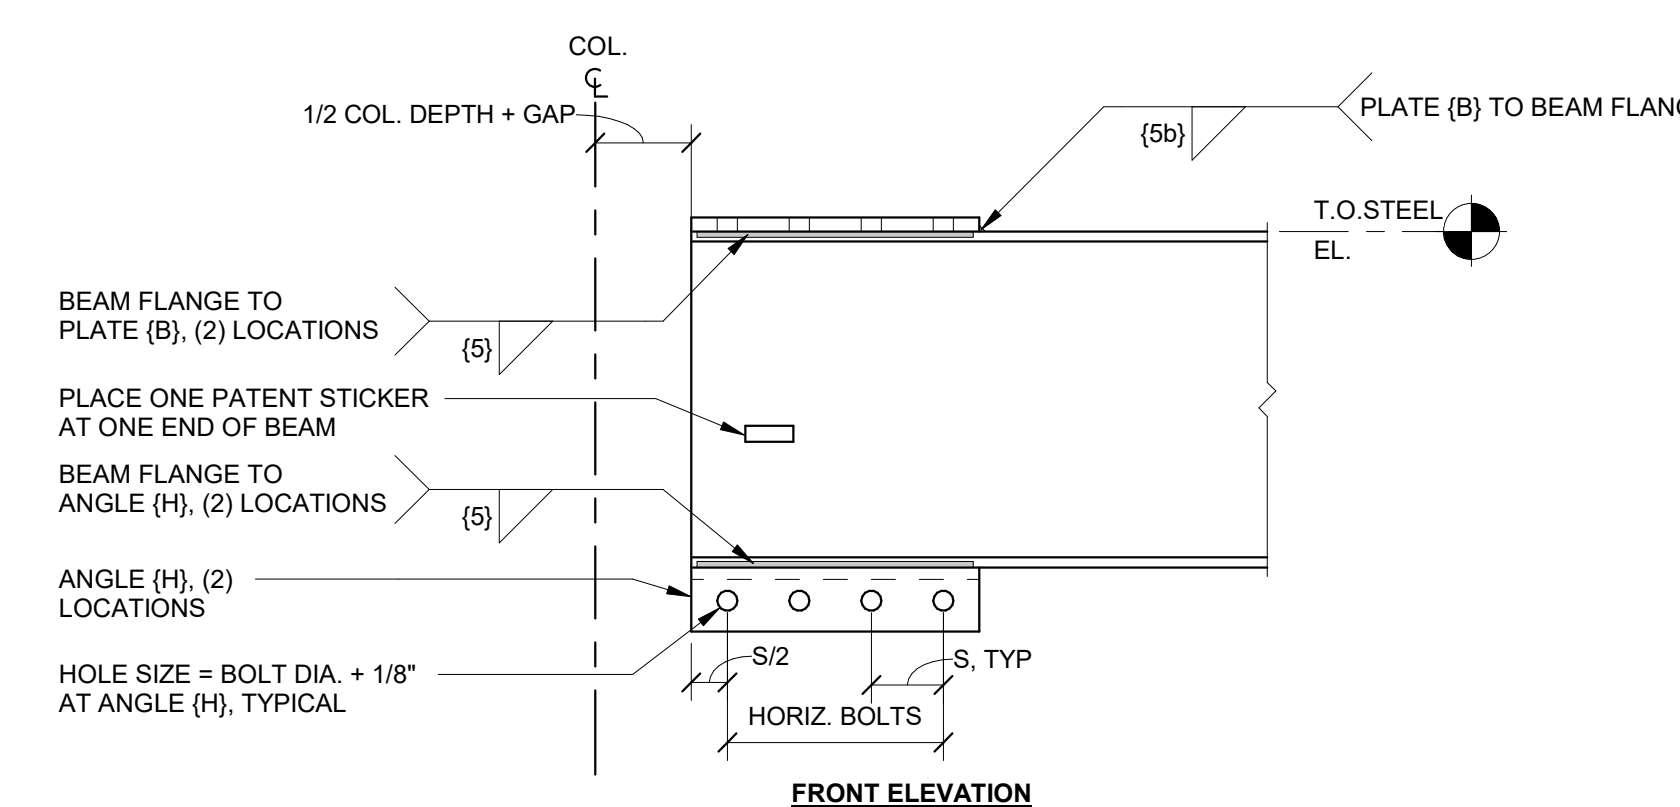


FRONT ELEVATION

NOTE(S):
 1. USE SLOTTED OR RECTANGULAR COVER PLATE (B) PER SCHEDULE. FOR RECTANGULAR COVER PLATE, SEE DETAIL 5 / S8.04


① BEAM END DETAIL
 N.T.S.

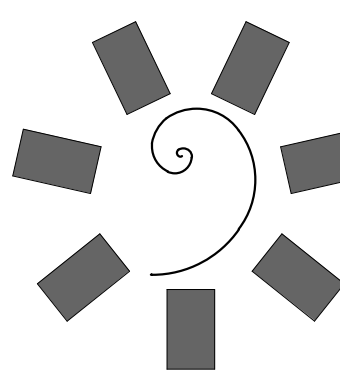

James R. Childers
 Architect, Inc.
 45 South 4th Street
 Fort Smith, AR 72901
 479-783-2450
 www.childersarchitect.com

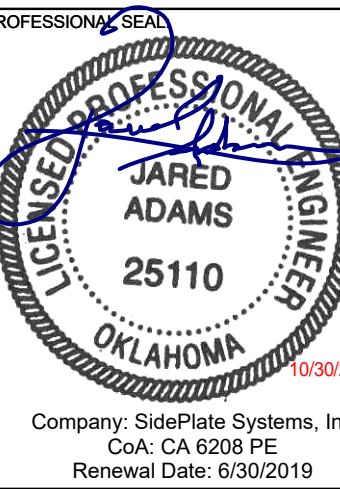

CONSULTANT LOGO

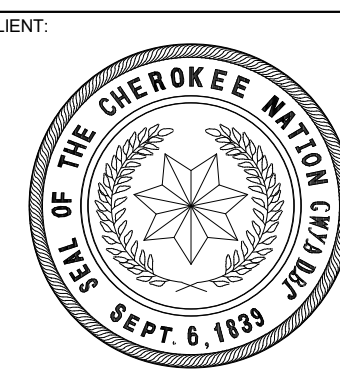

WILMA P. MANKILLER HEALTH CENTER
 EXPANSION
 STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE:
 BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION


DATE: 11-01-19 JOB NUMBER: 18-01.01

SHEET NUMBER:

S8.04


SIDEPLATE BEAM DETAILS

INTELLECTUAL PROPERTY RIGHTS NOTICE
 The SIDEPLATE® steel frame connection system is covered by one or more of U.S. Pat. Nos. 6,138,427; 6,516,583; 6,591,573; 7,178,296; 8,122,671; 8,122,672; 8,146,322; 8,176,706; 8,205,408; and 9,091,065 and foreign counterparts.
 Other U.S. and foreign applications pending.
 SIDEPLATE® is a registered trademark of MiTek Holdings, Inc., an affiliate of SidePlate Systems, Inc.
 Copyright © 2019 SidePlate Systems, Inc. All rights reserved. Without limitation, this drawing and the information hereon may be used only following payment of a license fee to SidePlate Systems, Inc. and for the design, construction, operation, repair, maintenance, restoration or demolition of the building(s) specifically identified.
 v15.08.02

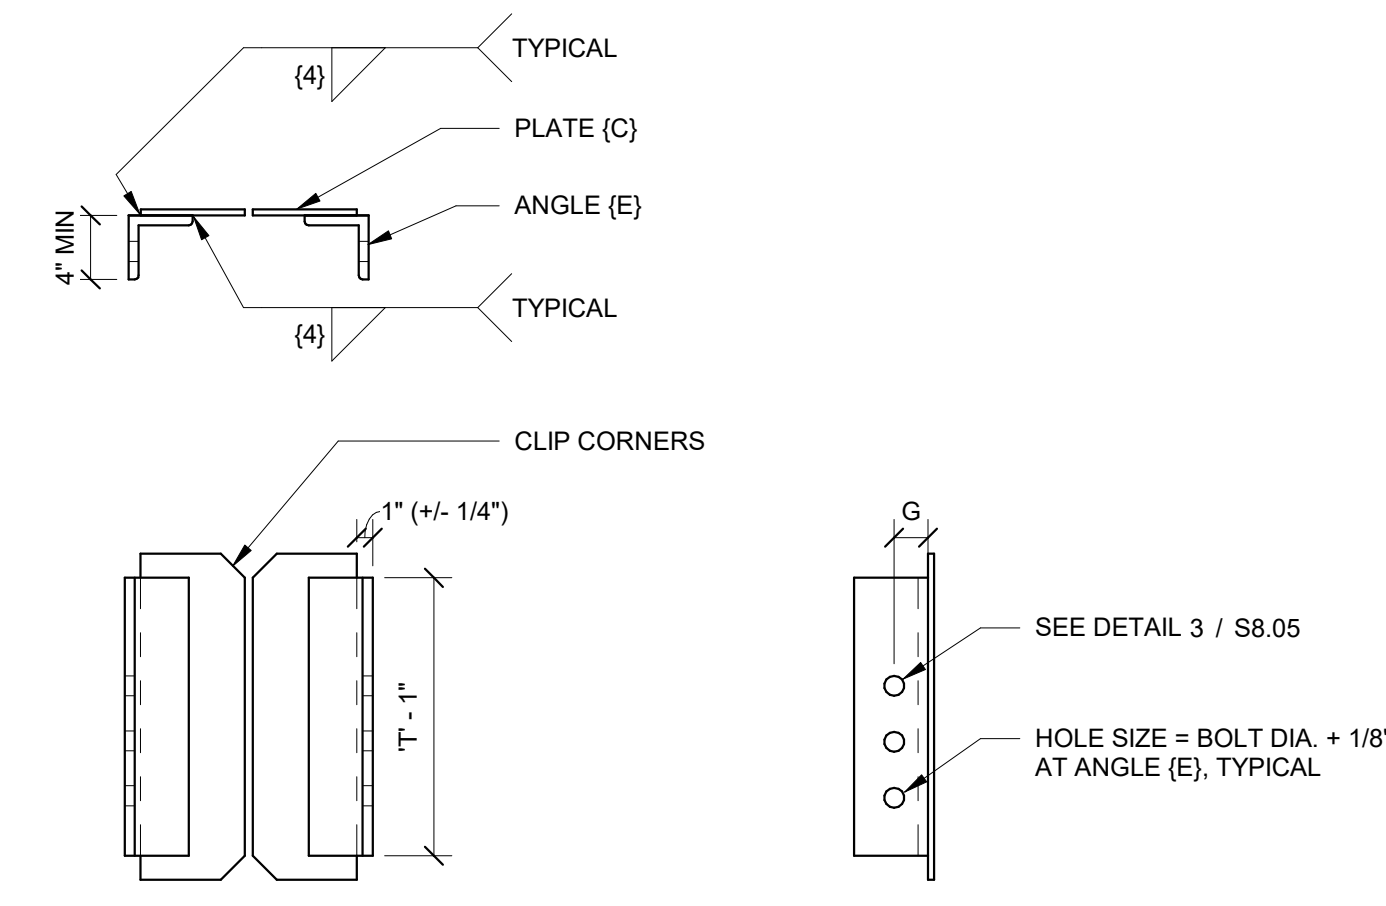

NOTE(S):
 1. SEE SIDEPLATE SCHEDULE FOR BOLT QUANTITY.

4 VSE (F) DETAIL
 N.T.S.

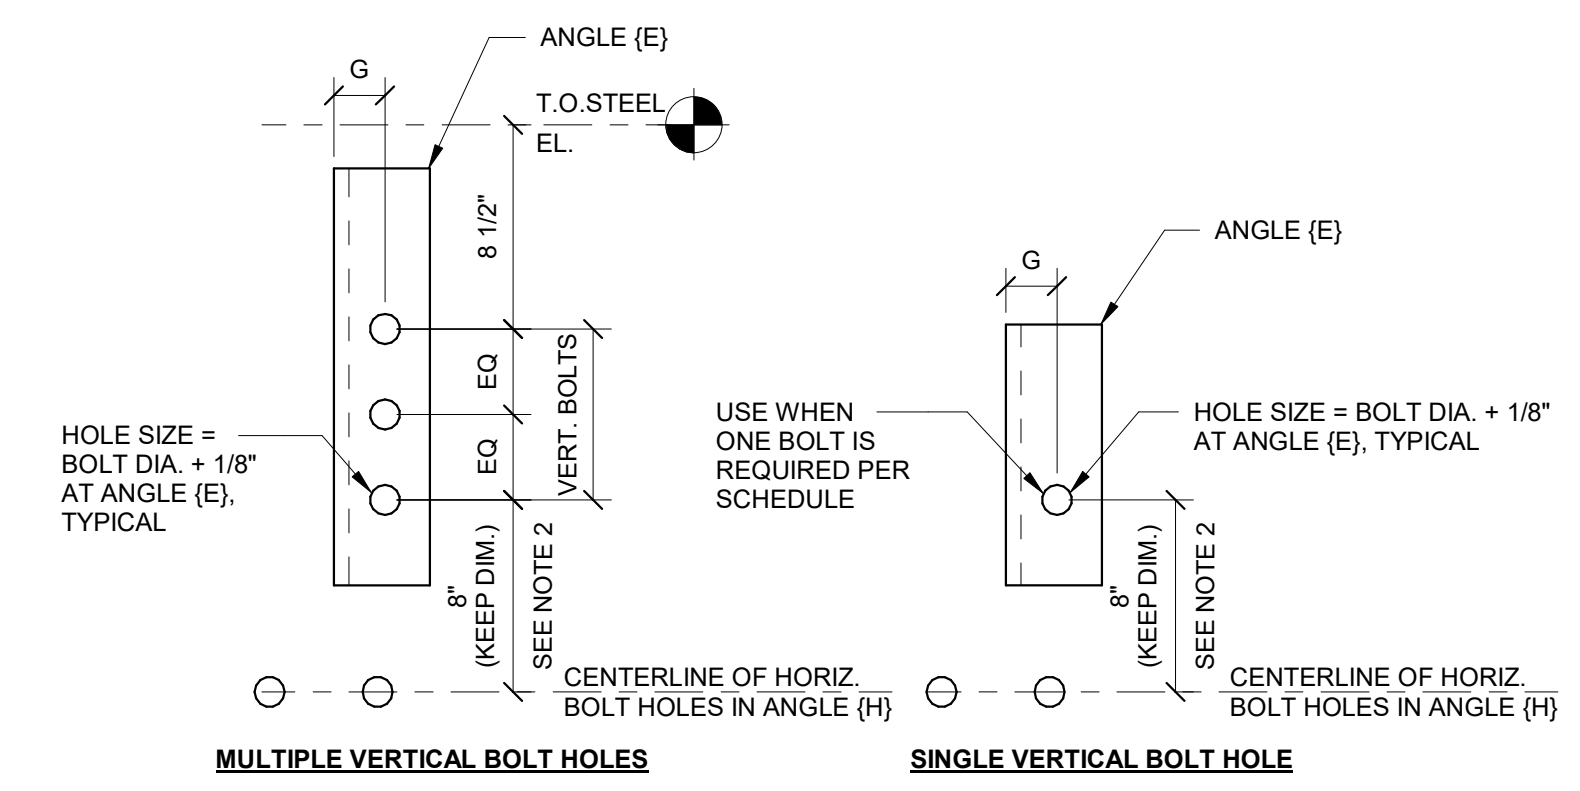


NOTE(S):
 1. SEE BEAM END SCHEDULE FOR BOLT QUANTITY.
 2. EFFECTS OF MILL AND FABRICATION TOLERANCES ARE ACCOUNTED FOR BY MEASURING FROM THE CENTERLINE OF THE HORIZONTAL ROW OF BOLTS IN THE BOTTOM ANGLES (H).

3 VSE (F) HOLE DETAIL
 N.T.S.


ID	BEAM DESIGN (INCHES)																
	BEAM		PLATE	ANGLE				WELD				BOLT					
	SHAPE	GAP	(C) THICKNESS	SUGGESTED SIZE	C	HORIZONTAL LEG	VERTICAL LEG	(E) SIZE	(4) SIZE	(5) SIZE	(5a) SIZE	DIAMETER	HORIZONTAL #	VERTICAL #	G	J	S
A15, B15	W24X68	2	3/8	L6X4X5/8	18	6	4	L4X4X1/2	1/4	5/16	5/16	1 1/8	4	2	2 1/8	15 3/4	4 1/2
A25, B25	W24X94	2	3/8	L6X4X5/8	22 1/2	6	4	L4X4X1/2	1/4	5/16	5/16	1 1/8	5	2	2 1/8	20 1/4	4 1/2
A45, B45	W36X160	2	3/8	L5X3-1/2X5/8	27	5	3 1/2	L4X4X1/2	1/4	5/16	5/16	1 1/8	6	3	2 1/8	24 3/4	4 1/2

2 NARROW BEAM END SCHEDULE
 N.T.S.

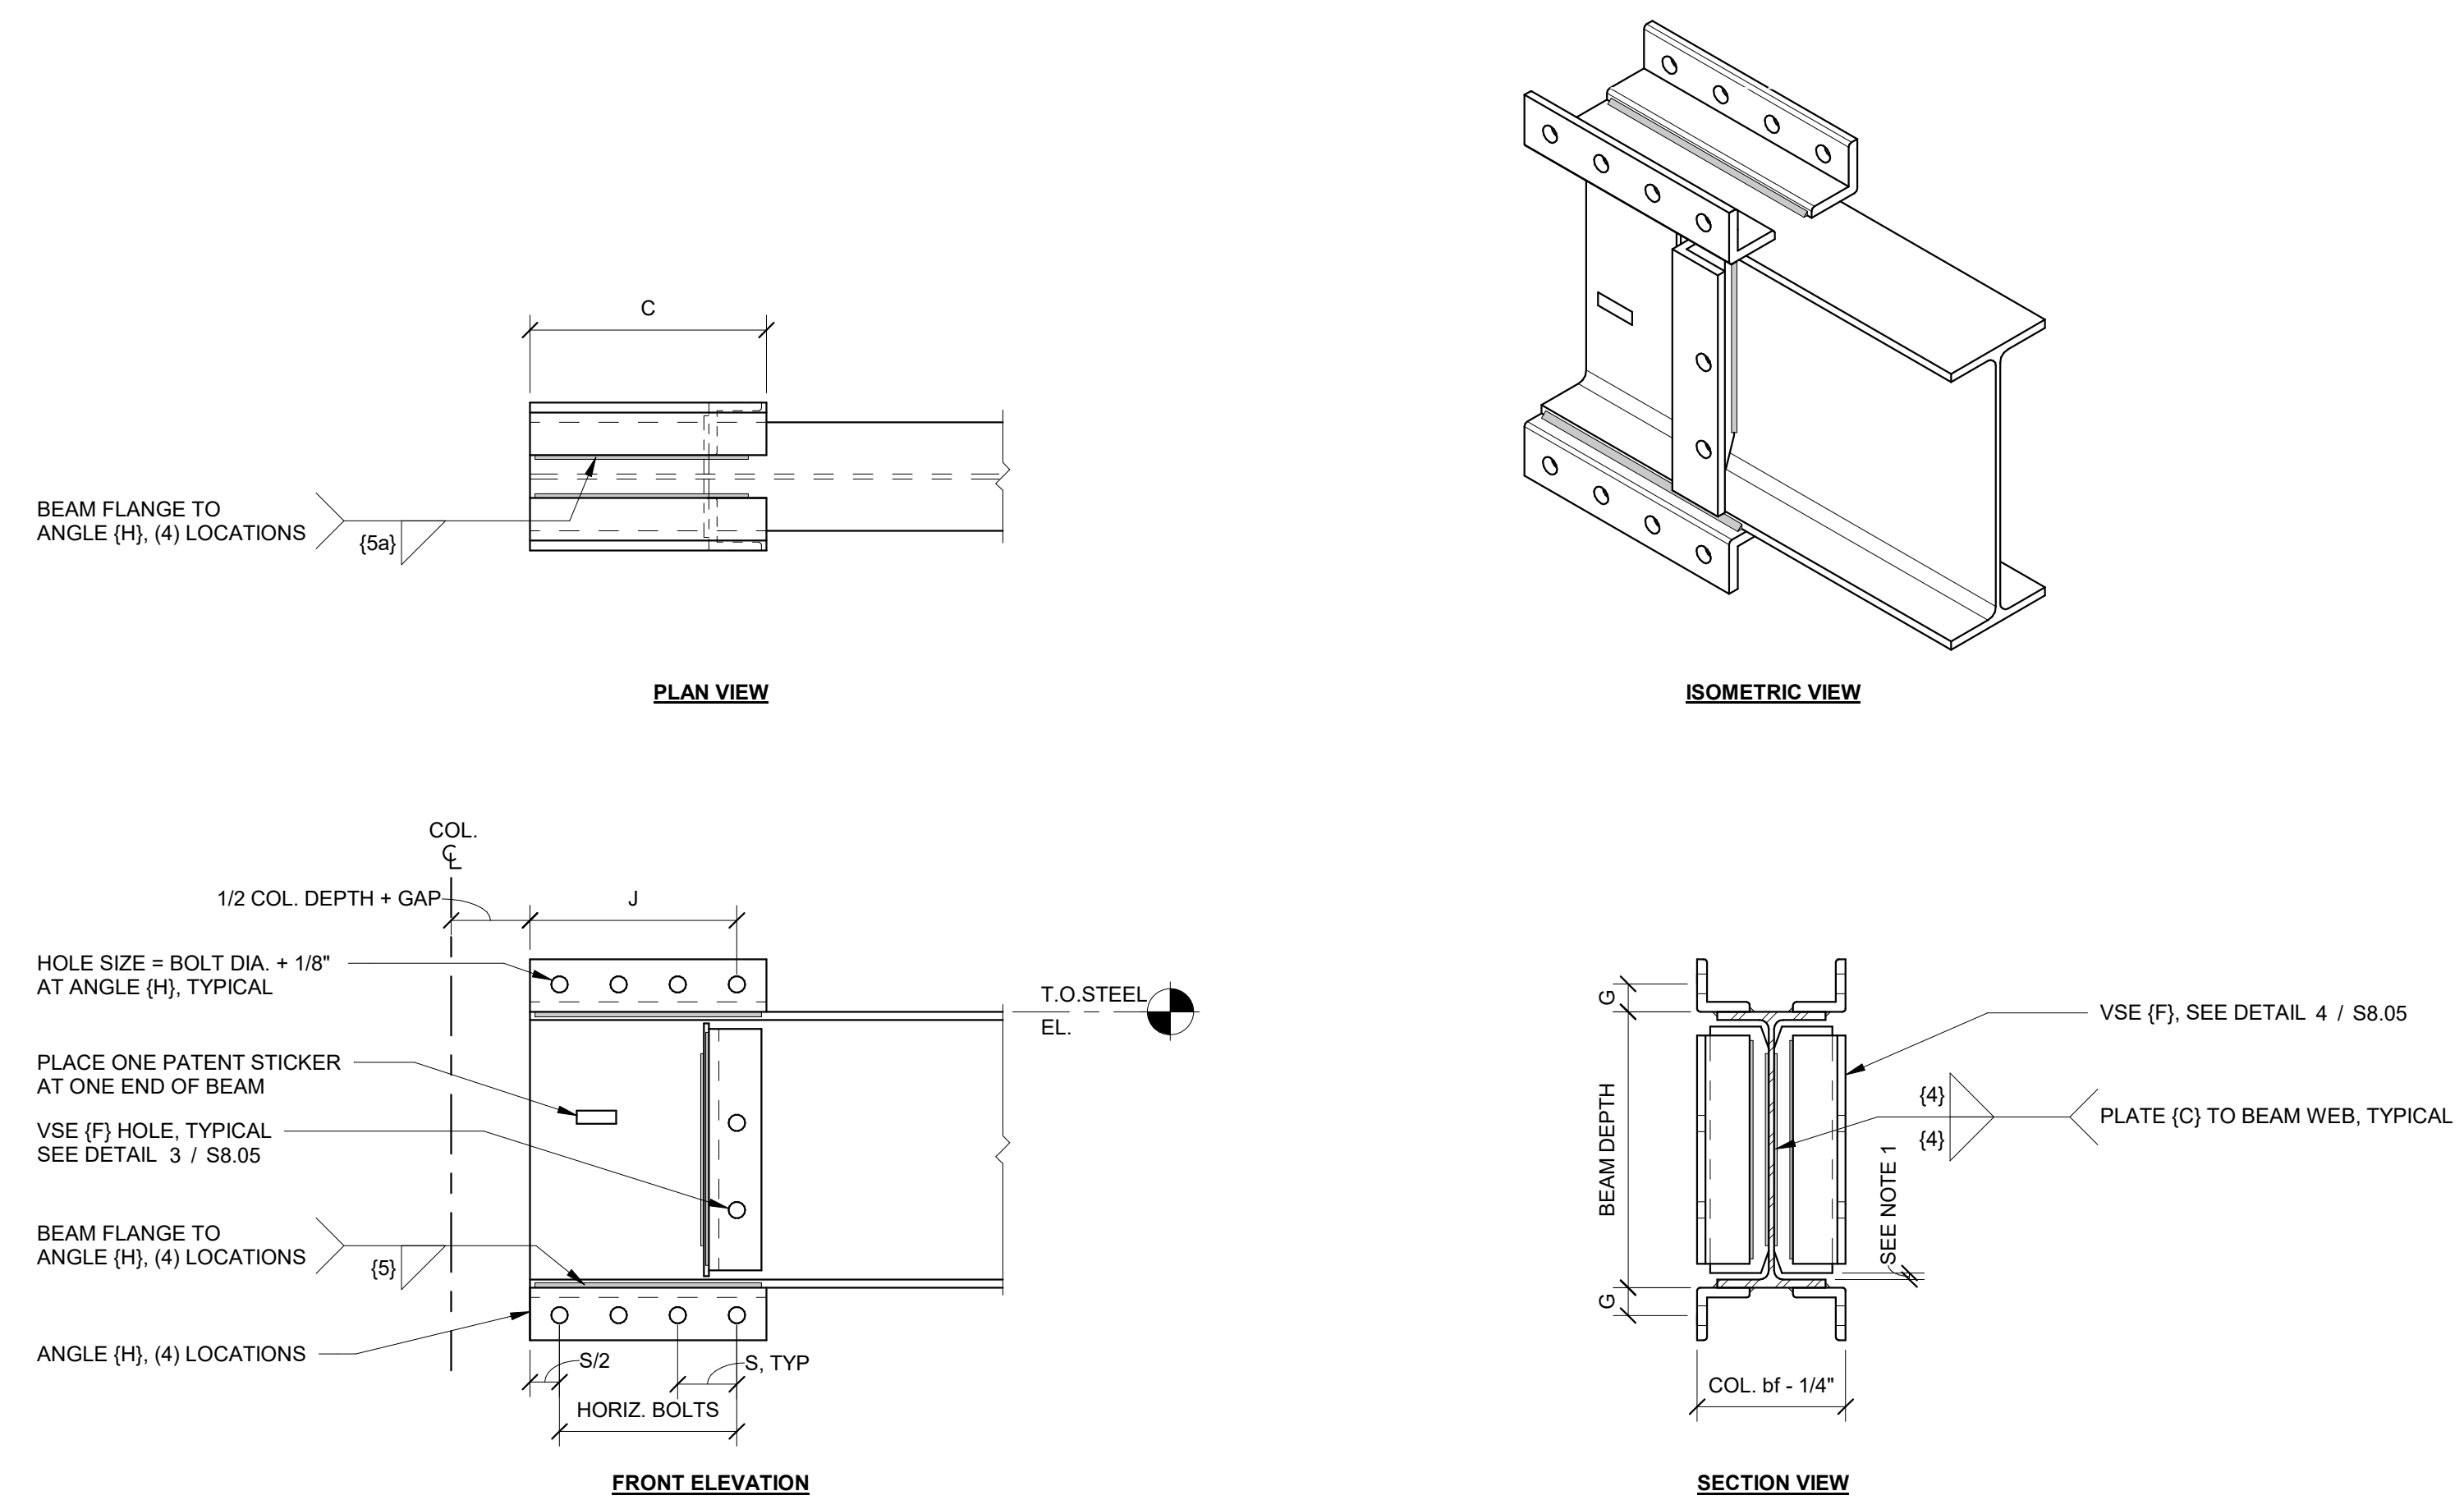


NOTE(S):
 1. DIMENSION BETWEEN PLATE (C) AND INSIDE FACE OF BEAM FLANGE SHALL NOT EXCEED 1/4 INCH, AND MAY VARY DEPENDING ON BEAM MILL TOLERANCES. PLATE (C) SHALL BE CENTERED ON THE DEPTH OF THE BEAM.


1 NARROW BEAM END DETAIL
 N.T.S.

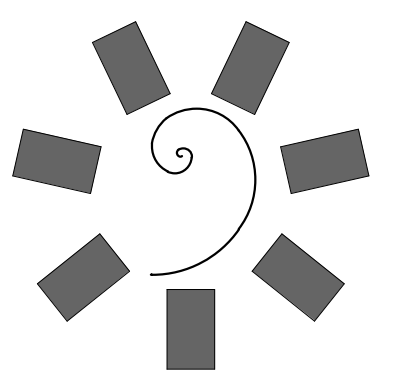

James R. Childers
 Architect, Inc.
 45 South 4th Street
 Fort Smith, AR 72901
 479-783-2450
 www.childersarchitect.com

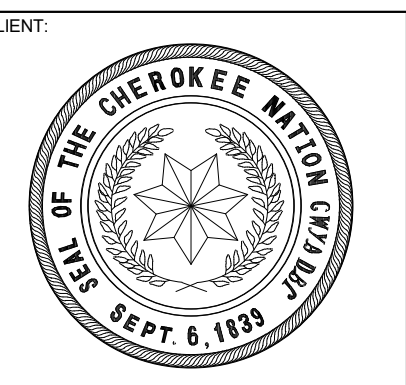

WILMA P. MANKILLER HEALTH CENTER
 EXPANSION
 STILWELL, OKLAHOMA

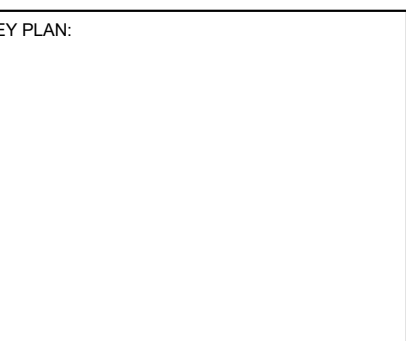

PROJECT PHASE:
 BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19 JOB NUMBER: 18-01.01


SHEET NUMBER:
 S8.05

SIDEPLATE BEAM
 DETAILS, NARROW


INTELLECTUAL PROPERTY RIGHTS NOTICE
 The SIDEPLATE® steel frame connection system is covered by one or more of U.S. Pat. Nos. 6,138,427; 6,516,583; 6,591,573; 7,178,296; 8,122,671; 8,122,672; 8,146,322; 8,176,706; 8,205,408; and 9,091,065 and foreign counterparts. Other U.S. and foreign applications pending.

SIDEPLATE® is a registered trademark of MitTek Holdings, Inc., an affiliate of SidePlate Systems, Inc.
 Copyright © 2019 SidePlate Systems, Inc. All rights reserved. Without limitation, this drawing and the information hereon may be used only following payment of a license fee to SidePlate Systems, Inc. and for the design, construction, operation, repair, maintenance, restoration or demolition of the building(s) specifically identified.

DATE PLOTTED: 11/20/20

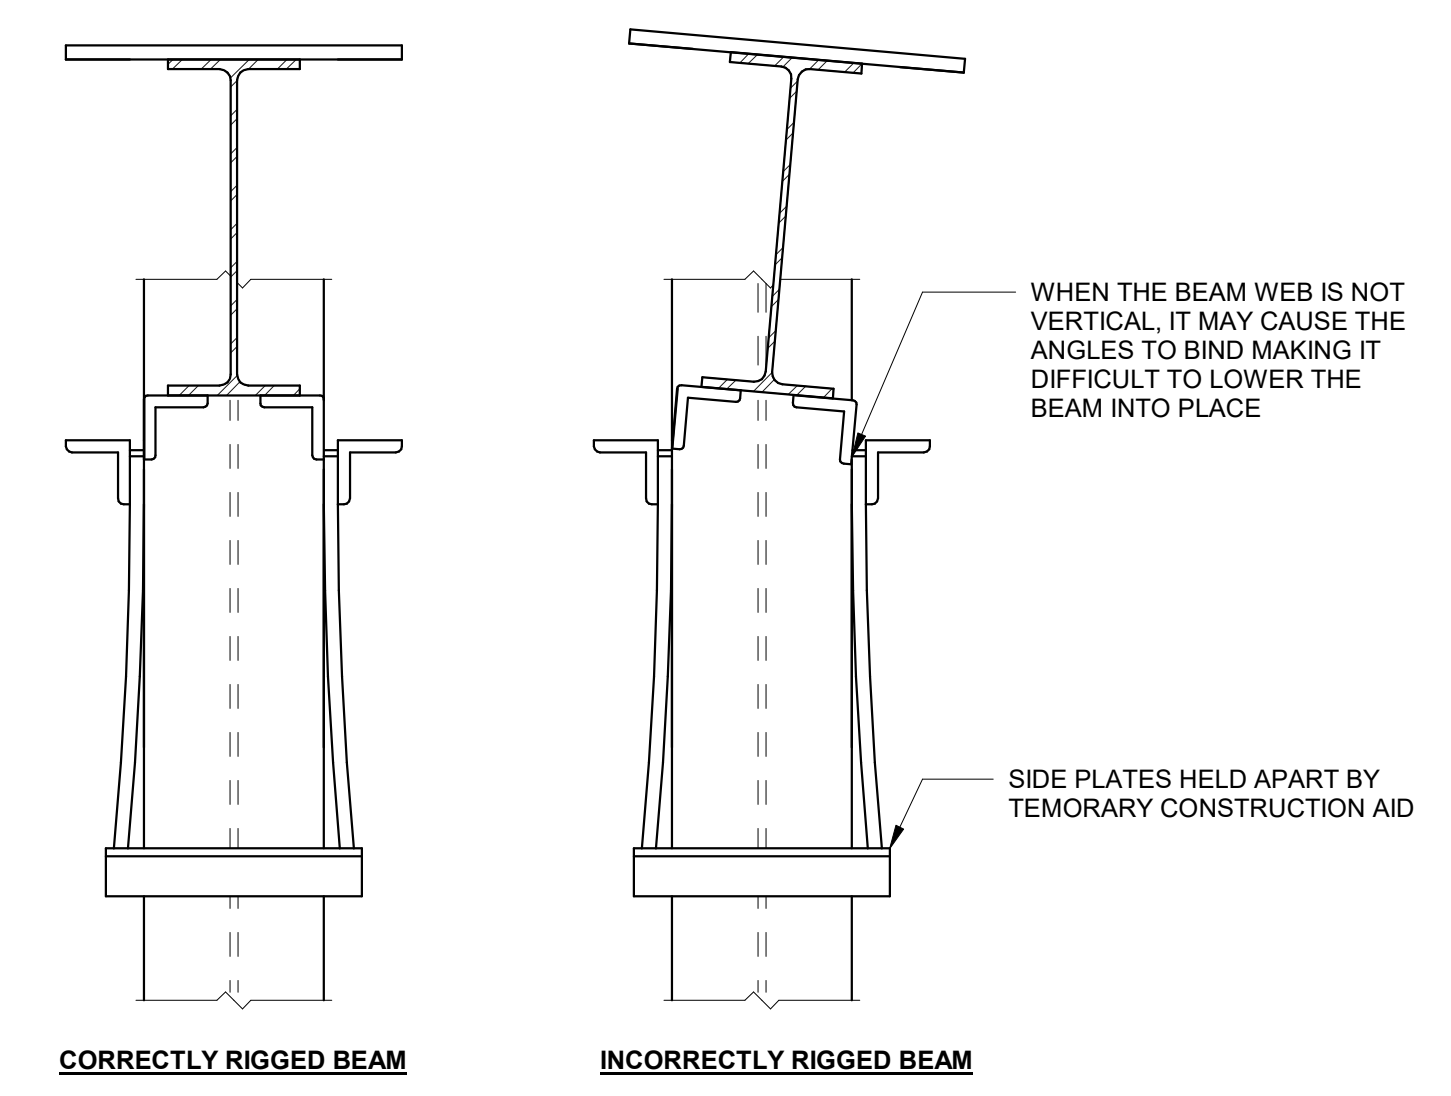

4 BEAM INSTALLATION DETAIL
 N.T.S.

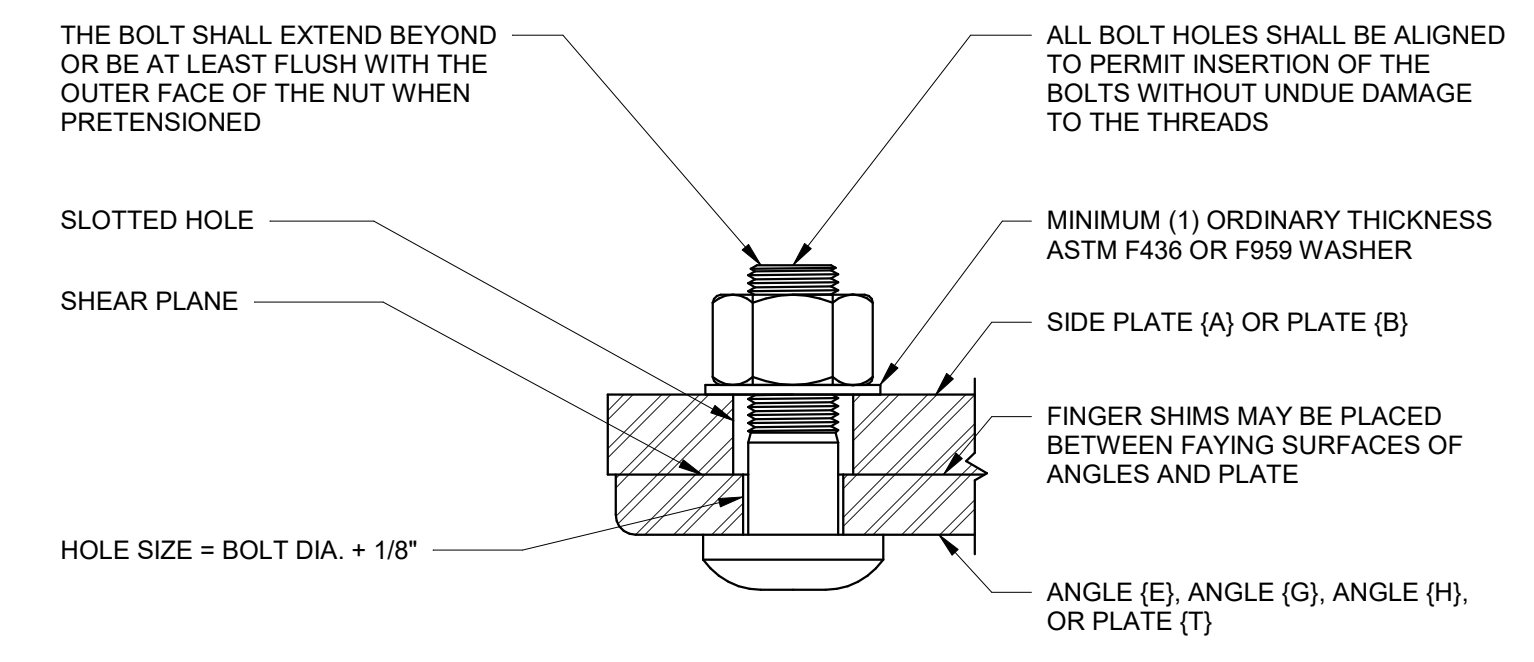

NOTES:
 1. BOLTS SHALL BE INSTALLED AS SHOWN TO KEEP THREADS OUTSIDE OF SHEAR PLANE.
 2. BOLTS SHALL BE SYSTEMATICALLY INSTALLED AS OUTLINED IN THE BOLTING SPECIFICATIONS. FIRST TO A SNUG TIGHT CONDITION, AND THEN PRETENSIONED.
 3. THE USE OF FINGER SHIMS ARE ALLOWED FOR GAPS GREATER THAN 1/8 INCH UP TO 1/4 INCH. CONTACT SIDEPLATE SYSTEMS, INC. IF GAPS ARE GREATER THAN 1/4 INCH.
 4. NUT SHALL BE ASTM A563.
 5. THE BOLT/FASTENER ASSEMBLY SHALL BE COVERED IN A LIGHT PROTECTIVE OIL.
 6. FOLLOW QUALITY CONTROL SECTION FOR EXPOSURE LIMITATION ON BOLTS/FASTENERS.



3 FIELD BOLTING DETAIL
 N.T.S.

ID	ERECTION DESIGN (INCHES)				
	BEAM		BOLT		
	SHAPE	DIAMETER	HORIZONTAL #	VERTICAL #	TOTAL # PER BEAM END
A15, B15	W24X88	1 1/8	4	2	20
A25, B25	W24X94	1 1/8	5	2	24
A45, B45	W36X160	1 1/8	6	3	30

6 NARROW BEAM ERECTION SCHEDULE
 N.T.S.



ID	ERECTION DESIGN (INCHES)			
	BEAM		BOLT	
	SHAPE	DIAMETER	HORIZONTAL #	TOTAL # PER BEAM END
A10, A11, A12, A19, B11, B12, B19	W24X88	1 1/8	4	16
A20, B20	W24X94	1 1/8	5	20
A30, B30	W36X150	1 1/8	6	24

2 BEAM ERECTION SCHEDULE
 N.T.S.

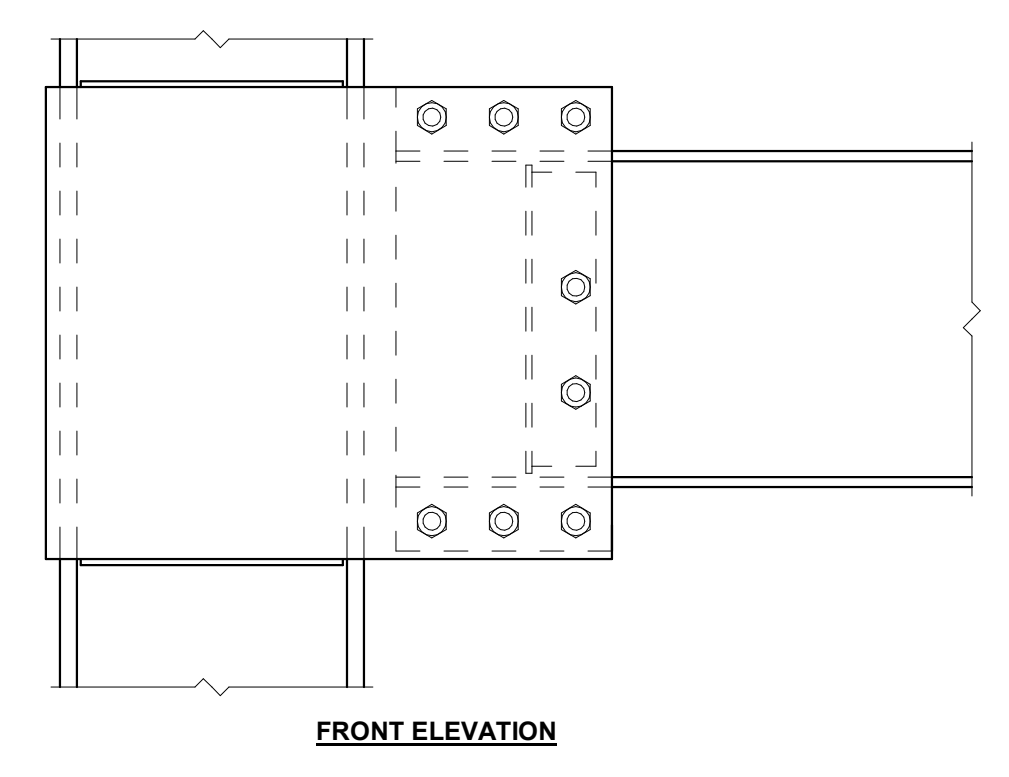
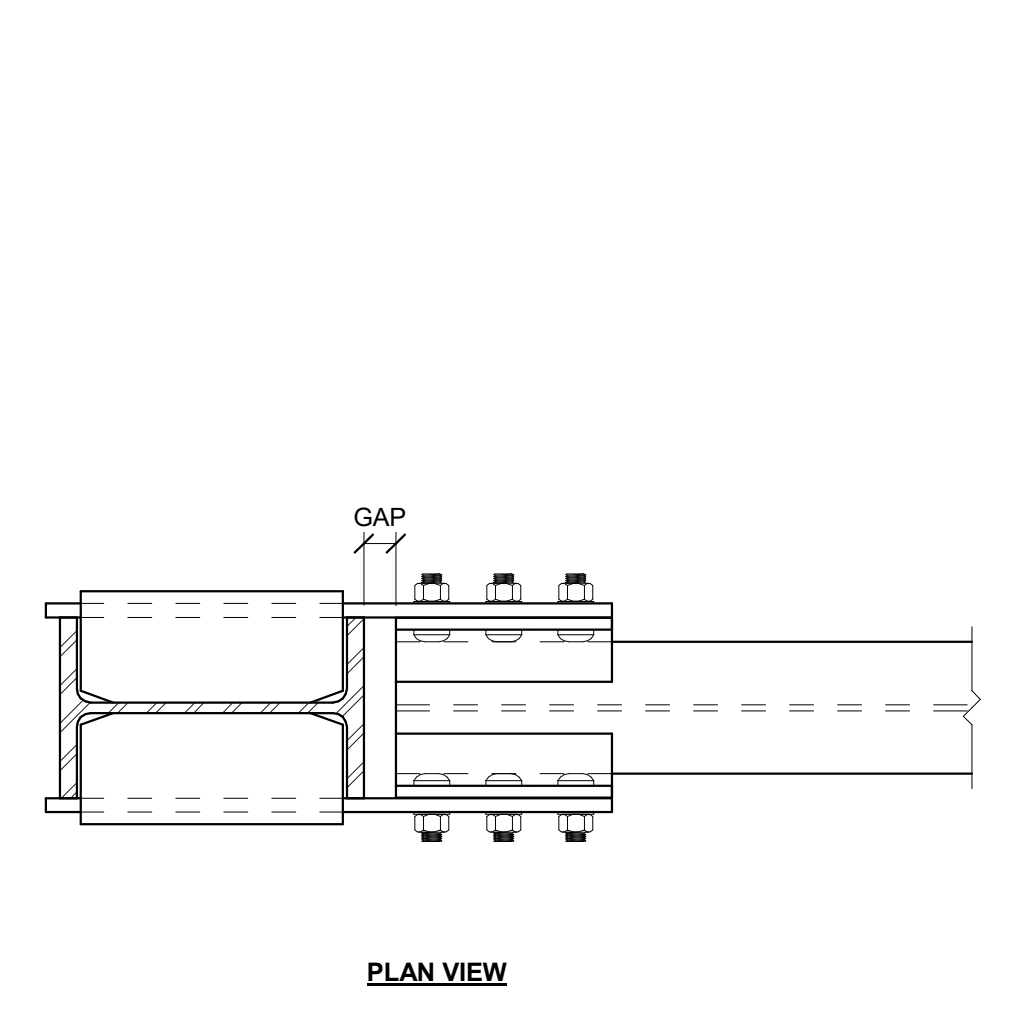


TYPICAL SEQUENCE OF ERECTION:
 1. LOWER THE BEAM INTO PLACE FROM ABOVE.
 2. STUFF A FEW BOLTS TO SECURE ASSEMBLY.
 3. **BOTTOM DOG SHALL BE REMOVED.** IT IS RECOMMENDED THAT IT BE REMOVED BY TORCH CUTTING A V SECTION OUT OF ONE OF THE ANGLE LEGS TO ALLEVIATE THE LOAD AND THEN PROCEED TO REMOVE IT. IT IS NOT RECOMMENDED TO USE A GRINDING WHEEL TO REMOVE THE WELDS WHILE THE DOG IS UNDER LOAD!
 4. BOLTS SHALL BE STUFFED INTO HOLES IN THE BEAM COVER PLATE (B) AND THE SIDE PLATES (A). SYSTEMATICALLY TIGHTEN BOLTS PER RCSC SPECIFICATIONS.
 5. THE WELD REMNANTS OF THE BOTTOM DOG MAY REMAIN IN PLACE AND DO NOT NEED TO BE GROUND SMOOTH.

5 NARROW BEAM ERECTION DETAIL
 N.T.S.

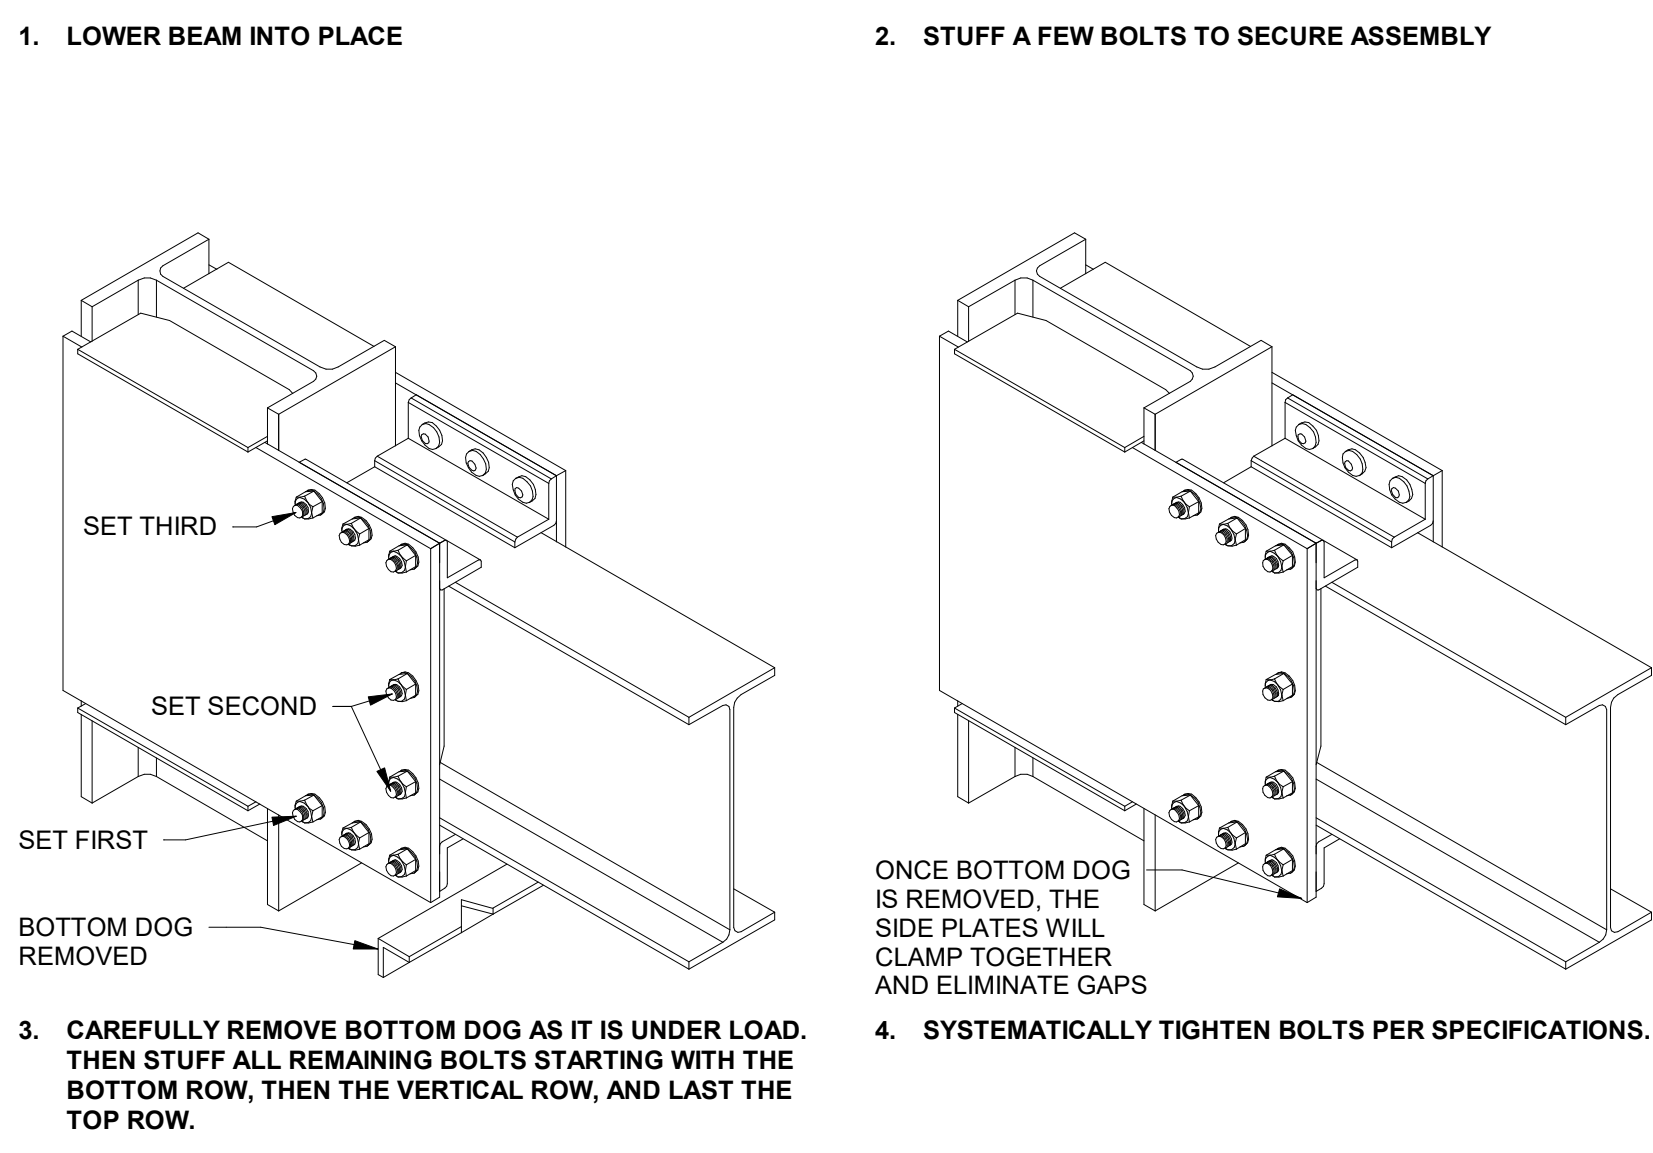
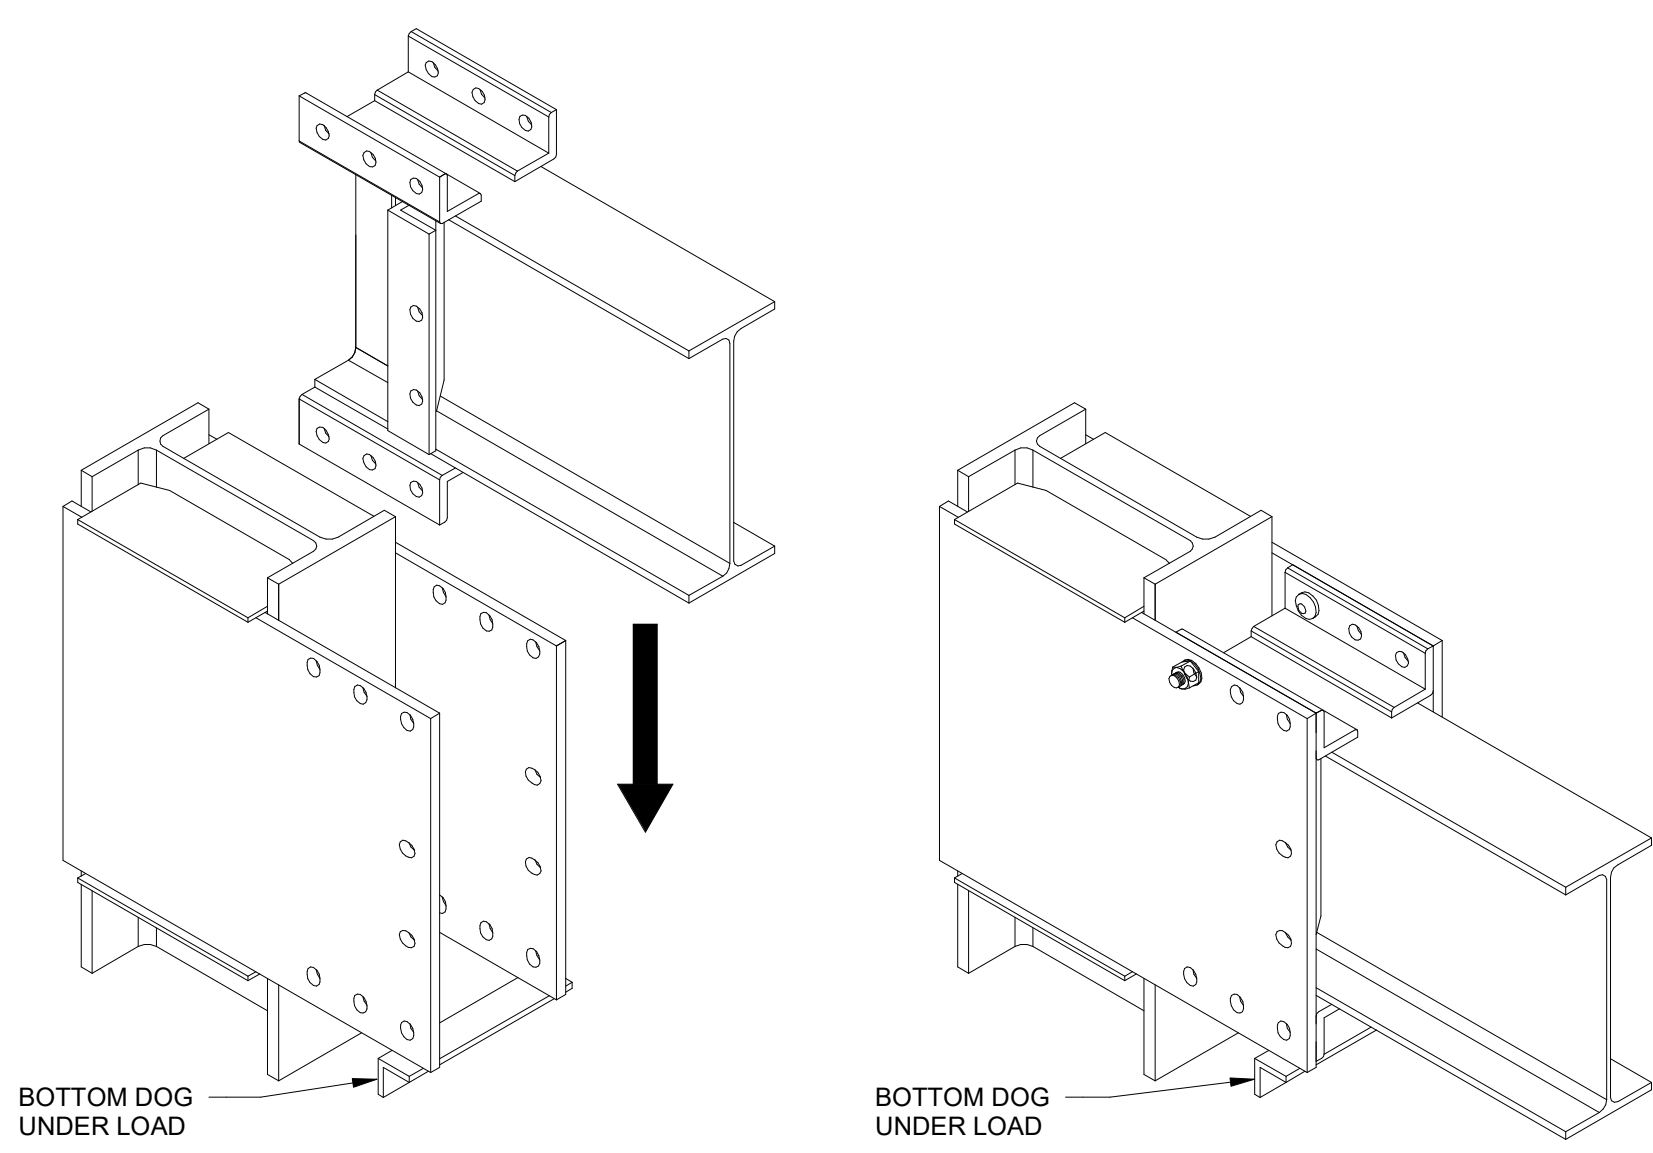


6 NARROW BEAM ERECTION SCHEDULE
 N.T.S.

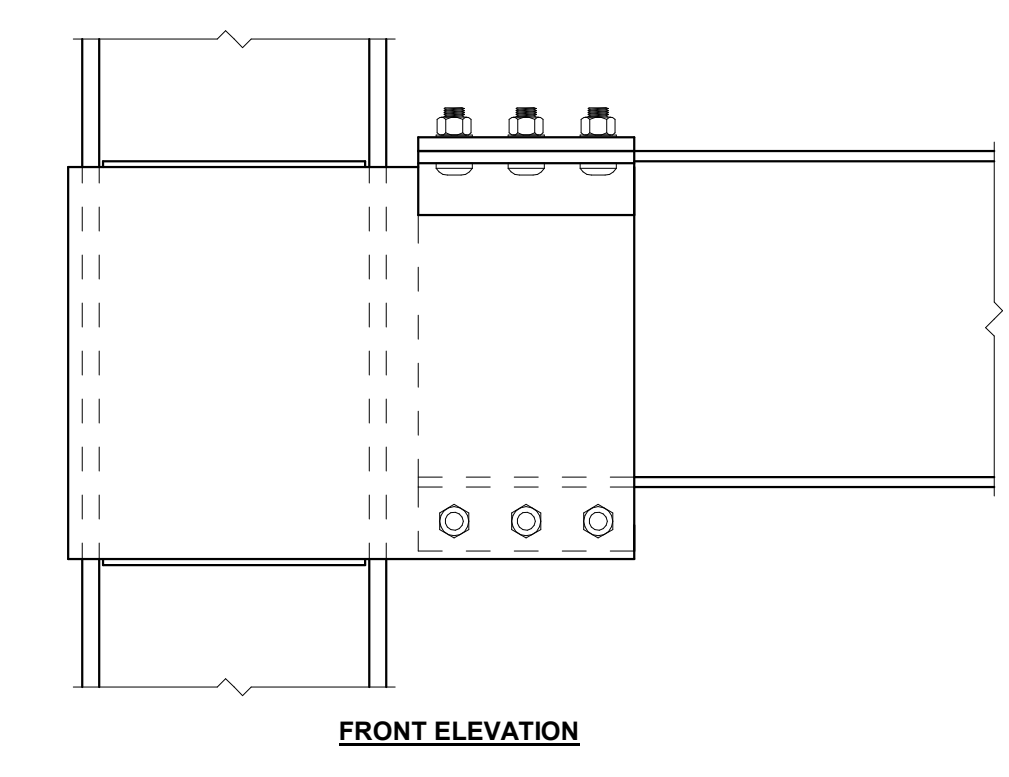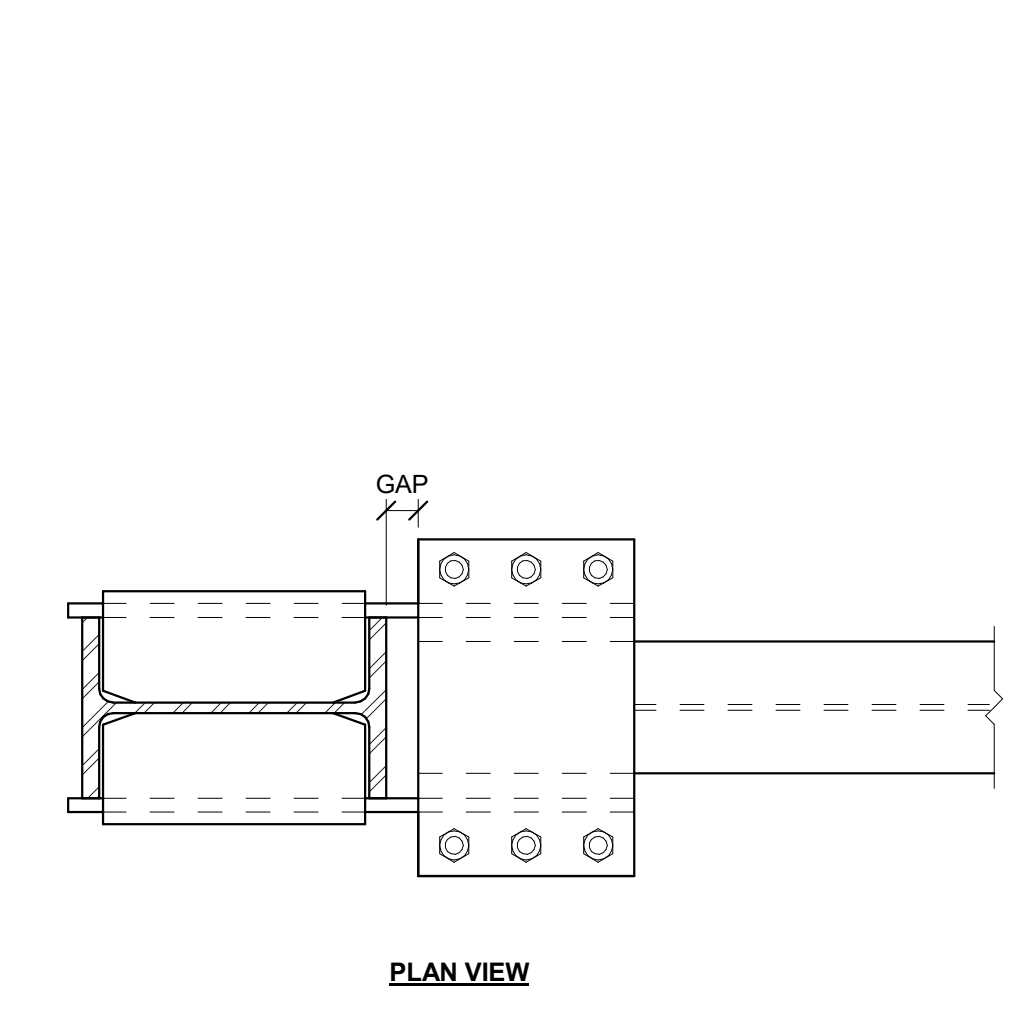

TYPICAL SEQUENCE OF ERECTION:
 1. LOWER THE BEAM INTO PLACE FROM ABOVE.
 2. STUFF A FEW BOLTS TO SECURE ASSEMBLY.
 3. **BOTTOM DOG SHALL BE REMOVED.** IT IS RECOMMENDED THAT IT BE REMOVED BY TORCH CUTTING A V SECTION OUT OF ONE OF THE ANGLE LEGS TO ALLEVIATE THE LOAD AND THEN PROCEED TO REMOVE IT. IT IS NOT RECOMMENDED TO USE A GRINDING WHEEL TO REMOVE THE WELDS WHILE THE DOG IS UNDER LOAD!
 4. BOLTS SHALL BE STUFFED INTO HOLES IN THE BEAM COVER PLATE (B) AND THE SIDE PLATES (A). SYSTEMATICALLY TIGHTEN BOLTS PER RCSC SPECIFICATIONS.
 5. THE WELD REMNANTS OF THE BOTTOM DOG MAY REMAIN IN PLACE AND DO NOT NEED TO BE GROUND SMOOTH.

3 BEAM ERECTION DETAIL
 N.T.S.

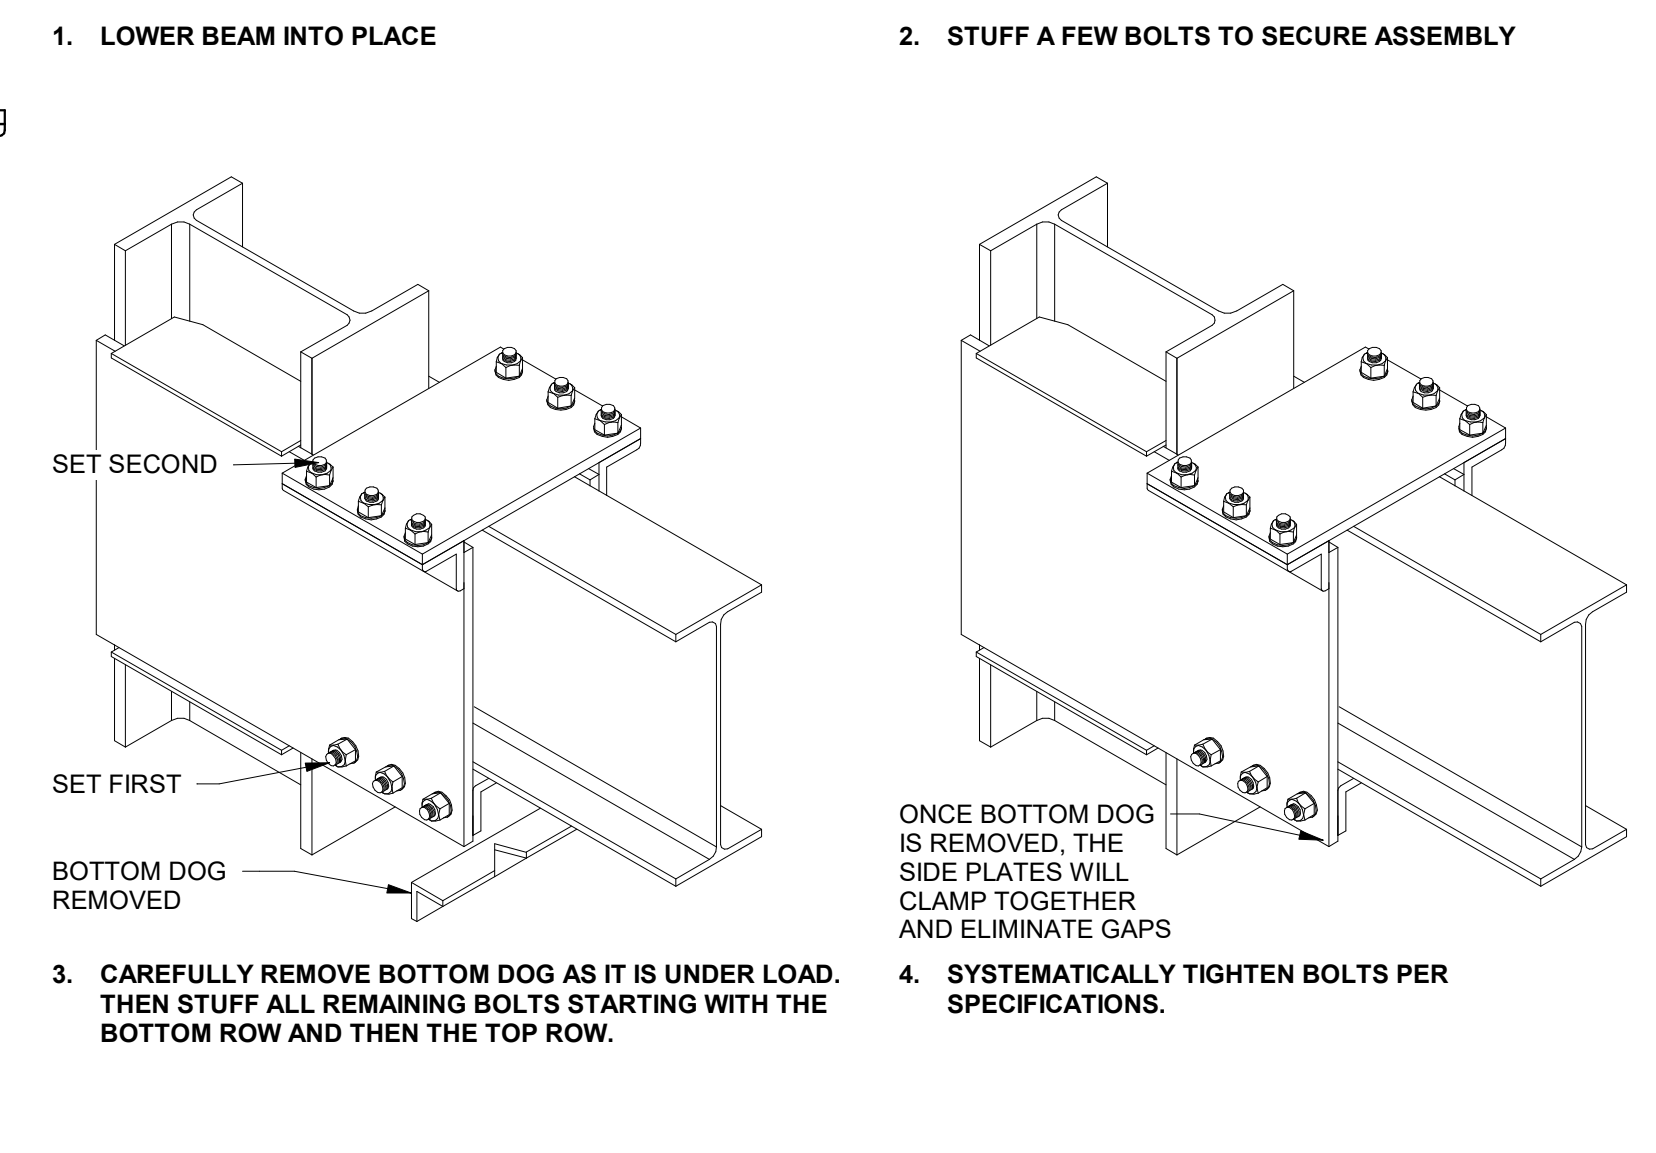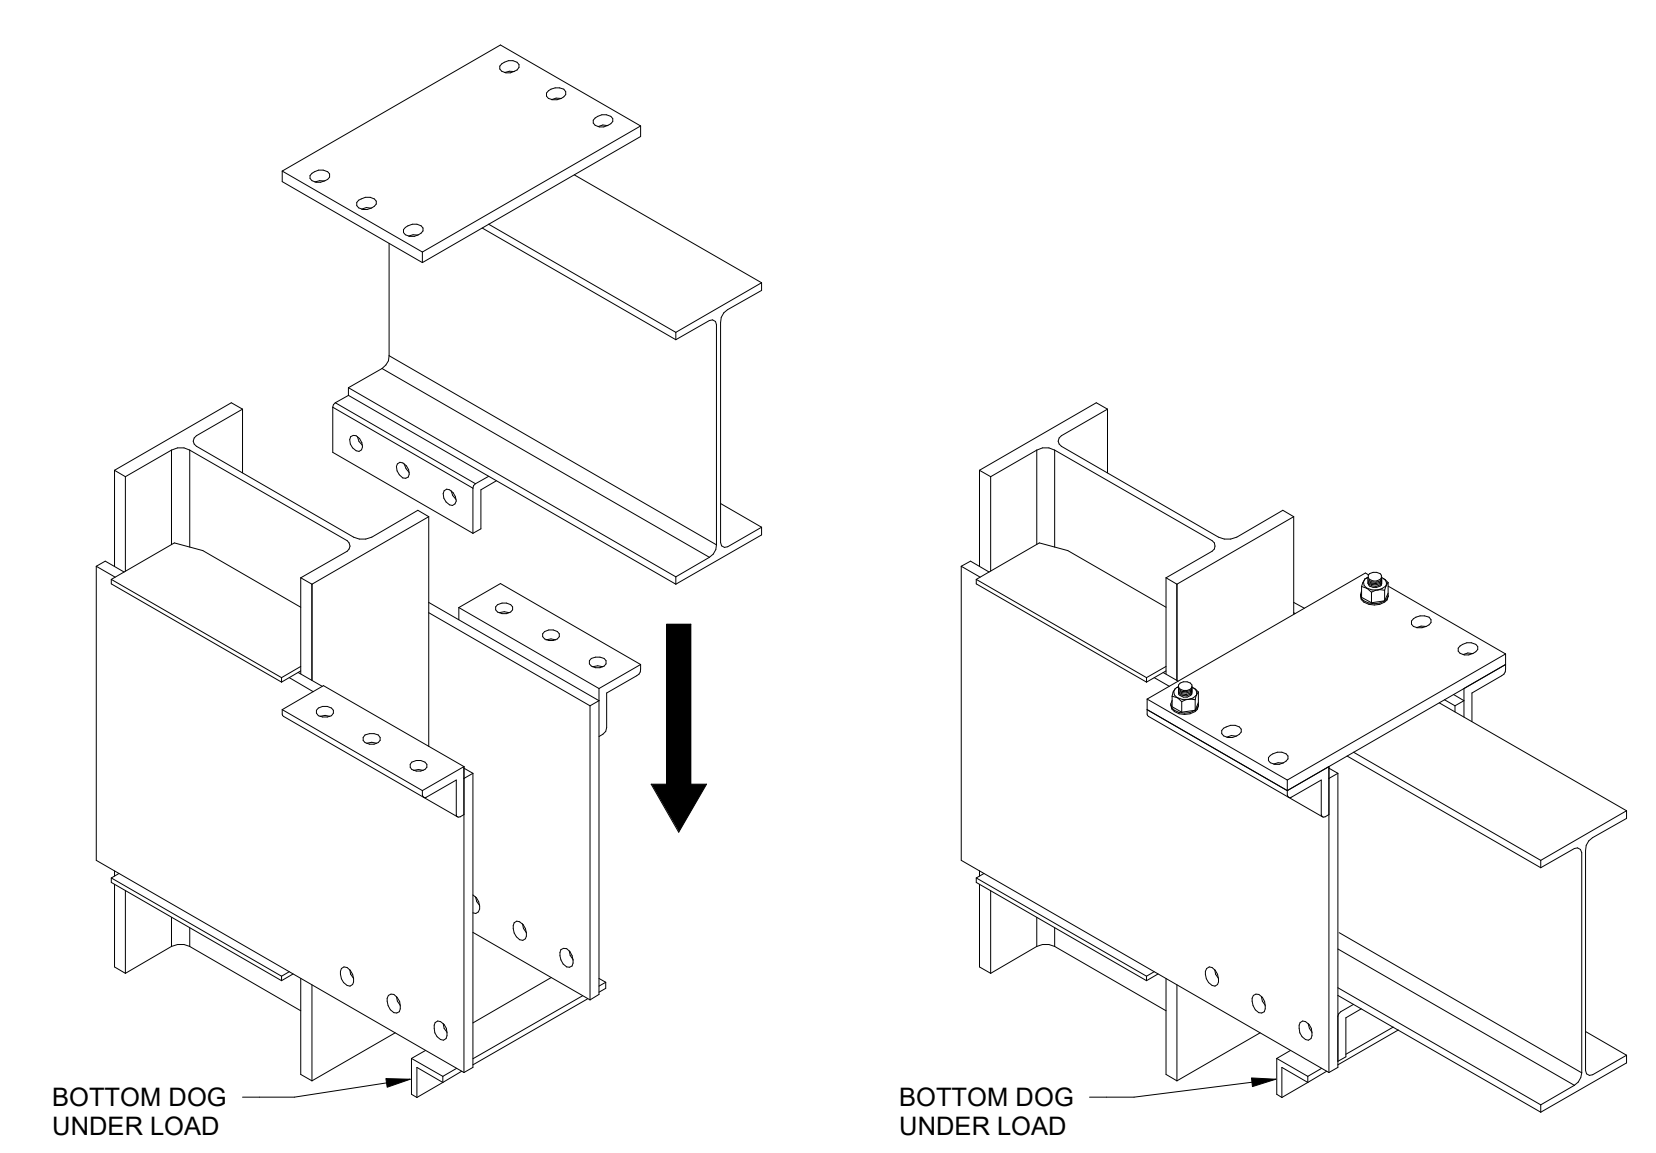


2 BEAM ERECTION SCHEDULE
 N.T.S.

INTELLECTUAL PROPERTY RIGHTS NOTICE
 The SIDEPLATE® steel frame connection system is covered by one or more of U.S. Pat. Nos. 6,138,427; 6,516,583; 6,591,573; 7,178,296; 8,122,671; 8,122,672; 8,146,322; 8,176,706; 8,205,406; and 9,091,065 and foreign counterparts. Other U.S. and foreign applications pending.
 SIDEPLATE® is a registered trademark of MiTek Holdings, Inc., an affiliate of SidePlate Systems, Inc.
 Copyright © 2019 SidePlate Systems, Inc. All rights reserved. Without limitation, this drawing and the information hereon may be used only following payment of a license fee to SidePlate Systems, Inc. and for the design, construction, operation, repair, maintenance, restoration or demolition of the building(s) specifically identified.
 v15.06.02


Misc ID	Coordinate with Detail
M1	11/S8.07

12 MISCELLANEOUS DETAILS SCHEDULE
N.T.S.

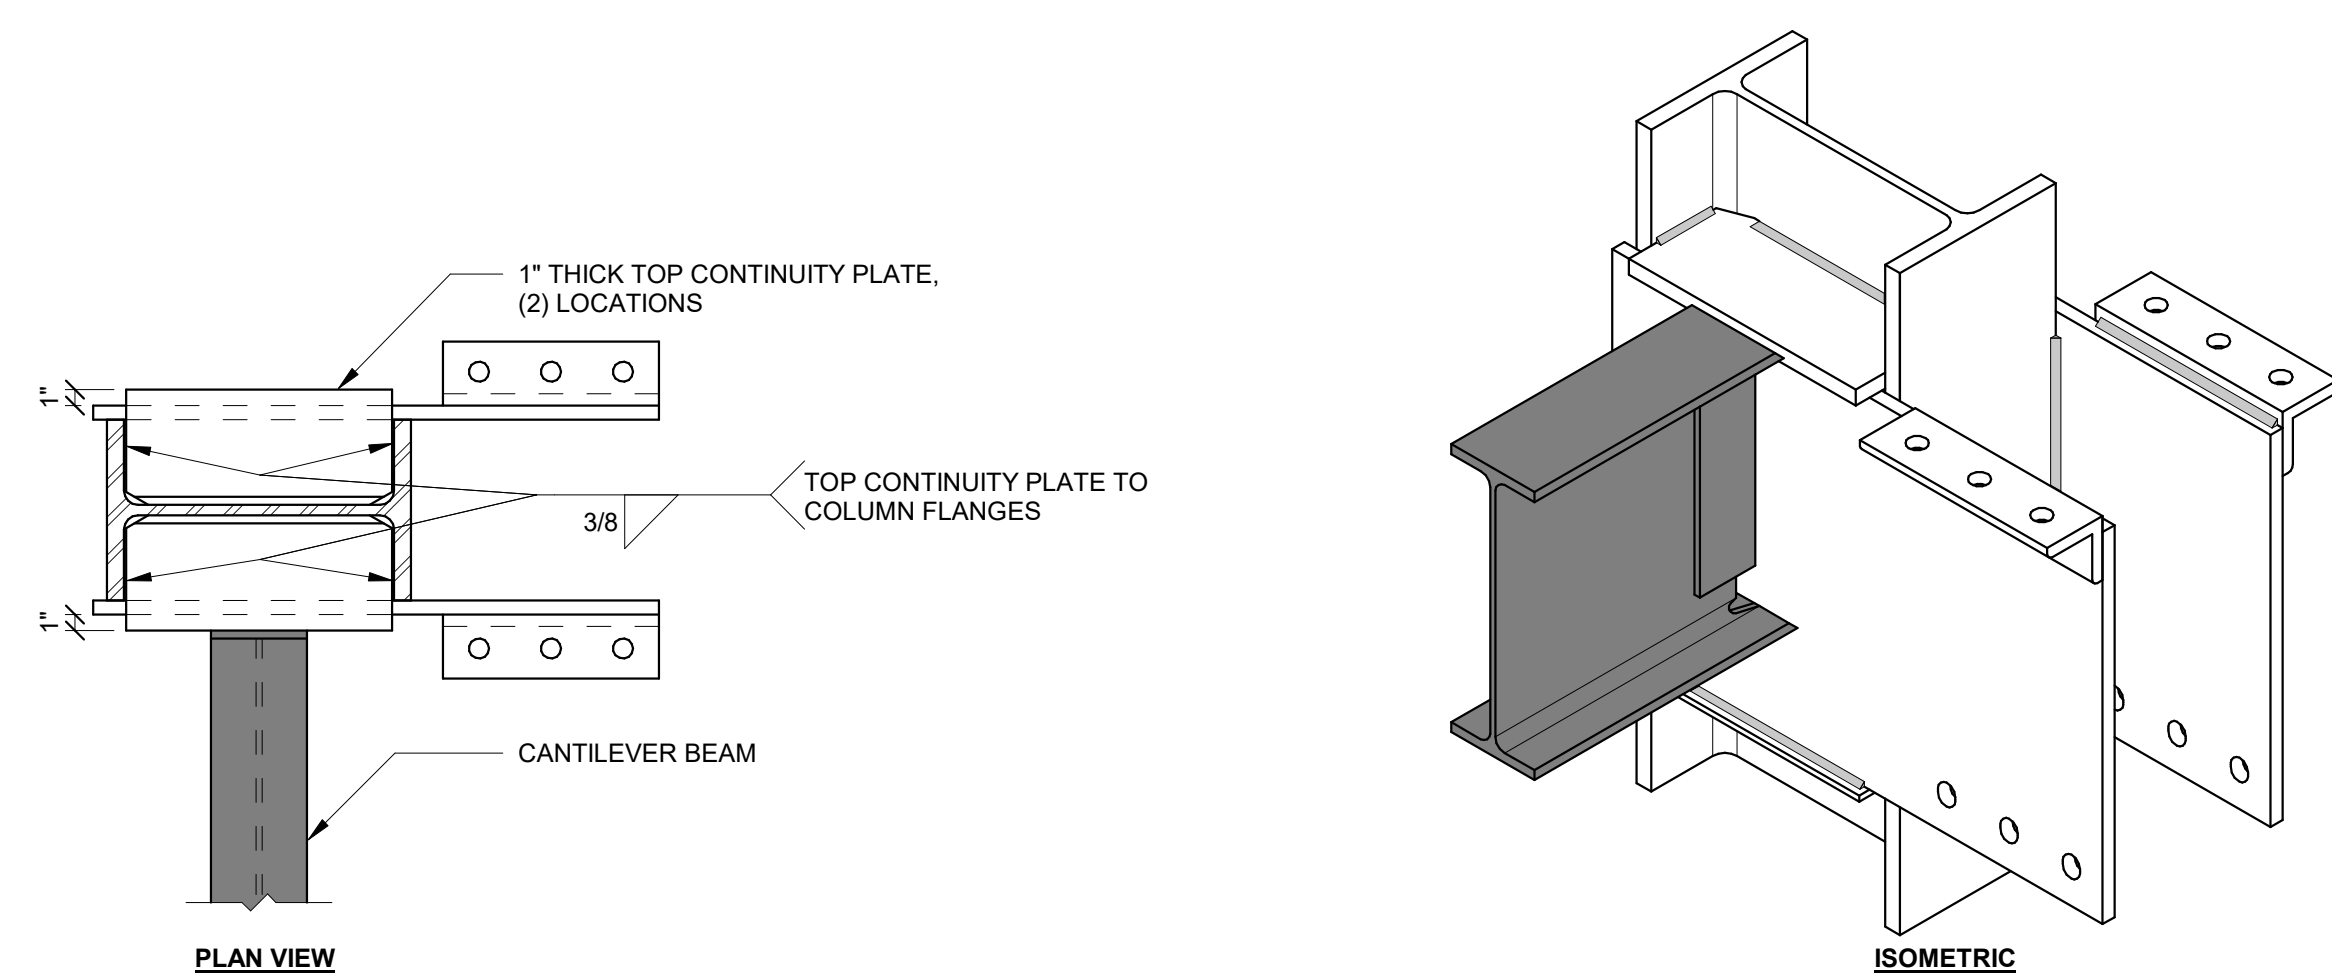


NOTES:
 1. ATTACHMENT SHOWN ON ONE SIDE OF SIDEPLATE CONNECTION FOR ILLUSTRATION. ATTACHMENT CAN OCCUR ON LEFT SIDE, RIGHT SIDE, OR BOTH SIDES OF CONNECTION AS APPLICABLE.


11 CANTILEVER TO SIDEPLATE CONNECTION
N.T.S.

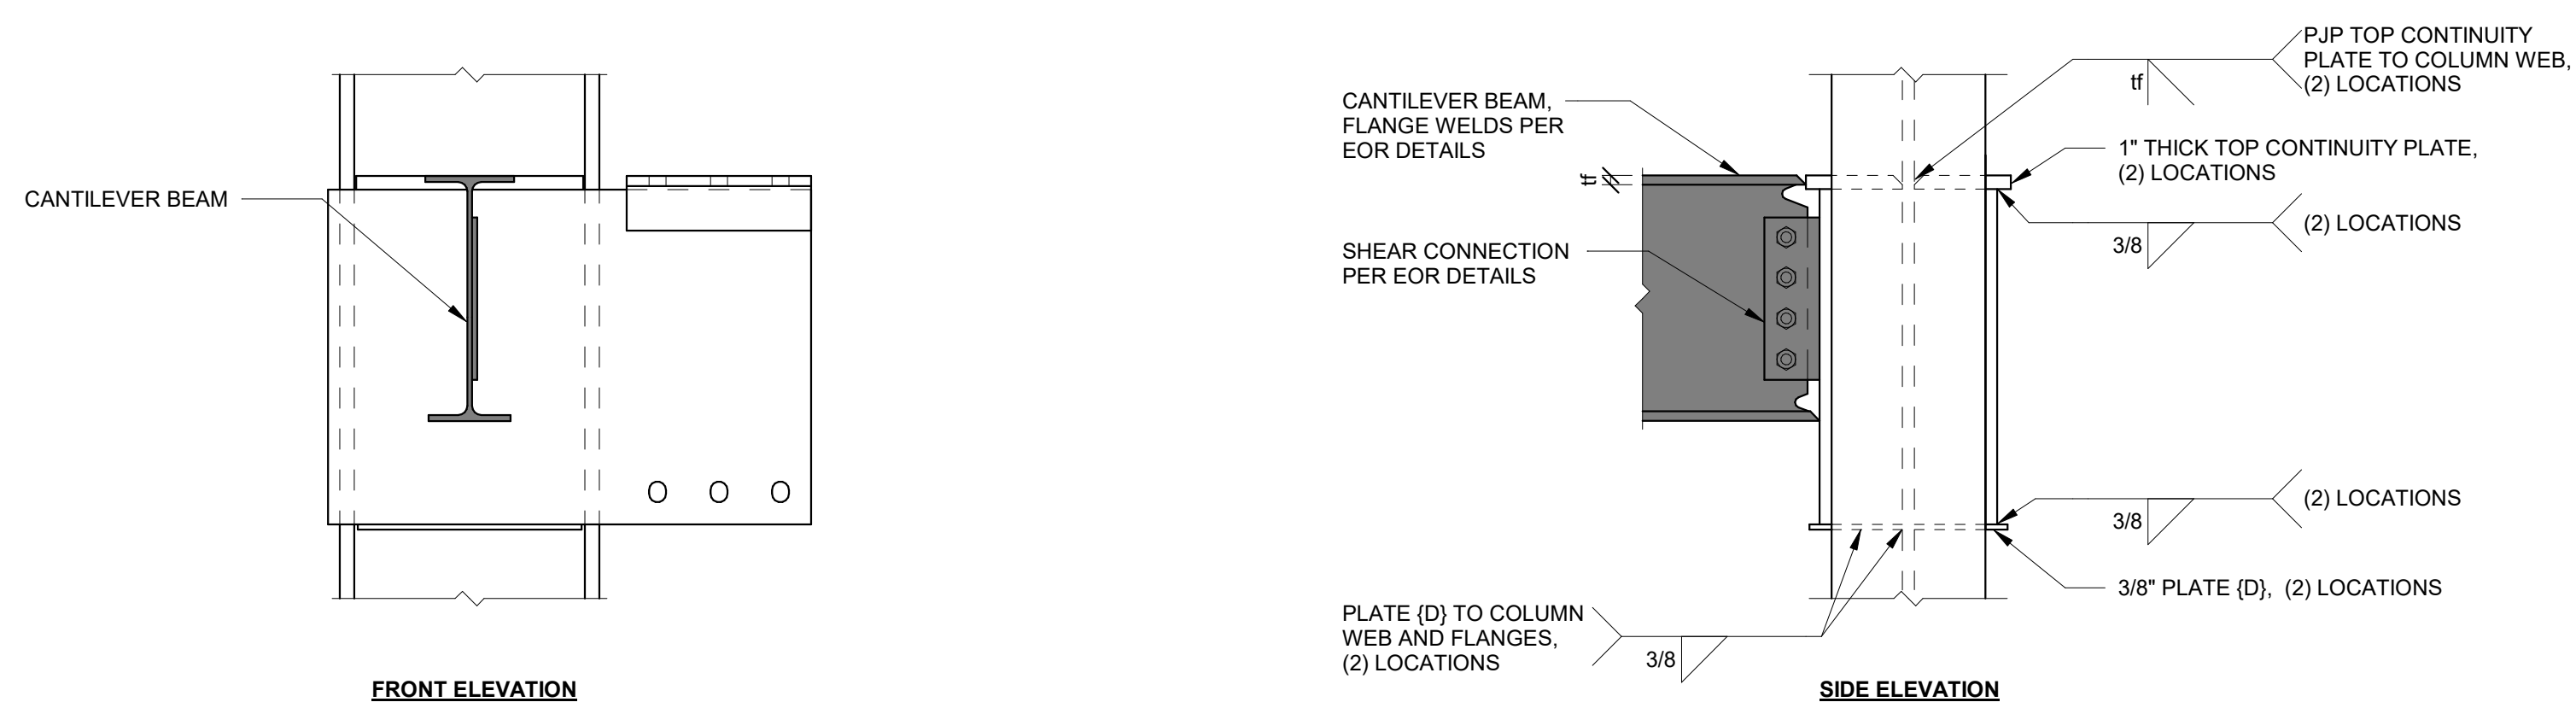


10 DECK SUPPORT ANGLE DETAIL
N.T.S.

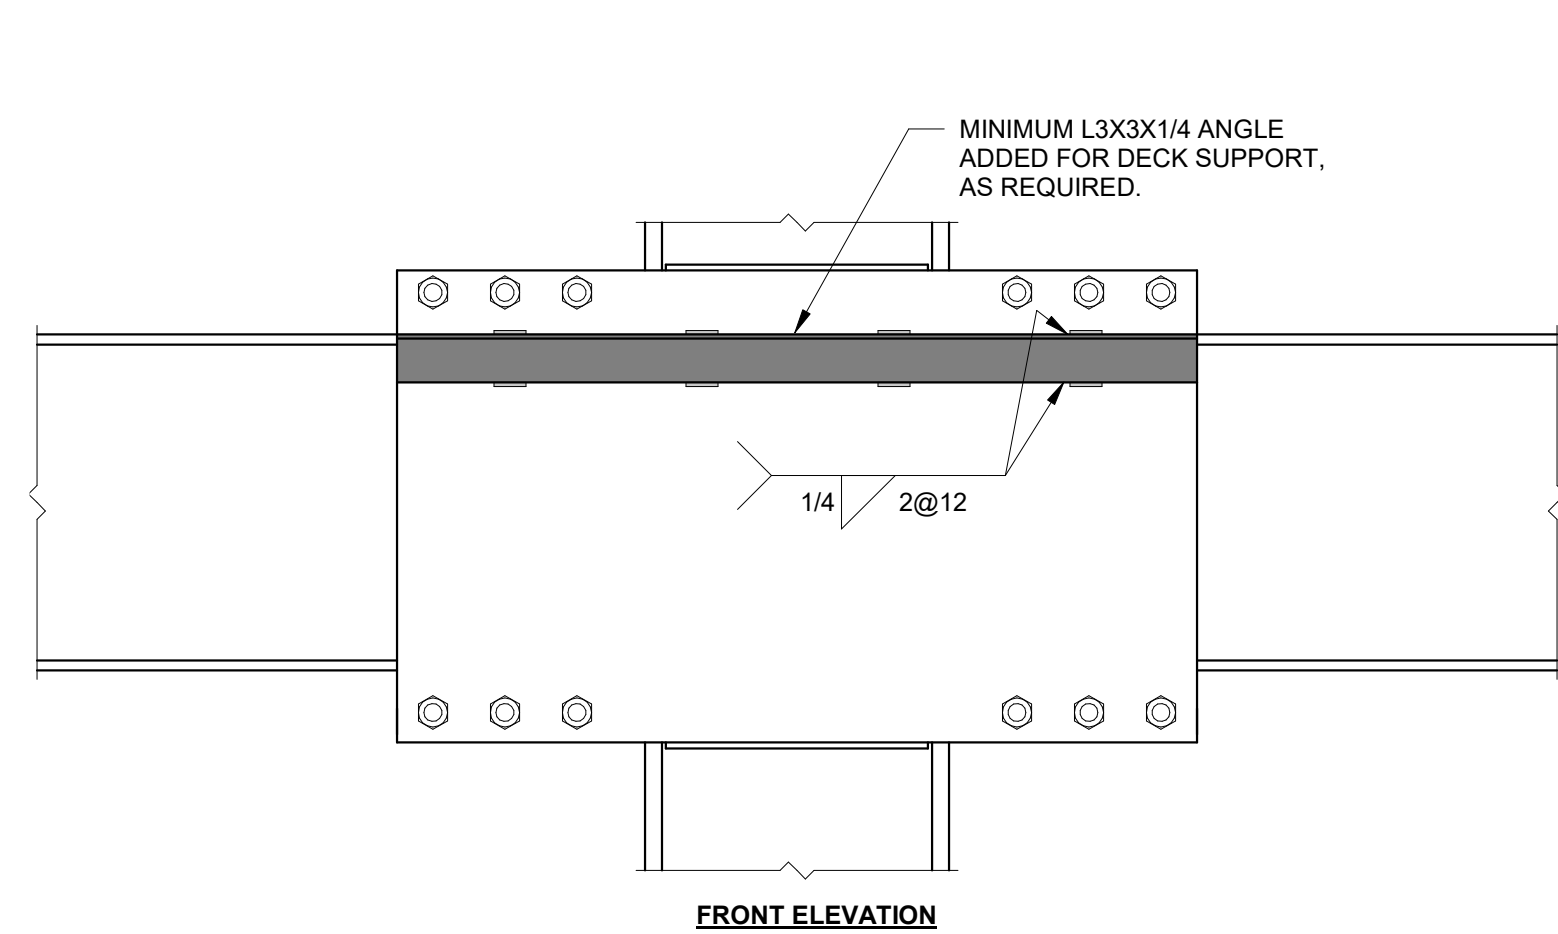


9 NARROW CONFIGURATION SLAB EDGE DETAIL
N.T.S.

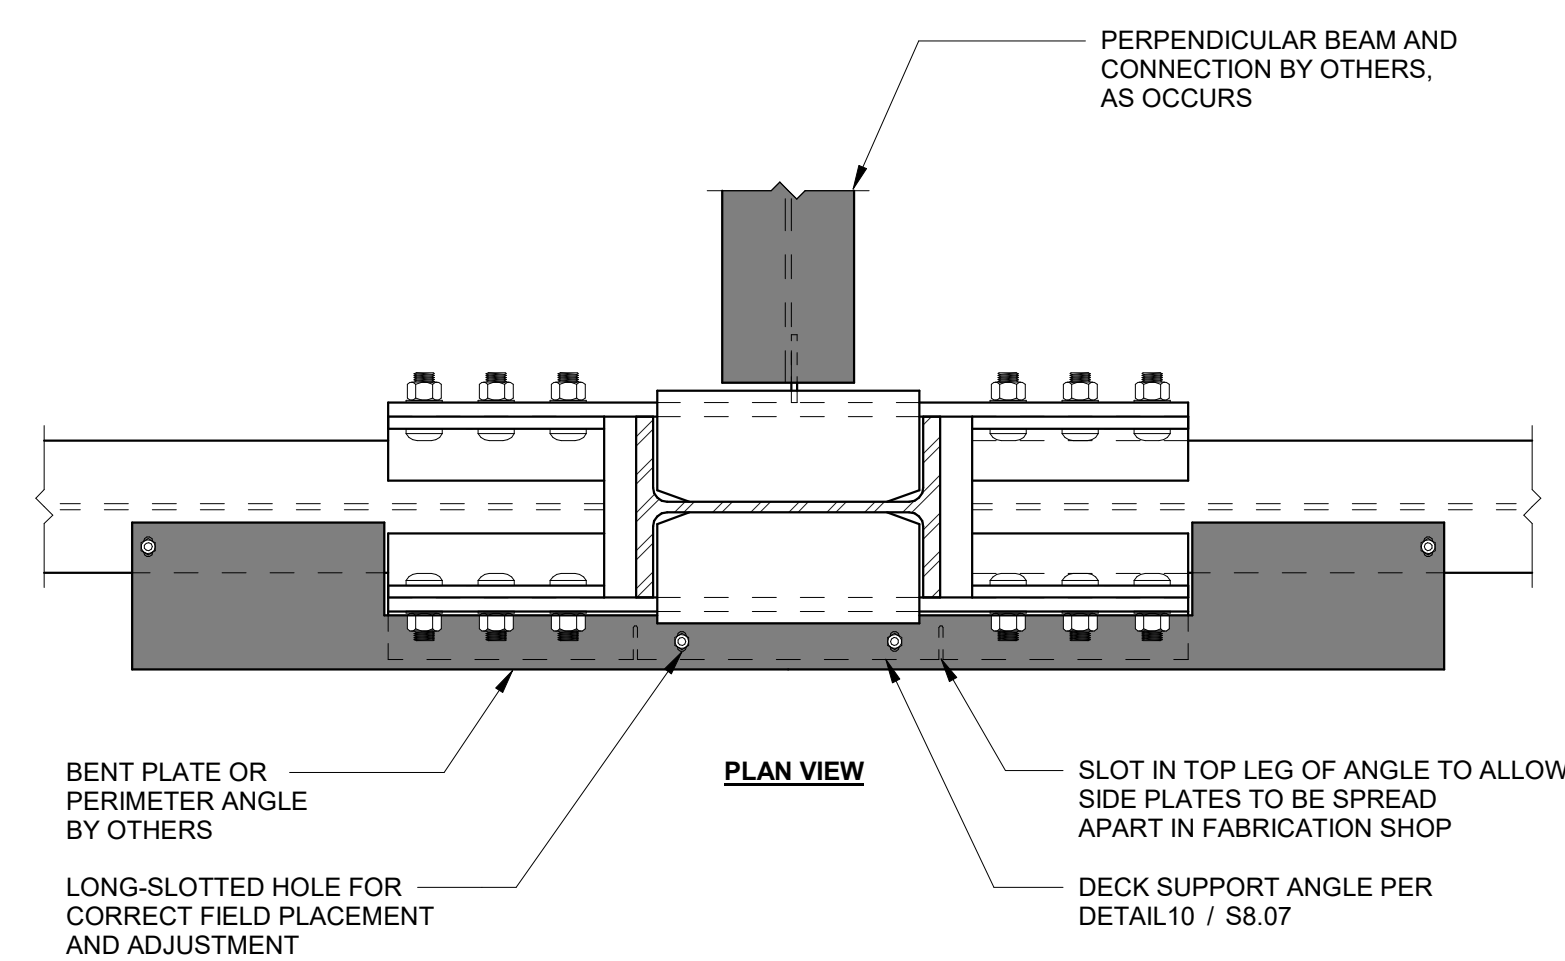


8 NARROW CONFIGURATION DECK SUPPORT DETAIL
N.T.S.

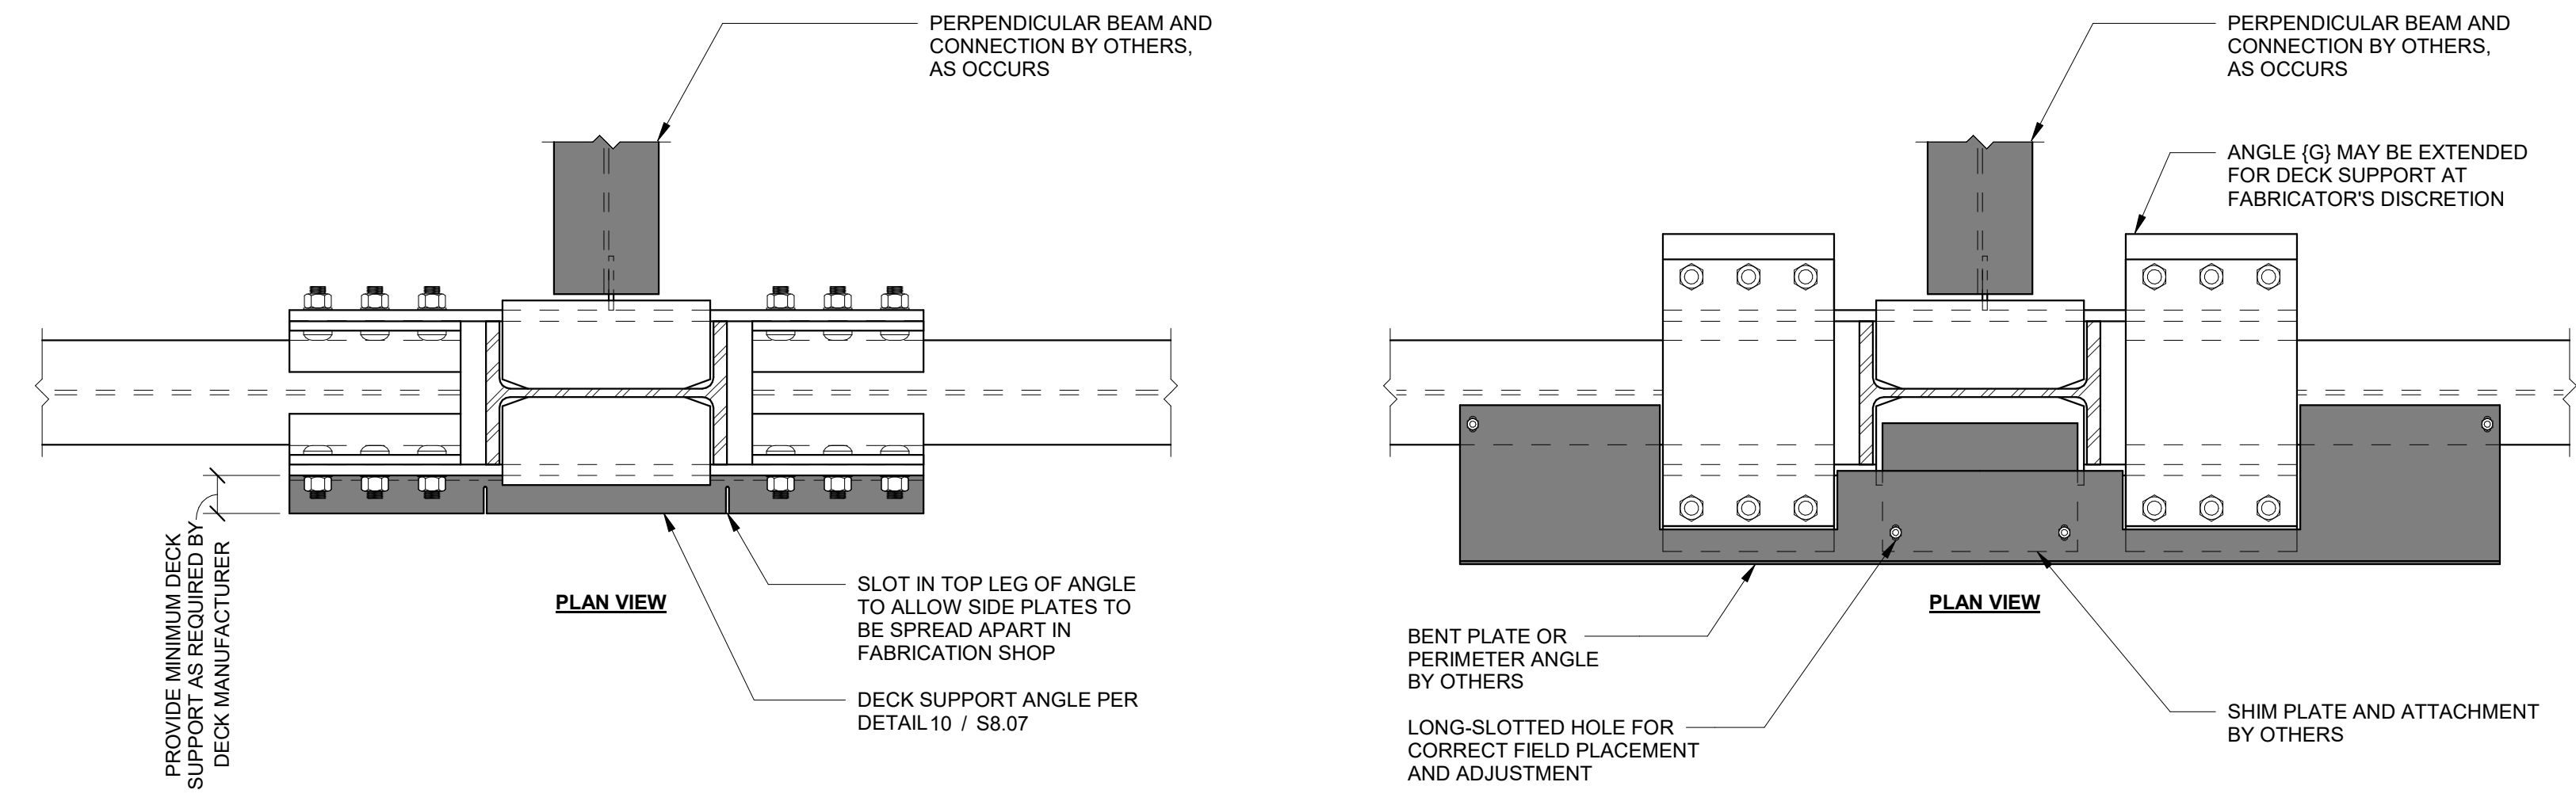


7 WELDED FLAT BAR FOR SLAB EDGE SUPPORT DETAIL
N.T.S.

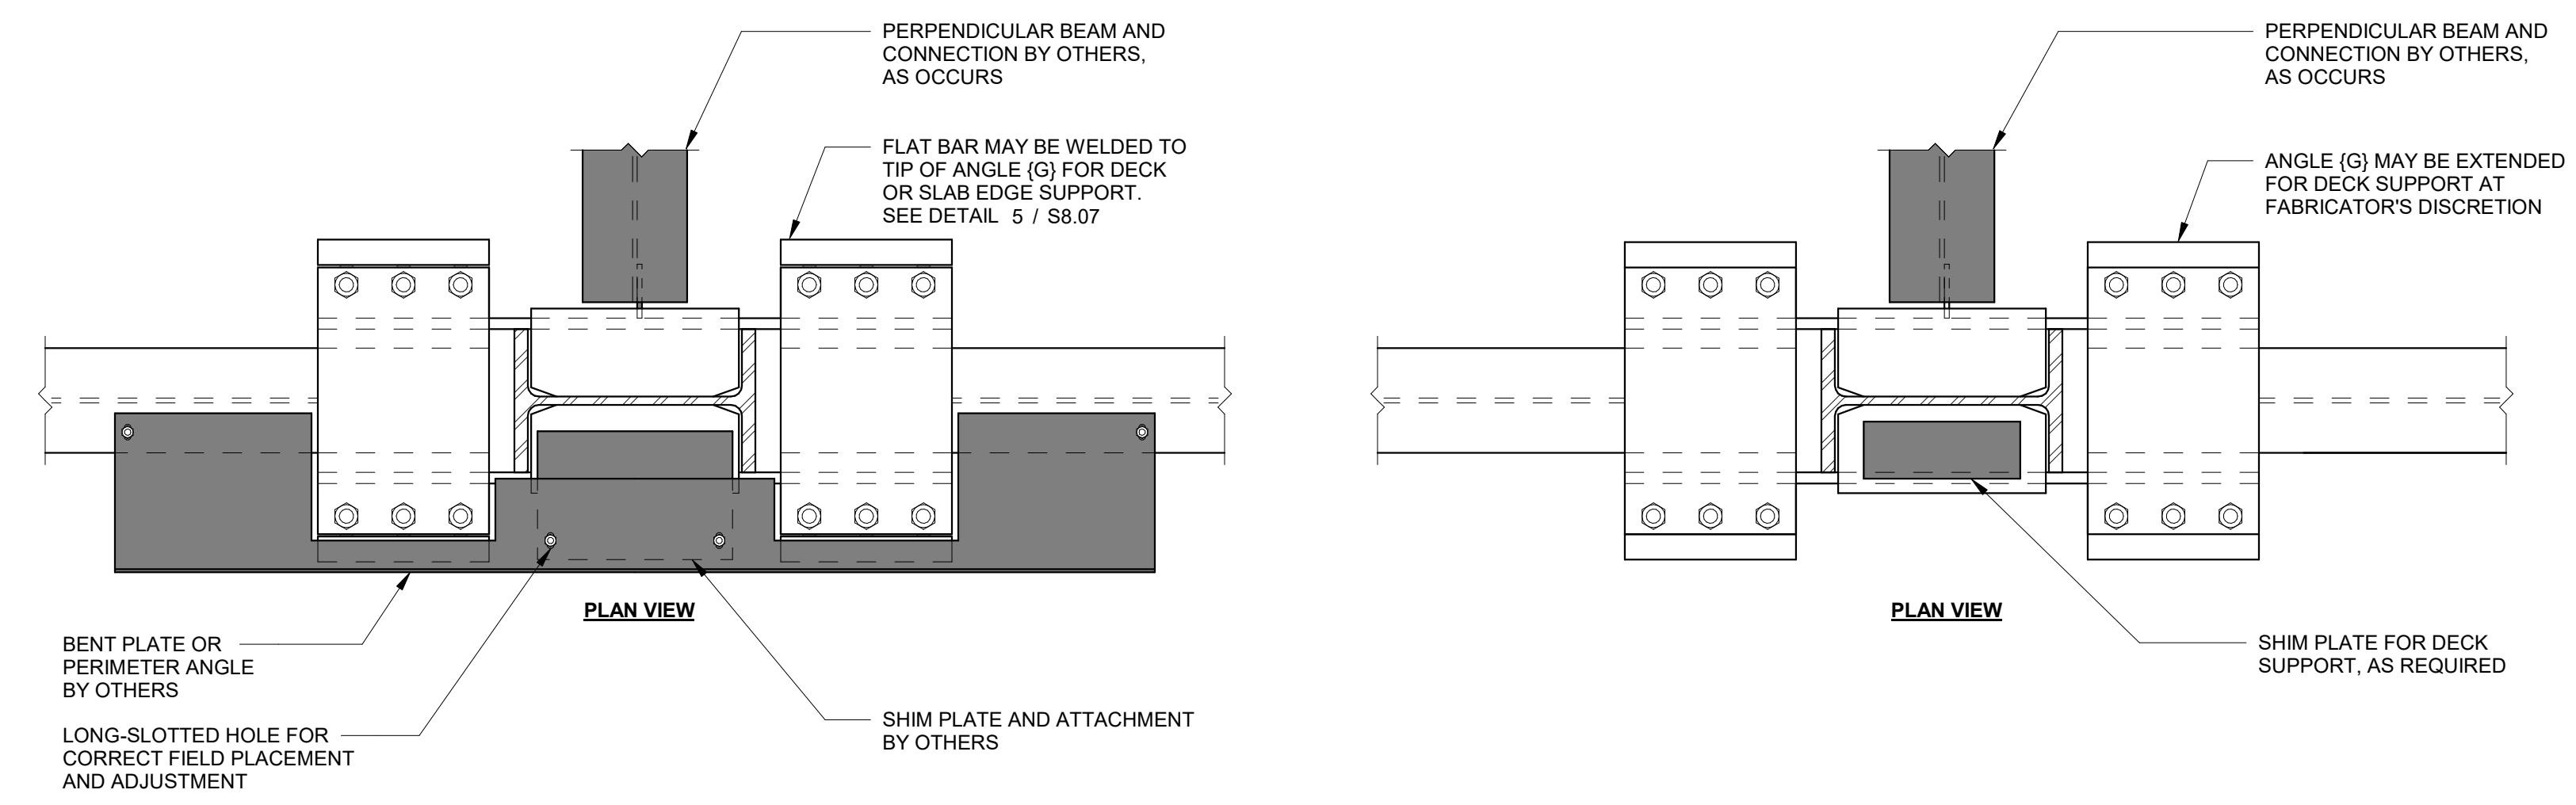


6 WELDED FLAT BAR DECK SUPPORT DETAIL
N.T.S.

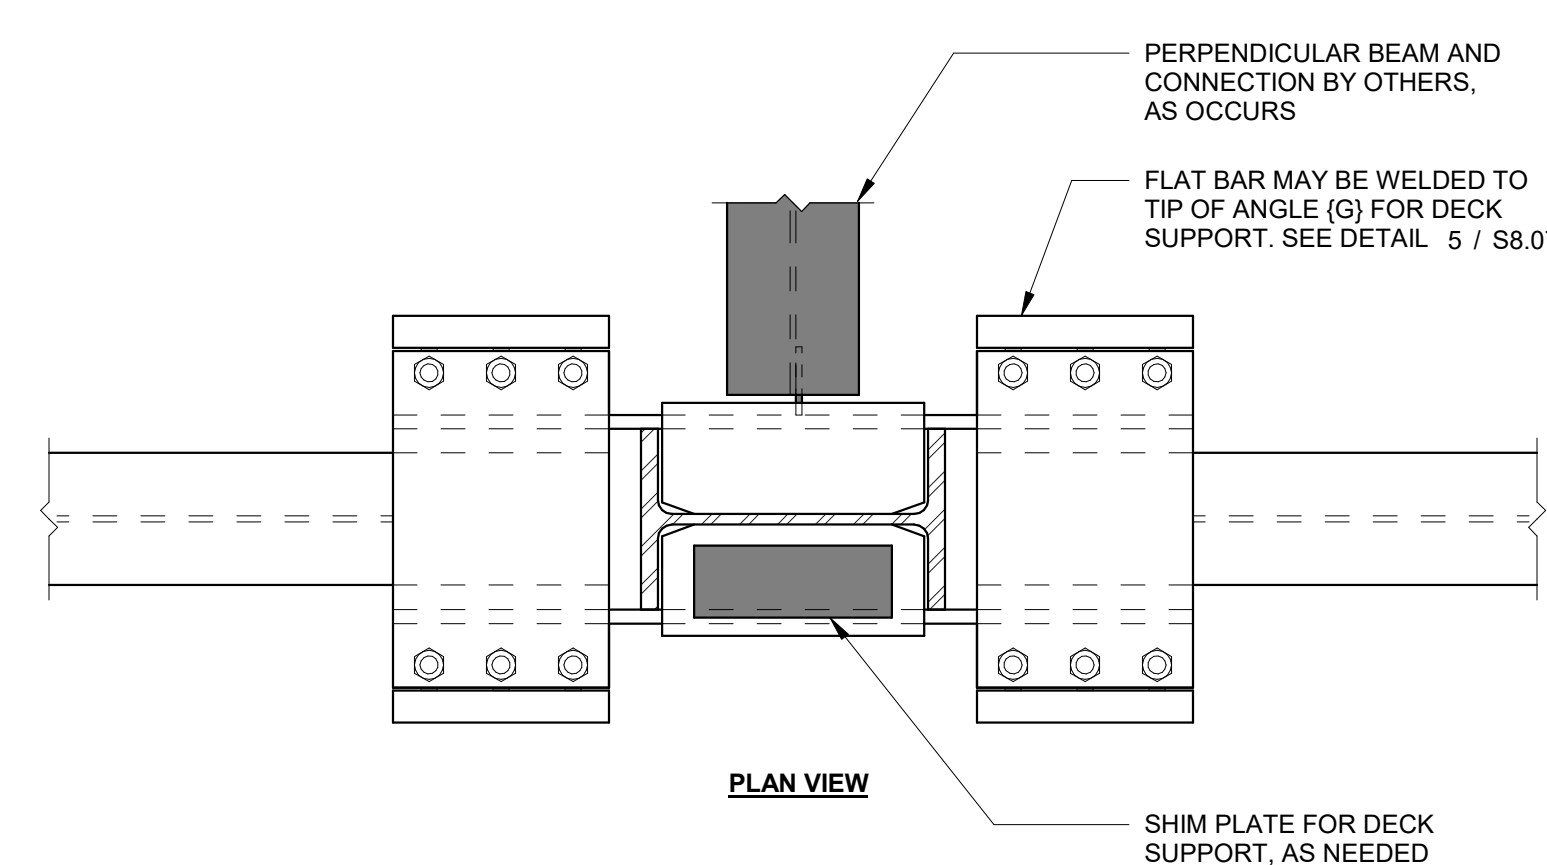


5 WELDED FLAT BAR TO ANGLE (G) FOR DECK SUPPORT
N.T.S.

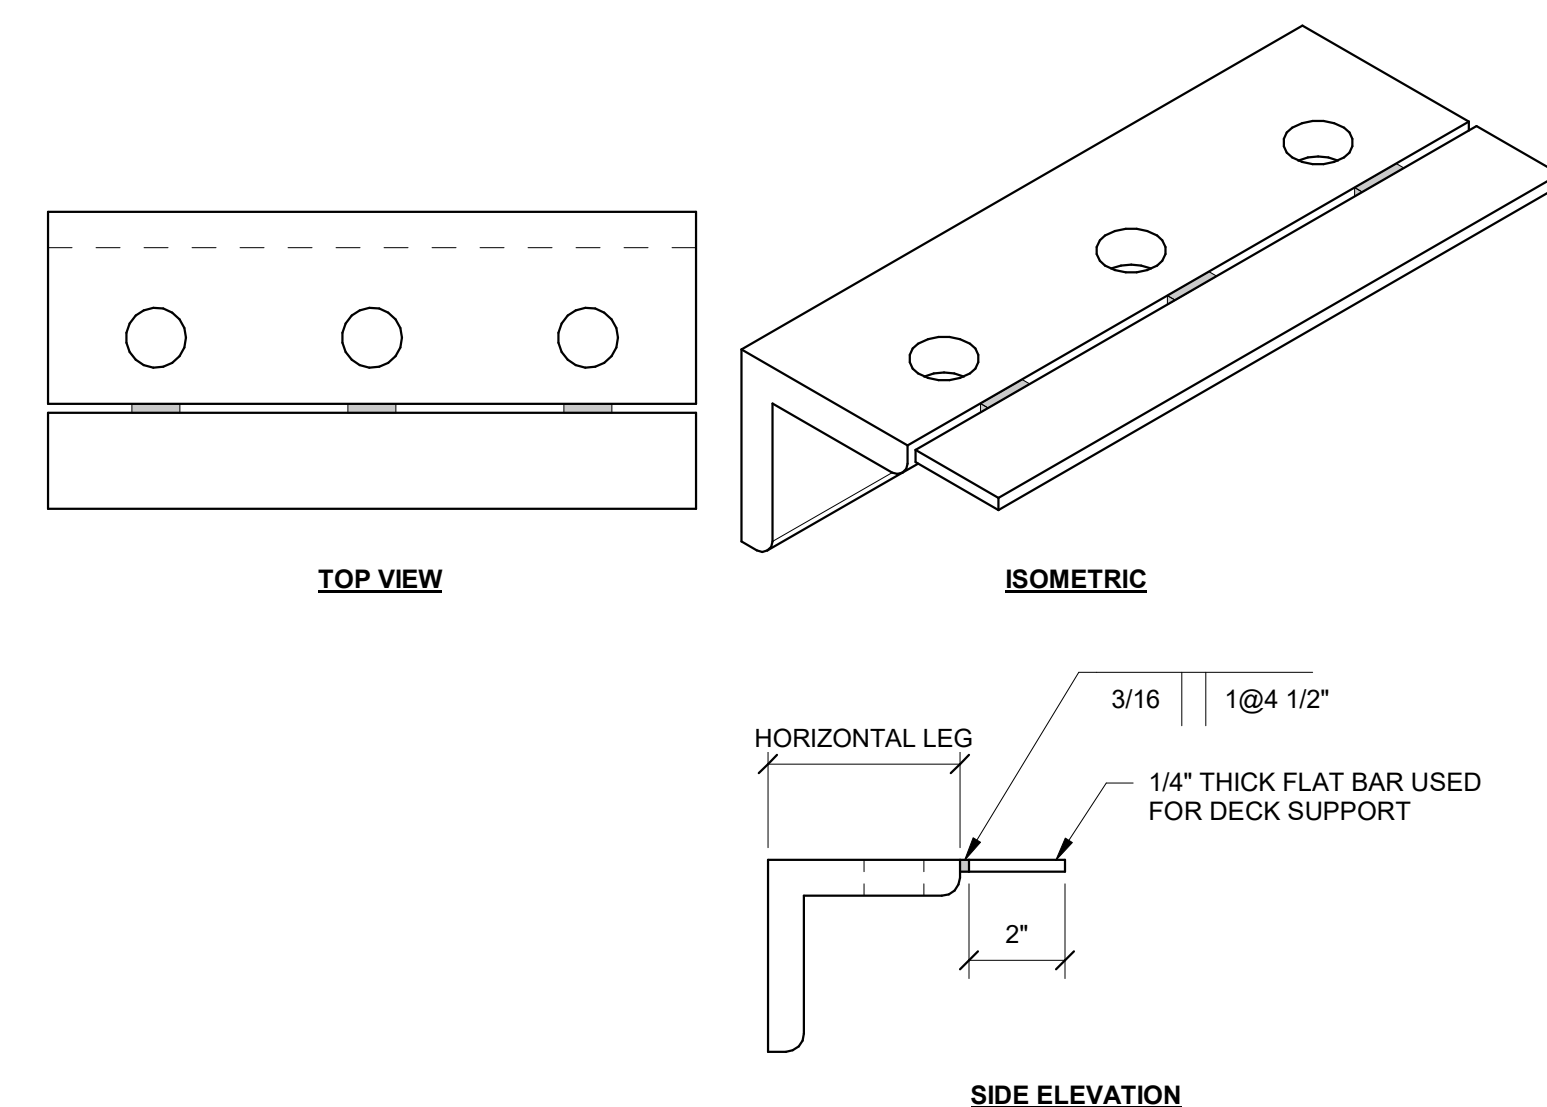

4 SLAB EDGE DETAIL
N.T.S.

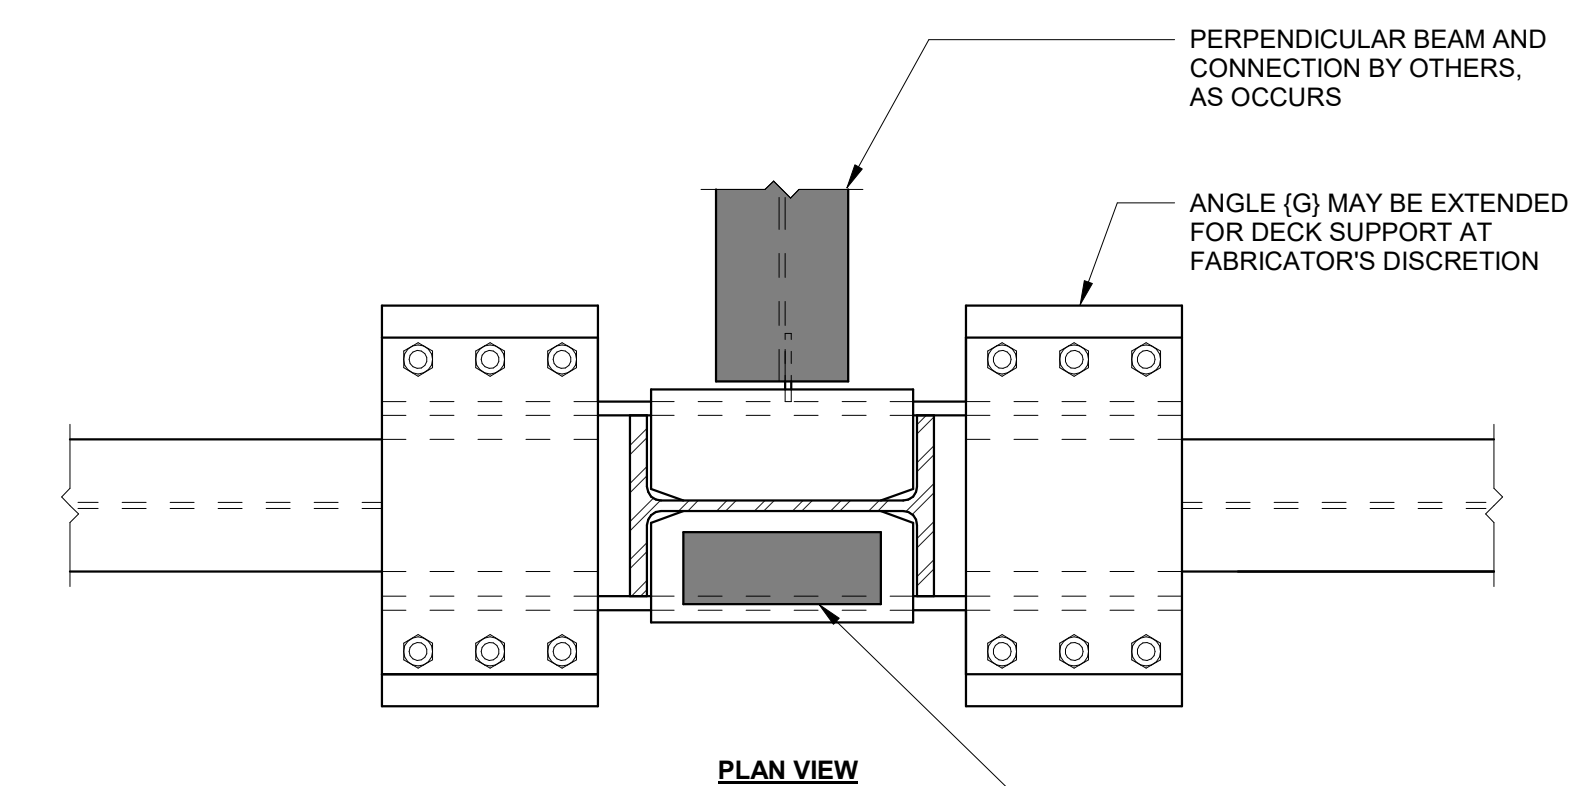


3 DECK SUPPORT DETAIL
N.T.S.

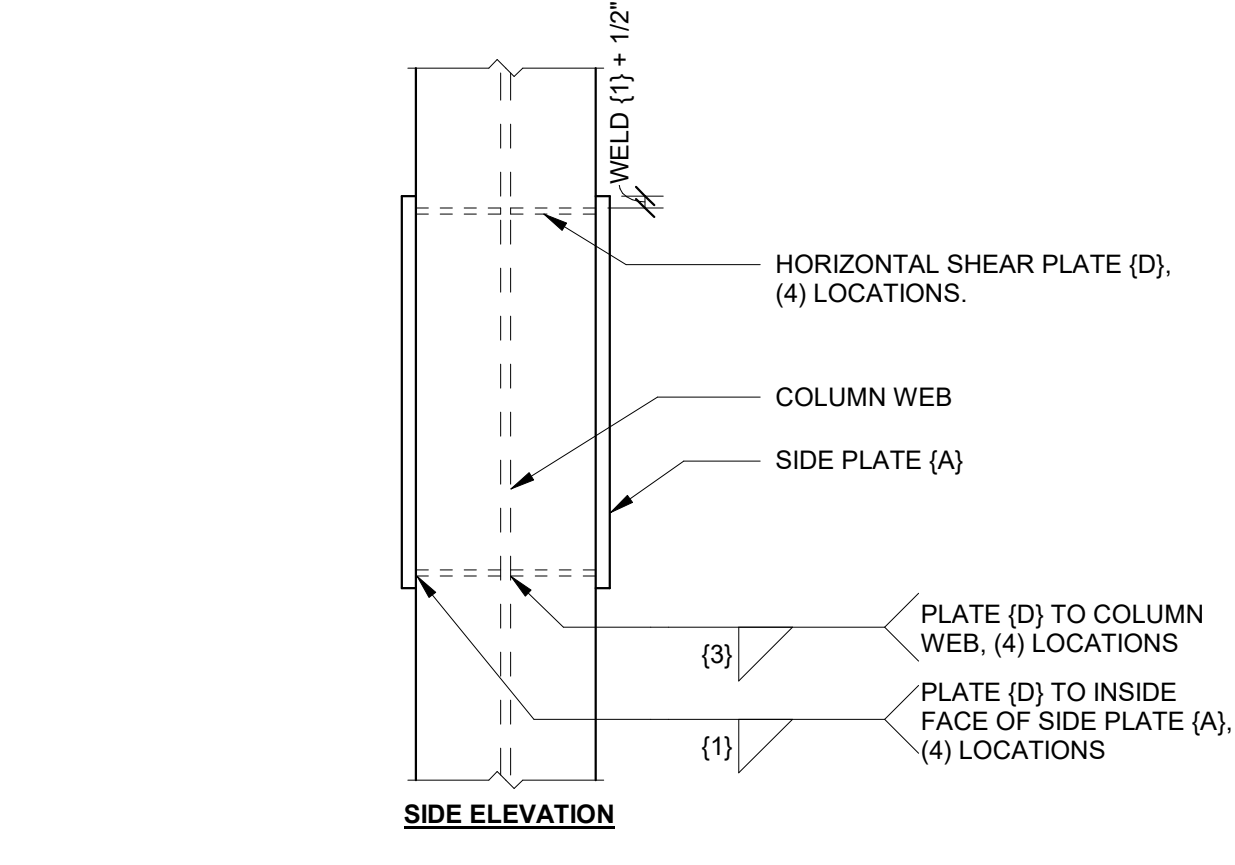


NOTE(S):
 1. LONGITUDINAL ANGLES (G) NOT SHOWN FOR CLARITY.

2 PLATE (D) ALTERNATE DETAIL
N.T.S.

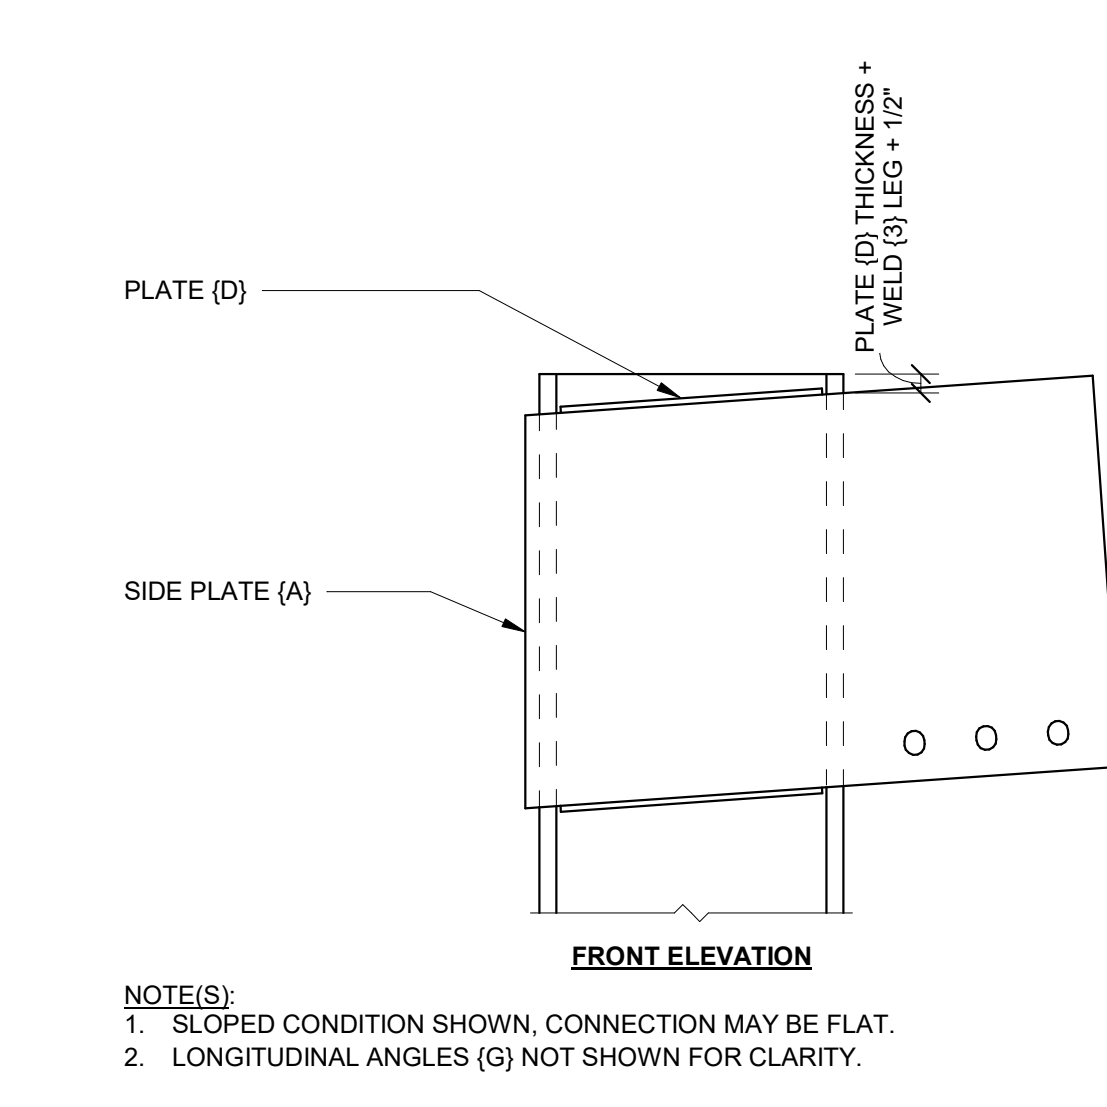


NOTE(S):
 1. SLOPED CONDITION SHOWN, CONNECTION MAY BE FLAT.
 2. LONGITUDINAL ANGLES (G) NOT SHOWN FOR CLARITY.

1 DISCONTINUOUS COLUMN DETAIL
N.T.S.

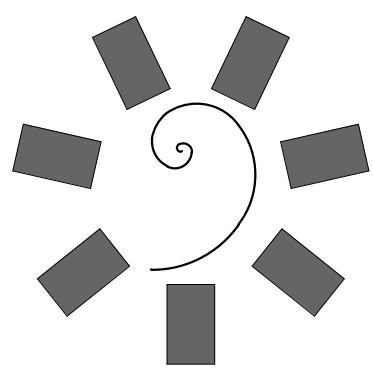

James R. Childers Architect, Inc.
 45 South 4th Street
 Fort Smith, AR 72901
 479-783-2450
 www.childersarchitect.com

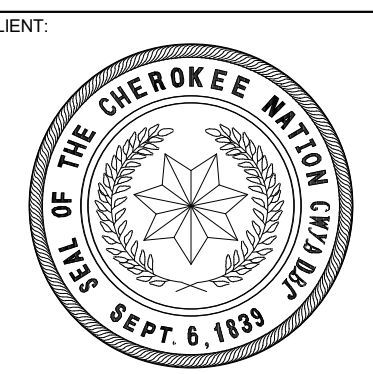

**WILMA P. MANKILLER HEALTH CENTER
 EXPANSION**
 STILWELL, OKLAHOMA

KEY PLAN

PROJECT PHASE
 BID PACKAGE 01


#	DATE	REVISIONS DESCRIPTION

DATE: 11-01-19
 JOB NUMBER: 18-01.01

SHEET NUMBER:

S8.07

SIDEPLATE MISC
 DETAILS AND
 COORDINATION ITEMS

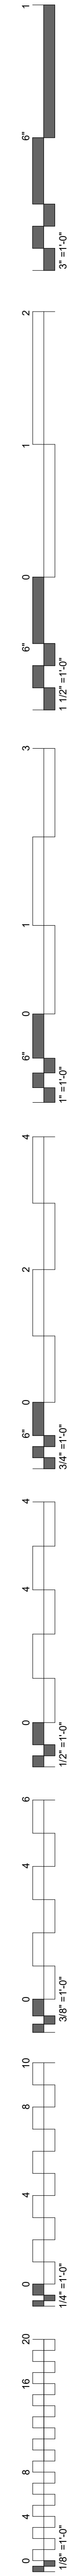


EXISTING ELECTRICAL AND DEMOLITION NOTES





- 1 PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE FACILITY AND RELATED SITE. REVIEW THE GENERAL NOTES AND ALL OTHER TRADE DRAWINGS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE CALLED OUT IN THIS PORTION OF THE BID PACKAGE. NOTIFY ARCHITECT, ENGINEER OR OWNER, AS SPECIFIED, OF ANY CONFLICTS OR DISCREPANCIES PRIOR TO SUBMITTING BID.
- 2 FIELD VERIFY ALL EXISTING CONDITIONS AND CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.
- 3 PROVIDE ALL DEMOLITION OF EXISTING ELECTRICAL SYSTEMS. PROVIDE NEW ELECTRICAL SYSTEM MODIFICATIONS REQUIRED BECAUSE OF BUILDING REMODELING, AS NOTED ON THE DRAWINGS, OR NECESSARY FOR PROPER OPERATION AND NEW CONSTRUCTION.
- 4 COORDINATE INTERRUPTION OF ALL BUILDING SERVICES INCLUDING BUT NOT LIMITED TO BRANCH CIRCUITS, DATA, TELEPHONE, ETC WITH BUILDING OWNER PRIOR TO INTERRUPTION. PROVIDE LABOR AND MATERIALS AS REQUIRED TO REDUCE INTERRUPTIONS IN ORDER TO MAINTAIN EXISTING OPERATION.
- 5 PAY SPECIAL ATTENTION NOT TO DAMAGE THE FINISH OF EXISTING WALLS AND CEILINGS THAT ARE TO REMAIN. REPAIR ANY DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.

KEYNOTES

- 26.22 EXISTING FIXTURES SHALL BE REMOVED, CLEANED, REPAIRED, AND STORED, UNTIL SUCH TIME WHEN THEY CAN BE REINSTALLED IN NEW CANOPY SECTIONS ON NORTH SIDE OF EXISTING TO REMAIN CANOPY.
- 26.23 E.C. SHALL SURVEY EXISTING CONDITIONS AND CONFIRM THAT ALL LIGHTS, FIRE ALARM, SECURITY AND GENERAL POWER CIRCUITS SHALL NOT BE AFFECTED BY BUILDING TO BE DEMOLISHED. IF ANY ISSUES ARE DISCOVERED E.C. SHALL REPAIR OR RELOCATE SO CLINIC WILL NOT BE AFFECTED BY DEMOLITION.

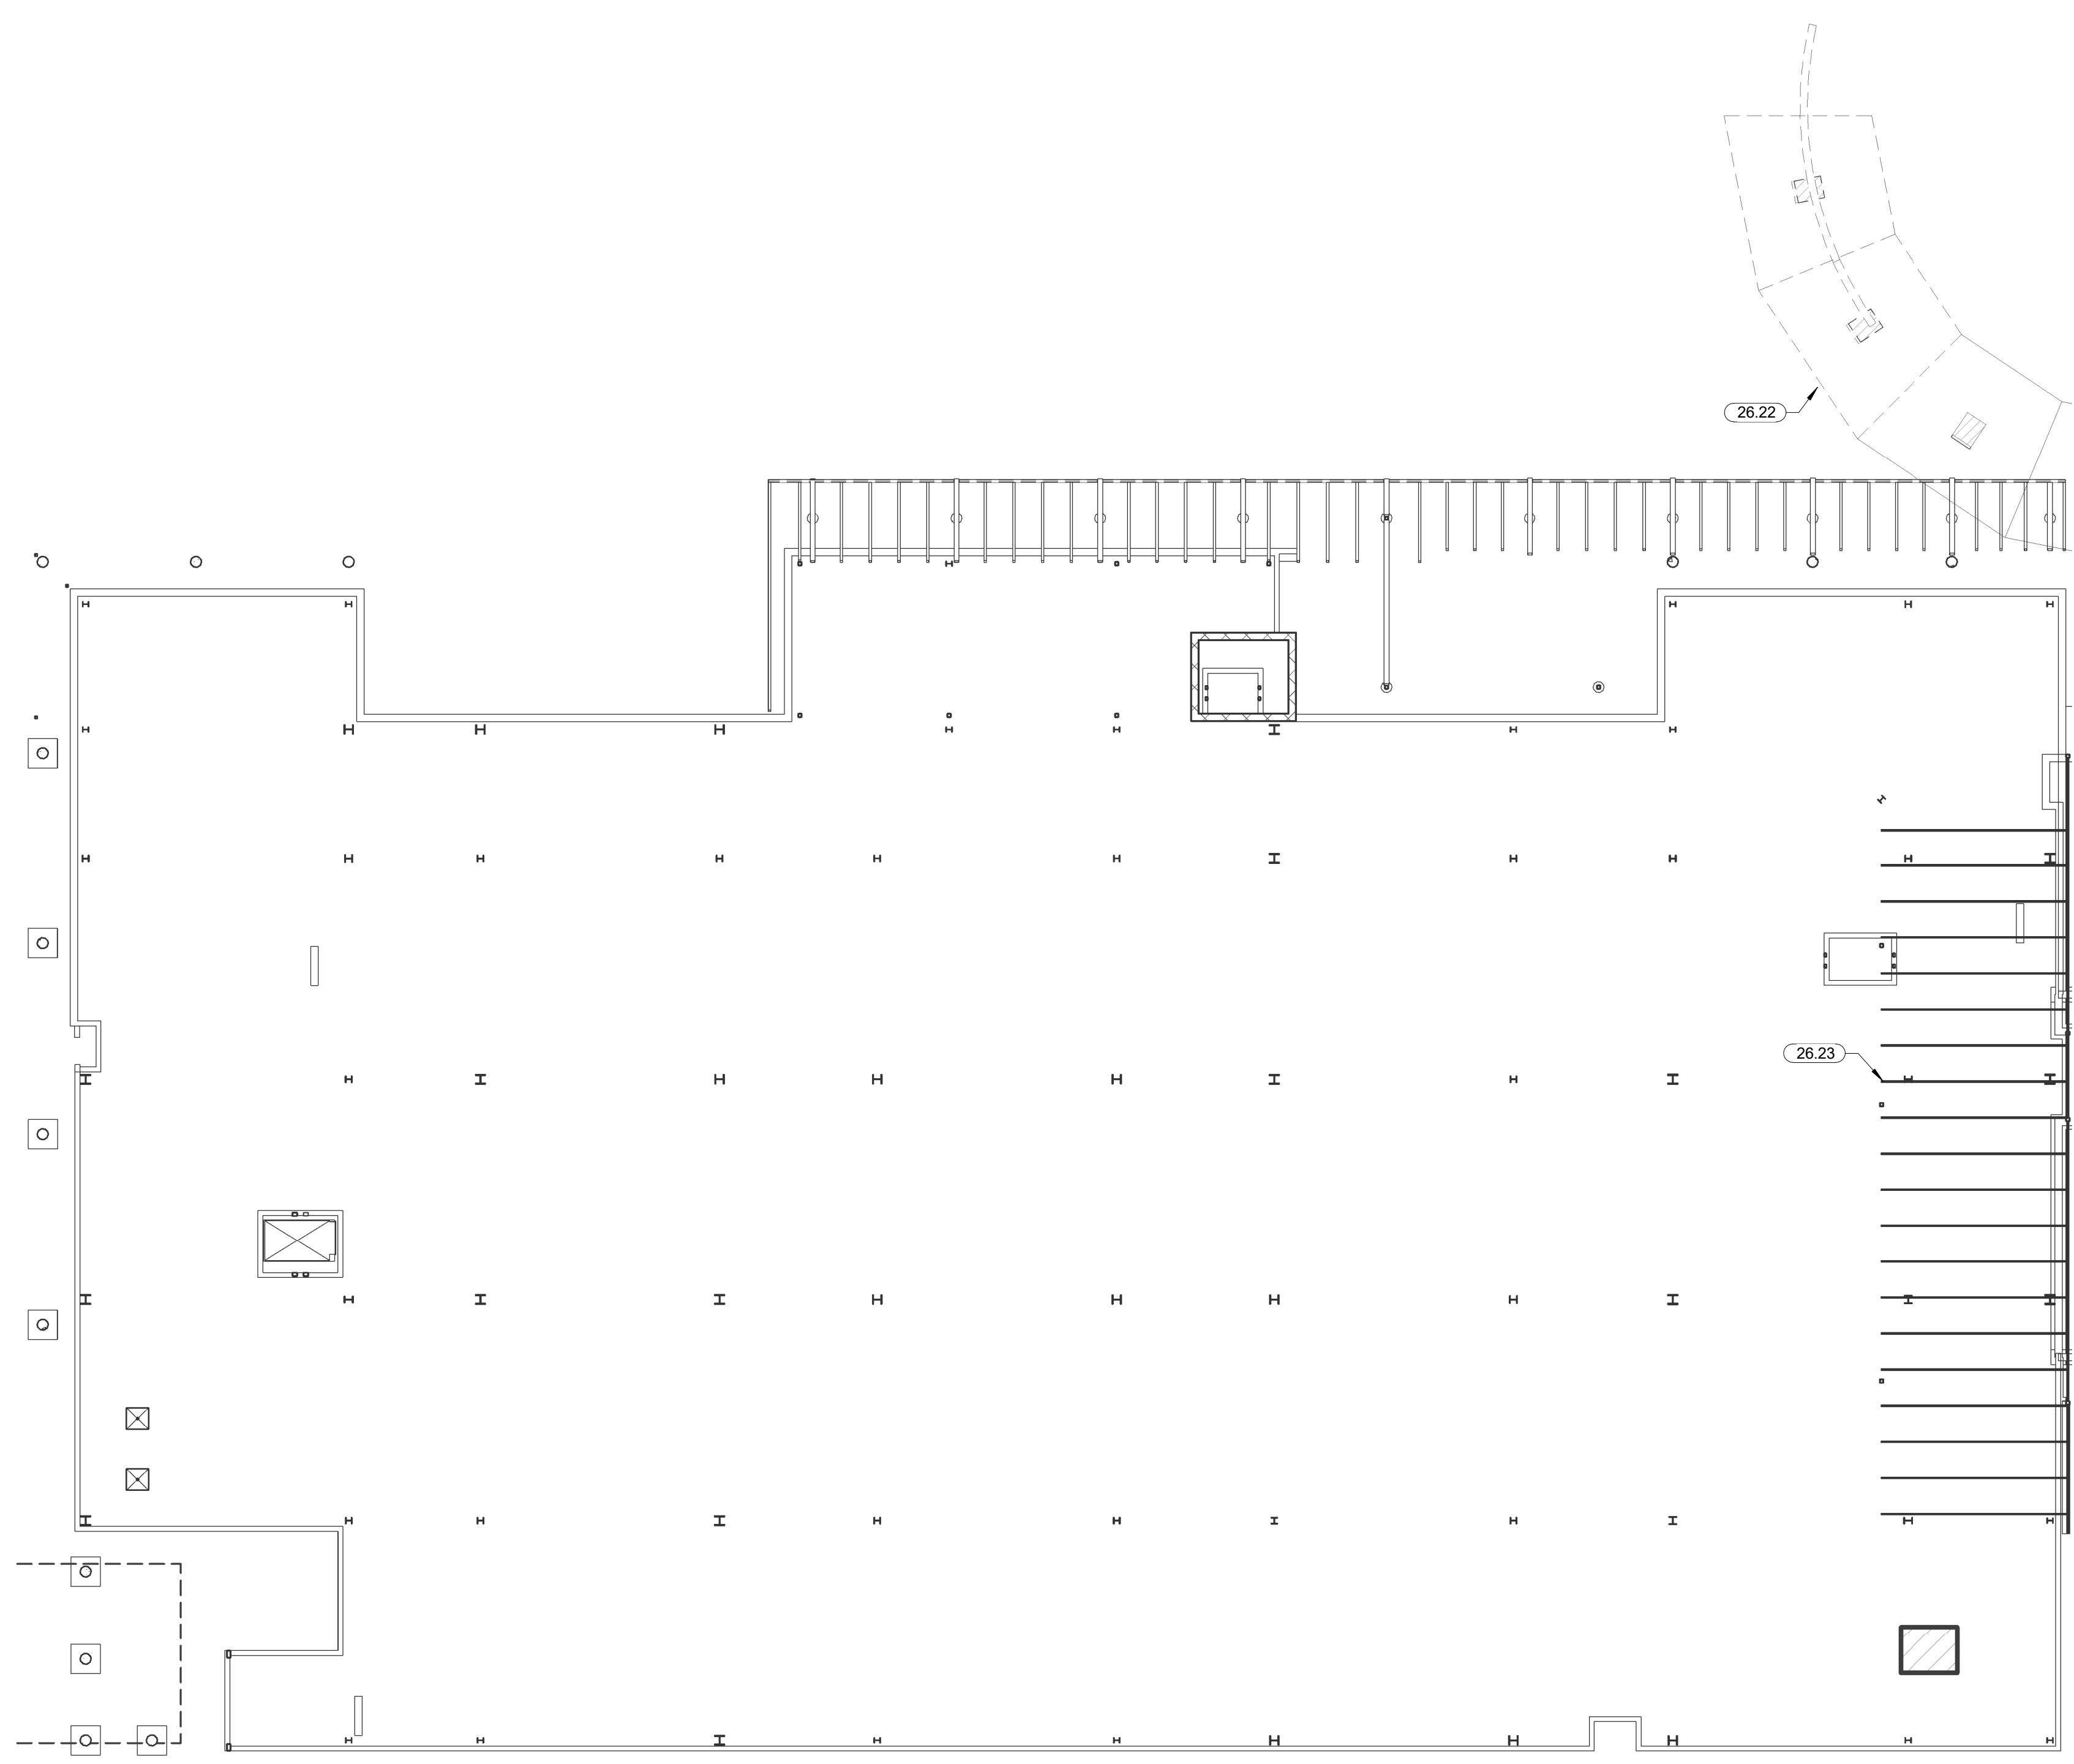

OVERALL ELECTRICAL DEMO PLAN
1/16" = 1'-0"

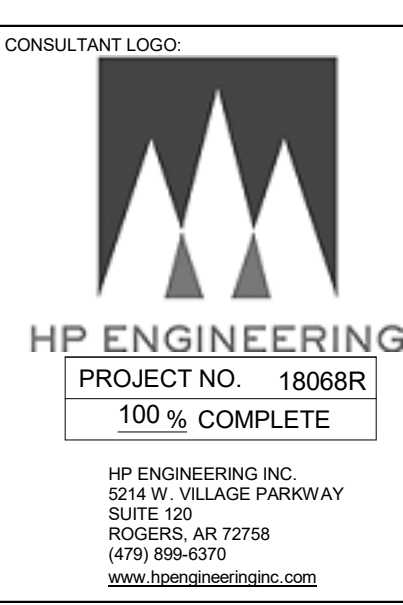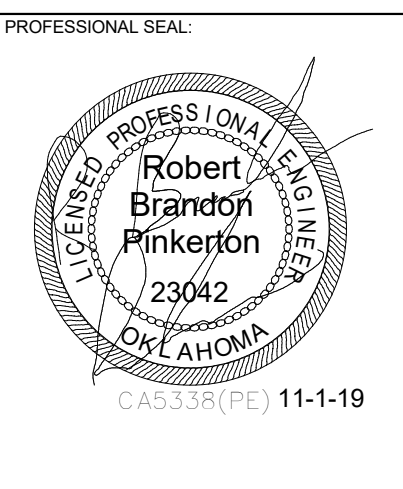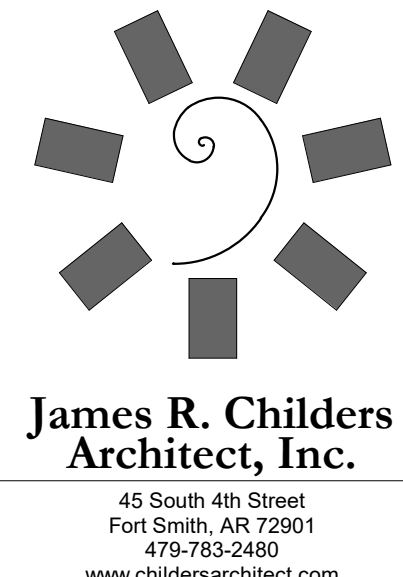

**WILMA P. MANKILLER HEALTH CENTER
EXPANSION**
STILWELL, OKLAHOMA

KEY PLAN:

PROJECT PHASE:
BID PACKAGE 01

#	DATE	REVISIONS DESCRIPTION

DATE: 11-1-19 JOB NUMBER: 18-01.01

SHEET NUMBER:
DE1.0
OVERALL ELECTRICAL DEMO PLAN